CIVICA RESOURCE
PRIVATE LIMITED





HIGH-CAPACITY UPS / SALES + LIFECYCLE SERVICE

Critical power. Long-term service.

D-TECH’s capability in UPS sales, solution coordination and ongoing AMC support for a corporate IT environment.

5+ YEARS
CUSTOMER RELATIONSHIP

UPS + AMC
SALES AND SERVICE FOCUS

Customer-supplied building and reception photographs | Capability case study

01 / ENGAGEMENT AND RELATIONSHIP

From equipment sales to sustained service support

D-TECH describes a five-plus-year UPS sales / AMC association. The supplied 2024 order documents an AMC engagement.

Engagement element	Source-supported position
Customer and location	Civica Resource Private Limited, Notus Pride, Sarabhai Campus, Vadodara, Gujarat.
Documented award	Purchase order CIVICA/24-25/Aug-24/16 dated 26 August 2024, issued to D-Tech Solution Integrators Pvt. Ltd.
Ordered service	UPS AMC as per quotation S14805 dated 20 August 2024. The quotation and detailed AMC schedule were not supplied.
Relationship context	Five-plus years of UPS sales and AMC service, as stated by D-TECH; the PO does not by itself establish a five-year contract term.
Capability positioning	High-capacity UPS solution and lifecycle service capability. Installed kVA / kW rating, brand, topology, unit count and battery details require asset records.

Explore the UPS design

View the SLA framework

Follow the service workflow

02 / HIGH-CAPACITY CAPABILITY SHOWCASE

Capability beyond the UPS cabinet

High-capacity projects require coordinated load assessment, electrical interfaces, batteries, monitoring and lifecycle planning.



Illustrative equipment art. Not CIVICA’s installed UPS system or a capacity claim.

D-TECH delivery focus

Requirement review → OEM / product coordination → supply and commissioning coordination → preventive and corrective support.

LOAD AND CAPACITY

Assess present demand, growth, power factor and connected load priorities. Check both kW and kVA against selected equipment ratings.

INTERFACES AND CONTINUITY

Coordinate input supply, protection, output distribution, battery interfaces and bypass arrangements with the approved electrical design.


SERVICEABILITY

Plan access, monitoring and service windows.

03 / FUNCTIONAL POWER-SYSTEM SCHEMATIC

How an online UPS supports the critical load

Illustrative double-conversion reference design; the actual CIVICA topology must be verified from the approved single-line diagram.

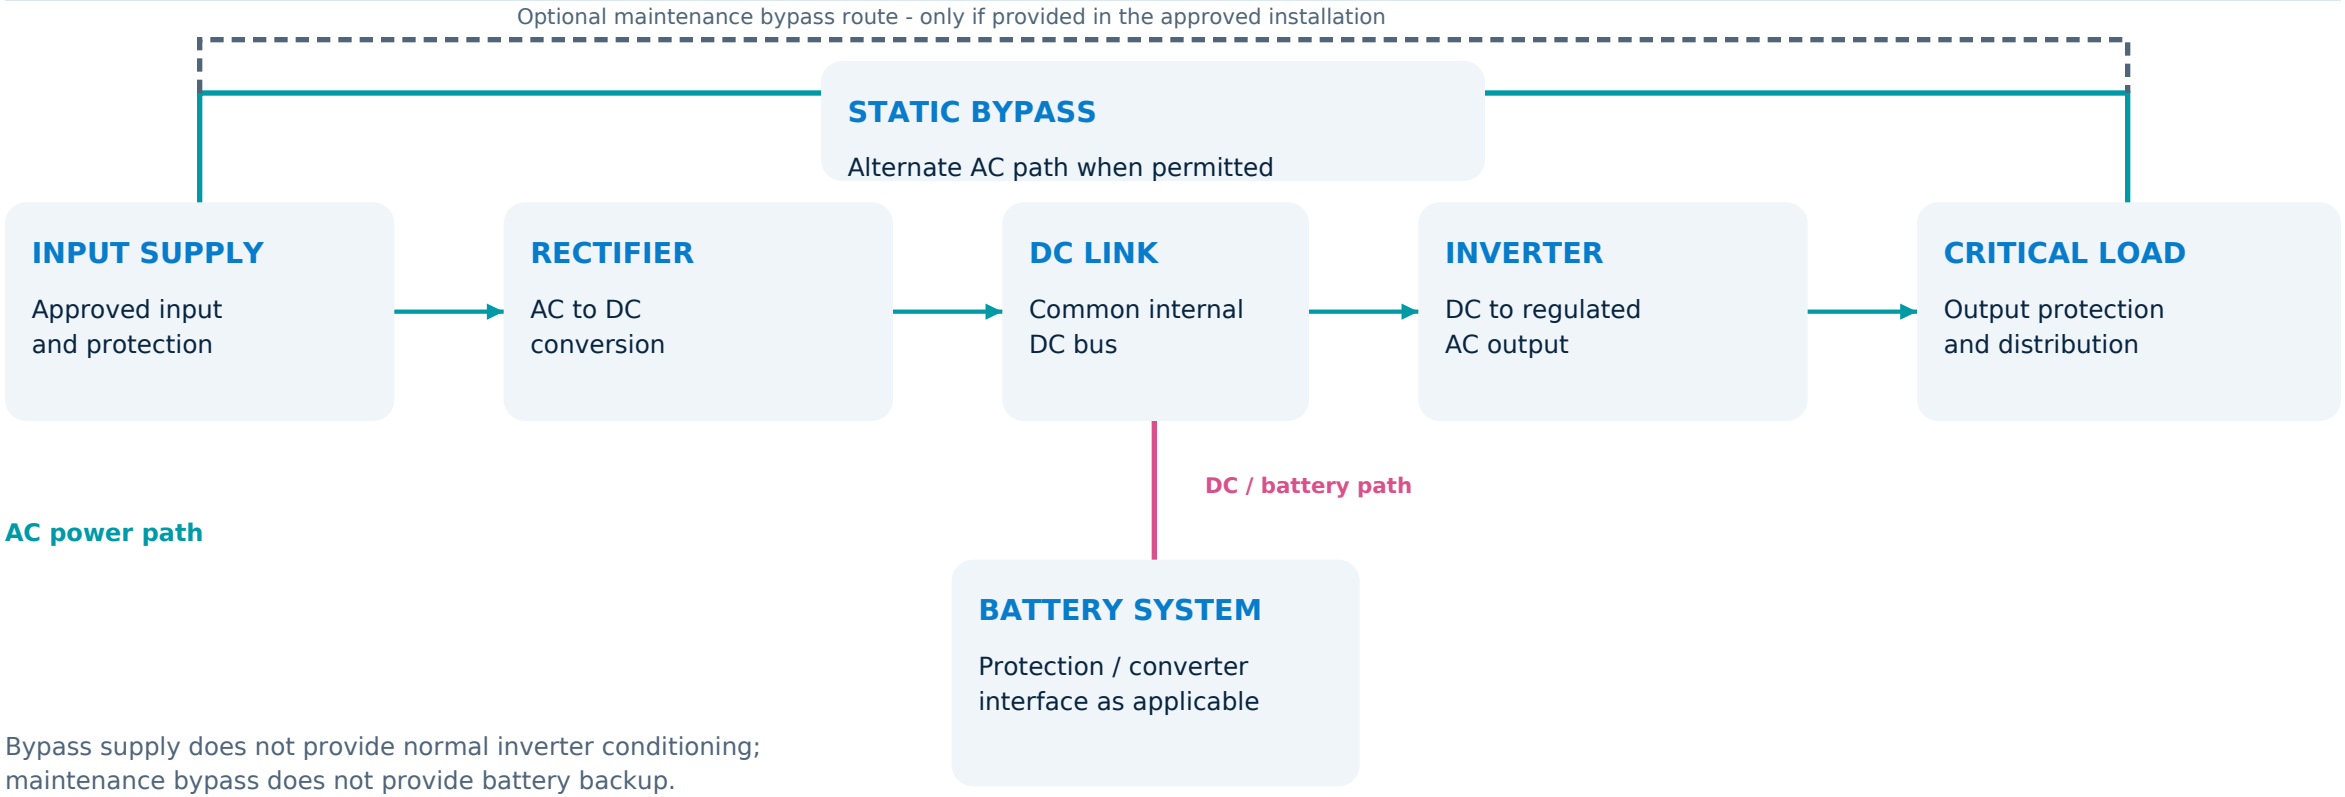

Bypass supply does not provide normal inverter conditioning; maintenance bypass does not provide battery backup.

Functional reference only. Switching, isolation and maintenance follow the OEM instructions and approved site procedures, executed by qualified personnel.

04 / SLA AND ESCALATION FRAMEWORK

Priority-led support with a visible service clock

A service-governance framework, not a statement of the historic PO’s agreed SLA timings. Numerical targets require the signed AMC schedule.

Priority	Example impact	Service handling and control
P1 / Critical	Critical load affected, UPS output unavailable or protection severely compromised.	Immediate escalation through the agreed emergency route. Record operating state, customer impact and the authorized technical owner.
P2 / High	Load remains supplied, but an alarm, bypass state or battery issue creates a material risk.	Prioritize diagnosis, assess remaining protection and coordinate attendance / OEM support under the agreed SLA.
P3 / Planned	Preventive visit, health review, non-critical advisory or approved improvement.	Schedule within the agreed service window and confirm prerequisites, test scope and customer acceptance.

SLA measure	How it is controlled
Acknowledgement / response	Ticket receipt to recorded acknowledgement or technical engagement; use the contracted target.
Attendance / restoration	Record dispatch, arrival, recovery and customer verification separately. OEM / access dependencies remain visible.
Escalation and closure	Name owners, maintain updates and document cause, action, evidence and customer-confirmed closure.

No 24x7 coverage, fixed onsite response time, uptime guarantee or unlimited replacement commitment is inferred from the supplied PO.

05 / PREVENTIVE AND CORRECTIVE CAPABILITY

Preventive care for the complete power chain

Illustrative maintenance scope for agreement against the installed model, battery technology and AMC inclusions.

System area	Technical service checks and records
Operating condition	Record available input / output readings, load level, alarms, event history and room conditions. Trend changes against earlier service records.
UPS power assembly	Inspect accessible cabinet condition and cooling / ventilation; review rectifier, inverter and bypass status. Follow model-specific OEM checks and approved access conditions.
Battery system	Check condition, temperature and applicable voltage / health measurements. Use compatible impedance or conductance trending where appropriate; assess replacement needs from evidence.
Functional verification	Agree the test method, load conditions and maintenance window. Battery discharge, load-bank or transfer tests require explicit scope and readiness confirmation.
Repair and follow-up	Log findings, approved remedy, parts ownership and post-service checks. Keep unresolved risks assigned to owners.

Autonomy is a measured requirement

Confirm runtime against the actual load and battery condition. No site runtime or redundancy claim is made.

06 / SALES-TO-SERVICE DELIVERY MODEL

A lifecycle approach to larger UPS requirements

Recommended D-TECH delivery stages for agreed supply / implementation projects and ongoing support.

01 DISCOVER

Capture critical loads, current demand, growth, autonomy requirement, access and the existing electrical arrangement.

02 DESIGN AND SELECT

Coordinate equipment sizing, OEM selection, battery solution, protection interfaces and serviceability.

03 PLAN DELIVERY

Confirm scope split, site readiness, handling, placement, installation responsibilities and the approved work window.

04 COMMISSION

Coordinate qualified commissioning, settings, alarms, agreed checks and witnessed acceptance records.

05 HAND OVER

Provide approved diagrams, equipment / battery inventory, warranty information, operating guidance and support contacts.

06 MAINTAIN

Plan preventive care, incident response, parts coordination and evidence-based improvement reviews.

07 / SERVICE WORKFLOW AND CUSTOMER CONFIDENCE

Five-plus years of association. A continuity mindset.

Relationship and sales capability are stated by D-TECH; the supplied AMC PO supports the documented customer engagement.

LOG

Record site, asset, alarm and load impact.

TRIAGE

Assess operating state and technical ownership.

RESOLVE

Coordinate approved action and specialist support.

VERIFY

Check service condition and record closure.

Source and scope notes

Customer source: PO CIVICA/24-25/Aug-24/16 dated 26 August 2024, referring to quotation S14805 dated 20 August 2024. The PO states UPS AMC; sales history, high-capacity positioning and five-plus-year continuity are D-TECH-provided context.

Engineering references below explain generic UPS and battery concepts; they do not identify CIVICA's installed brand or make those features part of the AMC.

Schneider Electric - static and maintenance bypass principles

Vertiv - battery preventive-maintenance reference

support.dtechindia.com **+91 99989 03042**