


SECTION 1 — MODEL DESCRIPTION

BUILDING DESCRIPTION

|                  |                                                                   |
|------------------|-------------------------------------------------------------------|
| Sector           | Commercial-Institutional                                          |
| Building type    | Education                                                         |
| Building subtype | Primary or secondary school, no mechanical ventilation - Mid-size |
| Vintage          | Before 1970                                                       |

3D MODEL

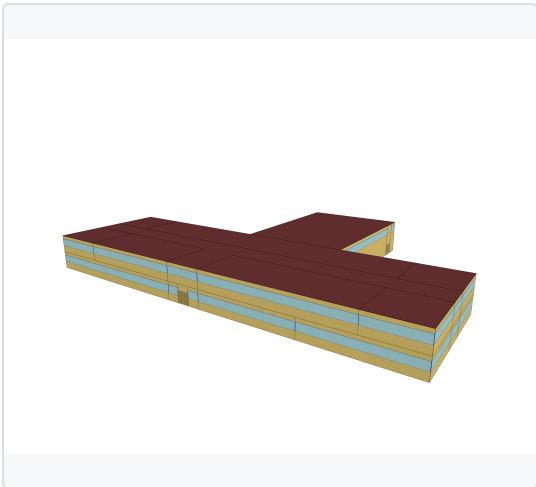

Three-dimensional geometric representation of the building model used for energy simulation and performance analysis.

BUILDING CHARACTERISTICS

|                     |                                                 |
|---------------------|-------------------------------------------------|
| Floor Area [m²]     | 3050                                            |
| Climate zone        |                                                 |
| HVAC SYSTEM         |                                                 |
| Cooling system      | /                                               |
| Heating system      | Electric Boiler with hydronic baseboard heaters |
| Ventilation system  | /                                               |
| Typical COP cooling | /                                               |

INSULATION & AIR TIGHTNESS

|                                   |      |
|-----------------------------------|------|
| Exterior walls [W/m²/K]           | 0.72 |
| Interior walls [W/m²/K]           | 0    |
| Roof [W/m²/K]                     | 0.28 |
| Slabs [W/m²/K]                    | 1.91 |
| Infiltration (I_design) [m³/h/m²] | 2.05 |

GLAZING

|                  |      |
|------------------|------|
| Glazing [W/m²/K] | 3.52 |
| SHGC             | 0.41 |


WINDOW-TO-WALL RATIO

|             |      |
|-------------|------|
| Average [%] | 33.5 |
|-------------|------|

ANNUAL END USES — ELECTRICITY [kWh]

| END USE            | [kWh/year] |
|--------------------|------------|
| Heating            | 246827     |
| Interior Lighting  | 59464      |
| Interior Equipment | 23322      |
| Fans               | 1786       |
| Pumps              | 4872       |
| Water Systems      | 9522       |
| Total End Uses     | 345794     |

MONTHLY CONSUMPTION BY END USE

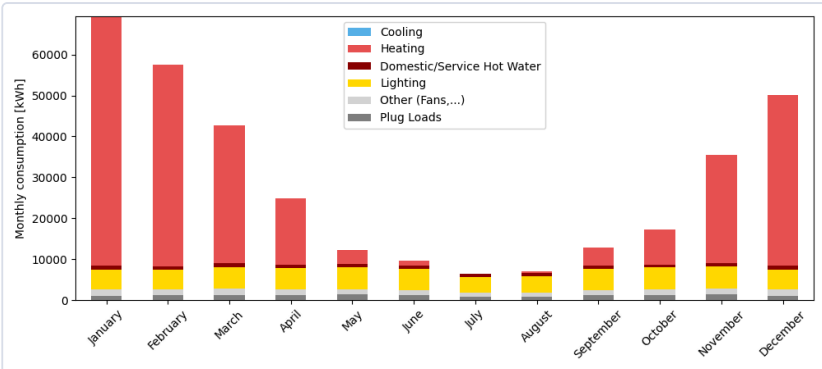

Monthly energy consumption breakdown by end use, showing the contribution of heating, cooling, lighting, domestic hot water, plug loads, and auxiliary systems throughout the year.

AVERAGE DAILY PROFILE BY USAGE



Average daily consumption profile for winter and summer, showing the contribution of cooling, lighting, domestic hot water, plug loads, and auxiliary systems throughout an average winter and summer day.

ENERGY USE INTENSITY

113

kWh/m²/yr

TOTAL CONSUMPTION

345792

kWh/yr

ELECTRICITY

345794

kWh/yr

NATURAL GAS

0

kWh/yr