


SECTION 1 — MODEL DESCRIPTION




BUILDING DESCRIPTION	
Sector	Residential
Building Type	Multi-Unit
Building Sub Type	MID Rise
Vintage	1945

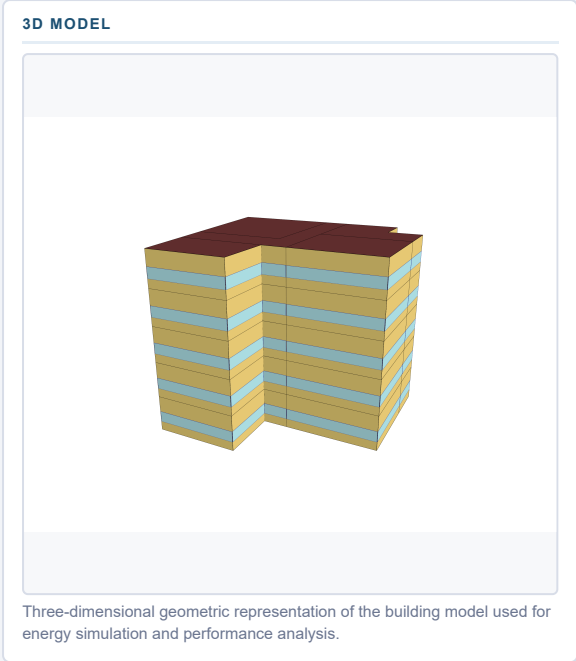

BUILDING CHARACTERISTICS	
Floor Area	1325.0 m²
Climate Zone	6A
Weather	outdoor_temperature_no_year
HVAC System	Central Electric Heat Pump System


ENVELOPE	
INSULATION & AIR TIGHTNESS	
Walls Ext [W/m2-K]	1.13
Walls Int [W/m2-K]	2.51
Roof [W/m2-K]	2.49
Slabs [W/m2-K]	1.14
Infiltration [m³/h-m²]	13.5
GLAZING	
Glazing [W/m2-K]	3.32
SHGC	0.66
WWR	
Average	30.0

ANNUAL END USES — ELECTRICITY [KWH]	
END USE	KWH/YR
Heating	169148.6
Cooling	14250.1
Interior Lighting	7086.2
Exterior Lighting	3183.4
Interior Equipment	110975.9
Fans	17069.6
Total End Uses	321713.7

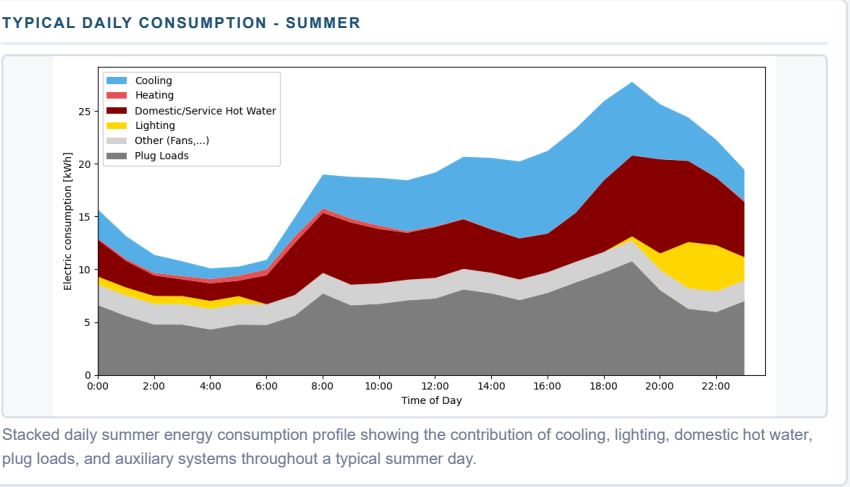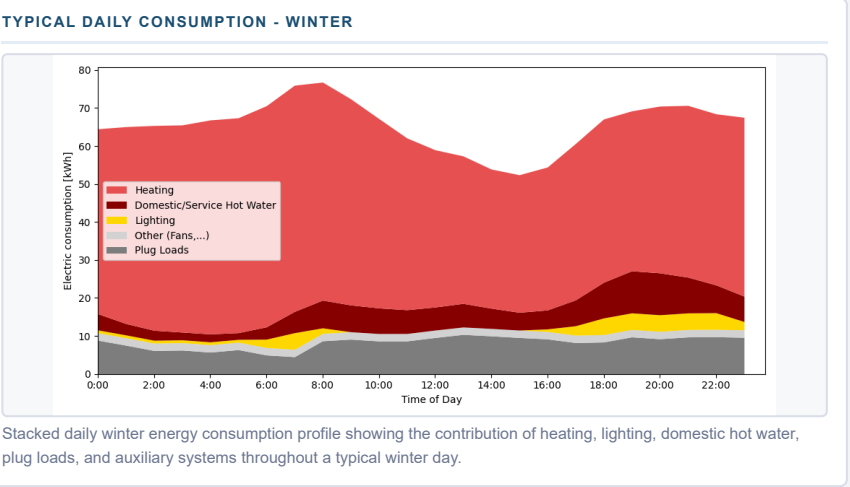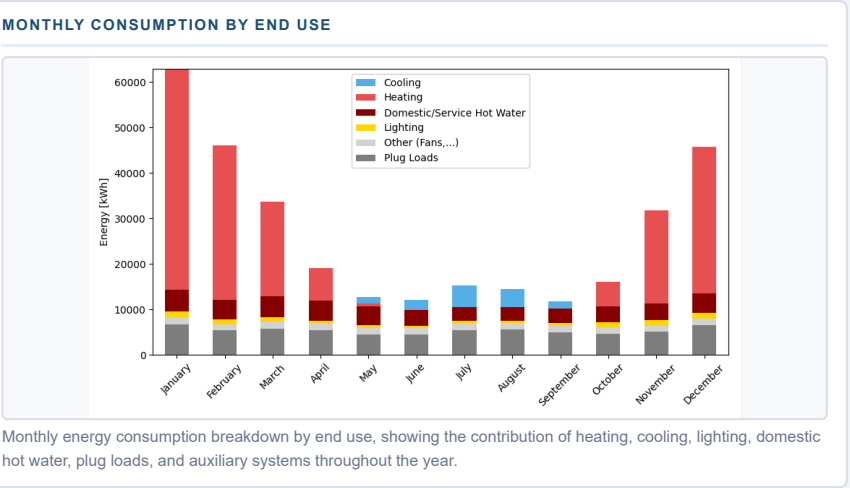


ENERGY USE INTENSITY 242.8 kWh/m²/yr	TOTAL CONSUMPTION 321711.0 kWh/yr	ELECTRICITY 321714.0 kWh/yr	NATURAL GAS 0 kWh/yr
--	---	-----------------------------------	----------------------------

TYPICAL DAY — WINTER

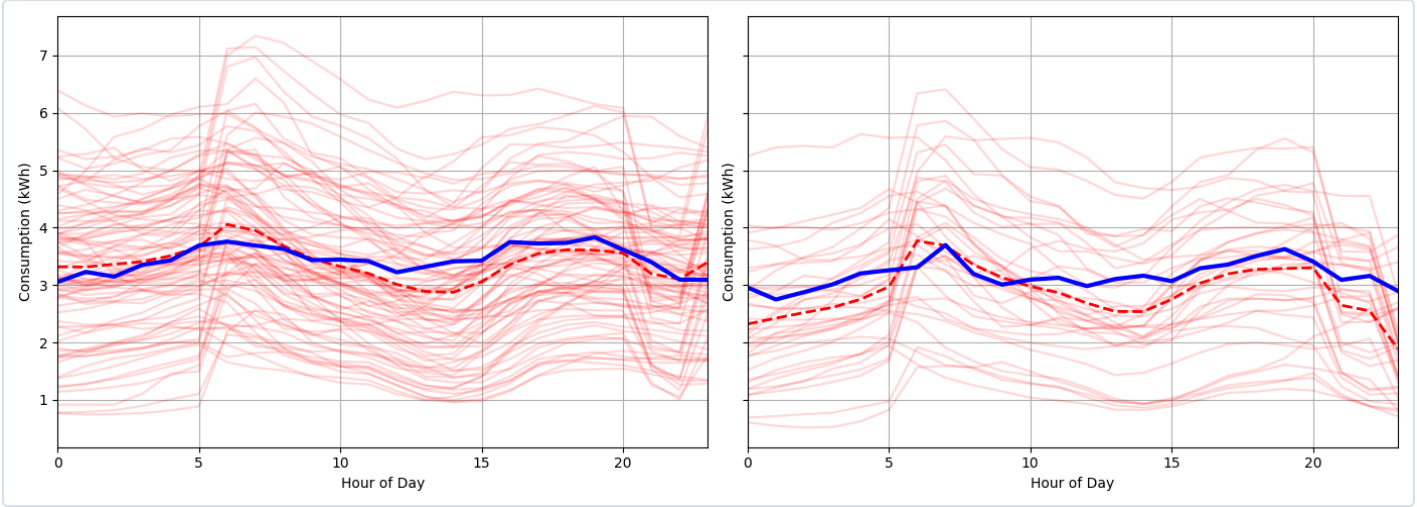

Winter daily consumption profile comparing simulated and measured hourly energy use. Red lines represent individual winter days from the model, the red dashed line indicates the average simulated profile, and the blue line shows measured data for comparison. The left plot represents weekdays, while the right plot represents weekends.


TYPICAL DAY — SUMMER

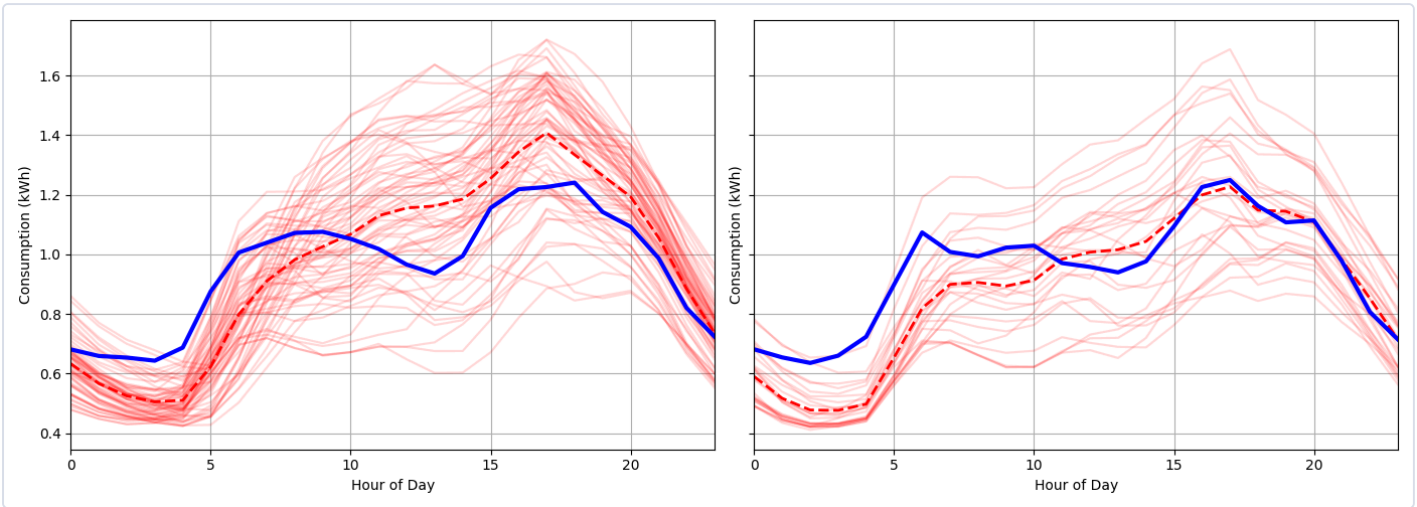

Summer daily consumption profile comparing simulated and measured hourly energy use. Red lines represent individual winter days from the model, the red dashed line indicates the average simulated profile, and the blue line shows measured data for comparison. The left plot represents weekdays, while the right plot represents weekends.

SECTION 3 — COMPARISON WITH REFERENCE DATA

PRISM CURVE

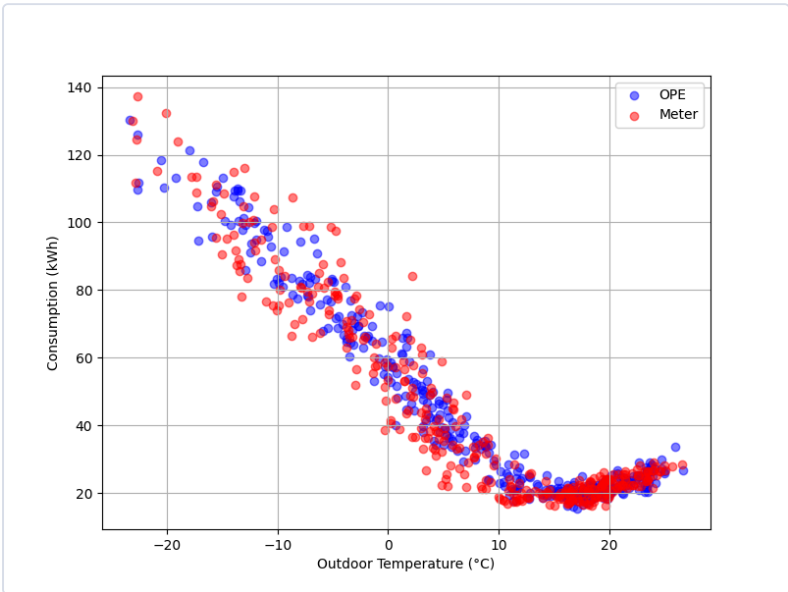

PRISM curve comparing simulated (OPE) and measured energy consumption as a function of outdoor temperature, illustrating the relationship between weather conditions and building energy demand across the year.

COMPARISON TABLE — KEY INDICATORS

INDICATOR	MODEL	REFERENCE	DELTA
Conso_annuelle_electricite_kWh	16086.08	16587.18	-501.1
Conso_base_electricite_kWhParJour	19.74	20.36	-0.6
Pente_chauffage_electricite_WparK	-133.33	-127.08	-6.2
Pente_climatisation_electricite_WparK	41.31	43.18	-1.9
Pointe_hiver_am_kW	7.34	6.77	0.6
Pointe_h_hiver_am	7.0	6.0	1.0
Pointe_hiver_pm_kW	6.42	6.55	-0.1
Pointe_h_hiver_pm	17.0	20.0	-3.0