


SECTION 1 — MODEL DESCRIPTION

BUILDING DESCRIPTION

Sector	Commercial-Institutional
Building type	Education
Building subtype	Primary or secondary school, mechanical ventilation - Mid-size
Vintage	Before 1970

3D MODEL

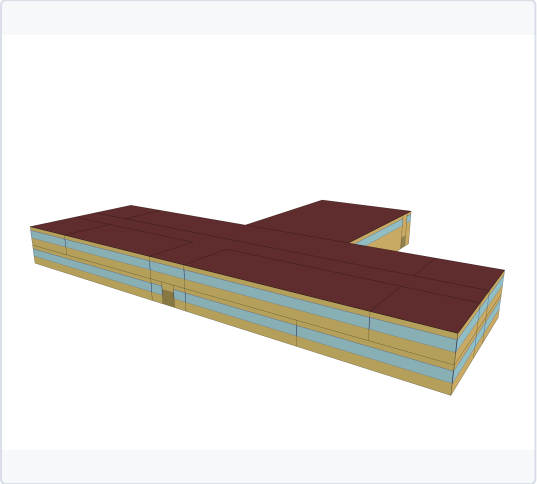

Three-dimensional geometric representation of the building model used for energy simulation and performance analysis.

BUILDING CHARACTERISTICS

Floor Area [m²]	3050
Climate zone	6A

HVAC SYSTEM

Cooling system	/
Heating system	Electric Boiler with hydronic baseboard heaters for perimeter
Ventilation system	Constant air volume with recirculation and terminal reheat
Typical COP cooling	/

INSULATION & AIR TIGHTNESS

Exterior walls [W/m²/K]	0.72
Interior walls [W/m²/K]	0
Roof [W/m²/K]	0.28
Slabs [W/m²/K]	1.91
Infiltration (I_design) [m³/h/m²]	2.05

GLAZING

Glazing [W/m²/K]	3.52
SHGC	0.41


WINDOW-TO-WALL RATIO

Average [%]	33.5
-------------	------

ANNUAL END USES — ELECTRICITY [kWh]


END USE	[kWh/year]
Heating	451535
Cooling	0
Domestic/Service Hot Water	9647
Lighting	59463
Plug Loads	13675
Other (Fans,...)	37100
Total	571420

MONTHLY CONSUMPTION BY END USE

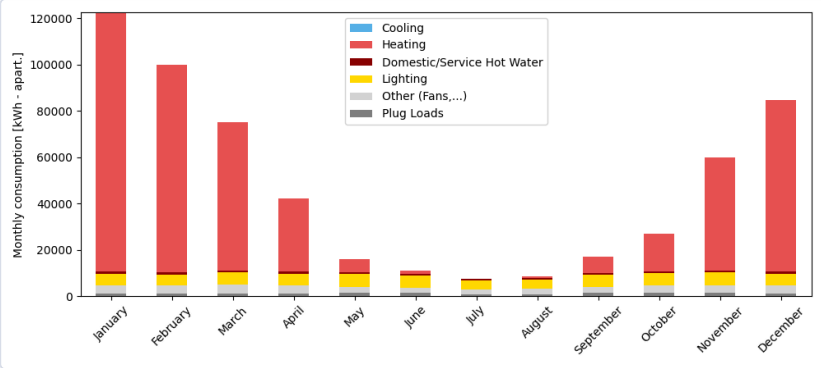

Monthly energy consumption breakdown by end use, showing the contribution of heating, cooling, lighting, domestic hot water, plug loads, and auxiliary systems throughout the year.

AVERAGE DAILY PROFILE BY USAGE

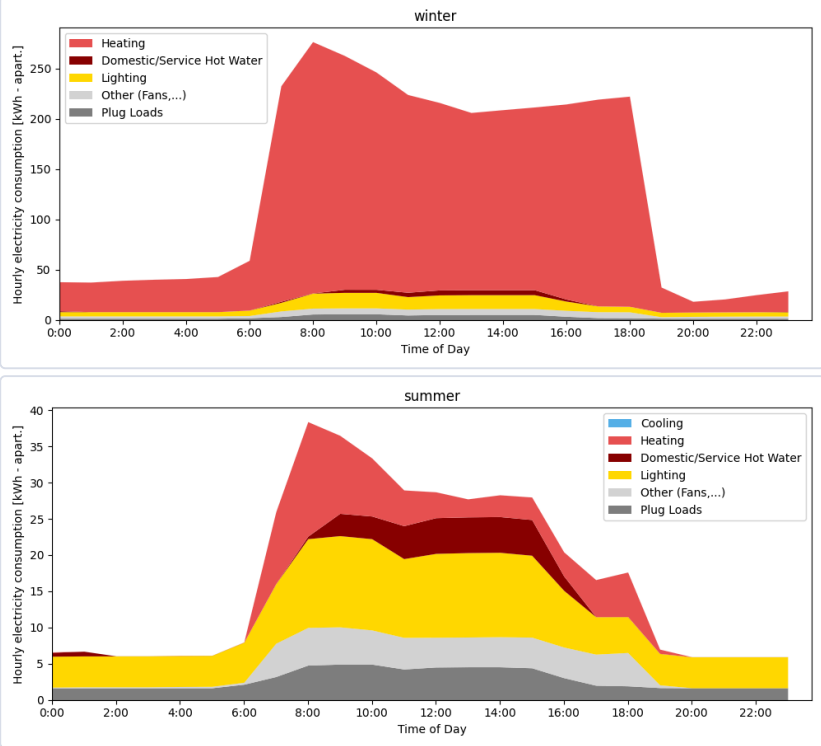

Average daily consumption profile for winter and summer, showing the contribution of cooling, lighting, domestic hot water, plug loads, and auxiliary systems throughout an average winter and summer day.

ENERGY USE INTENSITY

187
kWh/m²/yr

TOTAL CONSUMPTION

571423
kWh/yr

ELECTRICITY

571420
kWh/yr

NATURAL GAS

0
kWh/yr