


CI_EDU_SchoolPrim-noVent_Small_post2012

SECTION 1 — MODEL DESCRIPTION

BUILDING DESCRIPTION

Sector	Commercial-Institutional
Building type	Education
Building subtype	Primary school, no mechanical ventilation - Small
Vintage	After 2012

3D MODEL

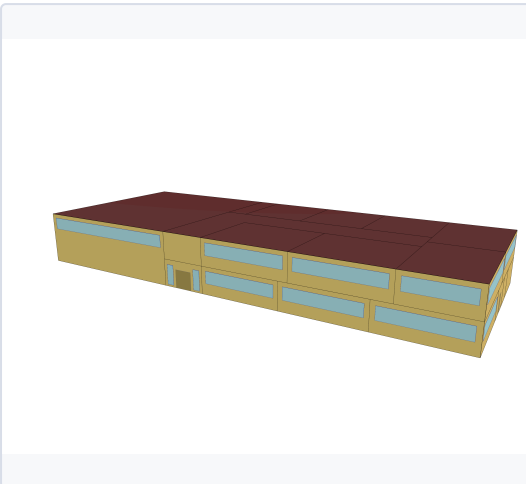

Three-dimensional geometric representation of the building model used for energy simulation and performance analysis.

BUILDING CHARACTERISTICS

Floor Area [m²]	1640
Climate zone	6A
HVAC SYSTEM	
Cooling system	/
Heating system	Electric Boiler with hydronic baseboard heaters
Ventilation system	/
Typical COP cooling	/

INSULATION & AIR TIGHTNESS

Exterior walls [W/m²/K]	0.28
Interior walls [W/m²/K]	0
Roof [W/m²/K]	0.18
Slabs [W/m²/K]	0.38
Infiltration (I_design) [m³/h/m²]	2.05

GLAZING

Glazing [W/m²/K]	2.77
SHGC	0.41


WINDOW-TO-WALL RATIO

Average [%]	27.7
-------------	------

ANNUAL END USES — ELECTRICITY [kWh]


END USE	[kWh/year]
Heating	63395
Cooling	0
Domestic/Service Hot Water	8062
Lighting	31974
Plug Loads	5683
Other (Fans,...)	9847
Total	118961

MONTHLY CONSUMPTION BY END USE

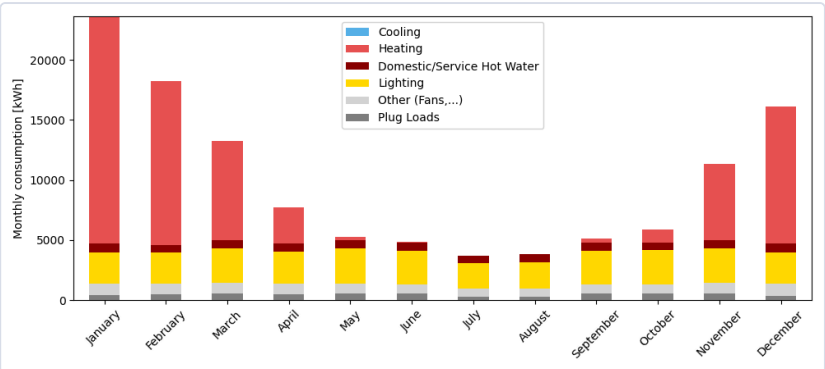

Monthly energy consumption breakdown by end use, showing the contribution of heating, cooling, lighting, domestic hot water, plug loads, and auxiliary systems throughout the year.

AVERAGE DAILY PROFILE BY USAGE

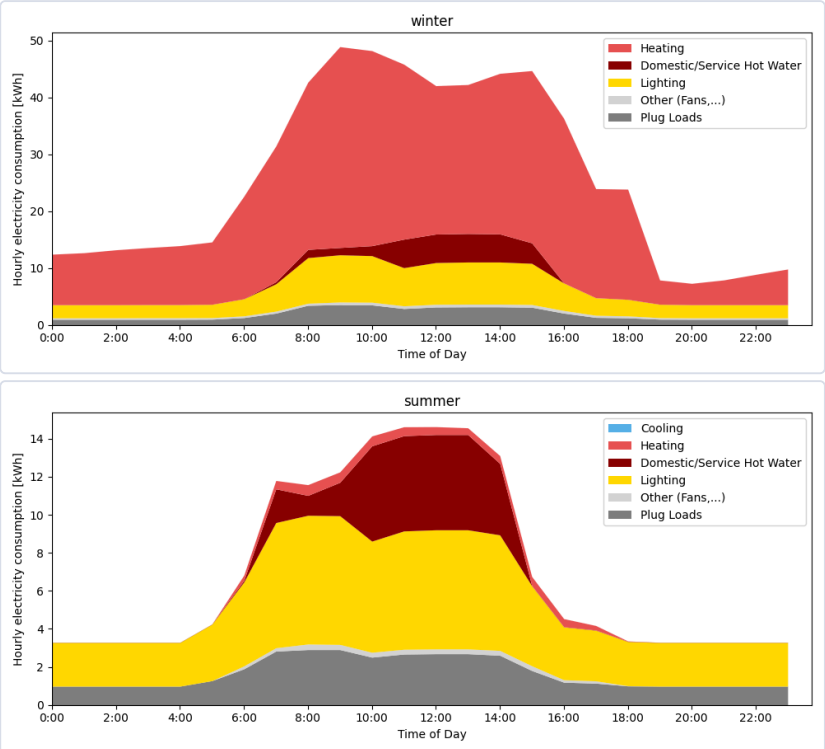

Average daily consumption profile for winter and summer, showing the contribution of cooling, lighting, domestic hot water, plug loads, and auxiliary systems throughout an average winter and summer day.

ENERGY USE INTENSITY

73
kWh/m²/yr

TOTAL CONSUMPTION

118961
kWh/yr

ELECTRICITY

118961
kWh/yr

NATURAL GAS

0
kWh/yr