


SECTION 1 — MODEL DESCRIPTION

BUILDING DESCRIPTION	
Sector	Residential
Building type	Single-Family
Building subtype	Semi-Detached - 1 Floor
Vintage	1986-2012



3D MODEL



Three-dimensional geometric representation of the building model used for energy simulation and performance analysis.

BUILDING CHARACTERISTICS	
Floor Area [m²]	195
Climate zone	6A
HVAC SYSTEM	
Cooling system	Air-Source Heat Pump (Mini-Split)
Heating system	Electric Baseboards
Ventilation system	/
Typical COP cooling	2.50
INSULATION & AIR TIGHTNESS	
Exterior walls [W/m²/K]	0.47
Interior walls [W/m²/K]	0
Roof [W/m²/K]	0.18
Slabs [W/m²/K]	4.16
Infiltration (ELA @4Pa) [cm²]	164.32
GLAZING	
Glazing [W/m²/K]	2.94
SHGC	0.6
WINDOW-TO-WALL RATIO	
Average [%]	13.9


ANNUAL END USES — ELECTRICITY [kWh]	
END USE	[kWh/year]
Heating	8785
Cooling	409
Domestic/Service Hot Water	3086
Lighting	568
Plug Loads	7369
Other (Fans,...)	29
Total	20246

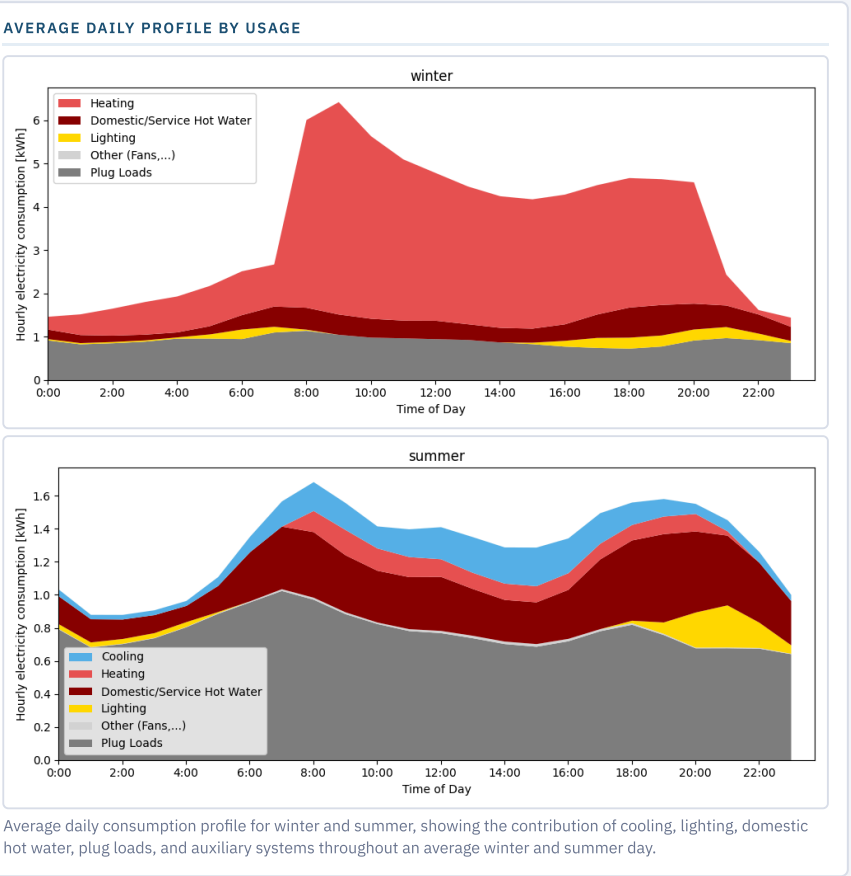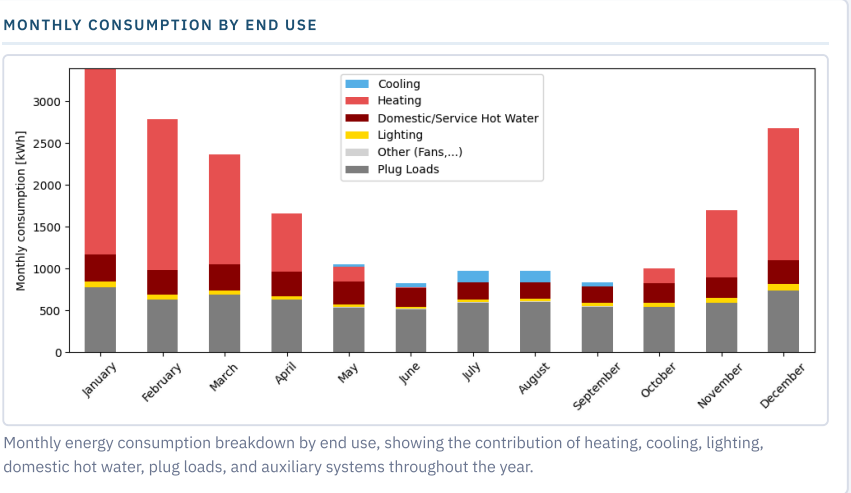

DONNÉES DE RÉFÉRENCE


The reference data used for the comparison come from a dataset of more than 60,000 residential electricity meters, combined with metadata. Filters were applied to ensure consistency with the building type and subtype of this card, as well as to exclude end uses such as pool, spa, and electric vehicle charging.

DAILY PROFILE

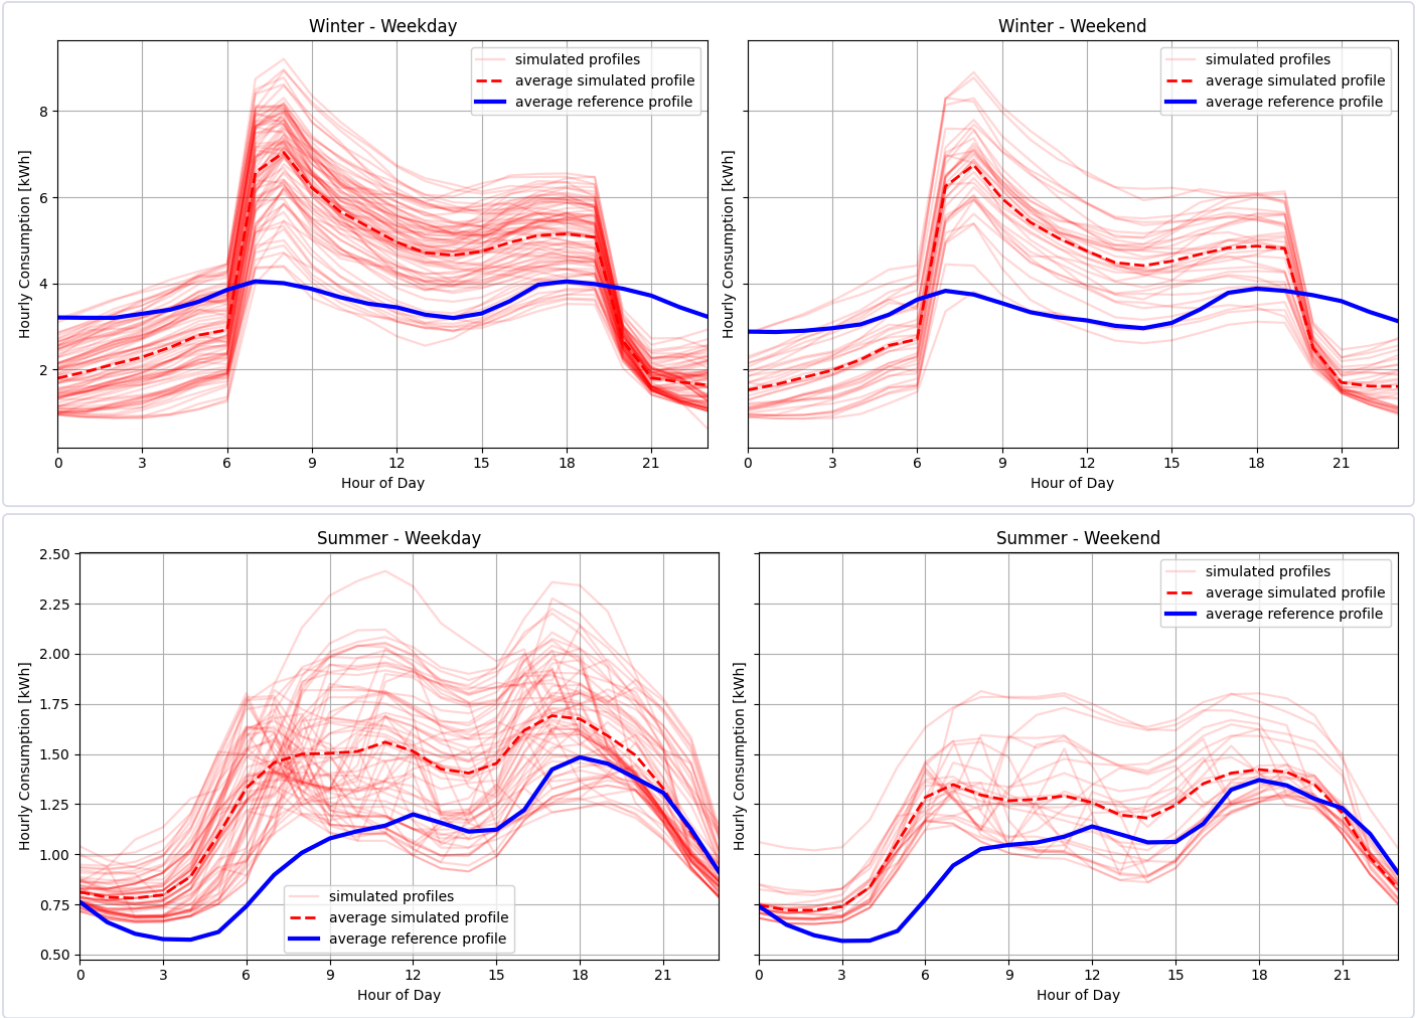

Daily consumption profiles for summer and winter comparing simulated hourly energy use with the reference data. Red lines represent individual days from the model for the given period, the red dashed line indicates the average simulated profile, and the blue line shows the average profile of the reference data. The figures on the left represent weekdays, while the figures on the right represents weekends.

DAILY CONSUMPTION VS. DAILY AVERAGE OUTDOOR TEMPERATURE

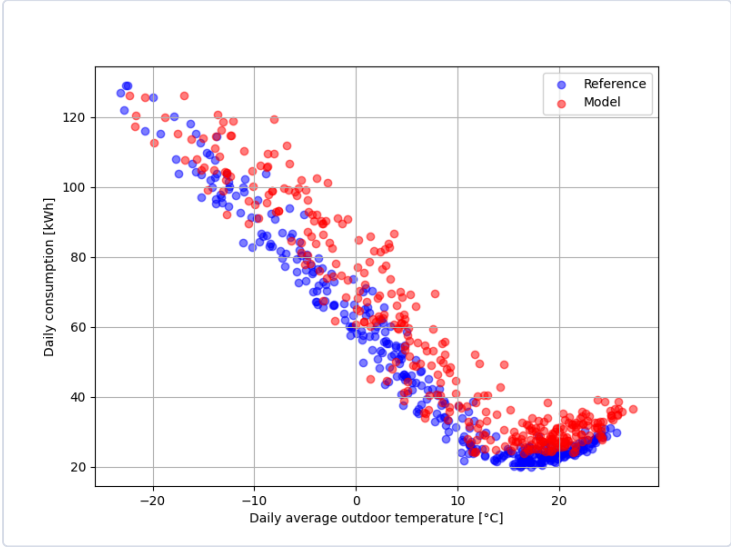

Comparison between modeled daily consumption and reference consumption as a function of outdoor temperature, for all days of the reference year.

COMPARISON TABLE — KEY INDICATORS

INDICATOR	MODEL	REFERENCE	DELTA
Yearly electricity consumption [kWh]	20246	20246	20246
Baseload consumption [kWh/day]	28.3	22.8	5.5
Electric heating slope [W/K]	-120.1	-123.1	3.0
Cooling slope [W/K]	50.2	57.2	-7.0
Winter peak demand - AM [kW]	9.2	6.1	3.1
Winter time of peak - AM	8.0	8.0	0.0
Winter peak demand - PM [kW]	6.7	6.0	0.8
Winter time of peak - PM	12.0	20.0	-8.0