OIML Certification System	CMI	V 3112

OIML Member State Czech Republic	**OIML Certificate No.** R137/2012-A-CZ1-26.01

OIML CERTIFICATE ISSUED UNDER SCHEME A

OIML Issuing Authority

Name: Czech Metrology Institute
Address: Okružní 31,
638 00 Brno
Czech Republic

Person responsible: Jan Kalandra

Applicant

Name: Chengdu Qinchuan IoT Technology Co., Ltd.
Address: No.931 South 4th Road, Economic and Technological Zone
610100 Longquanyi District, Chengdu City, Sichuan Province
China

Manufacturer

Name: Chengdu Qinchuan IoT Technology Co., Ltd.
Address: No.931 South 4th Road, Economic and Technological Zone
610100 Longquanyi District, Chengdu City, Sichuan Province
China

Identification of the certified type *(the detailed characteristics will be defined in the additional pages)*

diaphragm gas meter
type: G2.5, G1.6

Designation of the module *(if applicable)*

This OIML Certificate attests the conformity of the above identified type (represented by the sample(s) identified in the OIML type evaluation report) with the requirements of the following Recommendation of the International Organization of Legal Metrology (OIML):

OIML R137 Edition (year): 2012, Including Amendment 2014

For accuracy class (if applicable): 1.5

Český metrologický institut

This OIML Certificate relates only to metrological and technical characteristics of the type of measuring instrument covered by the relevant OIML Recommendation identified above.

This OIML Certificate does not bestow any form of legal international approval.

The conformity was established by the results of tests and examinations provided in the associated OIML type evaluation report:

- No. 0511-ER-P047-26 dated 5.8.2026 that includes 20 pages.
- Test Report No. 5012-PT-A0018-26 dated 4.8.2026 that includes 26 pages.

The technical documentation relating to the identified type is contained in documentation file:

0511-UL-P047-26

OIML Certificate History

Revision No.	Date	Description of the modification
-	13 August 2026	Issuing Certificate

Identification, signature and stamp
The OIML Issuing Authority
Ing. František Staněk, PhD.
Deputy Director of Certification Body

Date: 13 August 2026







Important note: Apart from the mention of the Certificate's reference number and the name of the OIML Member State in which the Certificate is issued, partial quotation of the Certificate and of the associated OIML type evaluation report(s) is not permitted, although either may be reproduced in full.

1 General information concerning the type

Information, indicated on the instrument	
Manufacturer's trade mark	泰川物联网 QINCHUAN IOT
Type designation	G1.6, G2.5
Accuracy class	1.5
Cyclic volume (if applicable)	0.9 dm^3 for G2.5, 0.5 dm^3 for G1.6
Minimum pressure *p*min	0 bar(g)
Maximum pressure *p*max	0.5 bar(g)
Ambient temperature range	(-10 … +55) °C
Gas temperature range	(-10 … +55) °C
Base pressure (if applicable)	Not applicable
Base temperature (if applicable)	Not applicable
*t*sp (if applicable)	Not applicable
Electrical power	Not applicable
Identification of software	Not applicable

Examples of the labels:

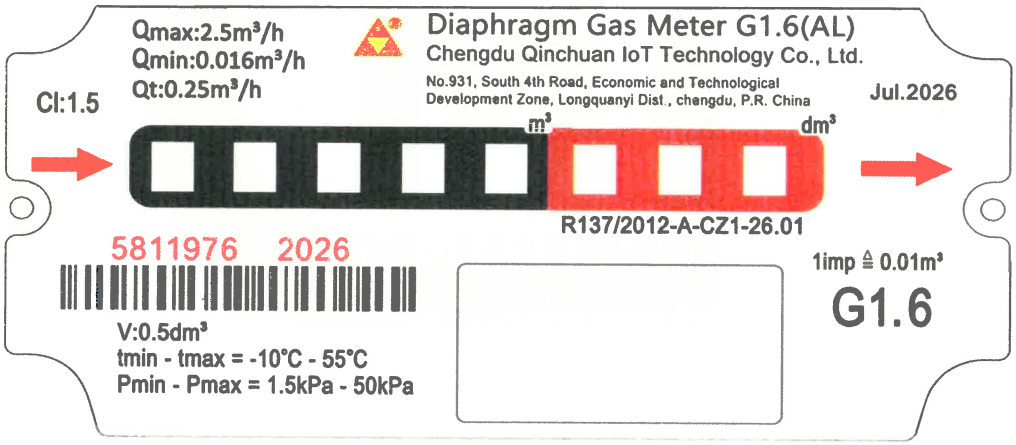


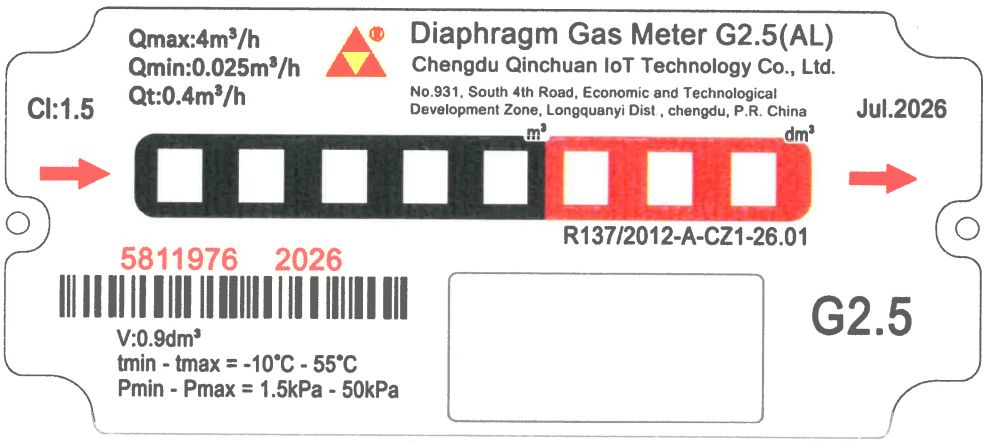

Český metrologický institut
-3-

Photos of the constructions:

G1.6

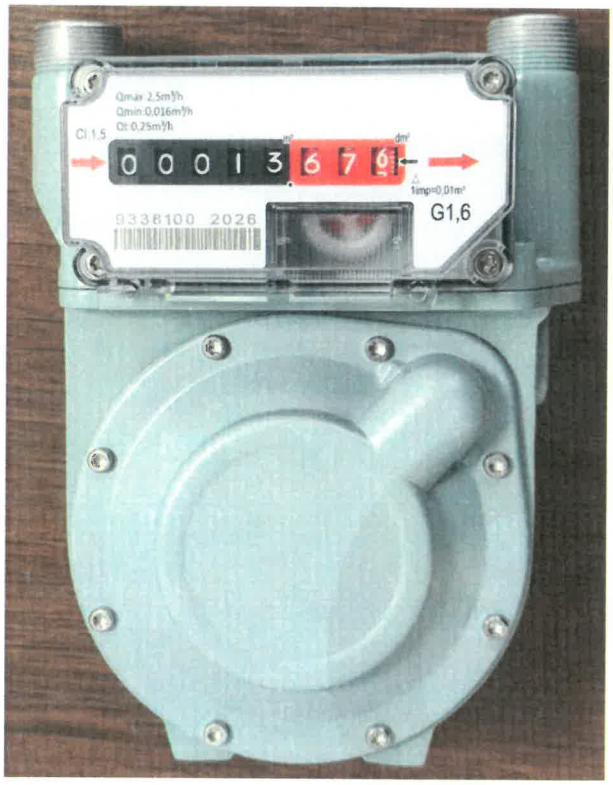

G2.5



2 Additional information concerning the type

Size G	Q_{max} (m^3/h)	Q_t (m^3/h)	Q_{min} (m^3/h)	Cyclic volume V (dm^3)	$Pmax$ (kPa)	Gas and ambient temperature range
G2.5	4.0	0.4	0.025	0.9	50	-10°C … +55 °C
G1.6	2.5	0.25	0.016	0.5	50	-10°C … +55 °C

The gas meter can be produced with the distance between connections (male threads):
130 mm


The male threads used in gas meters G2.5and G1.6:
M26x 1.5


The gas meter does not contain any electronic components.

A pulse emitter is approved only for G1.6.


Český metrologický institut
-3-


Dimensions of diaphragm gas meters G1.6:

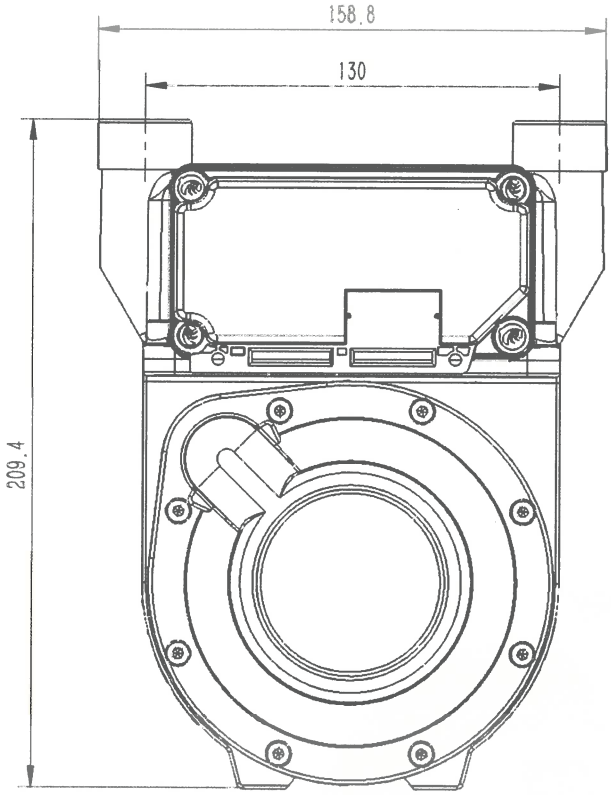

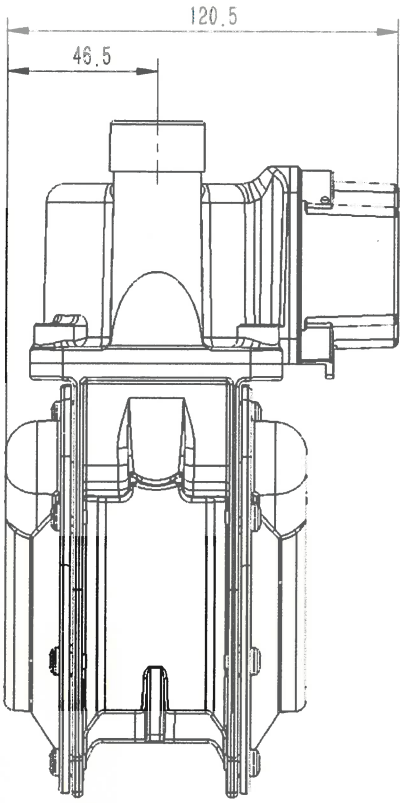


Dimensions of diaphragm gas meters G2.5:

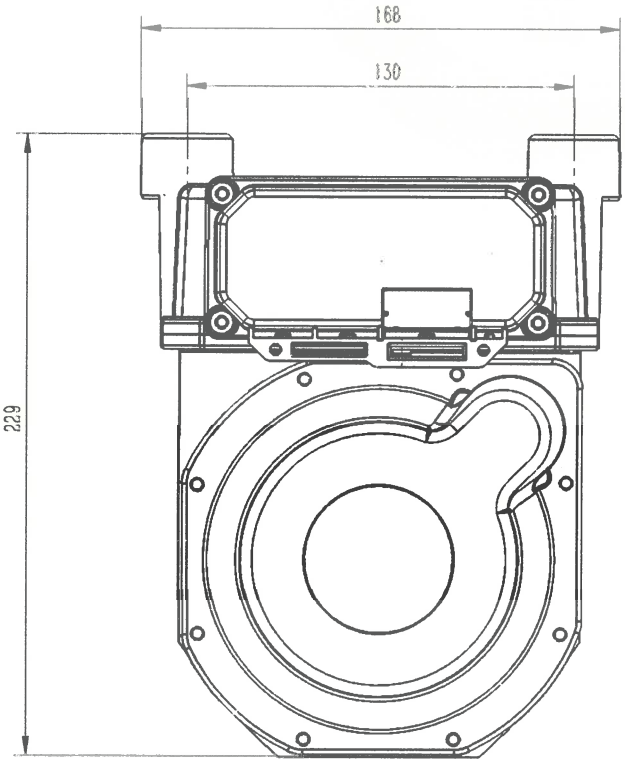

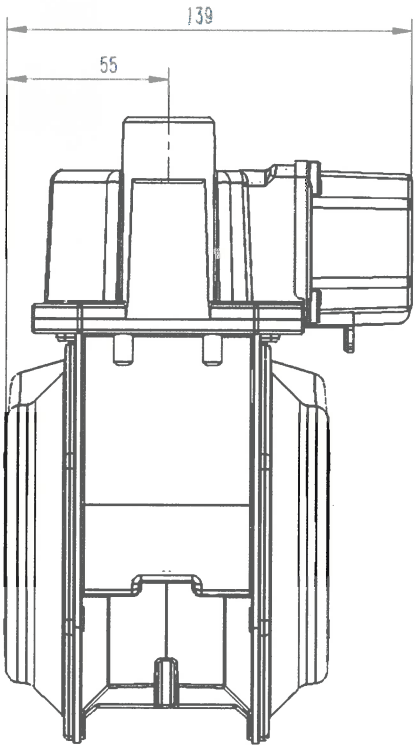


Český metrologický institut
-3-

Locations of 10 seals on diaphragm gas meter G1.6:

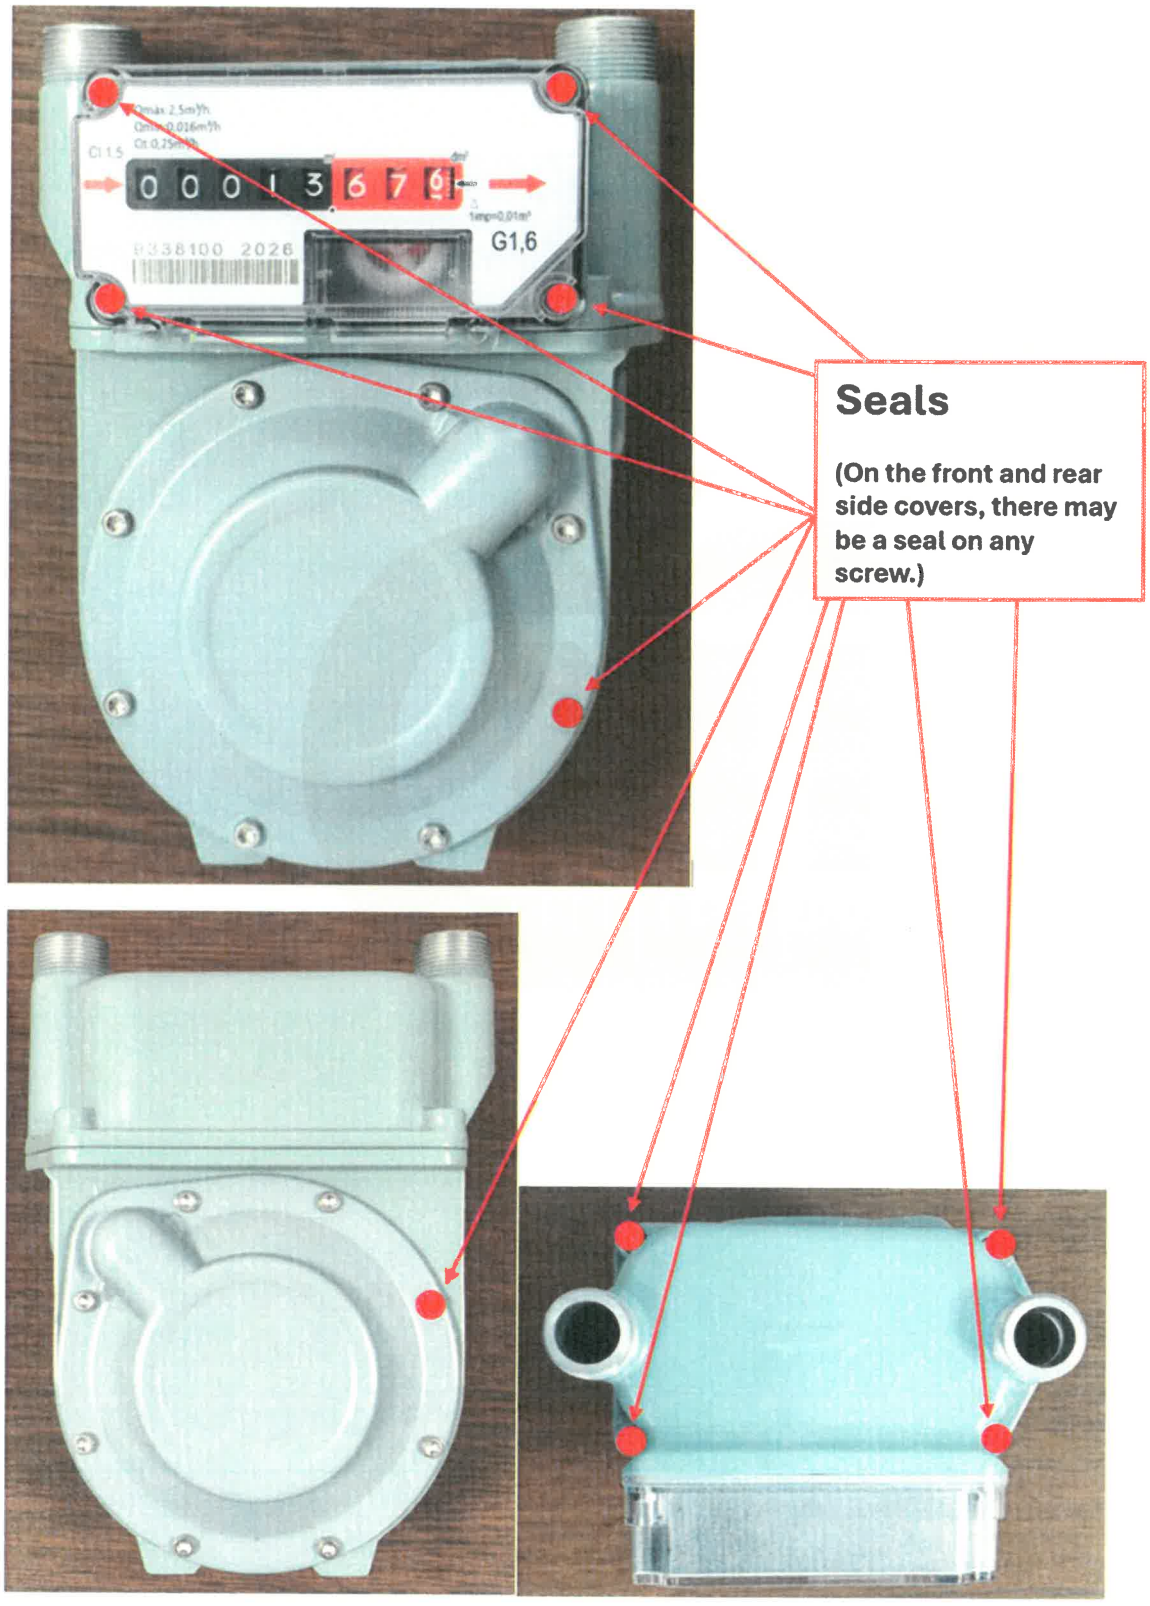

Český metrologický institut
-3-

Locations of 10 seals on diaphragm gas meter G2.5:

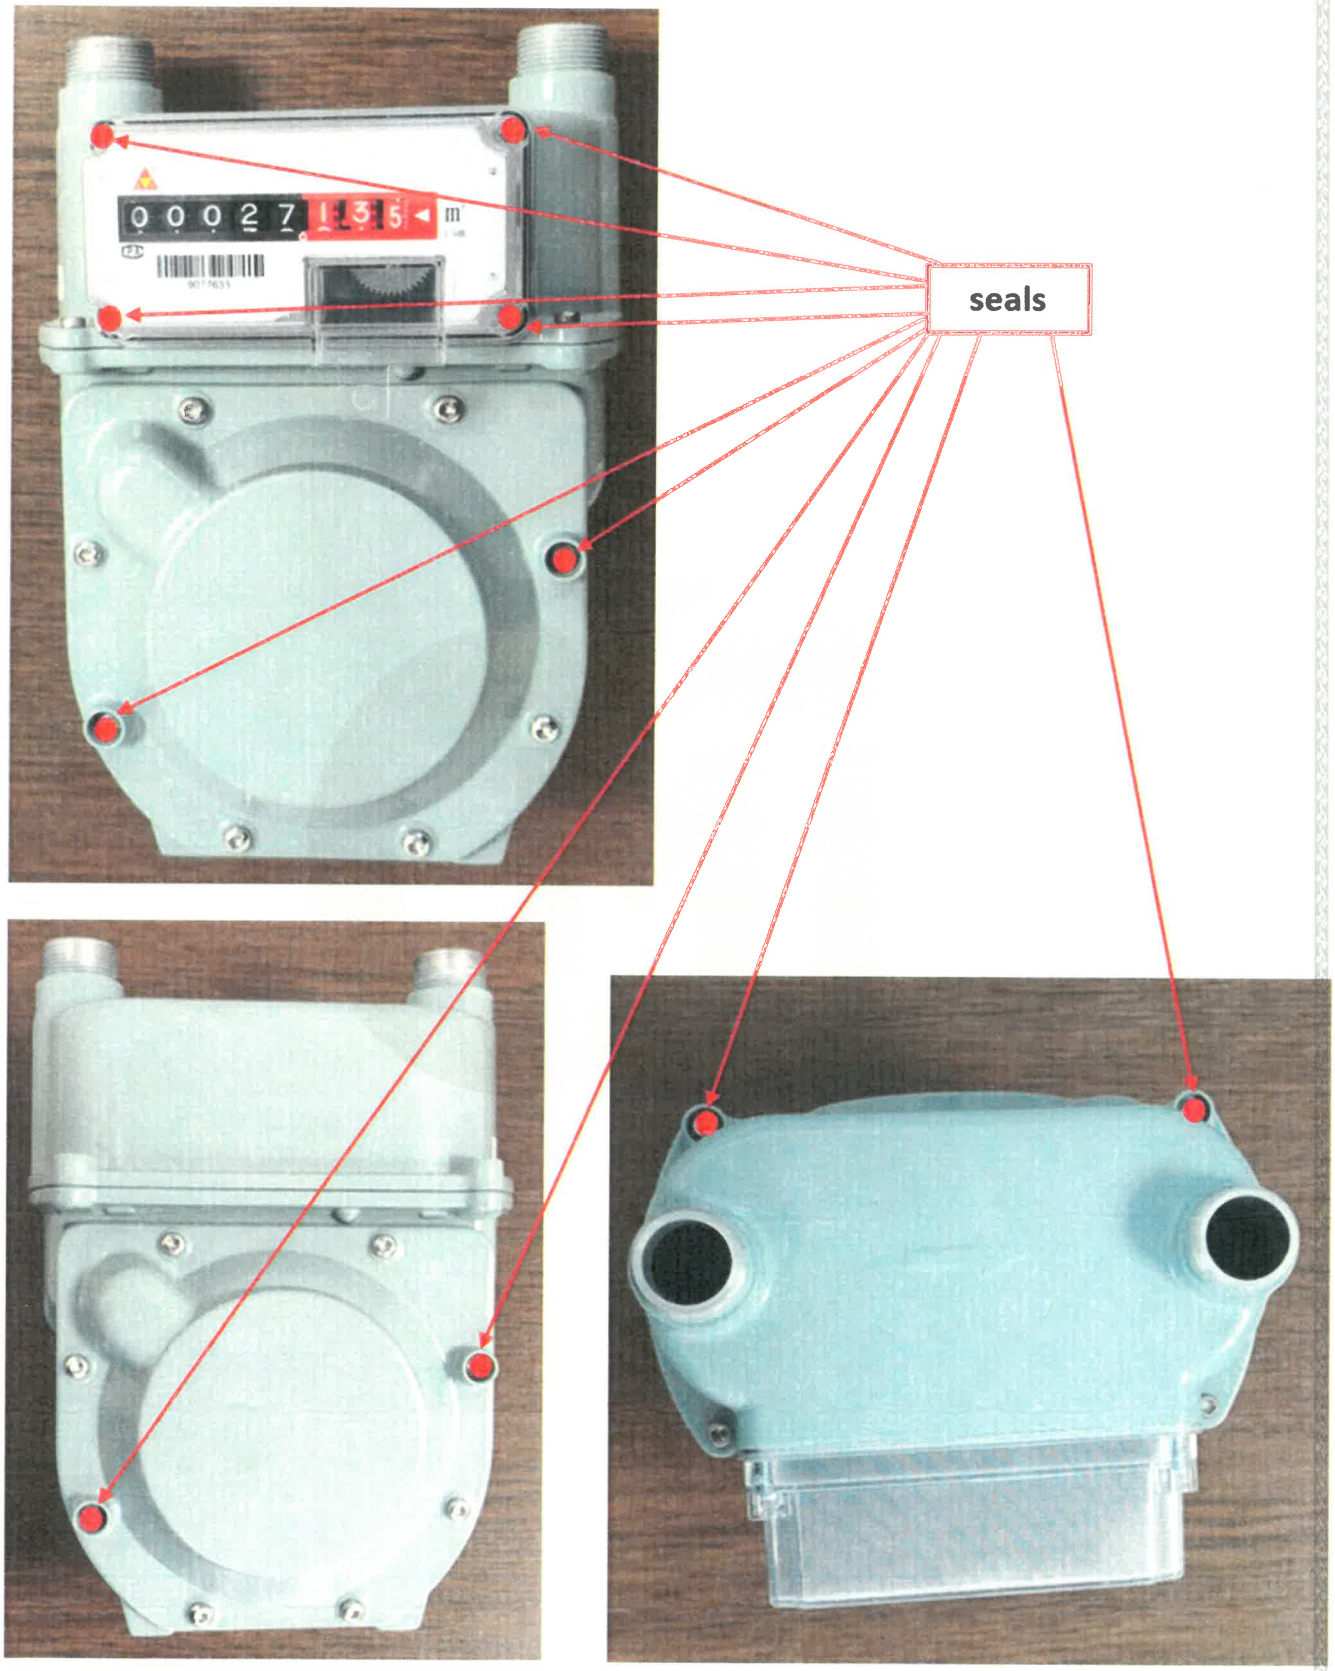

Český metrologický institut
-3-