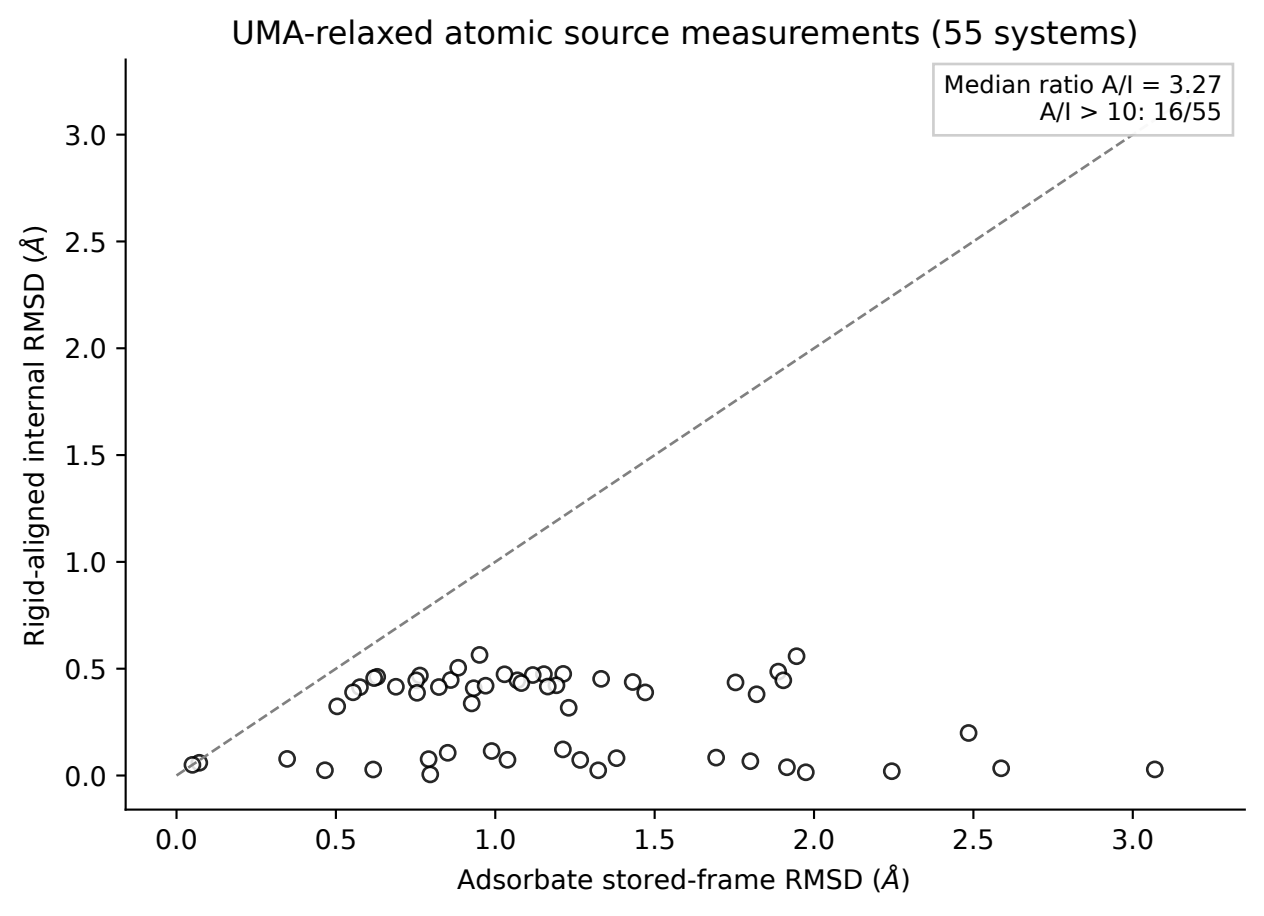
UMA-relaxed atomic source measurements (55 systems)
Median ratio A/I = 3.27
A/I > 10: 16/55
Rigid-aligned internal RMSD (Å)
Adsorbate stored-frame RMSD (Å)
0.0
0.5
1.0
1.5
2.0
2.5
3.0