



H30: R-M Motif Counts in TSS ± 300 bp Region

Exposed vs Shielded Regulators


TGGCCGGC (± 300 bp)
fold=2.81, $p=1.90e-04$

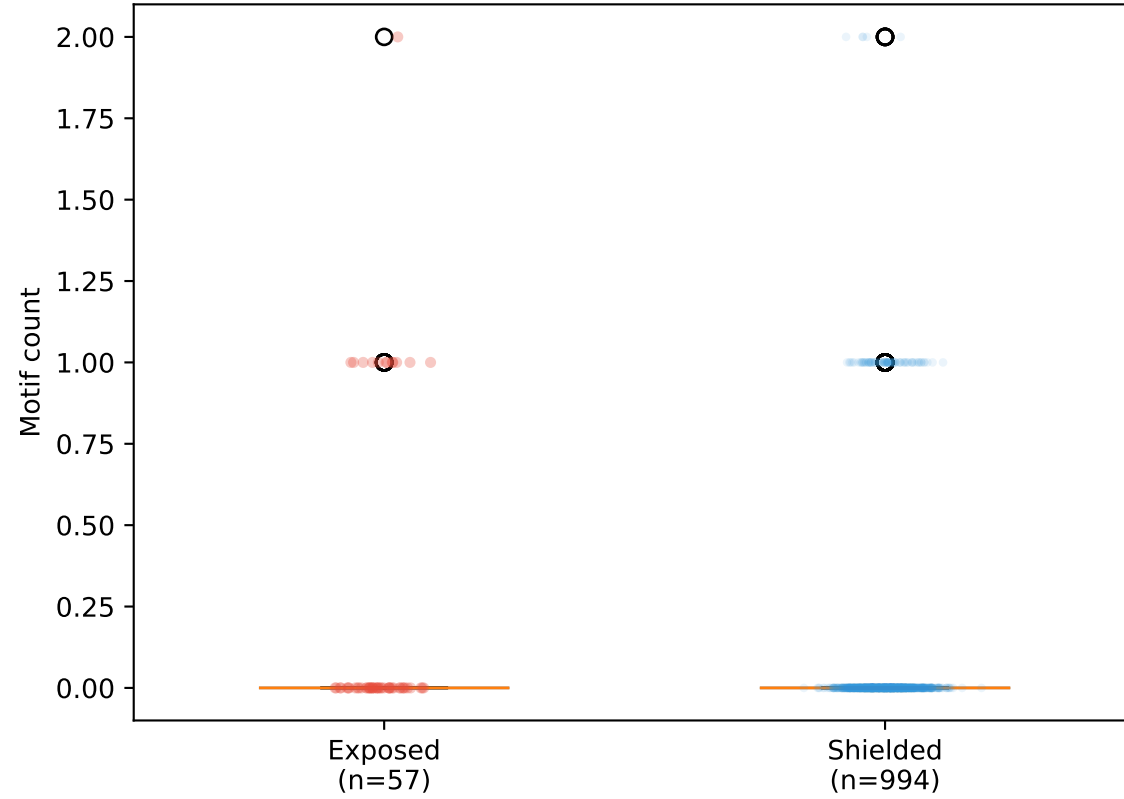

AAGCCCG (± 300 bp)
fold=4.10, $p=3.57e-07$

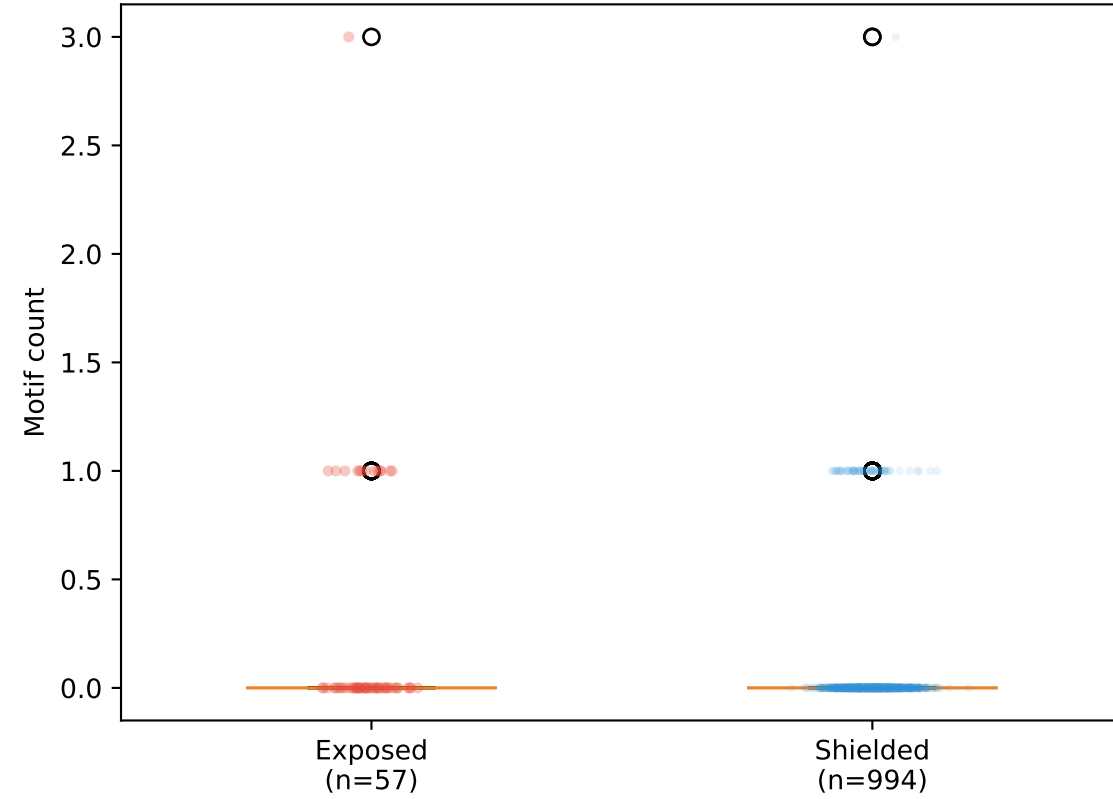

GCCGGC (± 300 bp)
fold=1.22, $p=3.76e-01$

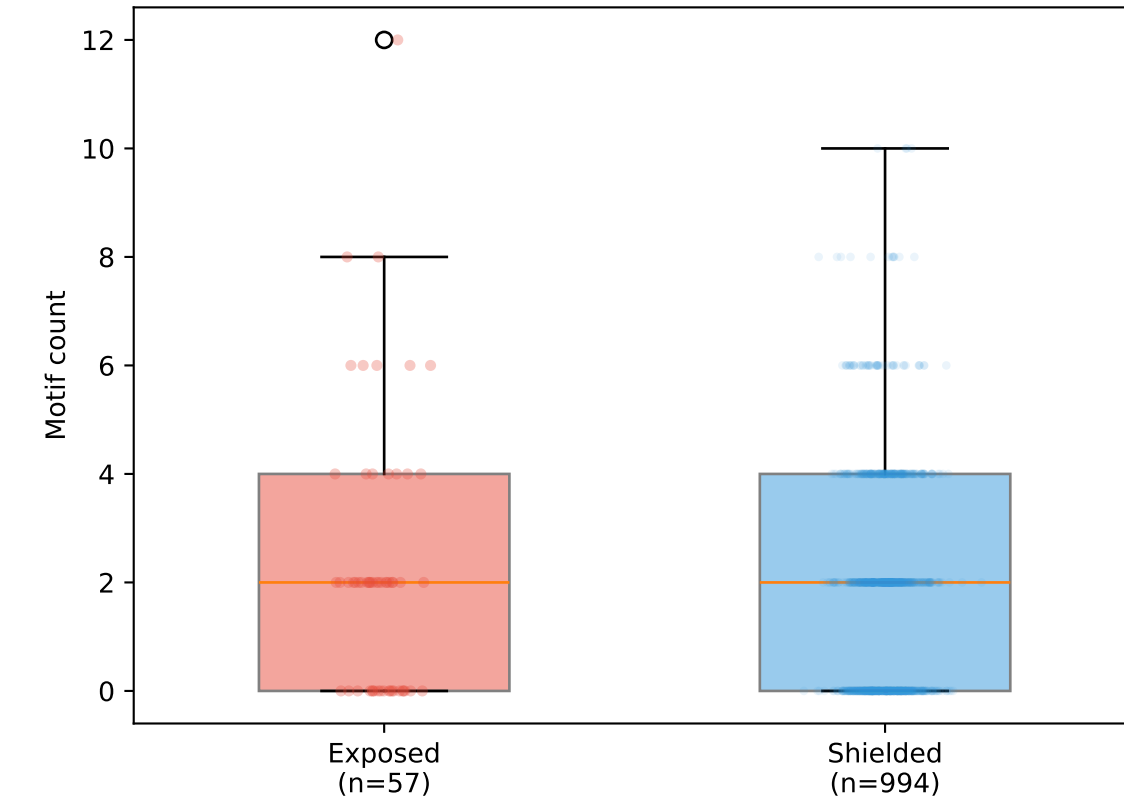

CCGG (± 300 bp)
fold=1.18, $p=5.23e-03$

