



H30: R-M Motif Counts in TSS ± 300 bp Region Exposed vs Shielded Regulators


TGCCGGC (± 300 bp)
fold=4.34, $p=3.30\text{e-}05$

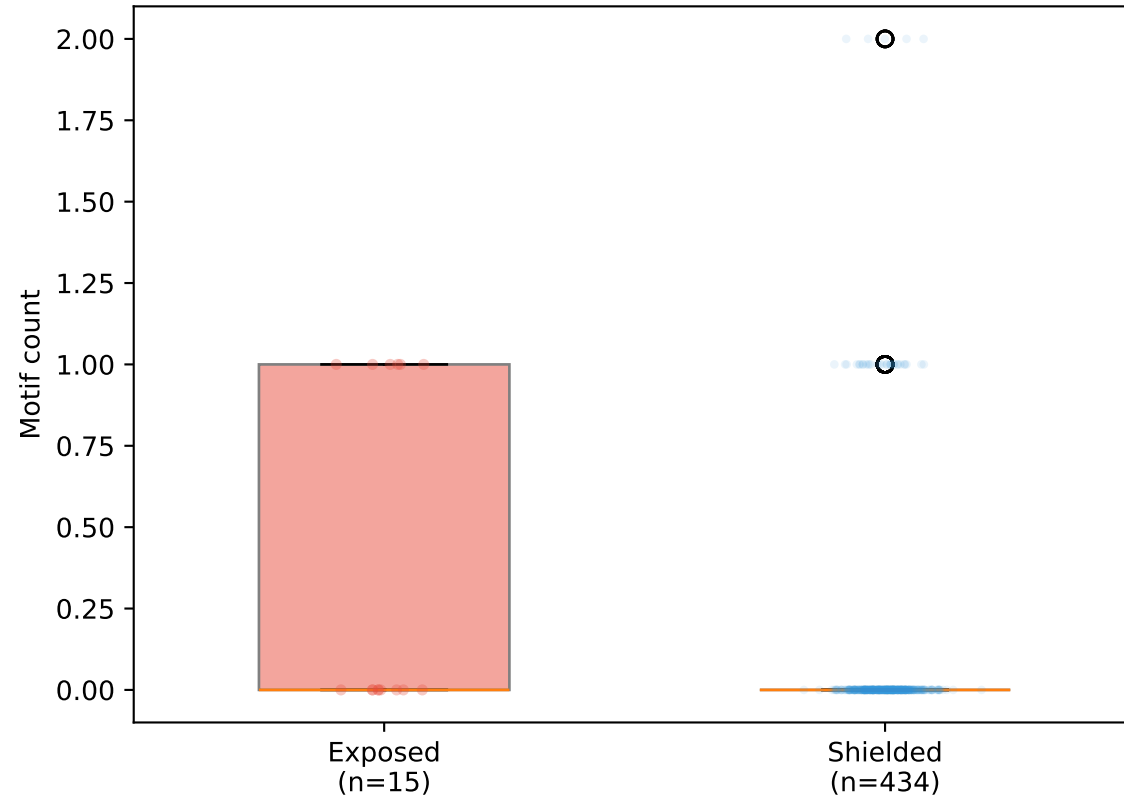

AAGCCCG (± 300 bp)
fold=3.13, $p=1.67\text{e-}02$

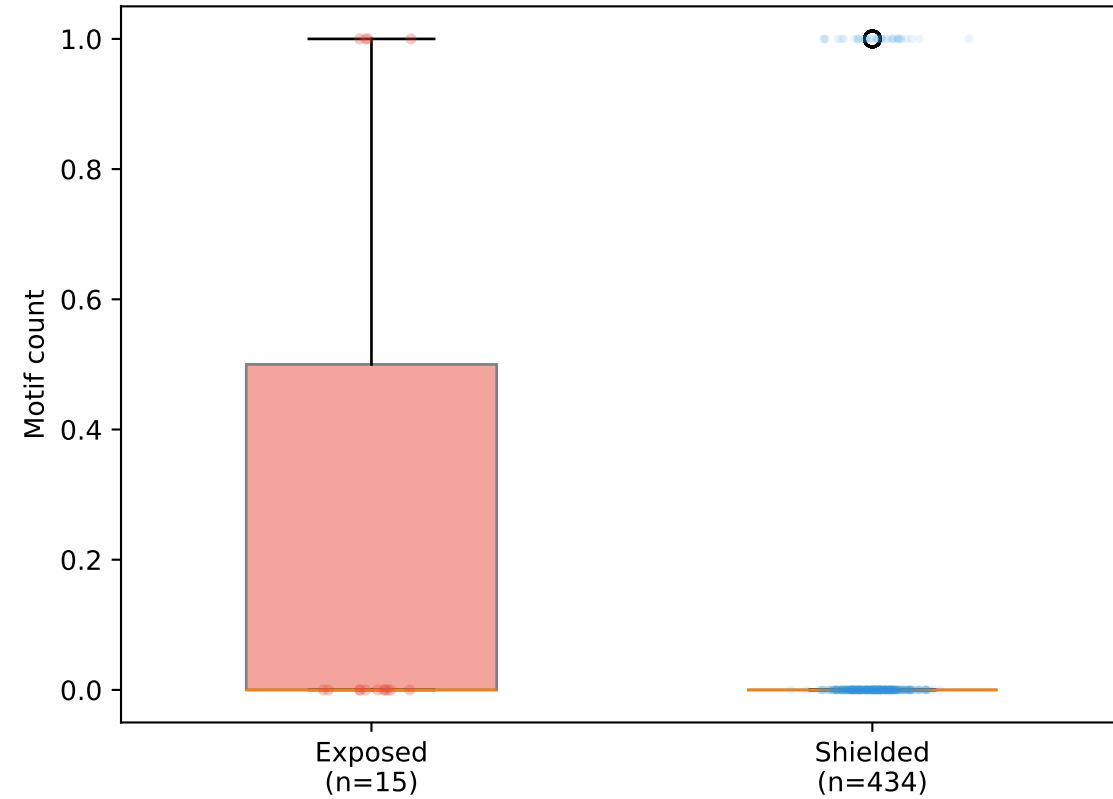

GCCGGC (± 300 bp)
fold=1.45, $p=1.61\text{e-}01$

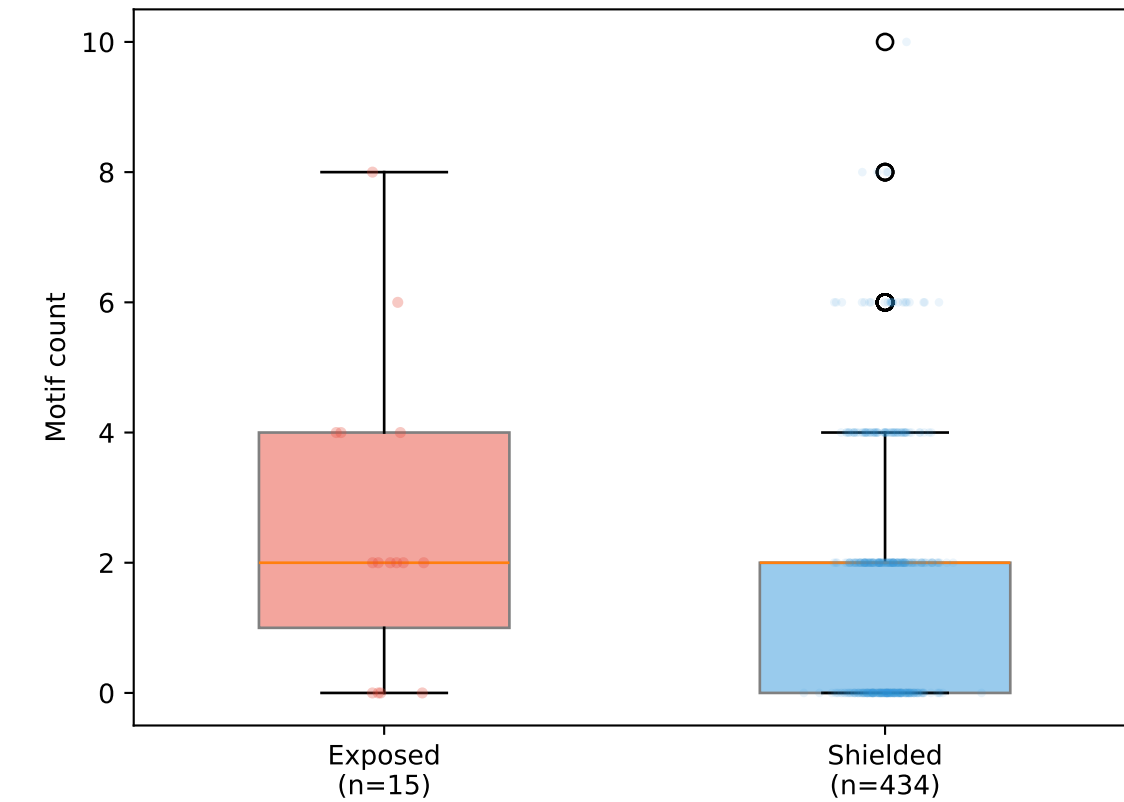

CCGG (± 300 bp)
fold=1.23, $p=2.25\text{e-}02$

