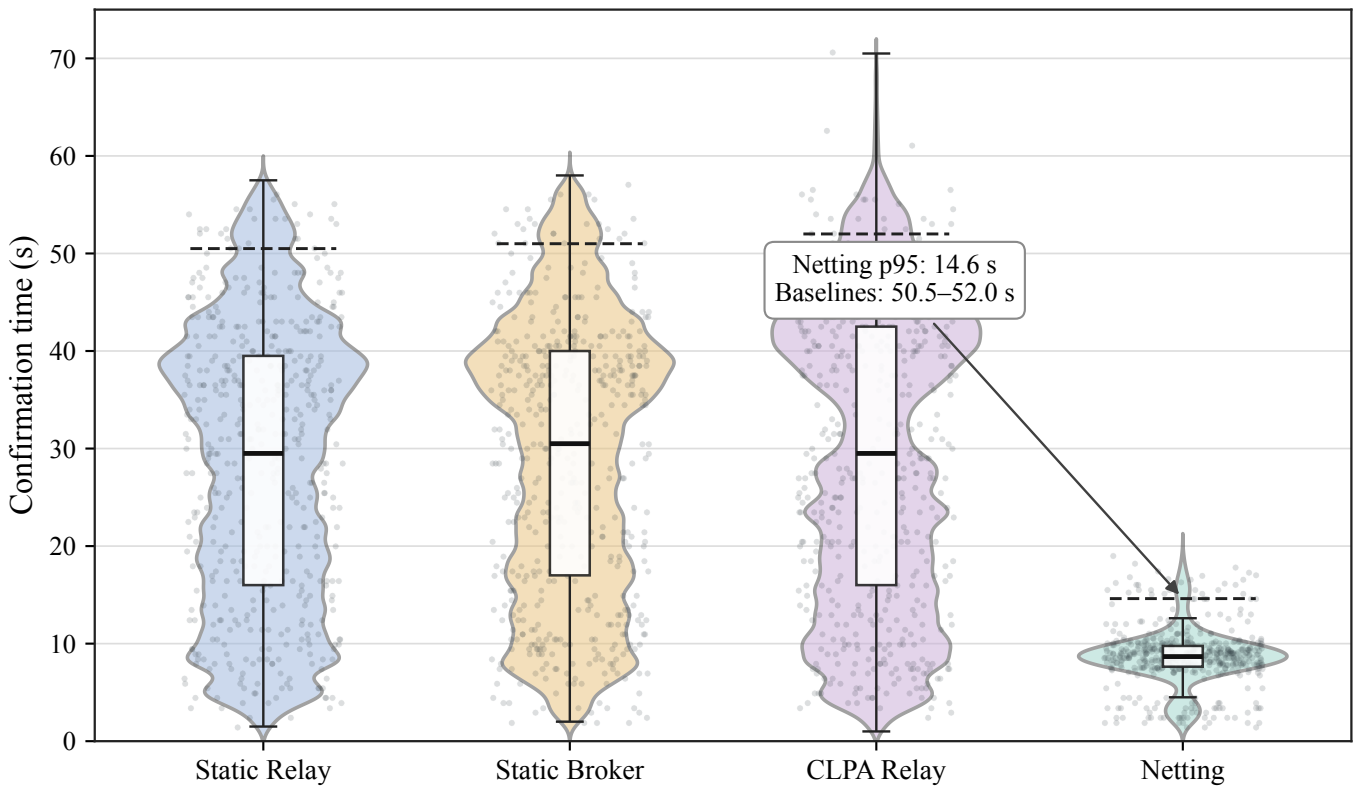

Confirmation time (s)
0
10
20
30
40
50
60
70
Netting p95: 14.6 s
Baselines: 50.5–52.0 s
Static Relay
Static Broker
CLPA Relay
Netting