


ELECTRICAL SINGLE-LINE DIAGRAM — CRITICAL POWER (UPS-02A)

Utility → 11 kV MV Switchgear → Transformer → LV Board → Static UPS (UPS-02A) → Critical Bus. Standby generator on ATS.

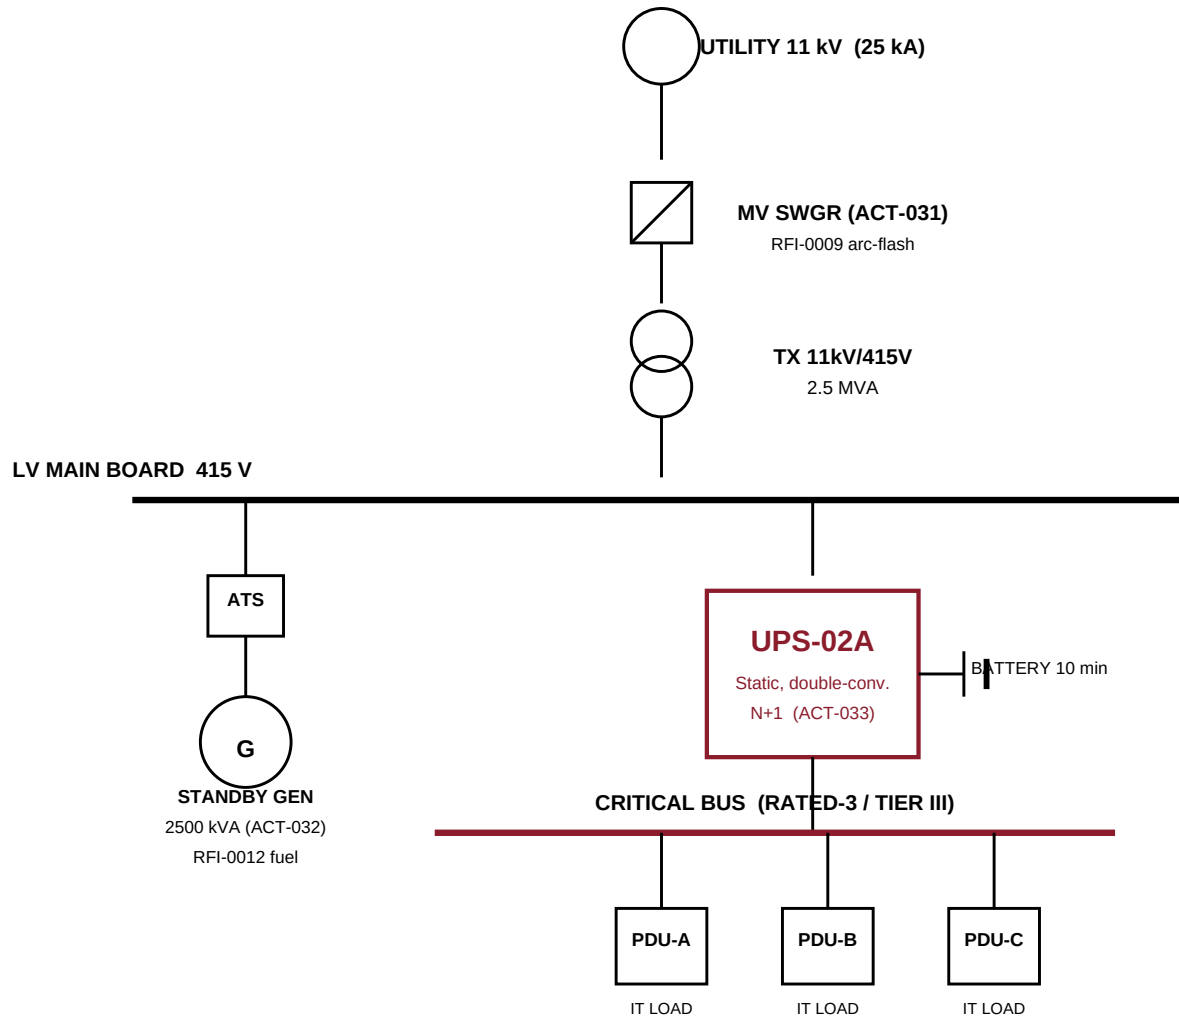

LEGEND

- 'G' in circle - source / generator
- Square with cross - circuit breaker
- Twin circles - transformer
- Rectangle - UPS / PDU / equipment
- Heavy line - busbar
- Battery symbol - battery bank

NOTES:

- Diagram is schematic; not all protection/metering shown.
- UPS-02A ratings per vendor submittal PMX-SUB-UPS02A-R2.
- Compliance thresholds per SPEC-MDC-P1-RevC, Div 26.
- Open RFIs referenced against affected equipment.

MERIDIAN

ENGINEERING (synthetic)

Meridian Data Centre — Phase 1 (Nashik, 24 MW)

ELECTRICAL SINGLE-LINE DIAGRAM

Discipline: Electrical (Div 26)

Status: Issued For Construction | Rated-3 (TIA-942) / Tier III (Uptime)

SIZE

A3

SCALE

NTS

DRAWING No.

SLD-001

REV

C