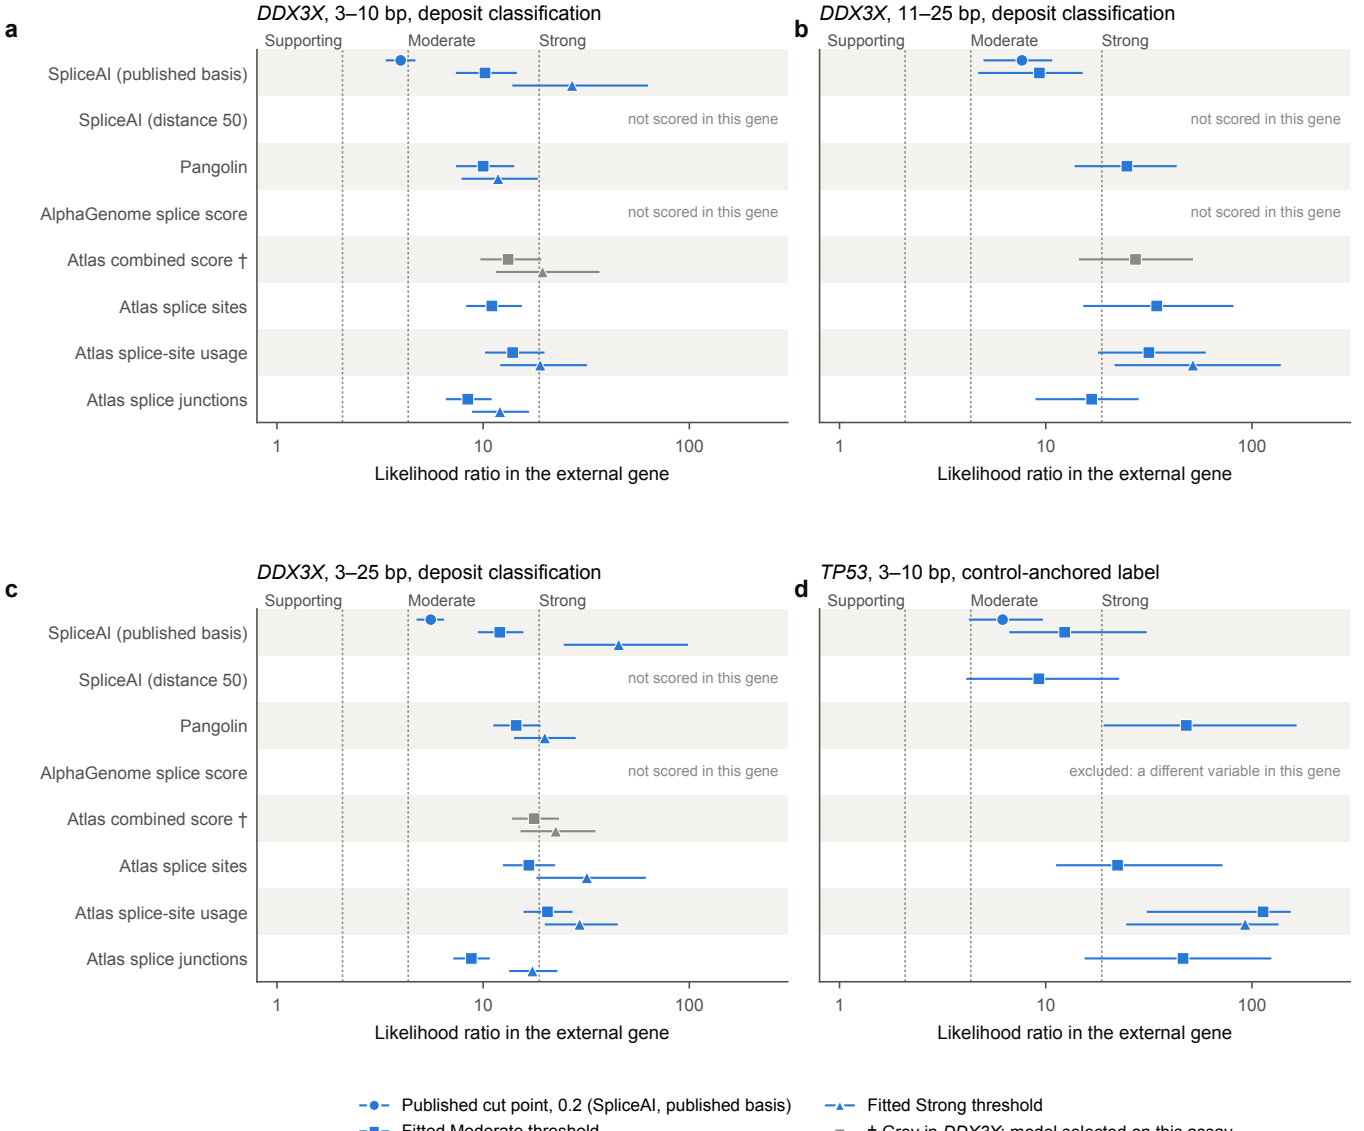
a
DDX3X, 3–10 bp, deposit classification
Supporting
Moderate
Strong
SpliceAI (published basis)
SpliceAI (distance 50)
Pangolin
AlphaGenome splice score
Atlas combined score †
Atlas splice sites
Atlas splice-site usage
Atlas splice junctions
not scored in this gene
not scored in this gene
1
10
100
Likelihood ratio in the external gene
b
DDX3X, 11–25 bp, deposit classification
Supporting
Moderate
Strong
not scored in this gene
not scored in this gene
1
10
100
Likelihood ratio in the external gene
c
DDX3X, 3–25 bp, deposit classification
Supporting
Moderate
Strong
SpliceAI (published basis)
SpliceAI (distance 50)
Pangolin
AlphaGenome splice score
Atlas combined score †
Atlas splice sites
Atlas splice-site usage
Atlas splice junctions
not scored in this gene
not scored in this gene
1
10
100
Likelihood ratio in the external gene
d
TP53, 3–10 bp, control-anchored label
Supporting
Moderate
Strong
excluded: a different variable in this gene
1
10
100
Likelihood ratio in the external gene
Published cut point, 0.2 (SpliceAI, published basis)
Fitted Moderate threshold
Fitted Strong threshold
† Grey in DDX3X: model selected on this assay