

PRINT 4
1A (PPA) 822C 586'
FNAP-CBL-144EUC
A,1-48
PON2165PA,193-252
A,109-144

1B
(PPA) 822C 983'
FNAP-CBL-144EUC
A,1-48
PON2165PA,193-216
A,73-144

3 (PPA) 822C 704'
FNAP-CBL-024
PON2165PA,217-240
822C
FIBER-TELCO
704 PLAC
1 822C
FNAP-CBL-024
704 PLAC
2 822C
2 TERM
17 822C
1 PCOIL

OPP 144-1 RED OAK CIR
EVOLV8/100TIP (PPA) 822C
PON2165PA,217-224

SEE PRINT #8

RESET LOOP
22 822C
1 PCOIL

F 149-1 SCENIC DR
EVOLV4/100TIP (PPA) 822C
PON2165PA,209-212

F 137-1 RED OAK CIR
EVOLV4/100TIP (PPA) 822C
PON2165PA,237-240

F 129-1 RED OAK CIR
EVOLV4/100TIP (PPA) 822C
PON2165PA,233-236

F 121-1 RED OAK CIR
EVOLV8/100TIP (PPA) 822C
PON2165PA,225-232

CAUTION:
VOLTAGE TO GROUND
301V TO 15KV

PROJECT # A02R6E9		DATE SVC REQ'D 10/30/2024	
NPANNX 205631	GEO LOC 11447	CLLI grdlalnm	
PRIMARY ENGR.: SIMS, WENDLE C			
ENGR. ID: WS7293		PERMIT REQ'D.	Y
PHONE #: 3184731736		PRINT 7	OF 18

10 (PPA) 822C 704'
FNAP-CBL-048
A,1-12
PON2165PA,13-48

10A (PPA) 822C 552'
FNAP-CBL-048
A,1-12
PON2165PA,13-24
A,25-48

12 (PPA) 822C 280'
FNAP-CBL-024
PON2165PA,25-36
A,1-12

1

822C
FNAP-CBL-024
280 PLAC

2

822C
1 TERM

12

822C
1 PCOIL

11


822C
FIBER-TELCO
280 PLAC

F 2832-1 BUCKSKIN DR
EVOLV4/100TIP (PPA) 822C
PON2165PA,21-24

F 2820-1 BUCKSKIN DR
EVOLV4/100TIP (PPA) 822C
PON2165PA,33-36

F 2812-1 BUCKSKIN DR
EVOLV8/100TIP (PPA) 822C
PON2165PA,25-32

F 505-1 BUCKSKIN LN
EVOLV8/100TIP (PPA) 822C
PON2165PA,37-44

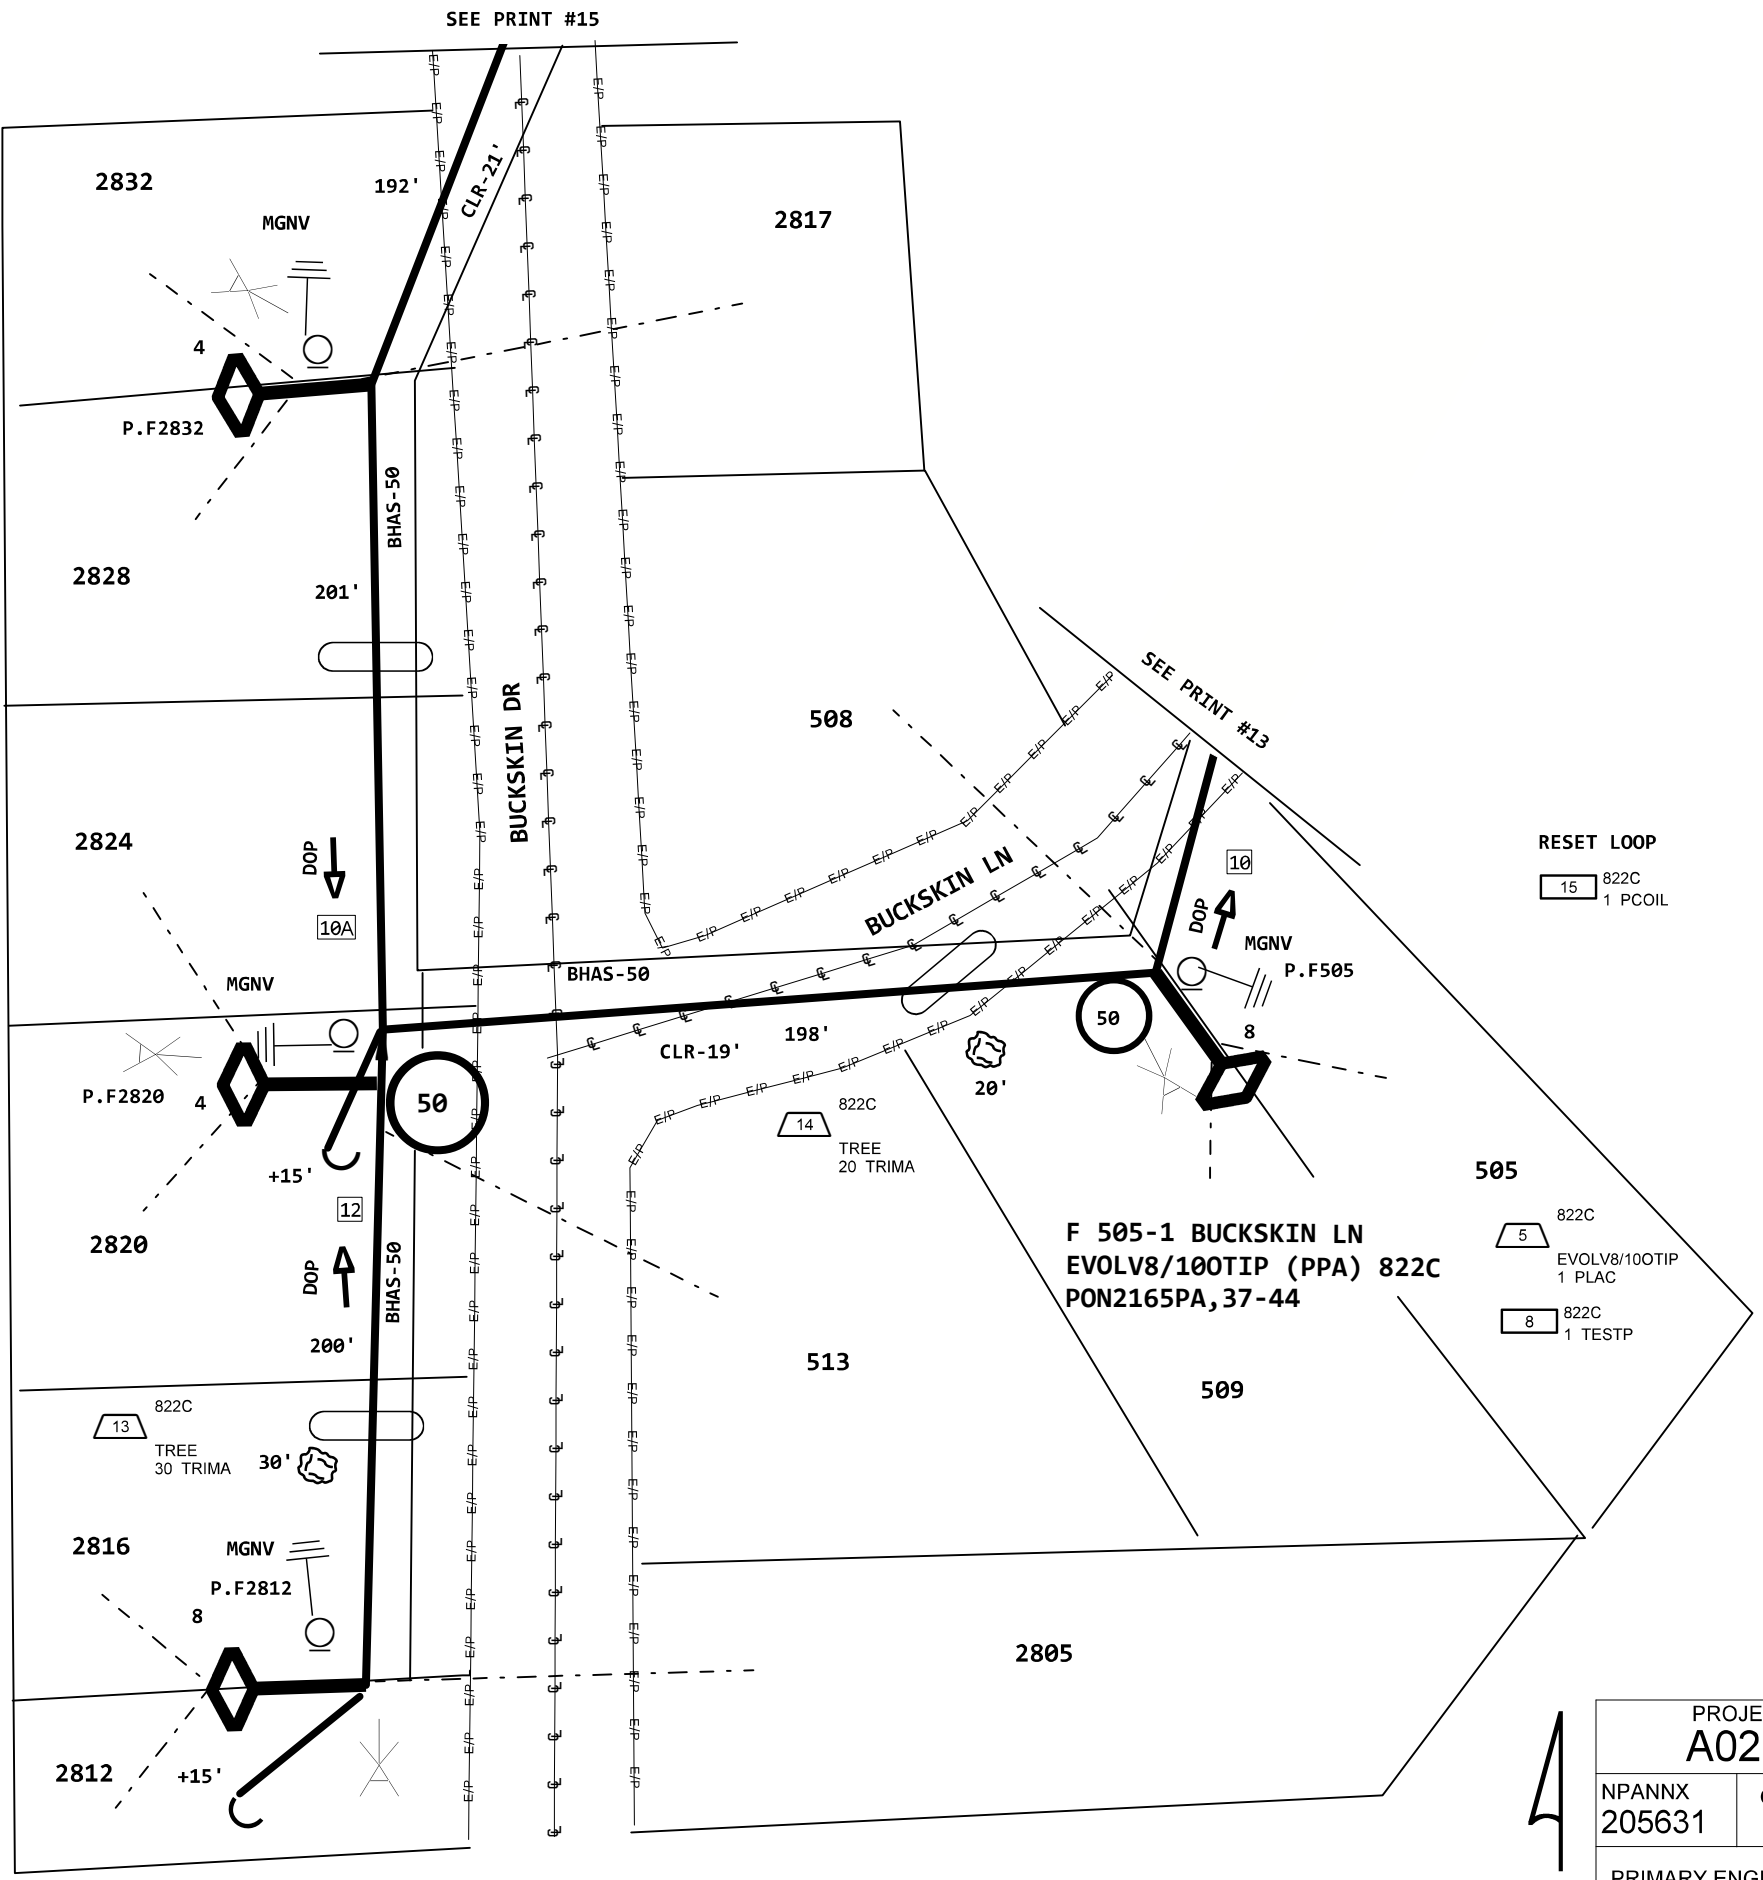

RESET LOOP
15 822C
1 PCOIL


5 822C
EVOLV8/100TIP
1 PLAC
8 822C
1 TESTP

CAUTION:
VOLTAGE TO GROUND
301V TO 15KV

PROJECT # A02R6E9		DATE SVC REQ'D 10/30/2024	
NPANNX 205631	GEO LOC 11447	CLLI grdlalnm	
PRIMARY ENGR.: SIMS, WENDLE C			
ENGR. ID: WS7293		PERMIT REQ'D.	Y
PHONE #: 3184731736		PRINT 14 OF 18	

PRINT 13

10A (PPA) 822C 552'
FNAP-CBL-048
A,1-12
PON2165PA,13-24
A,25-48

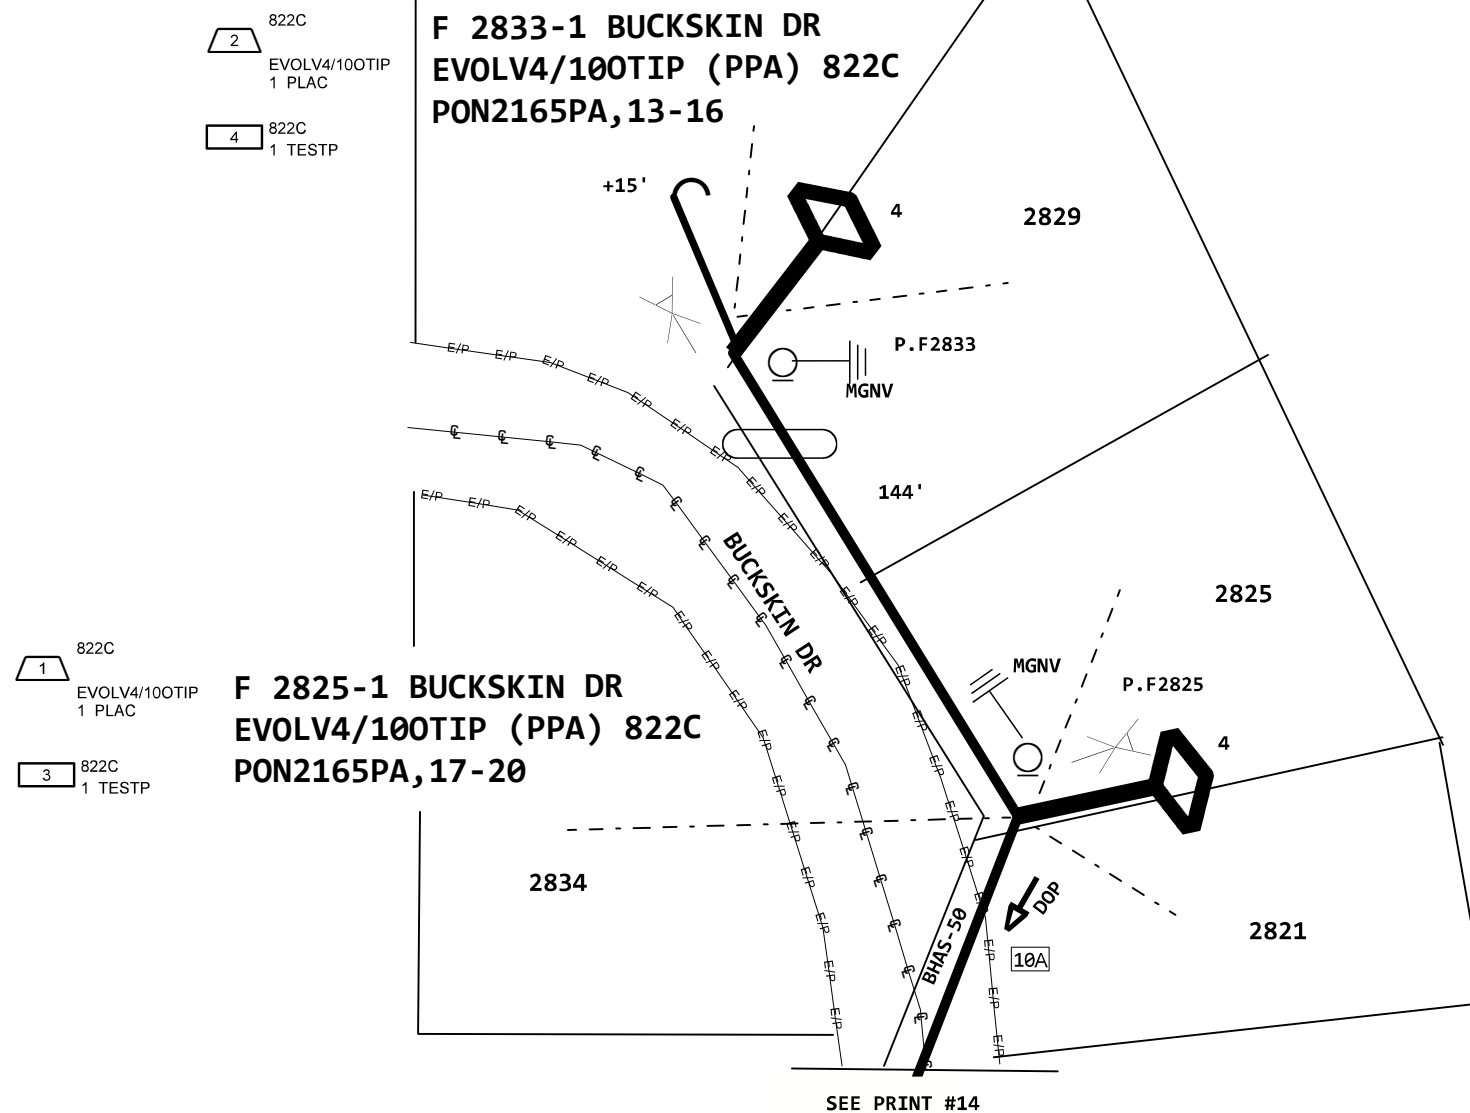


4

PROJECT # A02R6E9		DATE SVC REQ'D 10/30/2024	
NPANNX 205631	GEO LOC 11447	CLLI grdlalnm	
PRIMARY ENGR.: SIMS, WENDLE C			
ENGR. ID: WS7293		PERMIT REQ'D.	Y
PHONE #: 3184731736		PRINT 15 OF 18	

11 (PPA) 822C 1248'
FNAP-CBL-024EUC
PON2165PA,49-72

RESET LOOP
11 822C
1 PCOIL

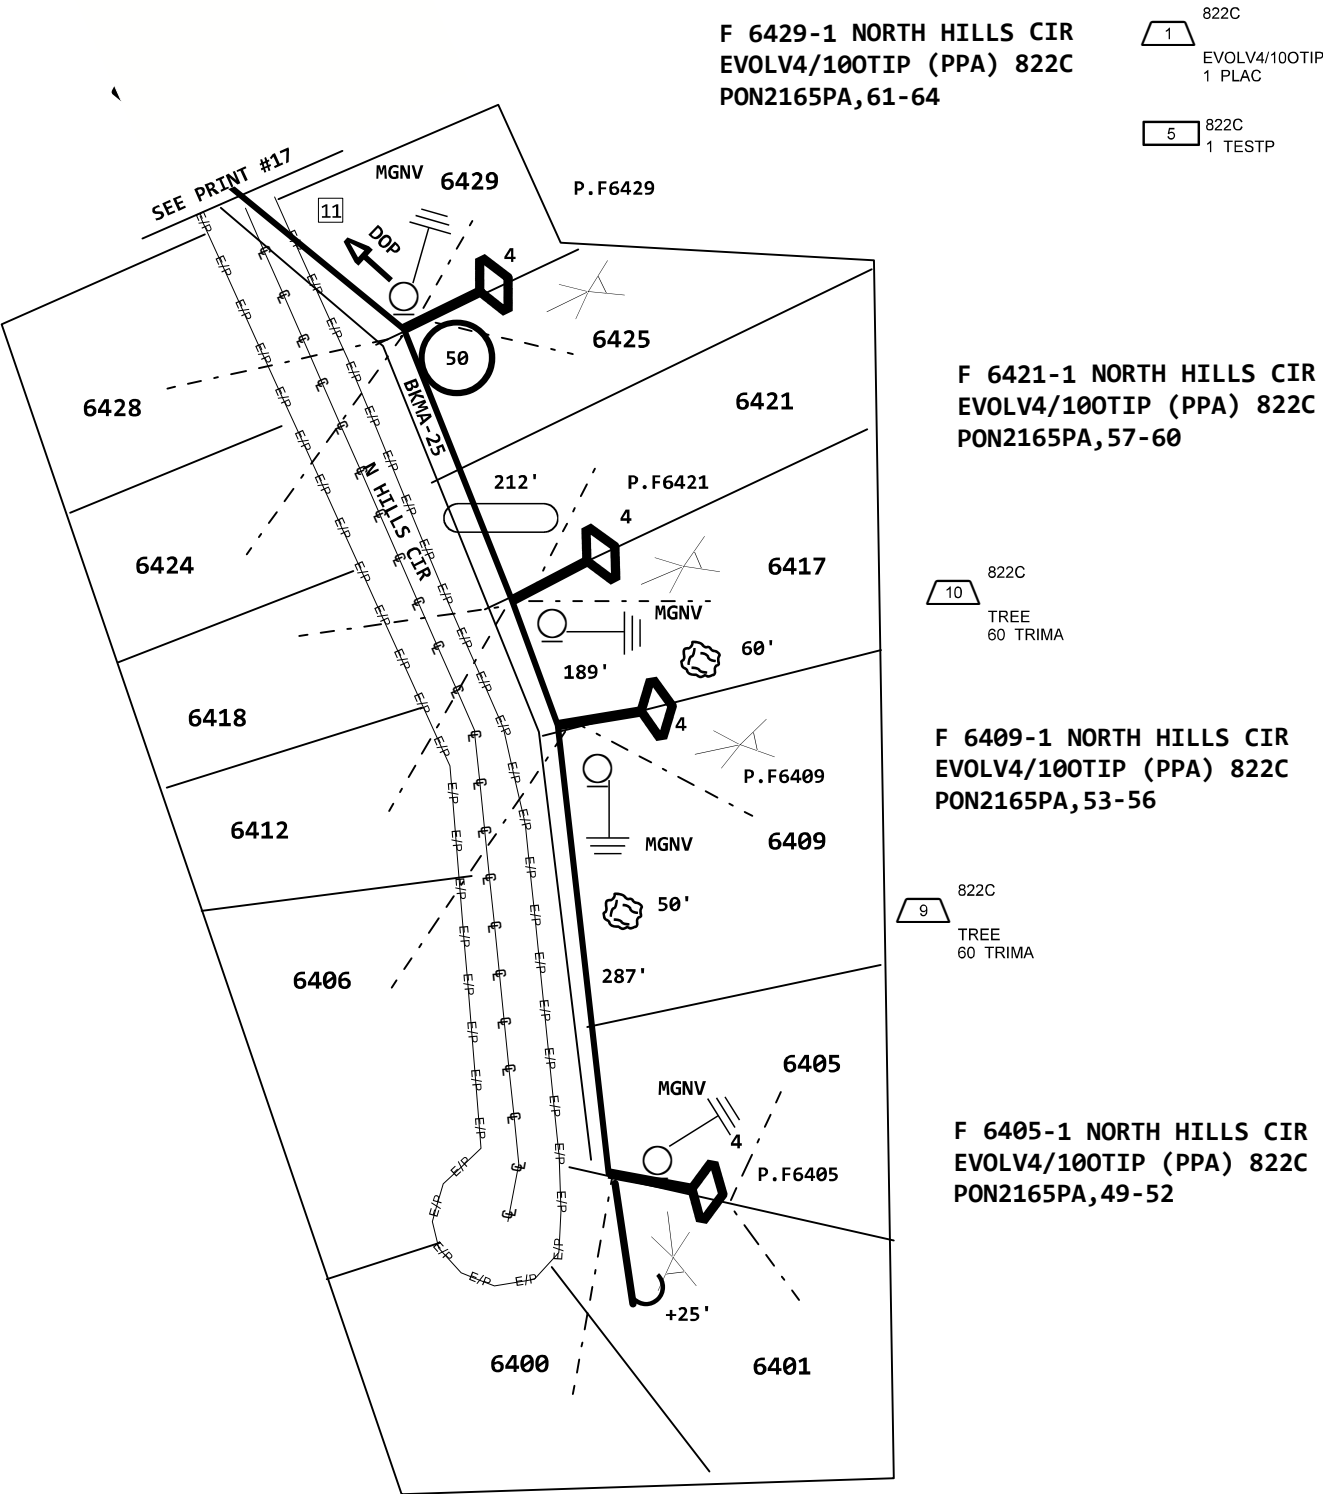

CAUTION:
VOLTAGE TO GROUND
301V TO 15KV

PROJECT # A02R6E9		DATE SVC REQ'D 10/30/2024	
NPANNX 205631	GEO LOC 11447	CLLI grdlalnm	
PRIMARY ENGR.: SIMS, WENDLE C			
ENGR. ID: WS7293		PERMIT REQ'D.	Y
PHONE #: 3184731736		PRINT 18 OF 18	