


1 (PPA) 1593'
FNAP-CBL-048-T
PON9401SS, 385-432

CONSTRUCTION NOTE:
42' INNERDUCT-1.5 (PPA) 845C
SEE TASK 3.1 ON PRINT#3

CABLE PLACEMENT ALONG SUNSET STRIP
R/W=106'
EOP TO EOP=62'
GRASS=17'
S/W= 4'
EOP TO PROPOSED CABLE=12'

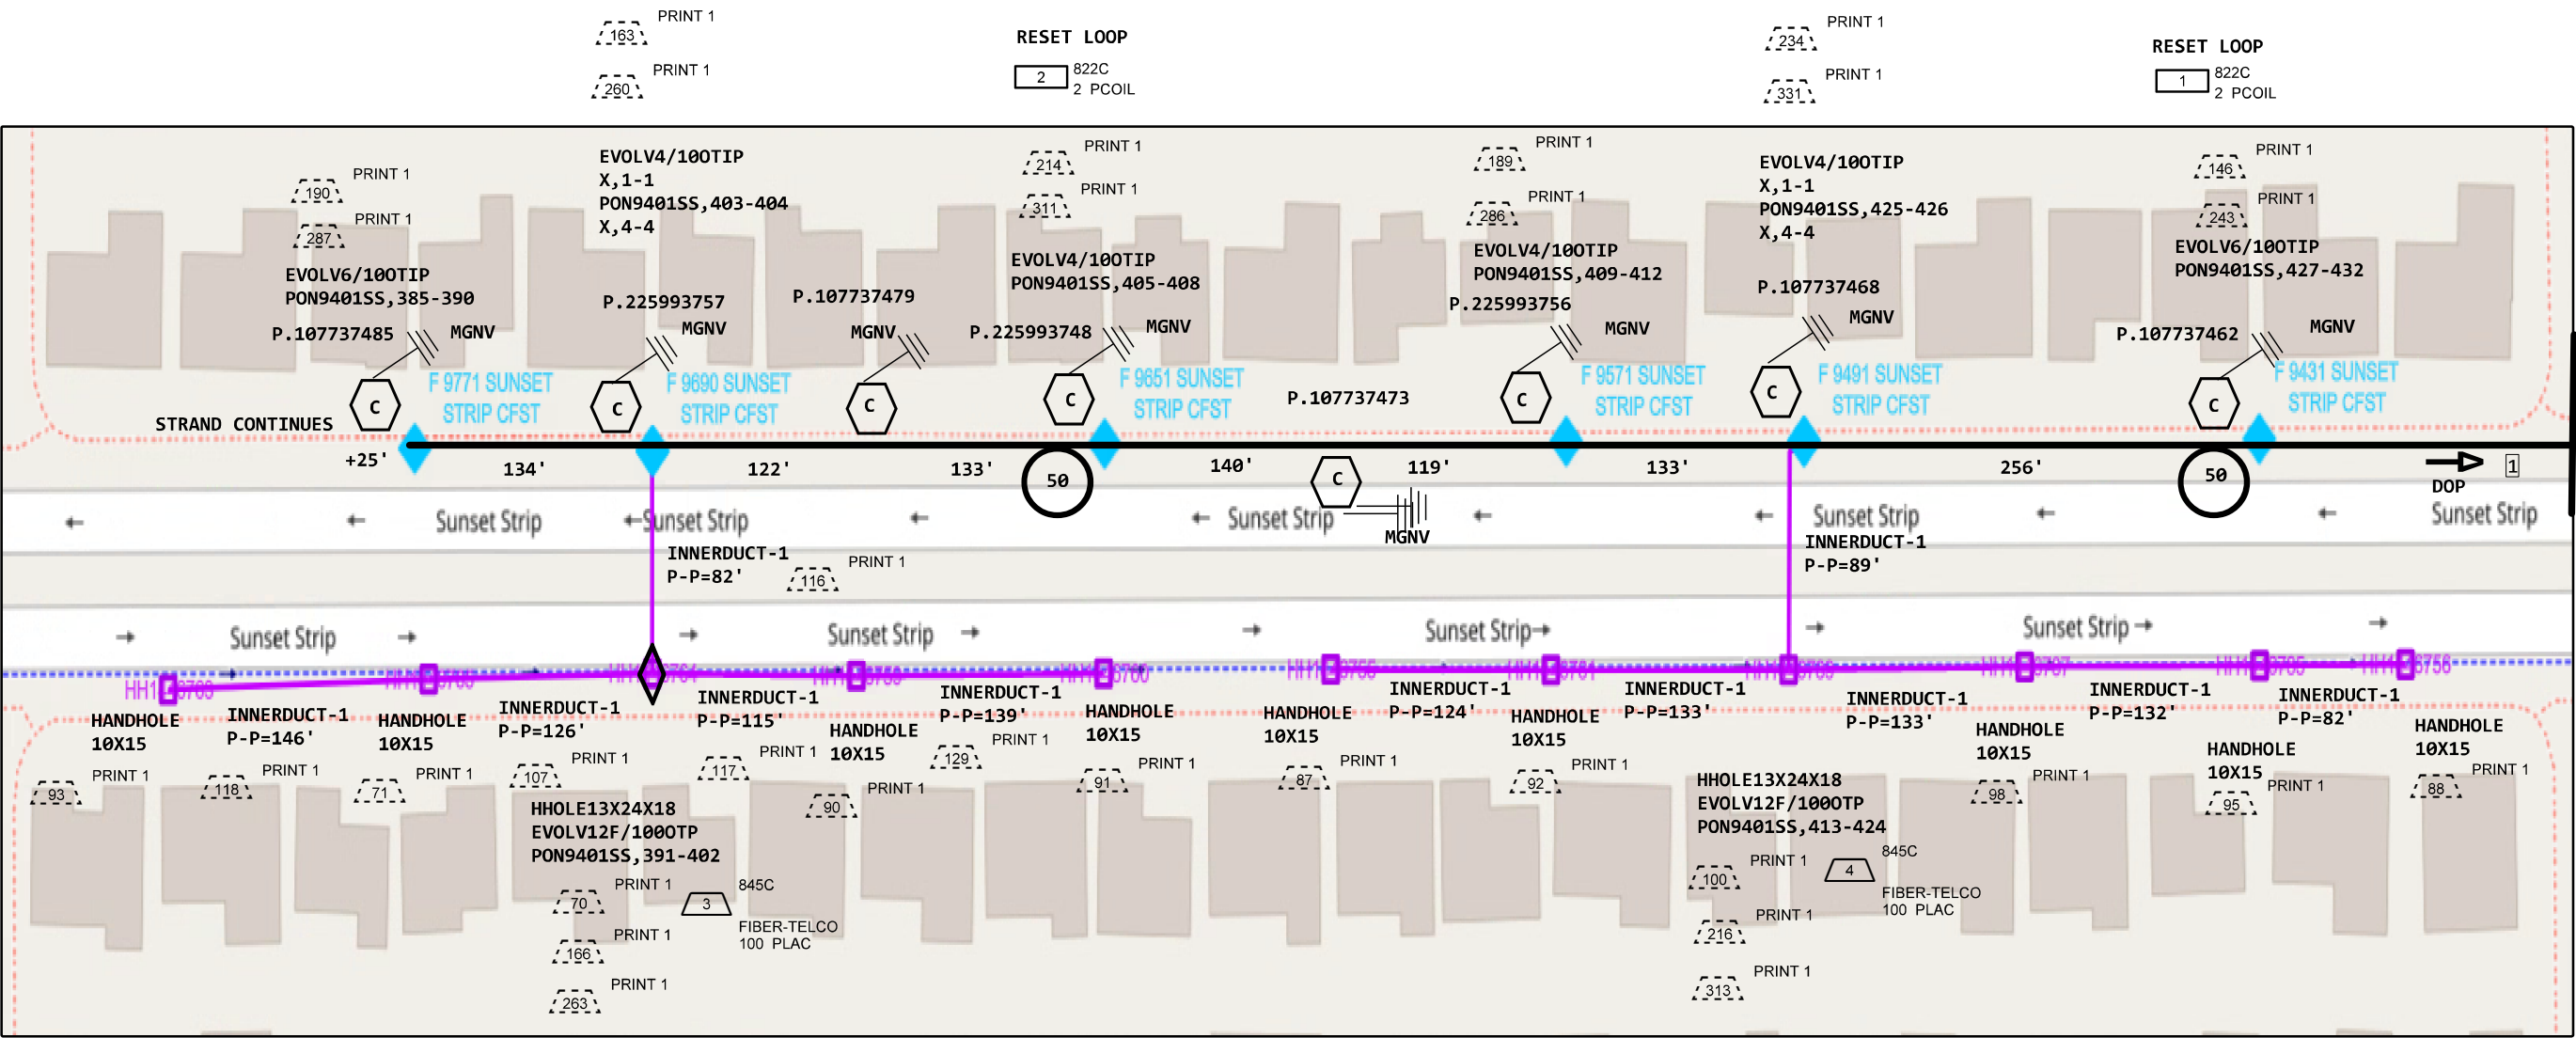

SEE PRINT 3

ALL CABLES TO BE LASH
TO EXISTING STRAND

CAUTION VOLTAGE RANGES
FROM 301V TO 15KV

AERIAL CABLE PLACEMENT NOTE: MAINTAIN
MINIMUM OF 15'6" OVER ROADS AND DRIVEWAYS

PROJECT # A053LM1		DATE SVC REQ'D 07/30/2025	
NPANNX 954741	GEO LOC E4410	CLLI ftldfisu	
PRIMARY ENGR.: MESSIAHDAS, ROBSON			
ENGR. ID: RX2644		PERMIT REQ'D.	Y
PHONE #: 3059292174		PRINT 4	OF 15