

Contents

Adaptive Jing-Zhang: Disagreement Atlas and Reversible City

Seeded Kruskal minimum-spanning-tree topology and selection-instability probe over hand-declared candidate edges.

Single bilingual source of truth. Proposal bodies, offline viewers, and narrative are generated or corrected from this record by the build scripts so the two languages cannot drift apart independently.

This record holds only decisions and references already verifiable inside the package. It introduces no external evidence, professional approval, budget, or tenure conclusion.

Registering an action does not make it authorized, funded, or established as feasible. Every row carries not_authorized, unfunded, and its unresolved D gates at the same time; an unresolved D gate is a blocking condition, not a footnote.

This diagram is topological: it carries no coordinate, no scale, no north arrow, and no distance. A line drawn between a component, a chain, and a gate shows only the blocking relation already recorded in the register.

01	Contents
02	ZZY-01 Zhongzhiyuan - what this drawing claims and what it does not
03	ZZY-02 Zhongzhiyuan - conditional ground plan with five separately drawn routes
04	ZZY-03 Zhongzhiyuan - reversible module sections A and B
05	ZZY-04 Zhongzhiyuan - step-free chain, operating modes and seasons
06	ZZY-05 Zhongzhiyuan - governance, stop conditions and evidence
07	AIO-01 AI Origin Community - what this drawing claims and what it does not
08	AIO-02 AI Origin Community - conditional ground plan with five separately drawn routes
09	AIO-03 AI Origin Community - reversible component sections A and B
10	AIO-04 AI Origin Community - step-free chain, operating modes and seasons
11	AIO-05 AI Origin Community - governance, stop conditions and evidence
12	DZS-01 Dazhongsi - a drawing that claims no position: claim limits and the Issue #1029 disclosure
13	DZS-02 Dazhongsi - not-to-scale four-quadrant order topology with five separately drawn lines
14	DZS-03 Dazhongsi - reversible module sections A and B
15	DZS-04 Dazhongsi - step-free chain, operating modes and seasons
16	DZS-05 Dazhongsi - governance, stop conditions and evidence

The seven non-tradeable gates


The seven gates are adjudicated by people and are not closed by this package. Each clause below states when a proposal fails the gate; no check, test, or ticked item inside the package substitutes for that adjudication.

G1 Safety · G2 Rights · G3 Heritage · G4 Affordability · G5 Accessibility · G6 Privacy · G7 Human Review


Denominator and rounding disclosure

The only ratio denominator the publication surfaces use is the provisional SITE-001 area recalculated from the submitted geometry, 11,412,825.386 m², that is 1,141.3 ha; the official announcement publishes an overall design area of 11,400,000 m², that is 11.4 km². The two differ by 12,825.386 m², which is 1.28 ha, or 0.1125% of the official value. That difference is a bookkeeping difference between a provisional working polygon and an official text area. It is not a measured boundary difference, and it does not indicate that the official boundary lies that distance away in any direction. Every percentage is rounded ROUND_HALF_UP to two decimal places with the trailing zero kept, and every hectare display to one decimal place. Both results for the same numerator are written out: the reference green space of 199.5 ha gives 17.48% under the provisional denominator and 17.50% under the official denominator, a difference of +0.02 percentage points; the park green and open space land use, code 1401 at 320.4 ha, gives 28.07% under the provisional denominator and 28.11% under the official denominator, a difference of +0.03 percentage points. Every publication surface uses the provisional denominator, and the two bases are never mixed. Once the official polygon closes D01, every ratio is recomputed for the package as a whole rather than edited in place.

ZZY-01 Zhongzhiyuan - what this drawing claims and what it does not

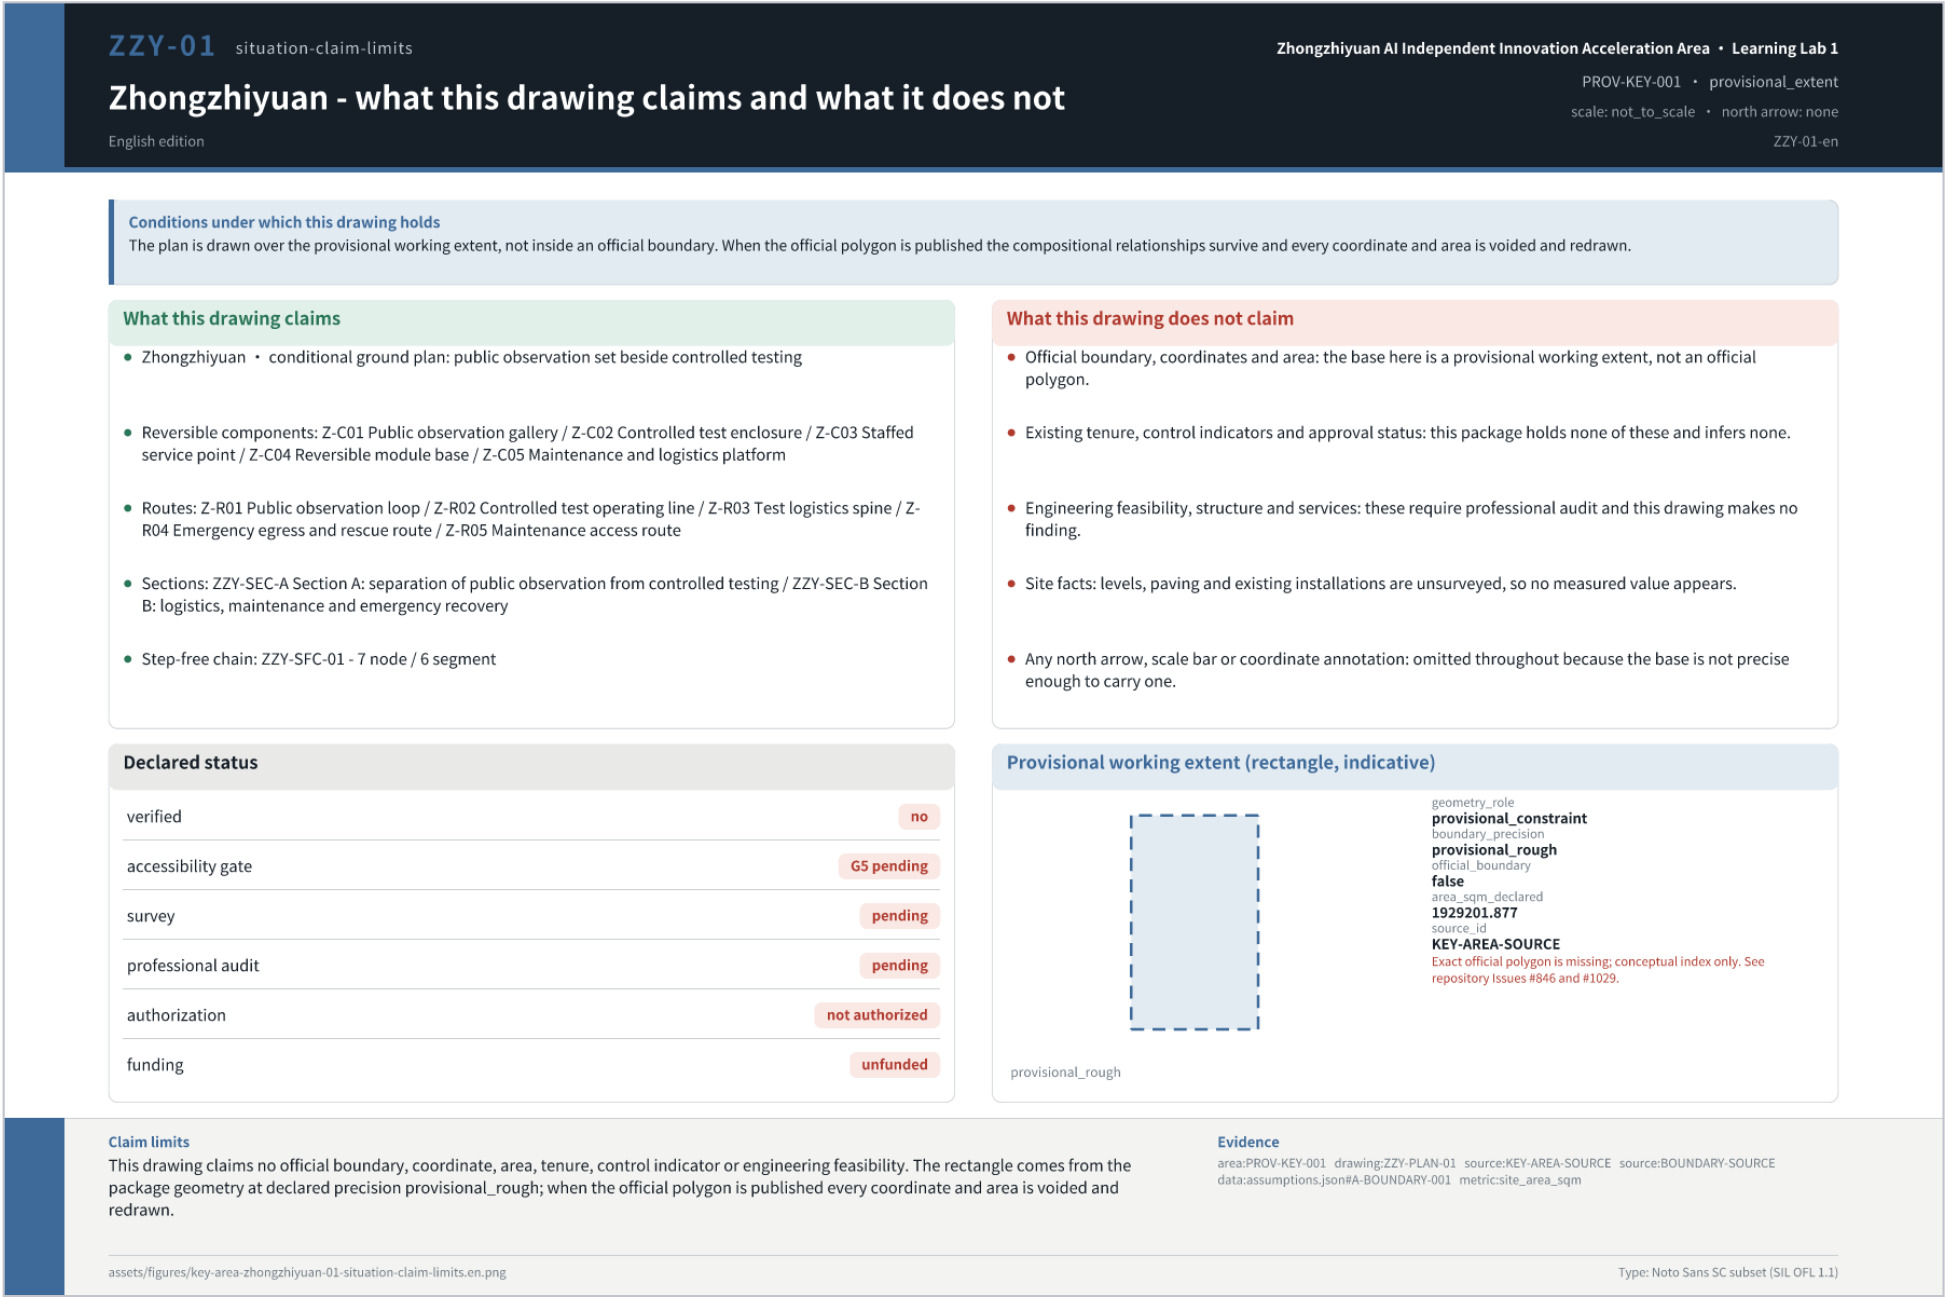

ZZY-02 Zhongzhiyuan - conditional ground plan with five separately drawn routes

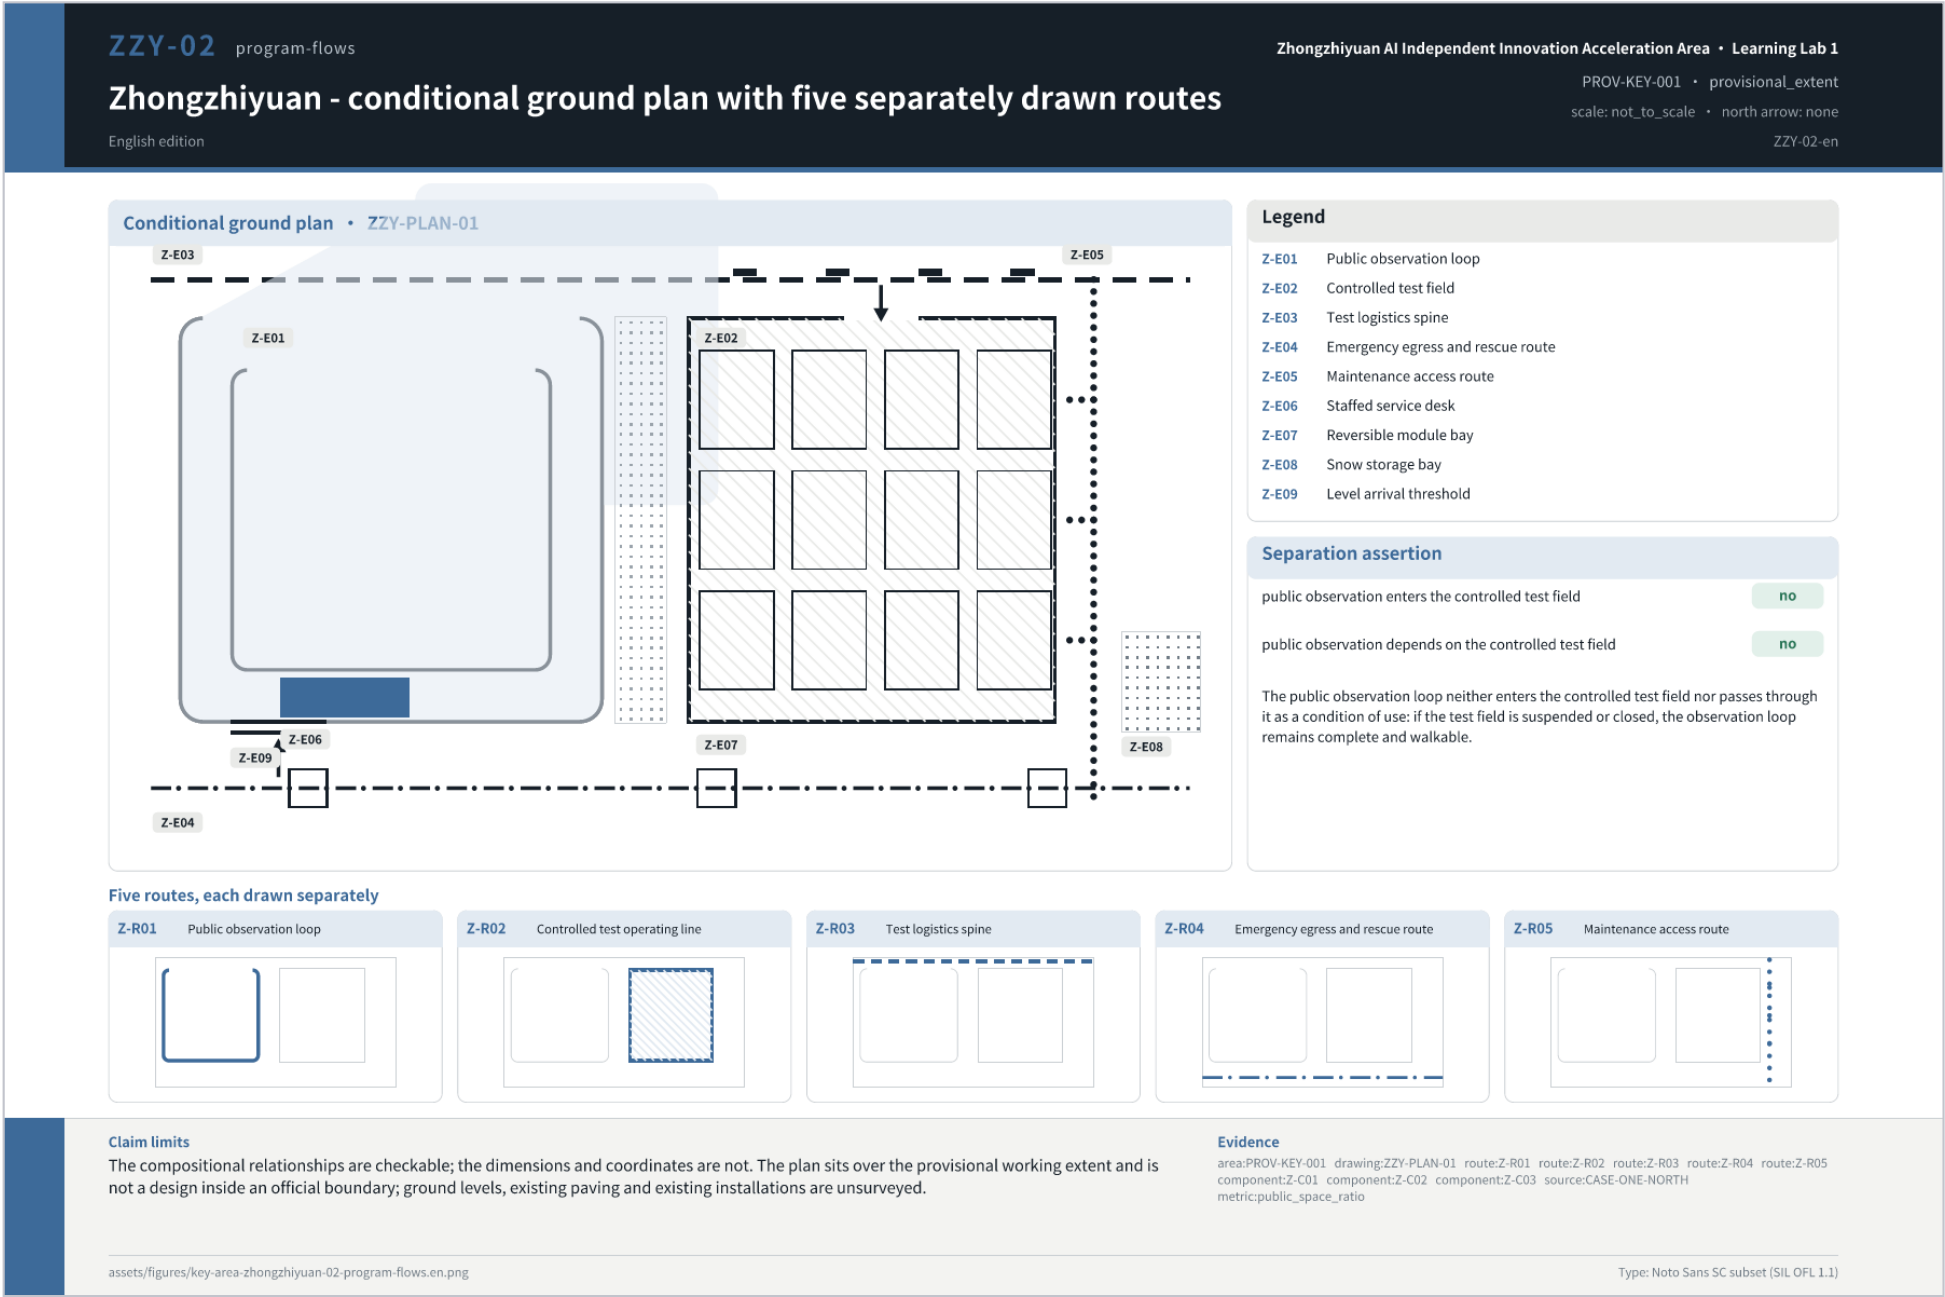

Five routes, each drawn separately

Z-R01

Public observation loop

Z-R02

Controlled test operating line

Z-R03

Test logistics spine

Z-R04

Emergency egress and rescue route

Z-R05

Maintenance access route

Claim limits

The compositional relationships are checkable; the dimensions and coordinates are not. The plan sits over the provisional working extent and is not a design inside an official boundary; ground levels, existing paving and existing installations are unsurveyed.

Evidence

area:PROV-KEY-001 drawing:ZZY-PLAN-01 route:Z-R01 route:Z-R02 route:Z-R03 route:Z-R04 route:Z-R05 component:Z-C01 component:Z-C02 component:Z-C03 source:CASE-ONE-NORTH metric:public_space_ratio

assets/figures/key-area-zhongzhiyuan-02-program-flows.en.png

Type: Noto Sans SC subset (SIL OFL 1.1)

Plate description: A conditional ground plan: a closed public observation loop on the left, a stippled separation zone in the middle, and a hatched controlled test field on the right with its own entry face; a logistics spine along the top, an emergency route along the bottom and a dotted maintenance route down the right edge. Five small diagrams beneath the plan draw each of the five routes on its own.

This is the dominant Zhongzhiyuan drawing. The public observation loop is a closed line that neither enters the controlled test field nor passes through it as a condition of use: when the field is suspended the loop is still complete. The separation zone is drawn as a stippled band belonging to neither side, with no shared edge and no shared threshold. The maintenance route stays outside the field throughout and reaches every module face from the outside. The five small diagrams below extract each route on its own, so that "drawn separately" is a checkable fact rather than a caption.

The compositional relationships are checkable; the dimensions and coordinates are not. The plan sits over the provisional working extent and is not a design inside an official boundary; ground levels, existing paving and existing installations are unsurveyed.

ZZY-02-en • Verification status: Not verified: accessibility gate G5 pending, survey pending, professional audit pending. • This plate is the English twin of the Chinese original.

Keyed detail panels

- Z-C01 Controlled Test Loop

A time-boxed low-speed test loop marked by movable barriers, with test and non-test hours posted separately. The barriers are not fixed to the ground.
- Unresolved D gates: D10 D12
- Z-C02 Stop Button and Human Takeover Post

One physical stop button per loop segment and one on-duty human takeover operator. Stop authority is named and the takeover procedure is on paper, so it needs no app.
- Unresolved D gates: D10 D16
- Z-C03 Public Test Log Desk

At the close of each test day the day's decisions and aggregate counts are posted at the desk. Decisions and aggregate evidence references only; no personal data.
- Unresolved D gates: D11
- Z-C04 Parts and Repair Bay

A repair bay and parts rack established at the same time as the test loop. Equipment without an available bay and a named maintainer may not enter a test window.
- Unresolved D gates: D12
- Z-C05 Boundary Notice and Exit

Every opening in the test boundary carries a bilingual notice and a threshold-free exit stating the day's test, how to stop it, and where complaints go.
- Unresolved D gates: D07
- Z-R01 Public observation loop

The proposed public observation loop, step-free throughout; it never enters the controlled-test area and does not depend on whether a test window is open.
- Unresolved D gates: D05 D07
- Z-R04 Emergency egress and rescue route


The proposed emergency egress route, set out step-free; its width, gradient and final alignment stand only once a qualified professional has verified them.
- Unresolved D gates: D05 D06 D07
- ENV-ZY-01 Phase 1 conceptual envelope

One 90-day reversible passage pilot: movable barriers, no penetration of the ground surface, restored to its prior state at closure against a dismantling checklist with a retained restoration verification record.
- Unresolved D gates: D10 D12


Method and provenance appendix 2 / 15 • Guaranteed by construction

- every run is connected
- every run selects exactly 11 edges


ZZY-03 Zhongzhiyuan - reversible module sections A and B

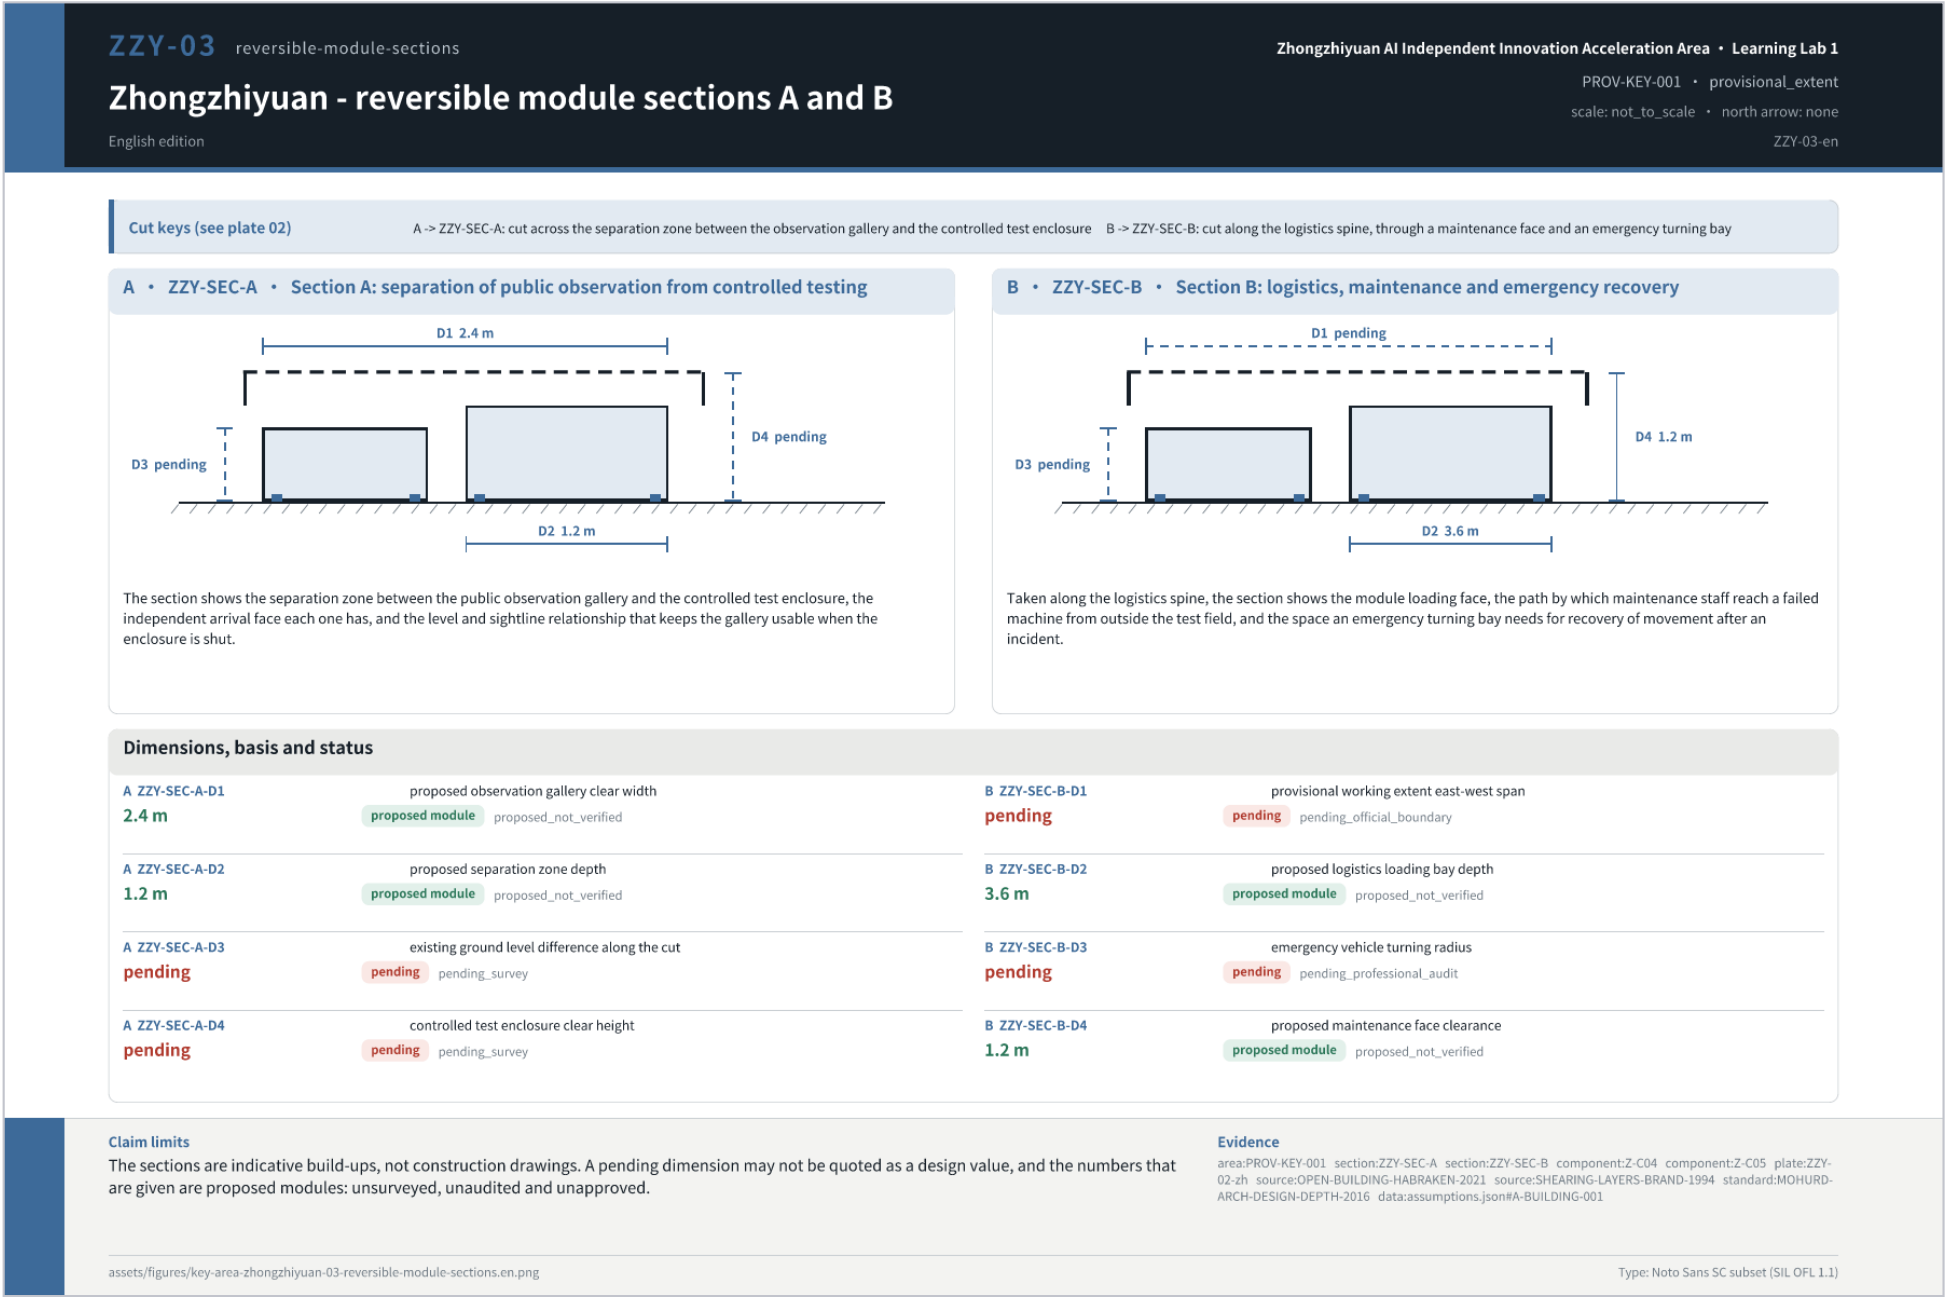

ZZY-04 Zhongzhiyuan - step-free chain, operating modes and seasons

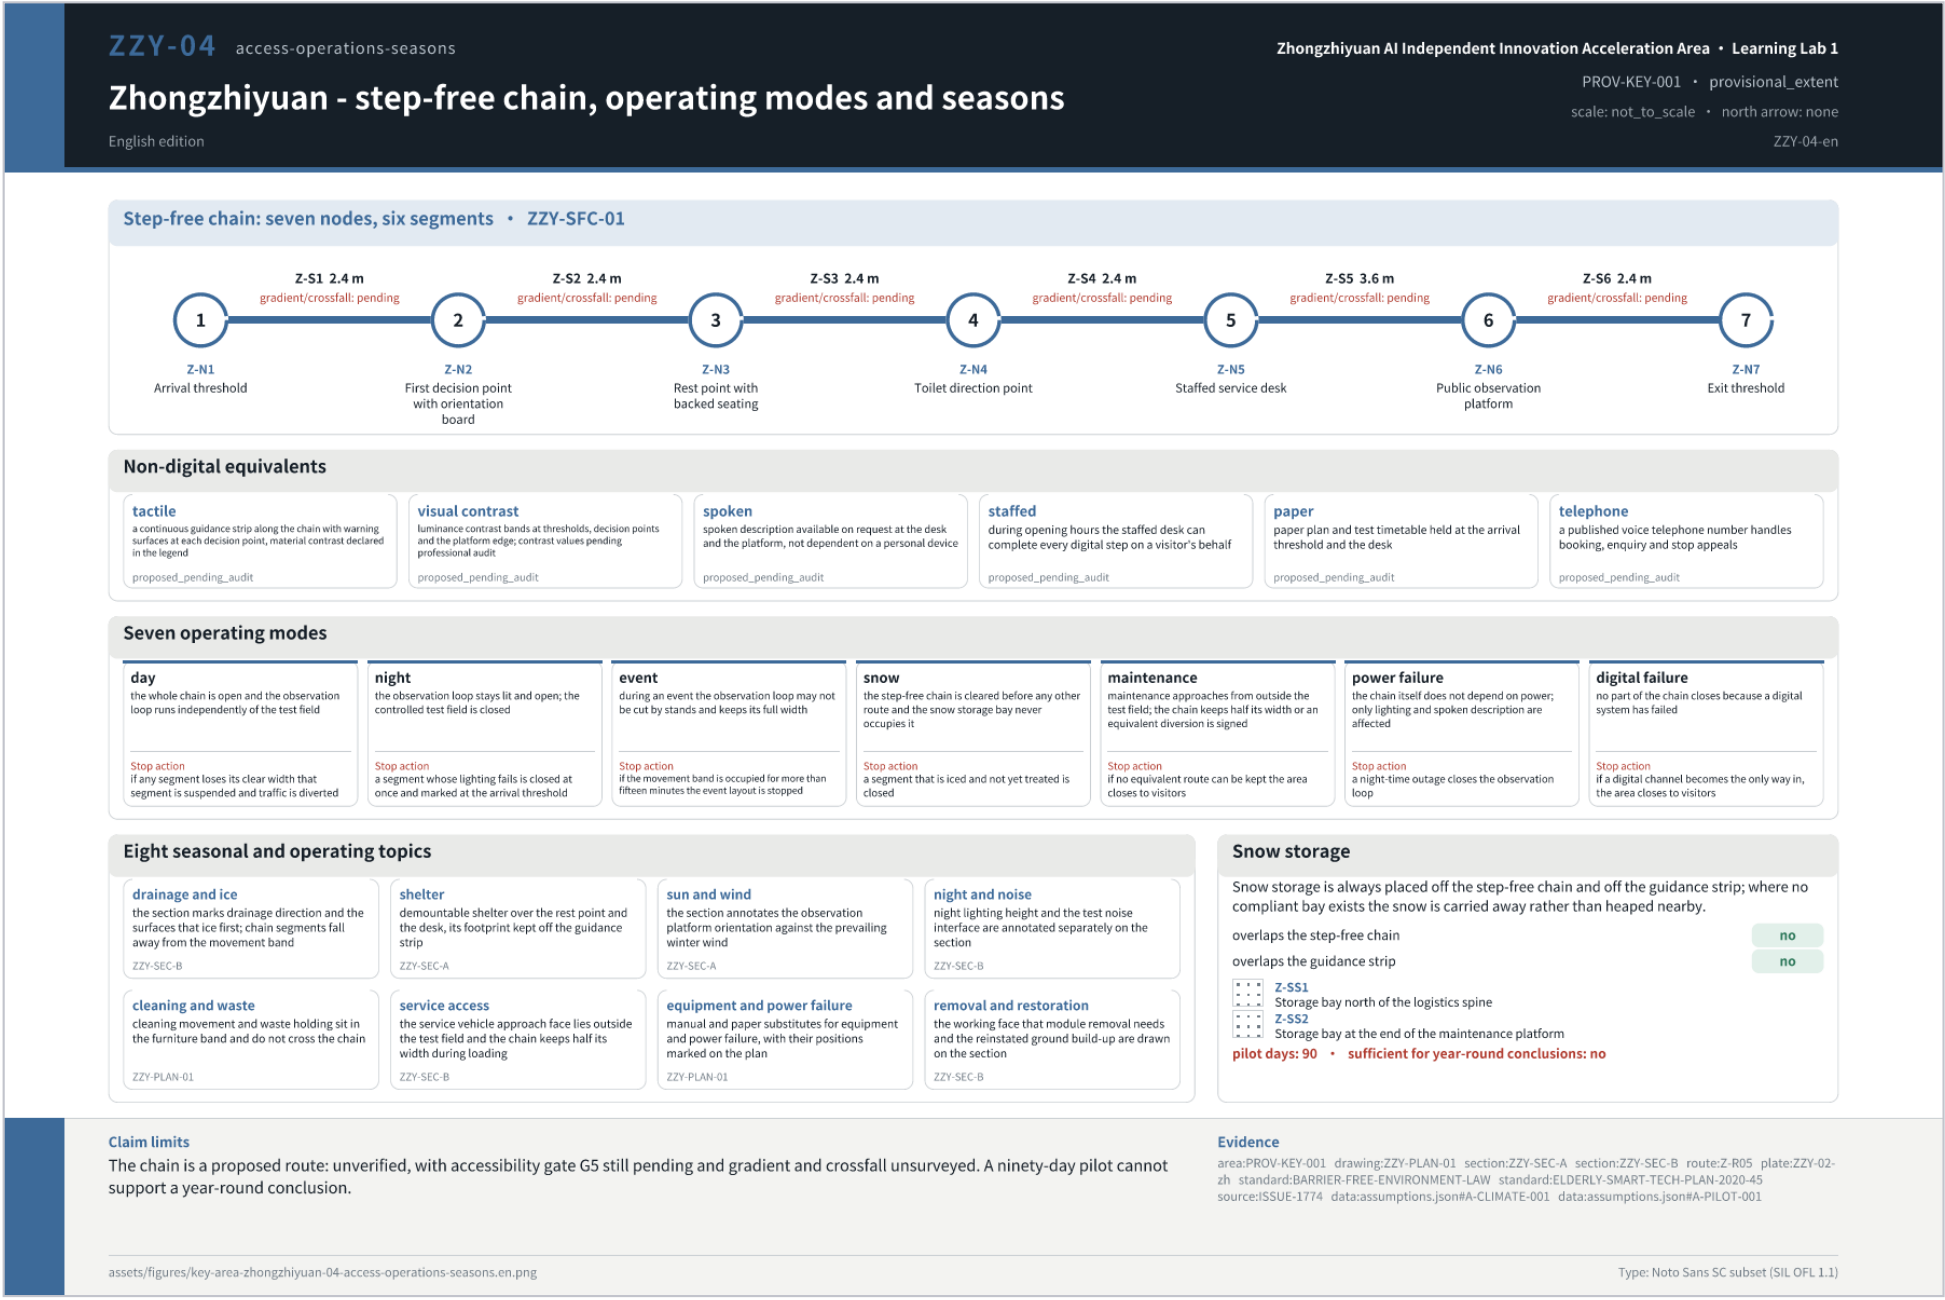

ZZY-05 Zhongzhiyuan - governance, stop conditions and evidence

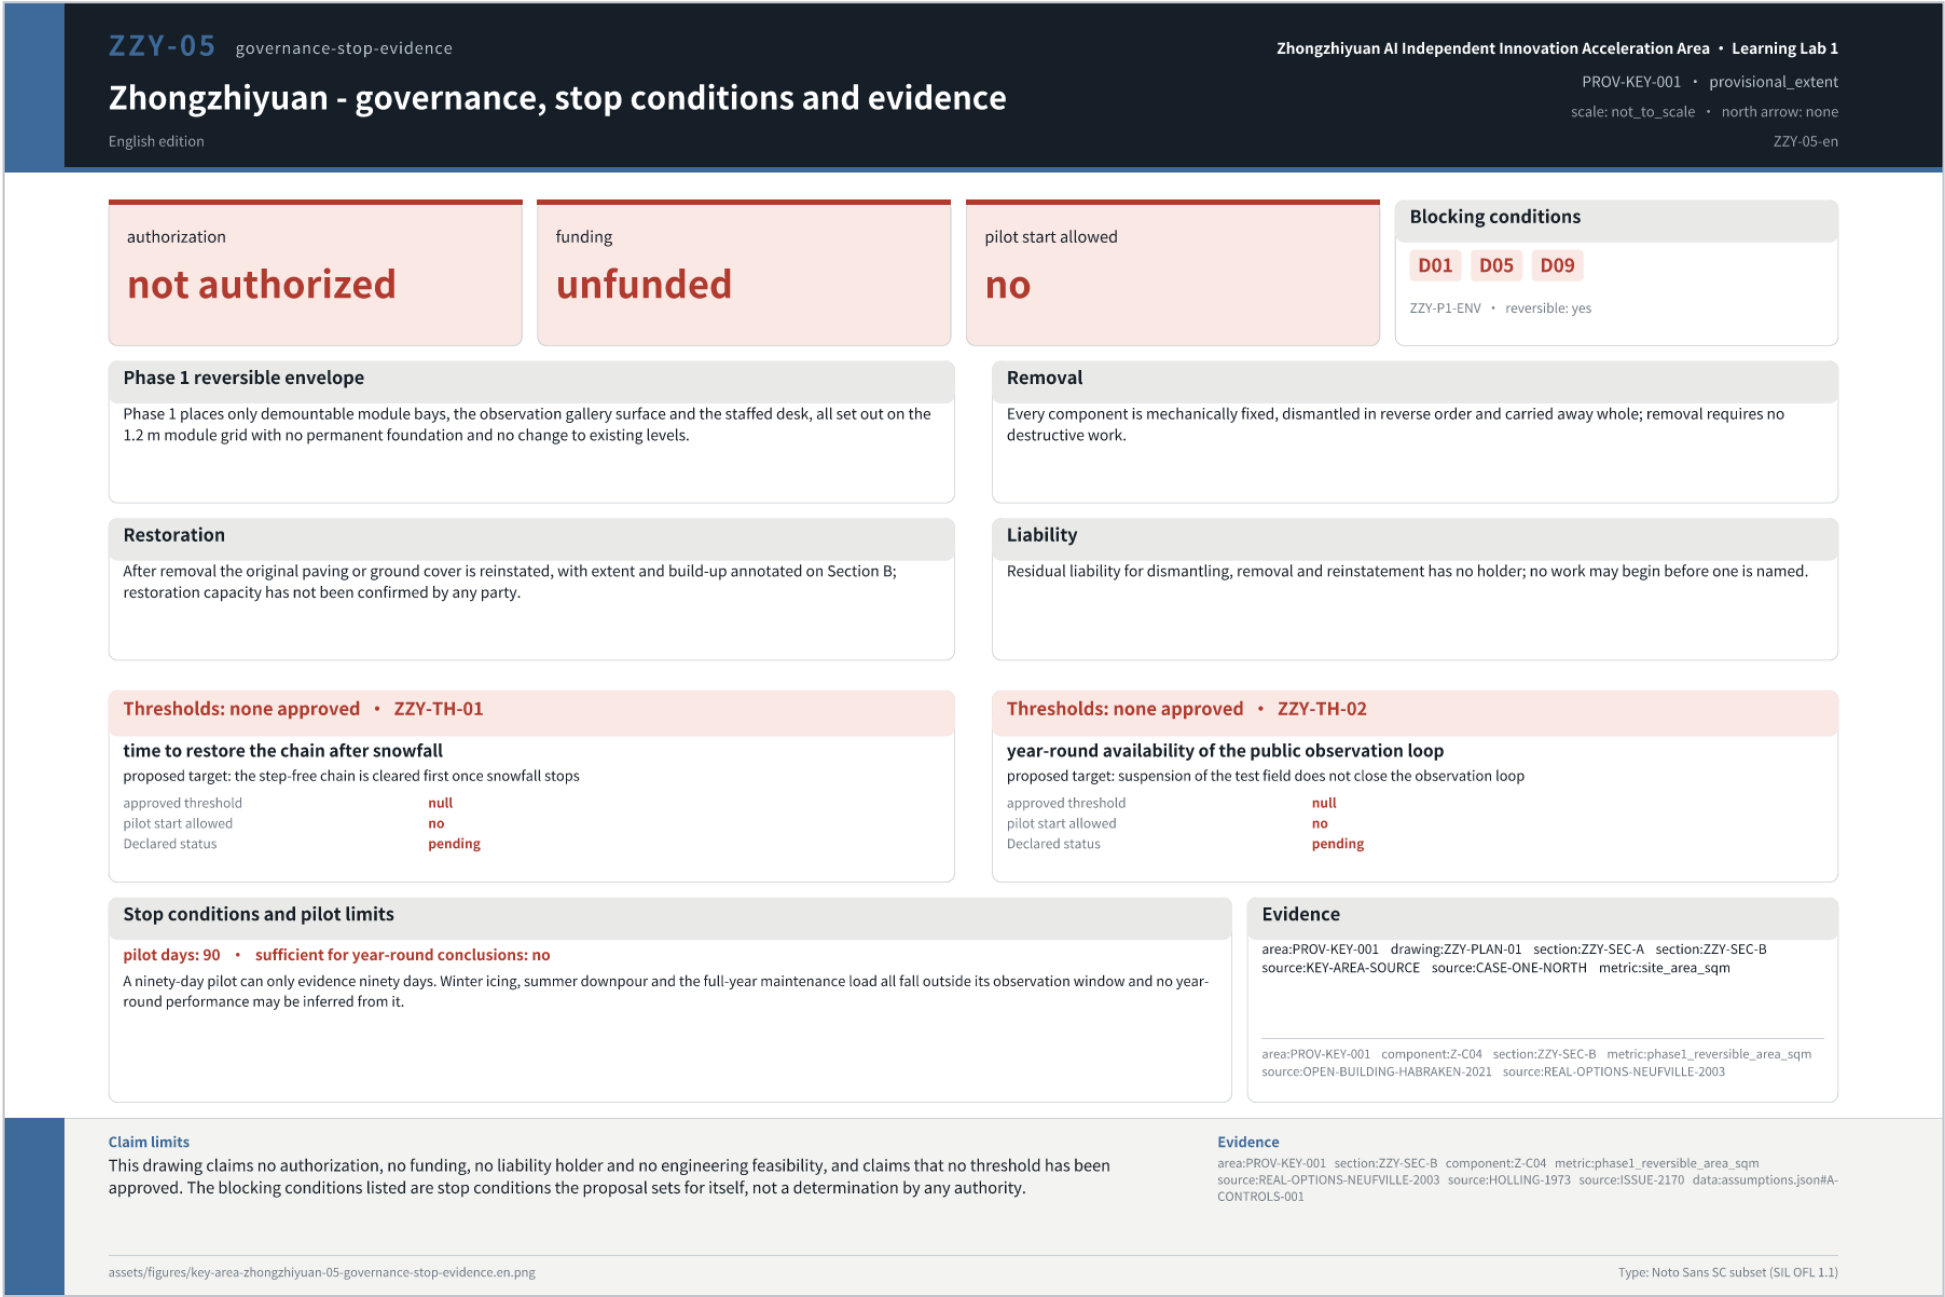

AIO-01 AI Origin Community - what this drawing claims and what it does not

AIO-01 situation-claim-limits

Beijing AI Origin Community • Learning Lab 2

PROV-KEY-002 • provisional_extent

scale: not_to_scale • north arrow: none

AIO-01-en

AI Origin Community - what this drawing claims and what it does not

English edition

Conditions under which this drawing holds

The plan places only the components and relationships this proposal puts forward; it depicts no existing tenure, boundary or building stock. The base is the provisional working extent and is redrawn when the official polygon is published.

What this drawing claims

- AI Origin Community • conditional ground plan: the release commons sharing ground with daily service
- Reversible components: O-C01 Model release commons / O-C02 Staffed service position / O-C03 Non-digital service position / O-C04 Care, quiet and affordable frontage set / O-C05 Conditional slow seam
- Routes: O-R01 Daily service line / O-R02 Release commons approach / O-R03 Care frontage approach / O-R04 Conditional slow seam route / O-R05 Maintenance and cleaning line
- Sections: AIO-SEC-A Section A: release commons, staffed service and care frontage / AIO-SEC-B Section B: slow seam, quiet frontage, winter shelter and maintenance
- Step-free chain: AIO-SFC-01 - 7 node / 6 segment

Declared status

verified	no
accessibility gate	G5 pending
survey	pending
professional audit	pending
authorization	not authorized
funding	unfunded

What this drawing does not claim

- campus entry control
- boundaries
- access controls
- ownership
- rights of way
- land divisions
- existing lower-level space
- This area draws and infers no campus gates, boundaries, access controls, ownership, rights of way, parcels or existing ground-floor space. The slow seam is annotated conditional precisely because whether it can exist depends on one of those unknowns.

Provisional working extent (rectangle, indicative)

	geometry_role provisional_constraint boundary_precision provisional_rough official_boundary false area_sqm_declared 1043236.909 source_id KEY-AREA-SOURCE Exact official polygon is missing: conceptual index only. See repository Issues #846 and #1029.
	provisional_rough

Claim limits

This drawing neither draws nor infers campus entry control, boundaries, access controls, ownership, rights of way, land divisions or existing lower-level space. The rectangle comes from the package geometry at declared precision provisional_rough.

Evidence

area:PROV-KEY-002 drawing:AIO-PLAN-01 source:KEY-AREA-SOURCE source:BOUNDARY-SOURCE
 data:assumptions.json#A-BOUNDARY-001 metric:public_space_area_sqm

assets/figures/key-area-ai-origin-community-01-situation-claim-limits.en.png

Type: Noto Sans SC subset (SIL OFL 1.1)

Claim limits

Announced area 104.3 ha Lab 2

Role: Campus-adjacent transfer and resident-led correction

This area answers a different question: how the people who live next to a system correct it when they had no part in designing it. It runs no equipment testing; it runs registration, appeal, and receipt.

- This record holds only decisions and references already verifiable inside the package. It introduces no external evidence, professional approval, budget, or tenure conclusion.

- Every row carries not_authorized, unfunded, and its unresolved D gates at the same time; an unresolved D gate is a blocking condition, not a footnote.

Plate description: A two-column comparison: the left column lists what the AI Origin Community plan claims - the commons, the service positions, the frontages and the slow seam - and the right column carries seven labels naming what is expressly not claimed: campus entry control, boundaries, access controls, ownership, rights of way, land divisions and existing lower-level space, with six declared status rows and an indicative extent rectangle below.

The difficulty in this area is that almost everything it wants to do would sit on ground belonging to somebody else. So this plate first sets out, as seven separate labels, what it does not claim: campus entry control, boundaries, access controls, ownership, rights of way, land divisions and existing lower-level space - none drawn, none inferred. The slow seam is annotated conditional on the plan precisely because whether it can exist at all depends on any one of those seven unknowns.

This drawing neither draws nor infers campus entry control, boundaries, access controls, ownership, rights of way, land divisions or existing lower-level space. The rectangle comes from the package geometry at declared precision provisional_rough.

AIO-01-en • Verification status: Not verified: accessibility gate G5 pending, survey pending, professional audit pending. • This plate is the English twin of the Chinese original.

Method and provenance appendix 6 / 15 • Reproducer

```
script visual/assets/reproduce_physarum.js
comparisons 633
derived_metrics 7
expected_mismatches 0
tamper_suite visual/assets/test-reproducer-tamper.js
```

AIO-02 AI Origin Community - conditional ground plan with five separately drawn routes

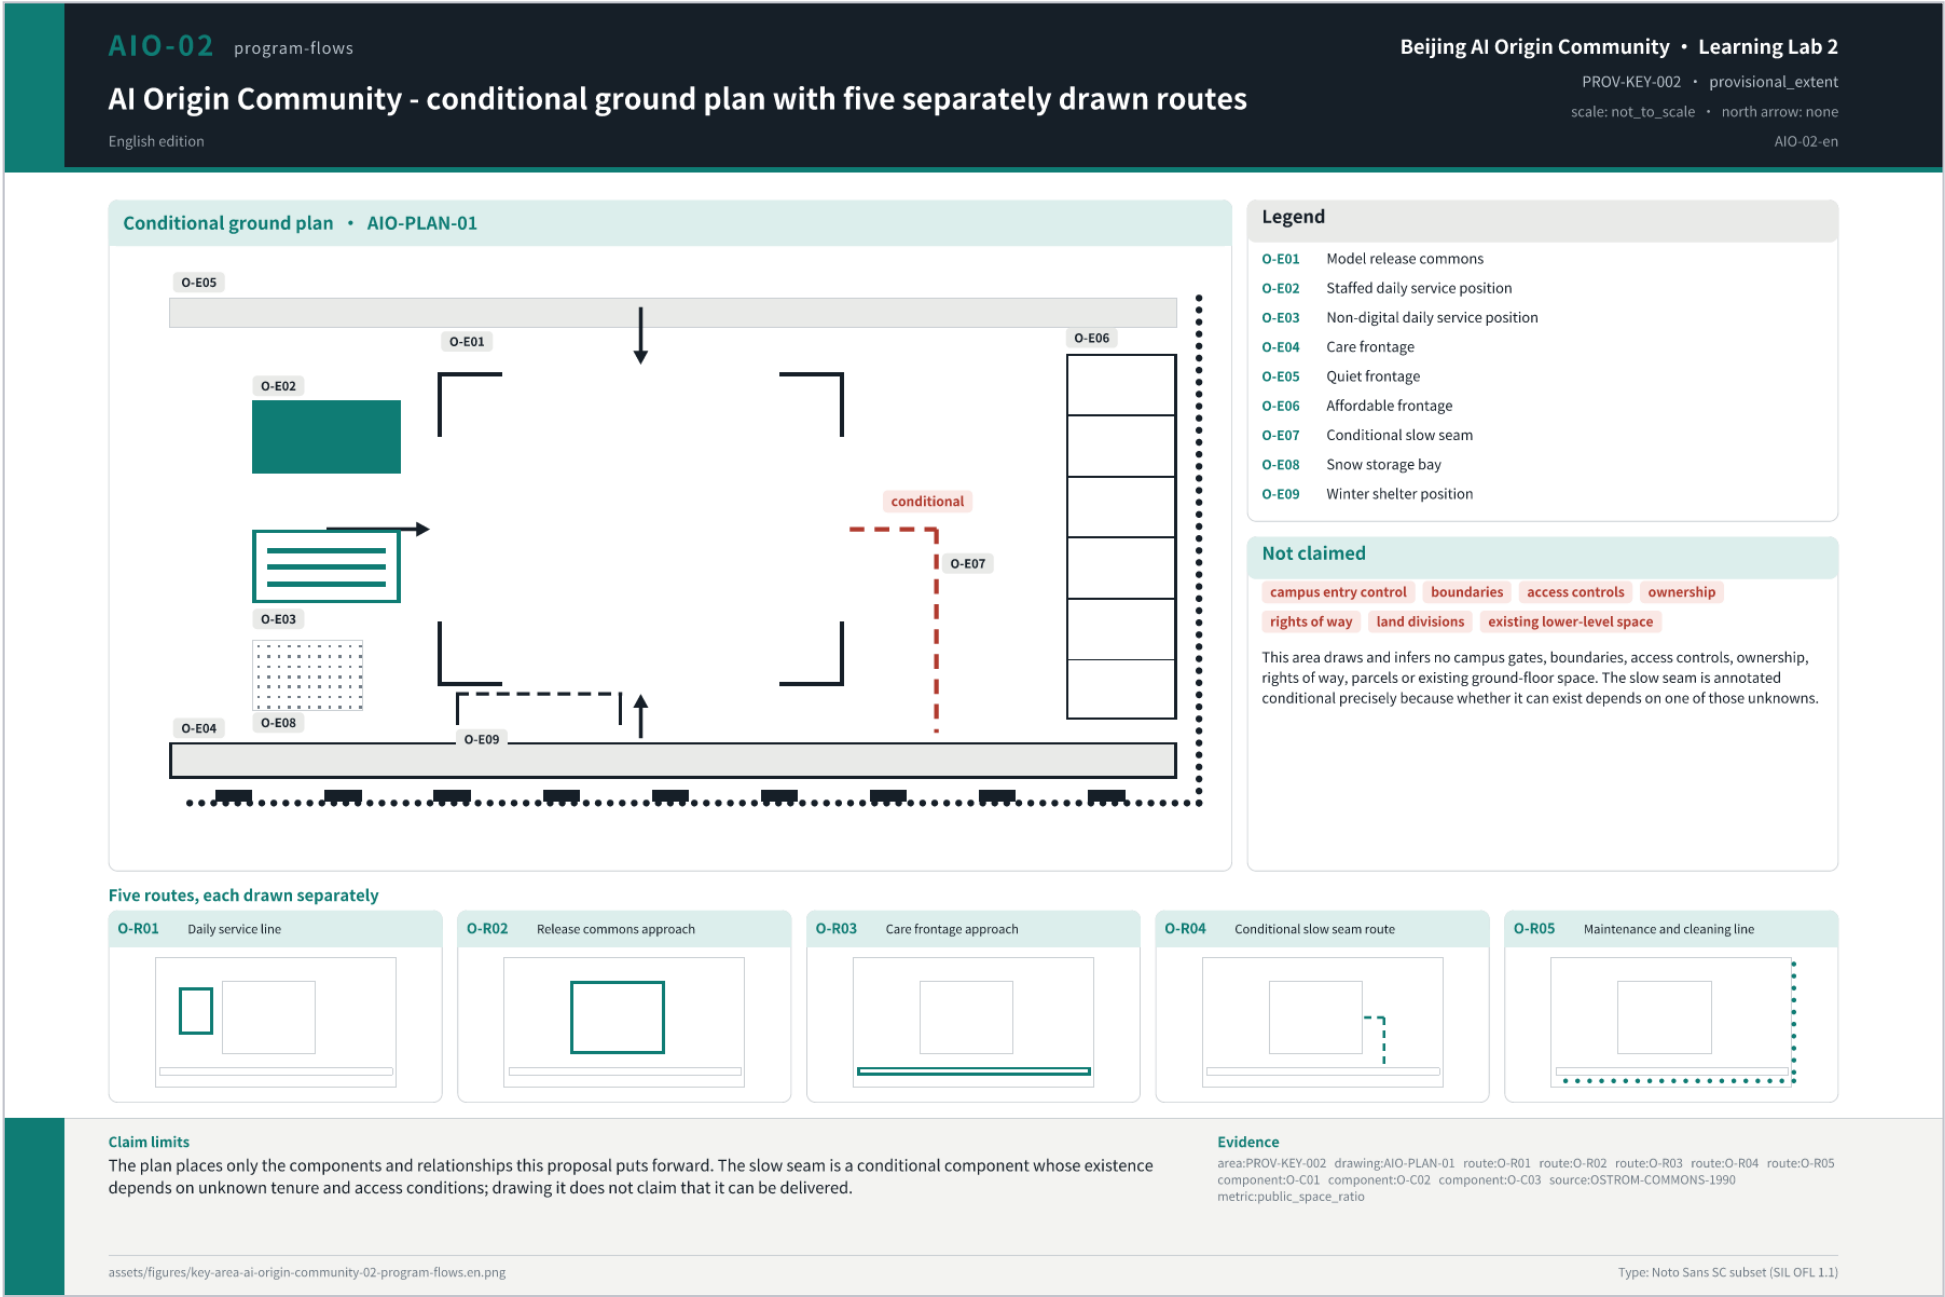


Plate description: A conditional ground plan: at the centre the model release commons, drawn with corner brackets and no enclosing line, reachable from three sides; on the left the staffed and the non-digital daily service positions; a quiet frontage along the top, a care frontage along the bottom and an affordable frontage of small subdividable bays down the right edge; a broken slow seam annotated conditional. Five small diagrams beneath the plan draw each of the five routes on its own.

The release commons is drawn as an open figure with no enclosing line, because an enclosing line is itself a claim about access control, and this area claims none. The staffed service position and the non-digital service position are drawn separately, so that a resident using no device still has a complete path through every step. The three frontages carry the care, quiet and affordable requirements and are annotated separately. The slow seam is broken-lined and tagged conditional, and is drawn only across ground the proposal itself creates.

The plan places only the components and relationships this proposal puts forward. The slow seam is a conditional component whose existence depends on unknown tenure and access conditions; drawing it does not claim that it can be delivered.

AIO-02-en • Verification status: Not verified: accessibility gate G5 pending, survey pending, professional audit pending. • This plate is the English twin of the Chinese original.

Keyed detail panels

O-C01 Open Registry Desk
Registers the name, responsible body, operating hours, and stop method of every AI+ scenario running in the area; the register is publicly readable.

Unresolved D gates: D11 D16

O-C02 Resident Correction Table
A paper correction table open at fixed hours where residents may correct any registered entry. The original record is retained and marked as corrected.

Unresolved D gates: D11

O-C03 Ground-Floor Shared Workroom
Shared work positions in existing ground-floor space, divided on open-building lines into support and infill: the support is untouched, the infill is replaceable. Until the existing-building determination is complete this remains a proposal hypothesis.

Unresolved D gates: D04 D06

O-C04 Lit and Sheltered Segment
Lighting and shelter improvement along the segment residents walk daily, covering first the stretch with the heaviest night use and the densest complaints. Illuminance targets depend on on-site measurement and no numeric claim is made before it.

Unresolved D gates: D05 D12

O-C05 Appeal Box and Receipt Board
A non-digital appeal channel: submitting a paper appeal returns a numbered receipt and the outcome is posted against that number. An arrangement requiring appeals to pass through an application is not accepted.

Unresolved D gates: D16

O-R01 Daily service line
The proposed daily service line, step-free throughout, connecting the staffed points that work without a phone.

Unresolved D gates: D05 D07

O-R02 Release commons approach
The proposed step-free approach to the release commons; the commons itself runs on published rules of assembly and has no access control.

Unresolved D gates: D05 D07

O-R03 Care frontage approach
The proposed step-free approach to the care, quiet and affordable frontage; the tenure of that frontage and any existing ground-floor space remain undetermined.

Unresolved D gates: D04 D07

O-R04 Conditional slow seam route
A conditional step-free slow-seam route. It does not stand until D04, D05, D08, D12 and D16 are all closed; any segment touching a road or a crossing is held with D08.

Unresolved D gates: D04 D05 D08 D12 D16

ENV-AO-01 Phase 1 conceptual envelope
One reversible pairing of a ground-floor shared workroom and a registry desk: existing ground-floor space only, demountable furniture and partitions, leaving no irreversible alteration at closure.


Unresolved D gates: D04 D06 D12

Method and provenance appendix 7 / 15 • Zero-jitter comparison


The ablation differs from the primary run in exactly one term: the per-edge jitter is set to zero while the five weight draws keep their order and their values. The difference is therefore attributable to the jitter term alone.

seeds 64 jitter_range [-0.12, 0.12] selected_edges_per_run 11
candidate_edges 24 largest_absolute_delta 0.546875 runs 64 nodes 10 edges 24

AIO-03 AI Origin Community - reversible component sections A and B

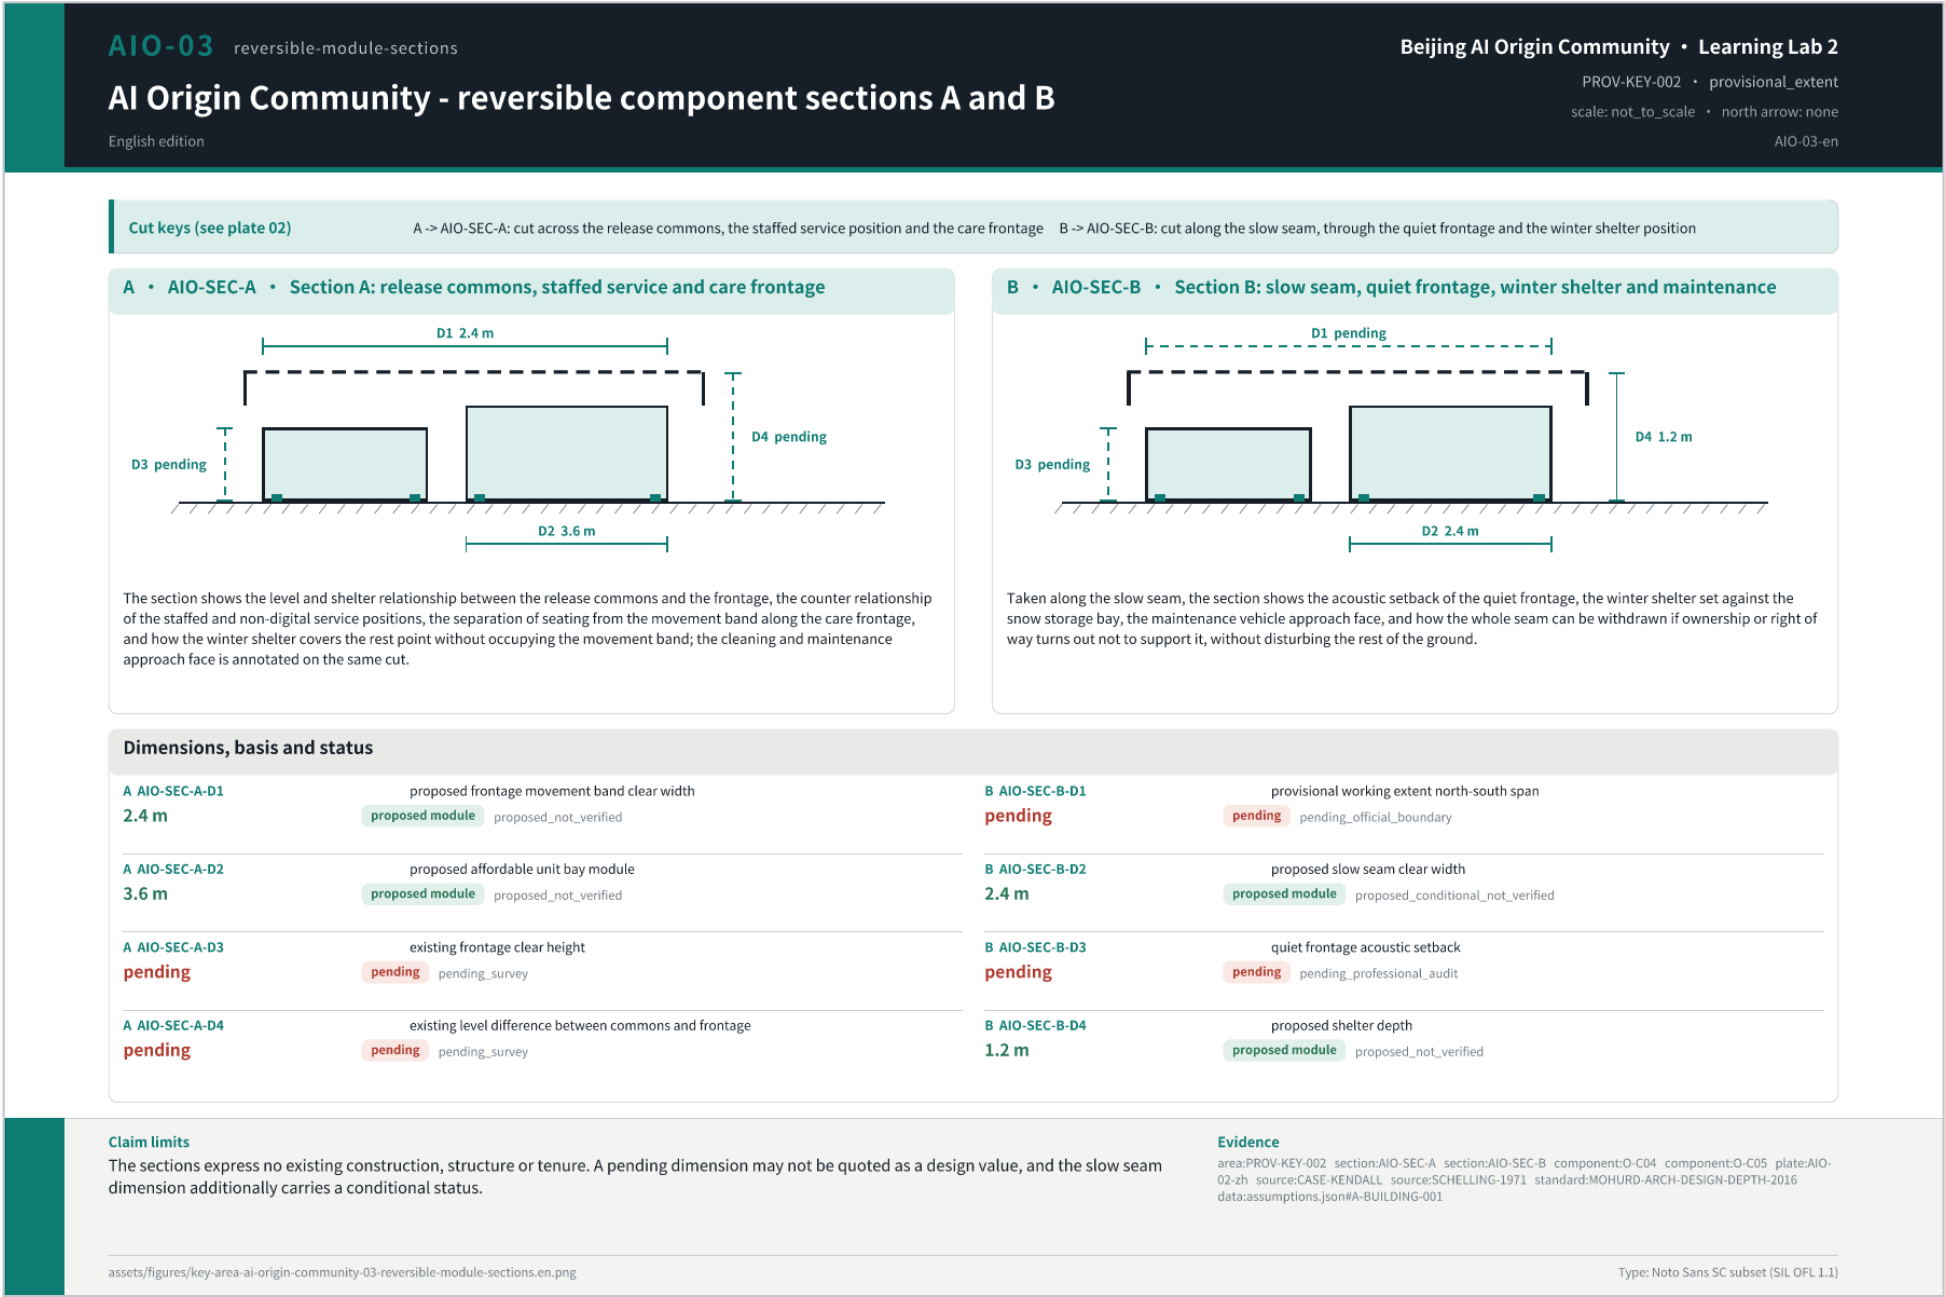

AIO-04 AI Origin Community - step-free chain, operating modes and seasons

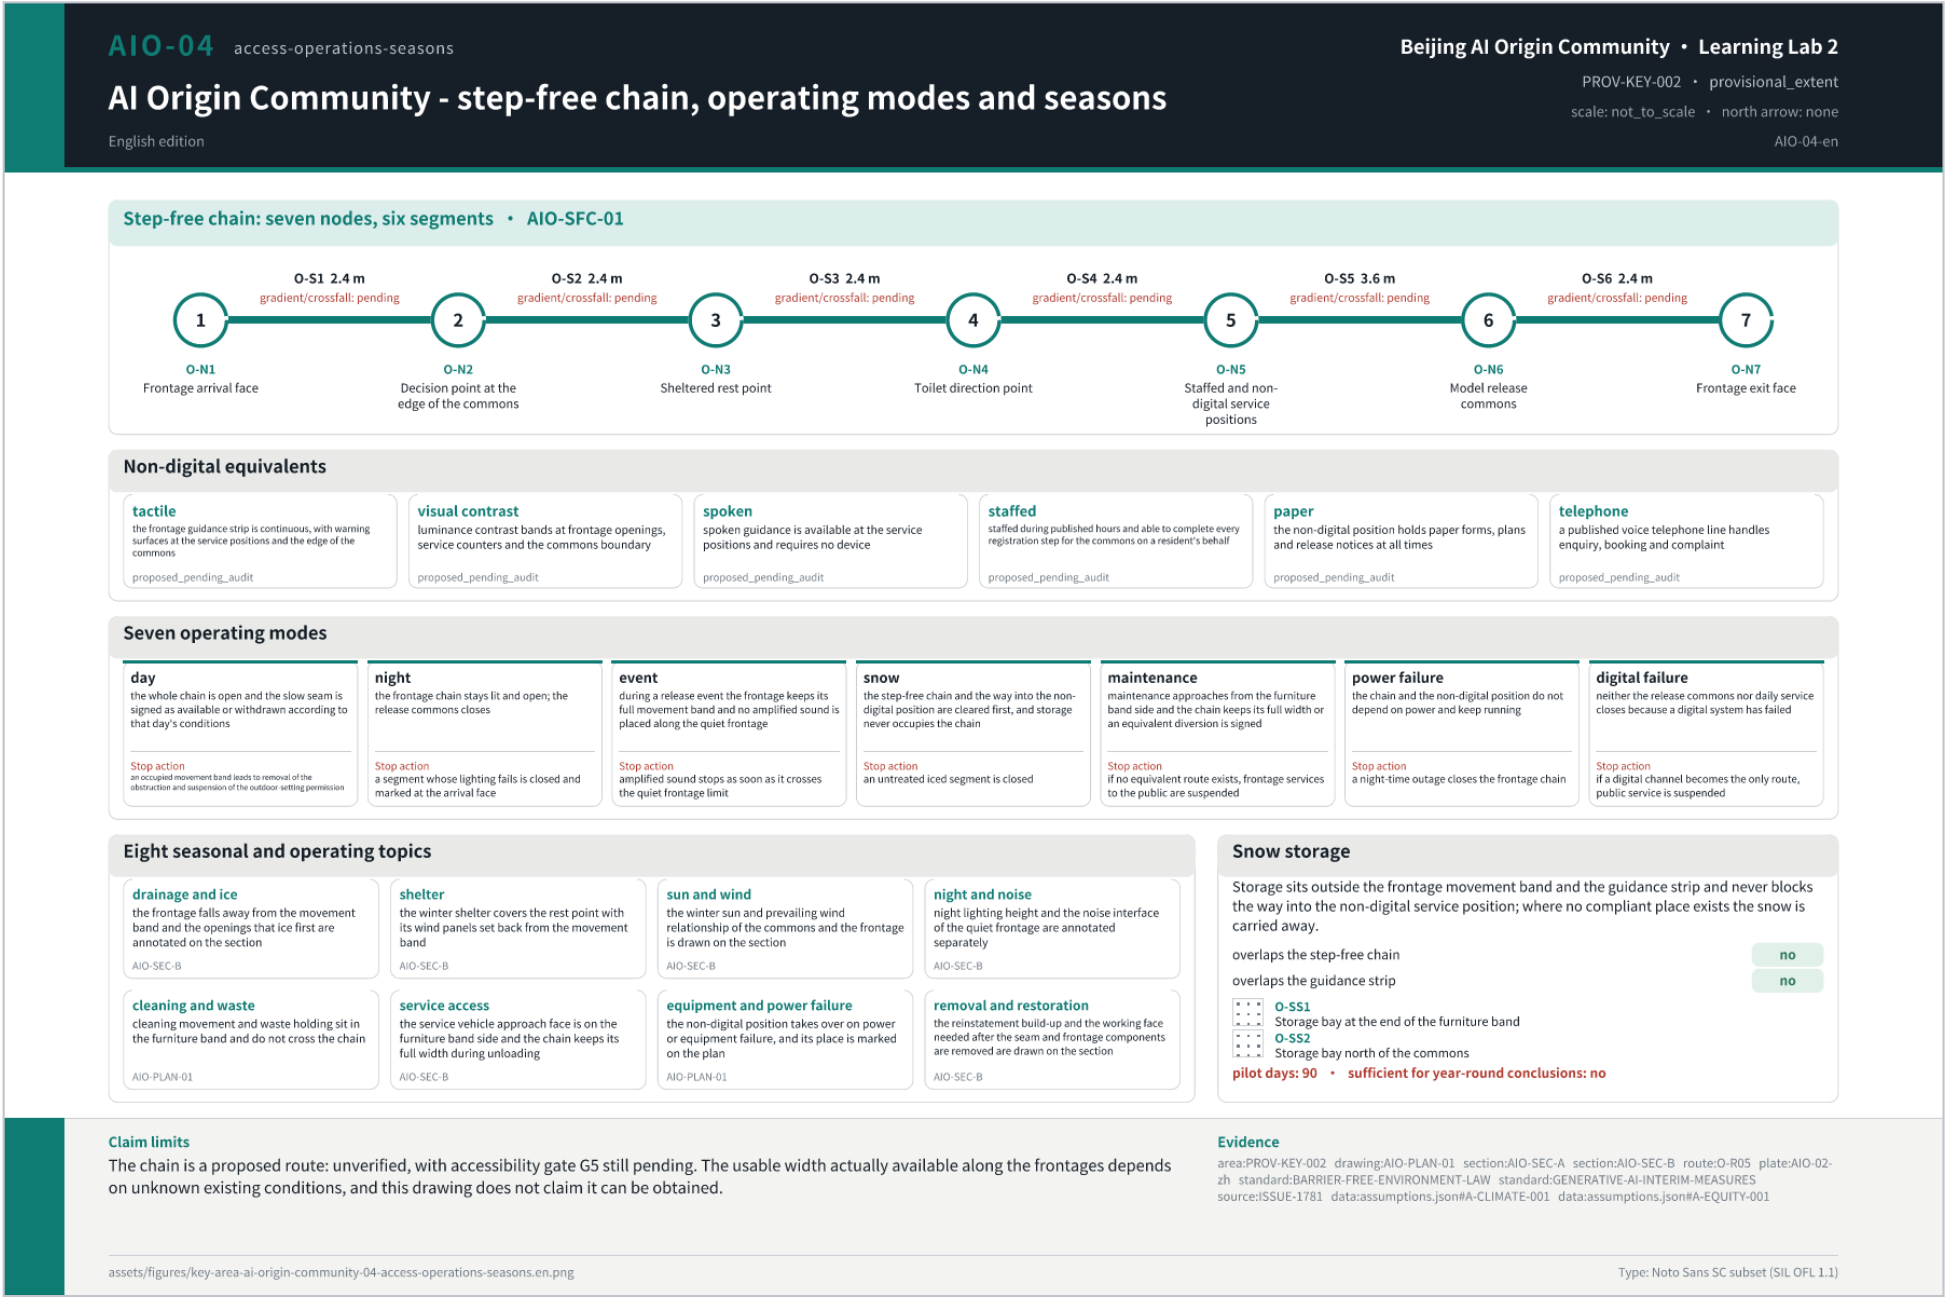

Winter operation

Winter operation: Winter reverses the clearing order: the daily-use and night-priority segments are cleared before any demonstration stretch. The correction table and appeal box keep an indoor or sheltered position through winter so the non-digital channel is never interrupted by season.

Maintenance duty: The registry desk and receipt board are maintained weekly by a named body; if maintenance lapses the corresponding scenario loses its registration standing under the posted rule. Staffing, budget, and term depend on D12 and D16.

step-free throughout


- O-R01 Daily service line — route:O-R01 | plate:AIO-02 | component:O-C04 | standard:BARRIER-FREE-ENVIRONMENT-LAW
- O-R02 Release commons approach — route:O-R02 | plate:AIO-02 | component:O-C01 | source:OSTROM-COMMONS-1990
- O-R03 Care frontage approach — route:O-R03 | plate:AIO-02 | section:AIO-SEC-A | standard:BARRIER-FREE-ENVIRONMENT-LAW
- O-R04 Conditional slow seam route — route:O-R04 | plate:AIO-02 | section:AIO-SEC-B | data:assumptions.json#A-NETWORK-001

Method and provenance appendix 9 / 15 • Zero-jitter comparison • edges

E01 0.453125 0.03125 -0.421875 E02 0.71875 0.96875 0.25
E03 0.890625 1 0.109375 E04 0.328125 0 -0.328125
E05 0.6875 1 0.3125 E06 0 0 0
E07 0.078125 0 -0.078125 E08 0.640625 1 0.359375
E09 0.703125 1 0.296875 E10 0.9375 1 0.0625
E11 0.03125 0 -0.03125 E12 0.546875 0 -0.546875
E13 0.6875 1 0.3125 E14 0.03125 0 -0.03125
E15 0.328125 0 -0.328125 E16 0.5 0.203125 -0.296875
E17 0.484375 0.875 0.390625 E18 0.953125 1 0.046875
E19 0.65625 0.921875 0.265625 E20 0.78125 1 0.21875
E21 0.09375 0 -0.09375 E22 0.171875 0 -0.171875
E23 0.296875 0 -0.296875 E24 0 0 0

This record is computational transparency material, not a design conclusion. It cannot show that any corridor ought to be built.

AIO-05 AI Origin Community - governance, stop conditions and evidence

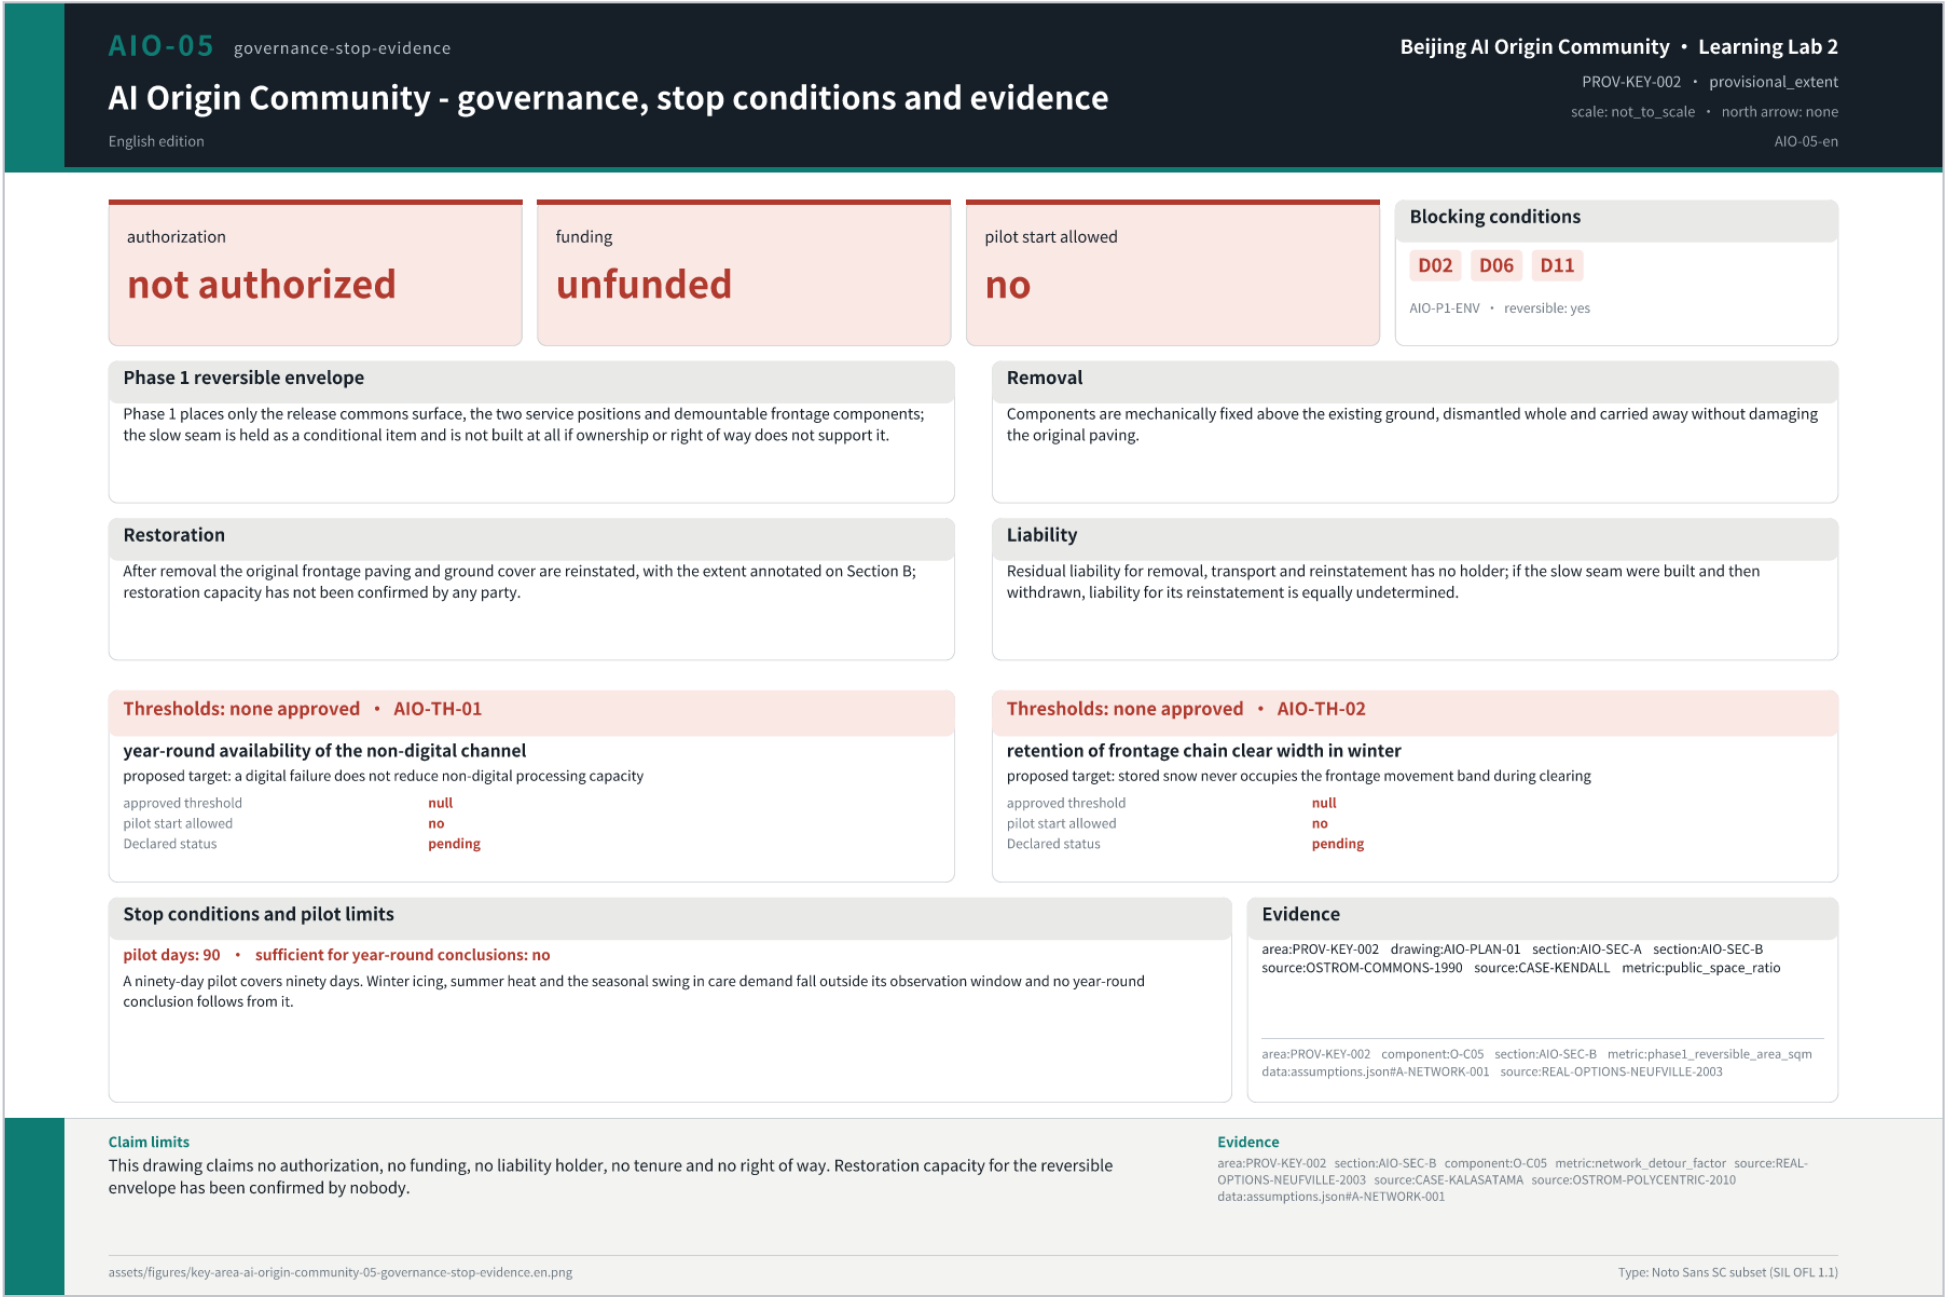

DZS-01 Dazhongsi - a drawing that claims no position: claim limits and the Issue #1029 disclosure

DZS-01 situation-claim-limits

Dazhongsi AI Industry Cluster • Learning Lab 3

Dazhongsi - a drawing that claims no position: claim limits and the Issue #1029 disclosure

PROV-KEY-003 • not_to_scale_topology

scale: not_to_scale • north arrow: none

DZS-01-en

English edition

Conditions under which this drawing holds

The diagram states only the order between four performance positions: arrive, transfer, stay, repair. The four sit in four quadrants, and the quadrants carry no direction, no distance and no land claim; where each position actually lands is to be assigned after survey.

What this drawing claims

- Dazhongsi • four-position performance topology (not to scale, not georeferenced)
- Reversible components: D-C01 Arrival wayfinding module / D-C02 Staffed service module / D-C03 Stay and shelter module / D-C04 Cycle parking and repair module / D-C05 Non-digital processing module
- Routes: D-R01 Order link from the arrive position to the transfer position / D-R02 Order link from the transfer position to the stay position / D-R03 Order link from the stay position to the repair position / D-R04 Cycle parking and repair line / D-R05 Module maintenance line
- Sections: DZS-SEC-A Section A: proposed cycle parking and repair module / DZS-SEC-B Section B: proposed stay and shelter module
- Step-free chain: DZS-SFC-01 - 7 node / 6 segment

Declared status

verified	no
accessibility gate	G5 pending
survey	pending
professional audit	pending
authorization	not authorized
funding	unfunded

What this drawing does not claim

- building stock - The package holds no verifiable evidence about existing building stock in this area, so it cites no building evidence and asserts nothing about what is already built.
- phasing - The order of the four positions is not a construction sequence. This area cites no phasing evidence and claims no position is built before another.
- station position - Issue #1029 questions where the provisional extent lies, so the package holds no usable positional evidence; no positional evidence is cited and no positive spatial relationship is established.

Positional claim: void

positional_claim: void

position assignment: to_be_assigned_by_survey

Evidence consequence: invalidate_and_redesign_lab_3

If official positional evidence is obtained later, its effect is to void this topology and redesign Lab 3, not to confirm the diagram.

Claim limits

Issue #1029 records a questioned discrepancy of approximately 2.26 km between the provisional extent and the station reference; this drawing establishes no station relationship.

Evidence

area:PROV-KEY-003 drawing:DZS-TOPO-01 source:ISSUE-1029 source:KEY-AREA-SOURCE
metric:key_area_count

assets/figures/key-area-dazhongsi-01-situation-claim-limits.en.png

Type: Noto Sans SC subset (SIL OFL 1.1)

Claim limits

non-georeferenced	Announced area 72 ha	Lab 3
-------------------	----------------------	-------

Role: Arrival, repair, and urban service interface

This area answers a third question: what can still be designed responsibly when the position itself cannot be confirmed. The answer is a set of performance modules that depend on no coordinate: arrival, repair, service, and waiting.

Issue #1029 disputes the position of the provisional Dazhongsi polygon relative to the station. The area is therefore treated as neither a station nor a georeferenced parcel: no entrance, road, crossing, parcel, distance, or positive station relationship is drawn or claimed. It is expressed only as non-georeferenced performance tasks.

- This record holds only decisions and references already verifiable inside the package. It introduces no external evidence, professional approval, budget, or tenure conclusion.

- feasible. Every row carries not_authorized, unfunded, and its unresolved D gates at the same time; an unresolved D gate is a blocking condition, not a footnote.

Plate description: A two-column comparison: the left column lists what this area claims - modules, an order and a step-free chain - and the right column states in large type that the positional claim is void, listing three excluded categories of evidence: building stock, phasing and station position, each with its reason. Six declared status rows and the Issue #1029 disclosure panel sit below. There is no base map, no polygon, no north arrow and no scale bar.

This area has no official geometry, and Issue #1029 records a questioned discrepancy of about 2.26 km. In that situation every convenience that would make the drawing easier to read - a reference line, a bearing, a distance - would also make it a claim about where things are. So this set declares the positional claim void as a whole, and expressly excludes three categories of evidence it could otherwise have borrowed, giving the reason for each, so that a reader can tell this is a judgement rather than an omission.

Issue #1029 records a questioned discrepancy of approximately 2.26 km between the provisional extent and the station reference; this drawing establishes no station relationship.

DZS-01-en • Verification status: Not verified: accessibility gate G5 pending, survey pending, professional audit pending. • This plate is the English twin of the Chinese original.

Method and provenance appendix 11 / 15 • Public memory

Public memory is append-only. It records decisions and aggregate evidence references only, never personal data.

- Correction: any record may be corrected by a later record; the original is retained and marked as corrected.
- Lawful retention: retention periods are stated in the operating contract and honoured on expiry.
- Redaction: entries touching identifiable information are redacted before publication.
- Access control: write access is named and read scope is tiered.

DZS-02 Dazhongsi - not-to-scale four-quadrant order topology with five separately drawn lines

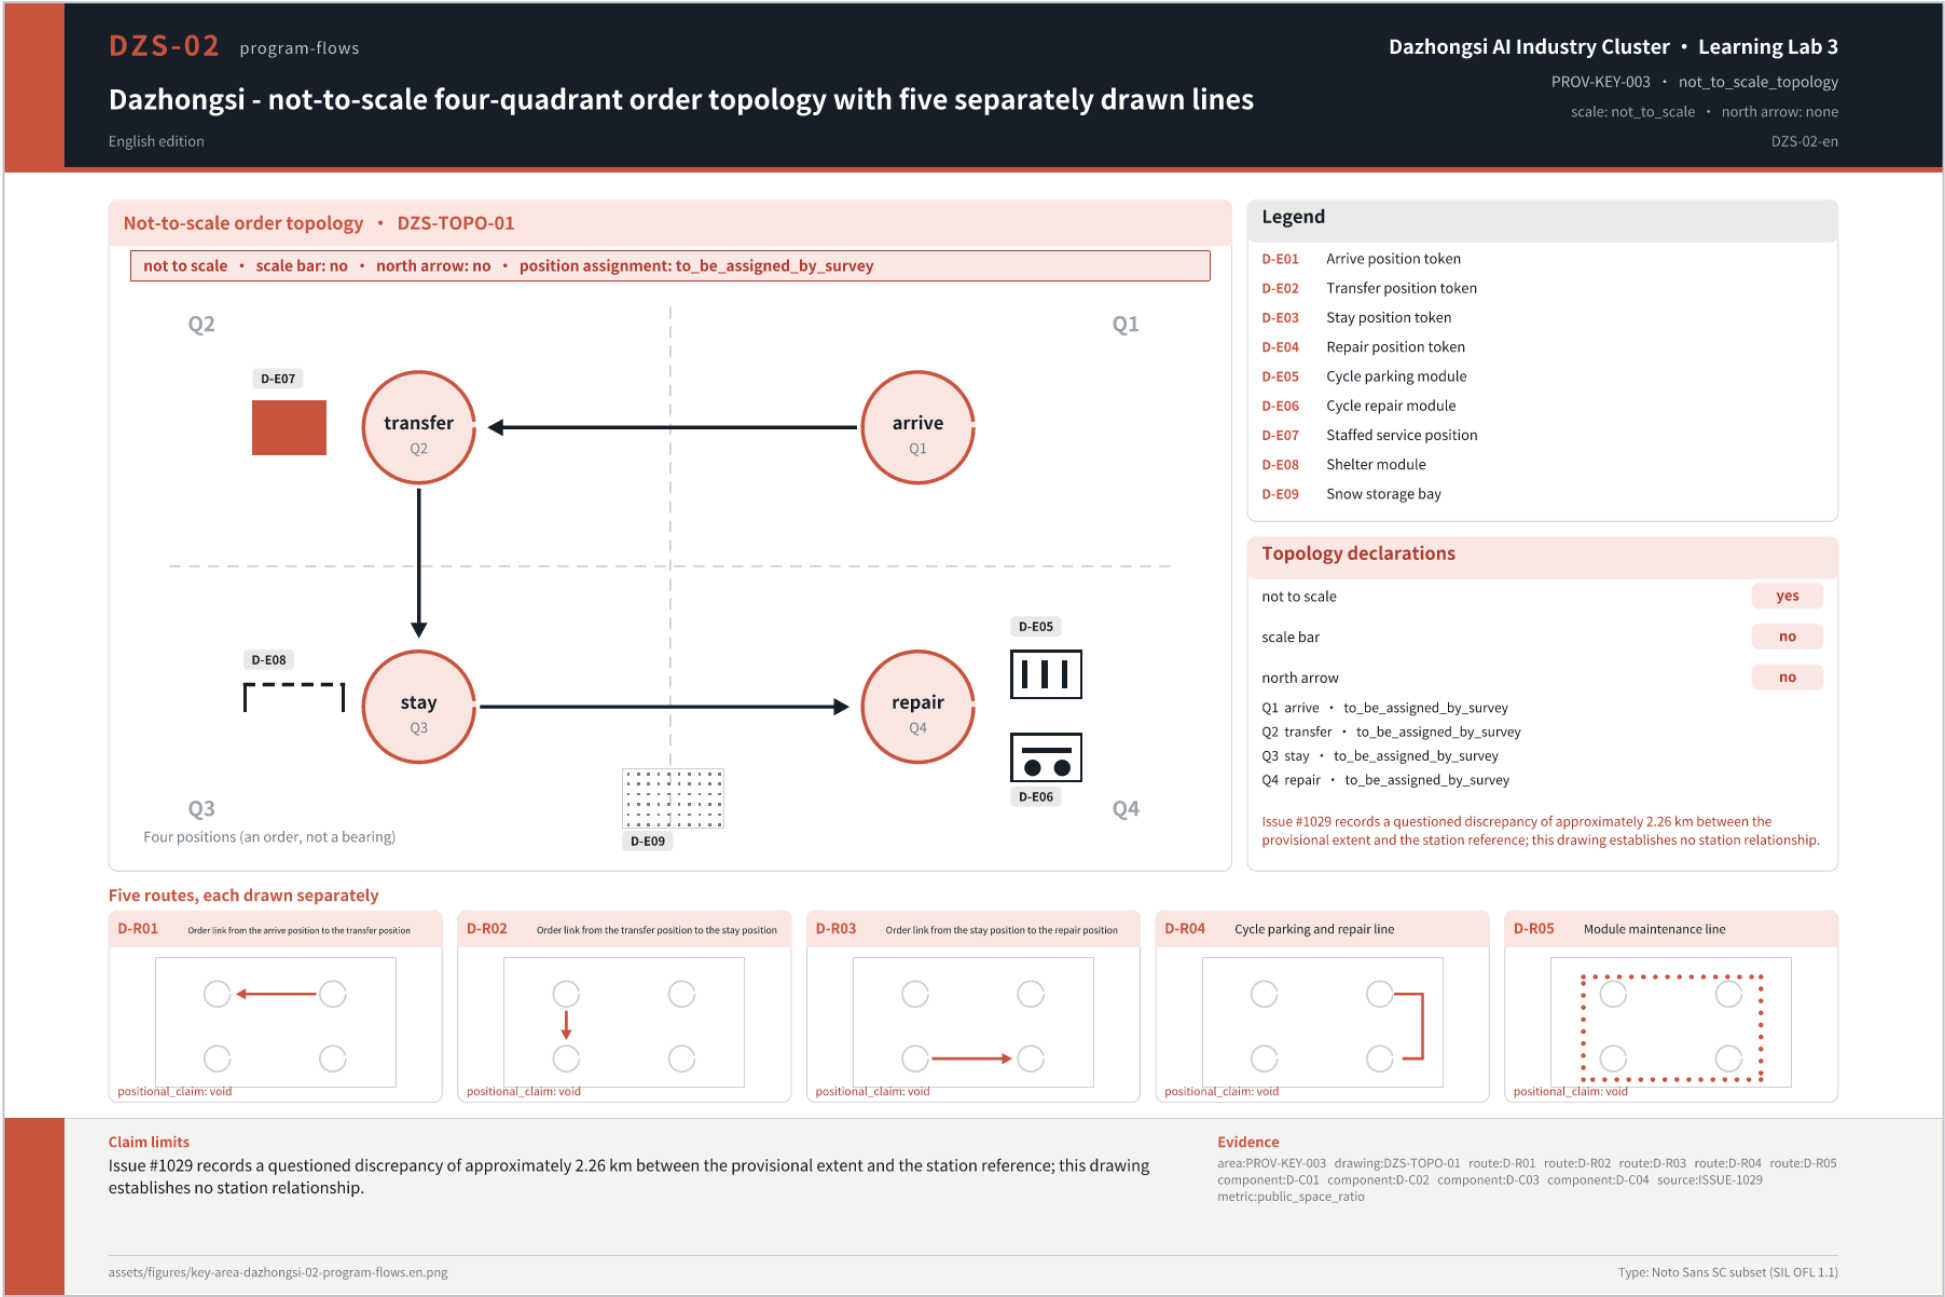


Plate description: A not-to-scale topology: a cross divides the sheet into four quadrants, each holding one circular token - arrive, transfer, stay and repair - joined by arrows in that order. The cycle parking module and the cycle repair module sit beside the repair token, the staffed module beside the transfer token, the shelter module beside the stay token, and the snow storage bay in a corner of its own. A banner across the top declares not to scale, no scale bar and no north arrow, and records that all four positions are to be assigned by survey. Five small diagrams below draw each of the five lines on its own.

A quadrant here is an order, not a bearing. The relative order of the four positions - arrive, then transfer, then stay, then repair - is the whole of what this set is able to claim; it corresponds to no actual place, direction or distance, and every position is recorded as to_be_assigned_by_survey. There is no base map, no polygon, no scale bar, no north arrow and no line that claims to correspond to anything on the ground. Cycle parking and cycle repair are drawn as their own modules because they are the everyday content this area can least afford to leave out.

Issue #1029 records a questioned discrepancy of approximately 2.26 km between the provisional extent and the station reference; this drawing establishes no station relationship.

DZS-02-en · Verification status: Not verified: accessibility gate G5 pending, survey pending, professional audit pending. · This plate is the English twin of the Chinese original.

Keyed detail panels

D-C01 Arrival Module
A coordinate-independent arrival unit: an enquiry position, seating, shelter, and bilingual guidance. Which arrival point it serves is decided by later evidence and is not specified here.

Unresolved D gates: D02 D03 D08
D-C02 Repair and Parts Module
A shared repair bay and parts library serving the pilot equipment of the whole belt; this is where the three labs' repair capacity sits.

Unresolved D gates: D02 D12
D-C03 Urban Service Counter Module
A counter unit placing open-source enterprise services beside public services, offering a paper path and a digital path side by side.

Unresolved D gates: D02 D16
D-C04 Sheltered Waiting Module
A covered waiting unit with seating, gaining a windbreak face in winter and keeping cross-ventilation in summer. It claims no position relative to any station.

Unresolved D gates: D02 D13
D-C05 Maintainer Station Module
A fixed station and training position for maintainers. A maintenance commitment without a station counts toward no implementation-capacity claim.

Unresolved D gates: D12 D16
D-R01 Order link from the arrive position to the transfer position
The order link from the arrive position to the transfer position, put forward as step-free; it carries no position, distance or level and establishes no relationship to the station.

Unresolved D gates: D03 D05
D-R02 Order link from the transfer position to the stay position
The order link from the transfer position to the stay position, put forward as step-free; the four quadrant positions are to be assigned by survey.

Unresolved D gates: D03 D05
D-R03 Order link from the stay position to the repair position
The order link from the stay position to the repair position, put forward as step-free; this drawing is not to scale and is not georeferenced.

Unresolved D gates: D03 D05
ENV-DZ-01 Phase 1 conceptual envelope
One reversible set of arrival and repair modules: every element is demountable and movable, removed item by item at closure. Not georeferenced; placement waits on the official polygon. How the modules would meet existing construction, levels or evacuation conditions is unsurveyed.


Unresolved D gates: D02 D03 D06 D12

Method and provenance appendix 12 / 15 · Spelling provenance


Both official spellings 集聚 and 聚集 appear in public material for the Dazhongsi area name. The package preserves both with provenance rather than silently normalizing one away, and makes no claim about which is uniquely correct.

- 集聚 official announcement wording as transcribed in the source registry OFFICIAL-ANNOUNCEMENT
- 聚集 agent taskbook wording and the submitted key-area attribute name AGENT-TASKBOOK

DZS-03 Dazhongsi - reversible module sections A and B

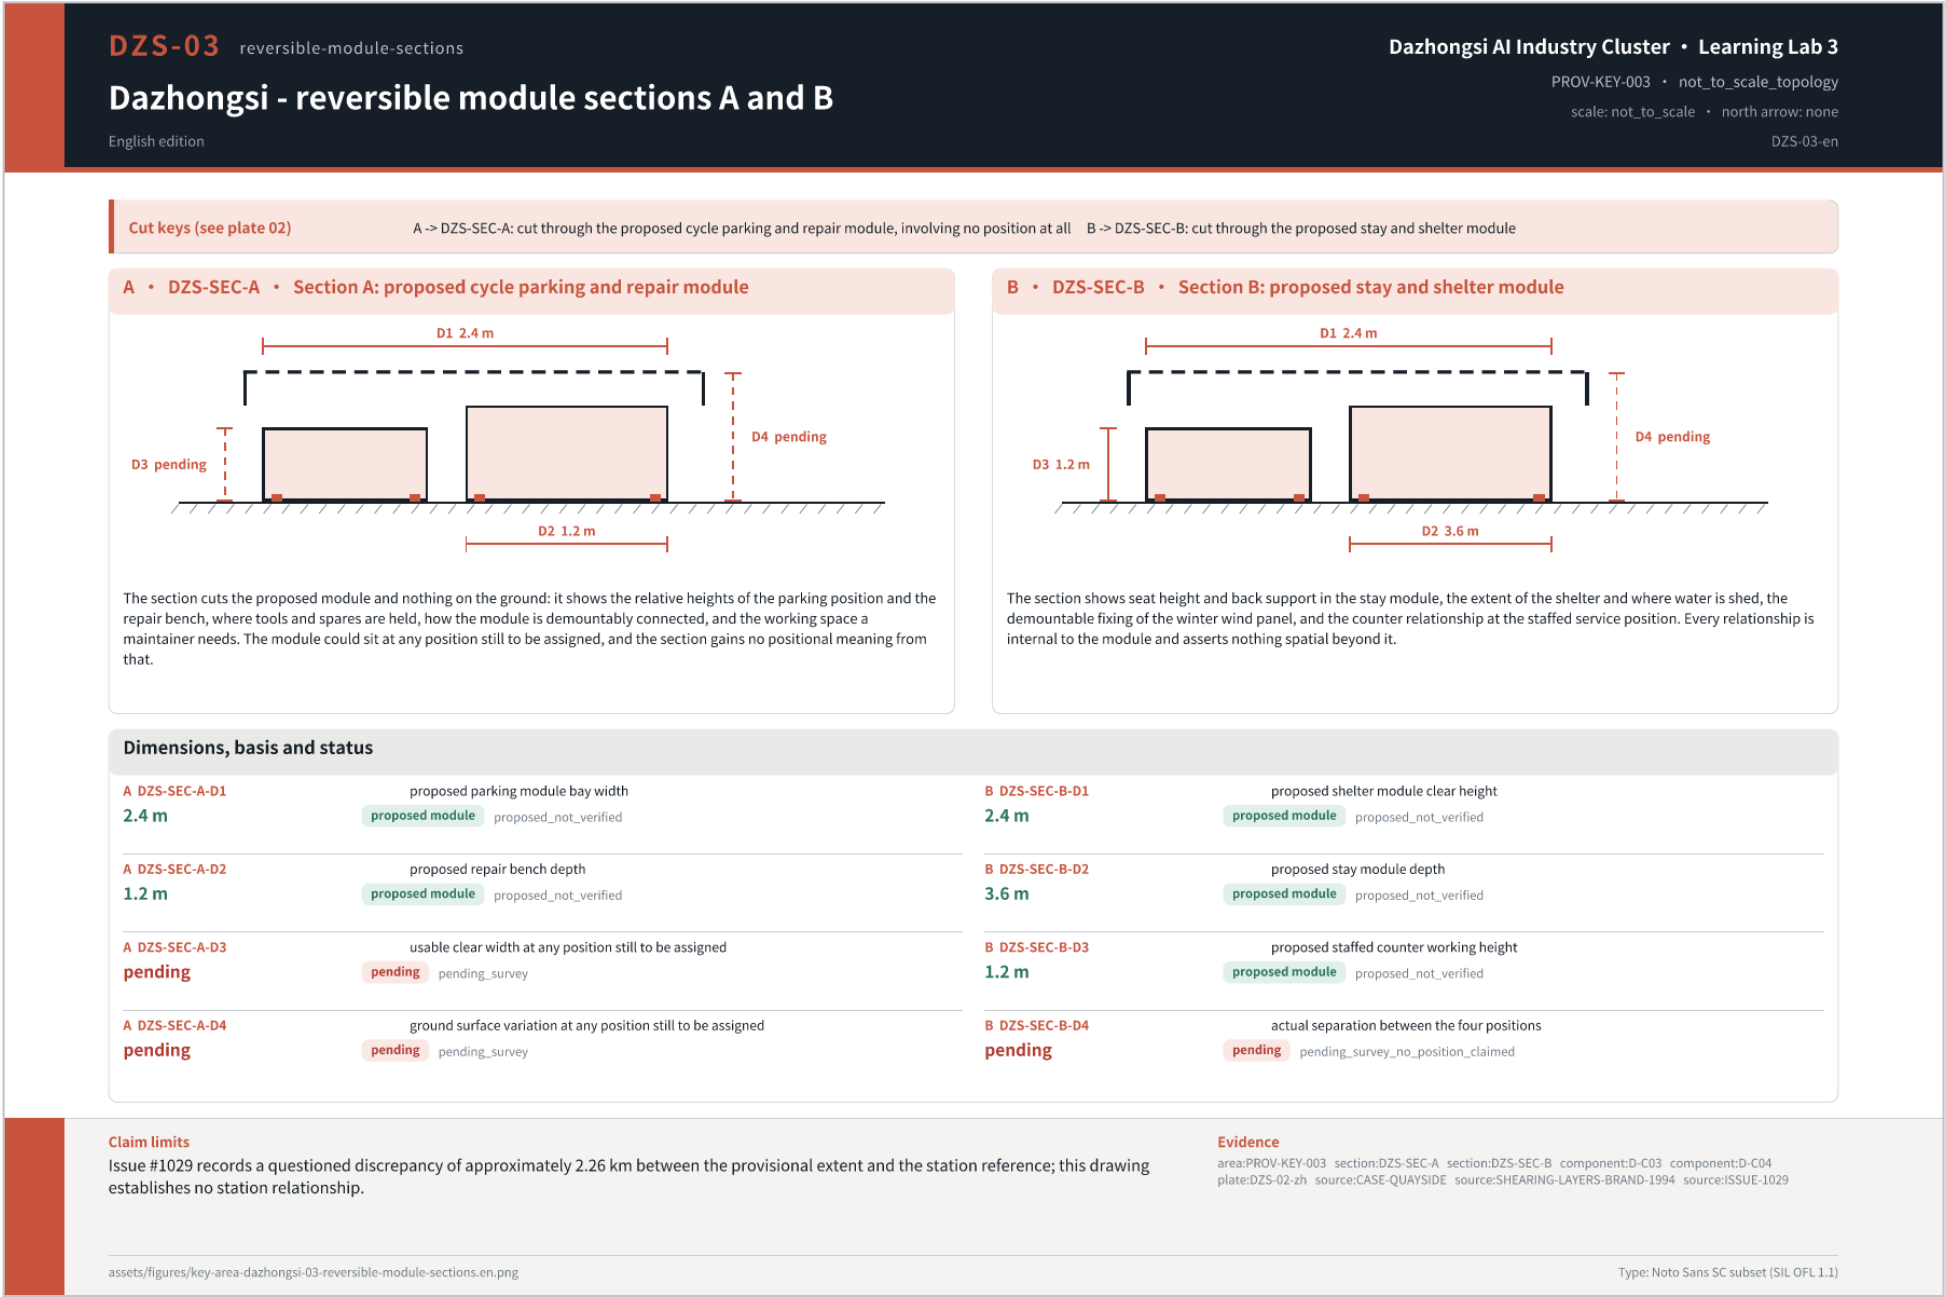

DZS-04 Dazhongsi - step-free chain, operating modes and seasons

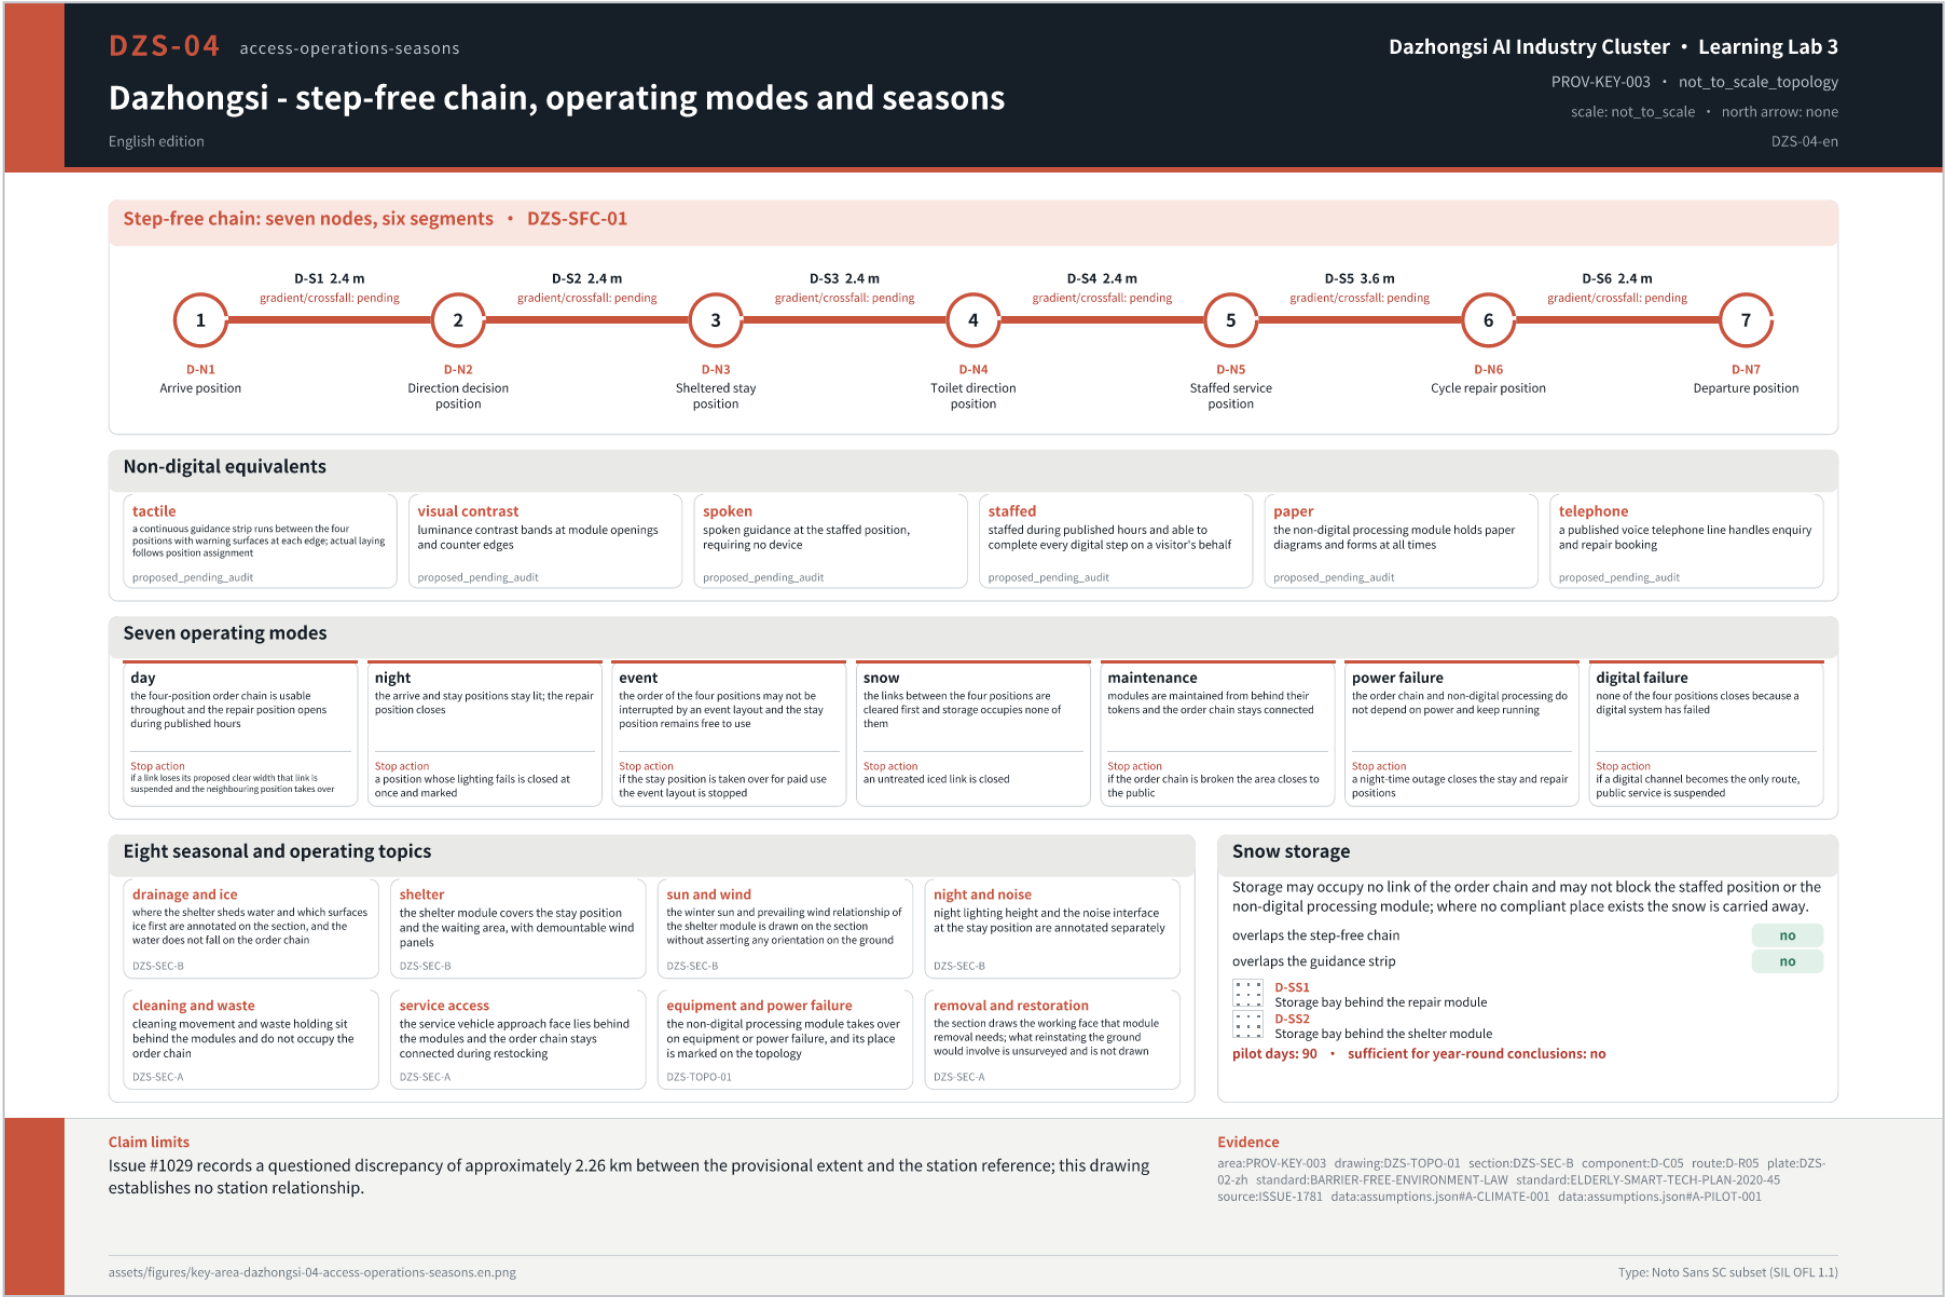

DZS-05 Dazhongsi - governance, stop conditions and evidence

DZS-05 governance-stop-evidence

Dazhongsi AI Industry Cluster • Learning Lab 3

Dazhongsi - governance, stop conditions and evidence

English edition

PROV-KEY-003 • not_to_scale_topology

scale: not_to_scale • north arrow: none

DZS-05-en

authorization

not authorized

funding

unfunded

pilot start allowed

no

Blocking conditions

D03

D07

D14

DZS-P1-ENV • reversible: yes

Phase 1 reversible envelope

Phase 1 places only four demountable module sets: arrival wayfinding, staffed service, stay and shelter, and cycle parking with repair. The modules carry no position and no boundary, and they sit at places assigned after survey. How they would meet the existing ground, levels, or evacuation conditions is unsurveyed, and this drawing draws no engineering conclusion about it.

Restoration

At closure the set is removed item by item against a dismantling checklist, with a record retained. What reinstating the ground would involve depends on conditions nobody has surveyed; neither a restoration method nor a restoration capacity has been confirmed by any party, and Section A draws the module build-up alone, never a site build-up.

Removal

The modules are mechanically fixed and are put forward as dismantled whole and carried away with no destructive work.

Liability

Residual liability has no holder. If official positional evidence is obtained later, this envelope is voided together with the topology and redesigned, and who carries the cost of that redesign is equally undetermined.

Thresholds: none approved • DZS-TH-01

year-round availability of the sheltered stay position

proposed target: the stay position does not close in winter because of ice or lying snow

approved threshold

null

pilot start allowed

no

Declared status

pending

Thresholds: none approved • DZS-TH-02

hours the cycle repair position is usable

proposed target: the repair position is usable during published hours and requires no device

approved threshold

null

pilot start allowed

no

Declared status

pending

Stop conditions and pilot limits

pilot days: 90 • sufficient for year-round conclusions: no

A ninety-day pilot speaks only for ninety days. No position here has been assigned, so a pilot cannot even hold the positional conditions constant, let alone support a year-round inference.

Evidence

Evidence consequence

invalidate_and_redesign_lab_3

If official positional evidence is obtained later, its effect is to void this topology and redesign Lab 3, not to confirm the diagram.

Excluded evidence categories

building stock

Claim limits

Issue #1029 records a questioned discrepancy of approximately 2.26 km between the provisional extent and the station reference; this drawing establishes no station relationship.

Evidence

area:PROV-KEY-003 section:DZS-SEC-A component:D-C01 metric:phase1_reversible_area_sqm
source:REAL-OPTIONS-NEUFVILLE-2003 source:CASE-SEOUL-AI-HUB source:ISSUE-1029
data:assumptions.json#A-CLIMATE-001

assets/figures/key-area-dazhongsi-05-governance-stop-evidence.en.png

Type: Noto Sans SC subset (SIL OFL 1.1)

Renewal Action Governance Register

P08 Shade and Stormwater Segment
Phase 2 Authorized target: none (no party with standing has accepted one)
Stop trigger: New ponding appears downstream, or a shade element moves under wind or snow load.

Unresolved D gates: D05 D12 D13

P09 Open-Source Service Desk
Phase 2 Authorized target: none (no party with standing has accepted one)
Stop trigger: The desk issues something framed as legal advice or as a professional approval determination.

Unresolved D gates: D12 D16

P10 Maintenance Parts Library
Phase 2 Authorized target: none (no party with standing has accepted one)
Stop trigger: A deployed equipment type turns out to have no parts or no named maintainer.

Unresolved D gates: D12 D16

P11 Annual Atlas Rerun
Phase 3 Authorized target: none (no party with standing has accepted one)
Stop trigger: A rerun result is presented as a computed conclusion about movement, demand, accessibility, public preference, or optimality for Beijing.

Unresolved D gates: D16 D17

Method and provenance appendix 15 / 15 • Marker migration

The trusted repository renderer recognizes only the five evidence marker kinds source/standard/depth/data/metric; [assumption:*] leaks into rendered HTML as literal text. Each assumption is already registered in assumptions.json, so the marker is redirected to that file using a supported kind. No assumption is deleted or reworted.

```
assumption → data assumptions.json expected_replacements 10 expected_distinct_ids 6
```

Typeface Every string on this drawing is generated from the registries inside the package; the drawing script carries no wording of its own.