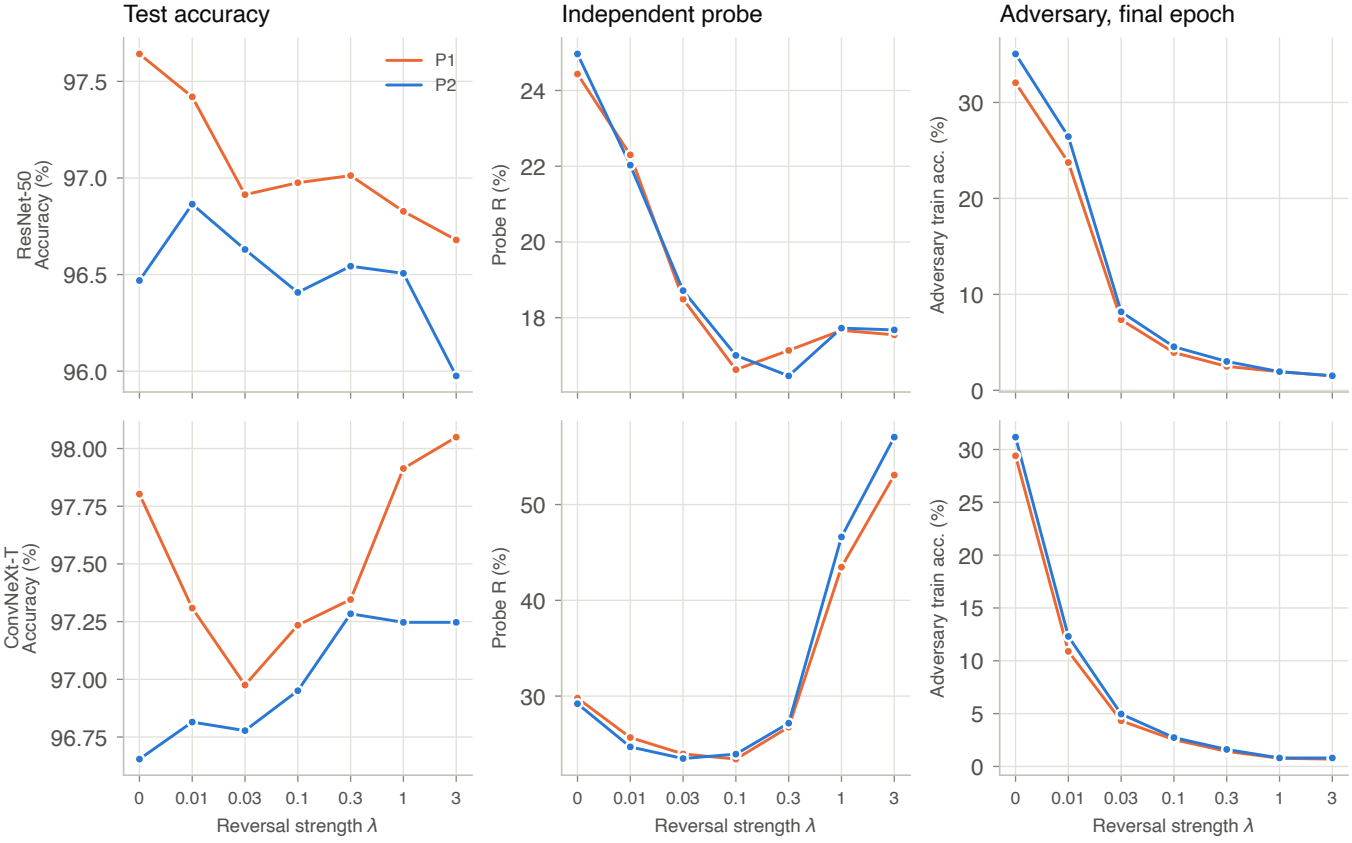
Test accuracy
Independent probe
Adversary, final epoch
P1
P2
ResNet-50
Accuracy (%)
ConvNeXt-T
Accuracy (%)
Probe R (%)
Adversary train acc. (%)
Reversal strength λ
0
0.01
0.03
0.1
0.3
1
3