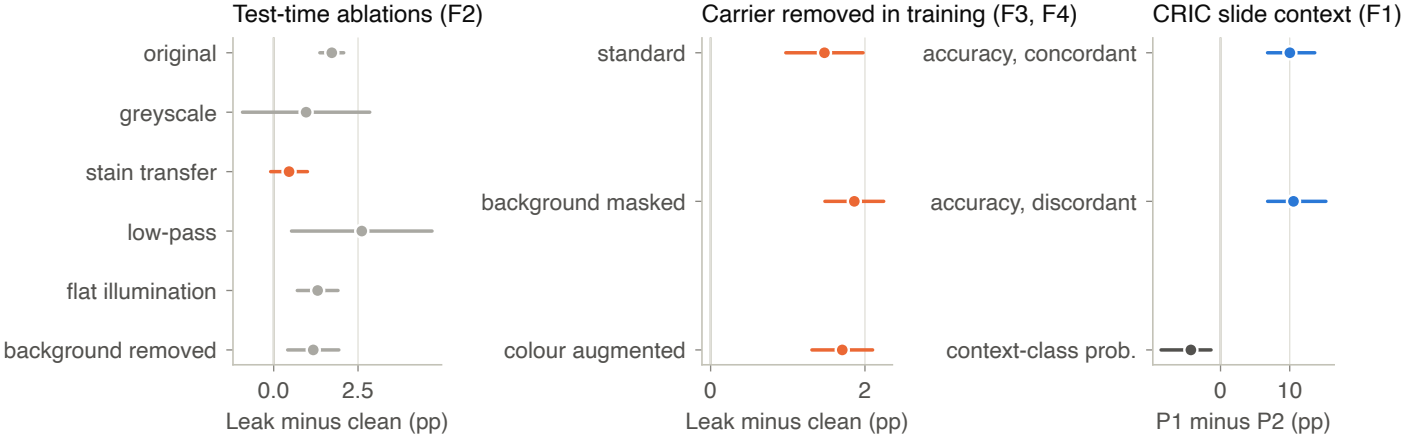
Test-time ablations (F2)
original
greyscale
stain transfer
low-pass
flat illumination
background removed
0.0
2.5
Leak minus clean (pp)
Carrier removed in training (F3, F4)
standard
background masked
colour augmented
0
2
Leak minus clean (pp)
CRIC slide context (F1)
accuracy, concordant
accuracy, discordant
context-class prob.
0
10
P1 minus P2 (pp)