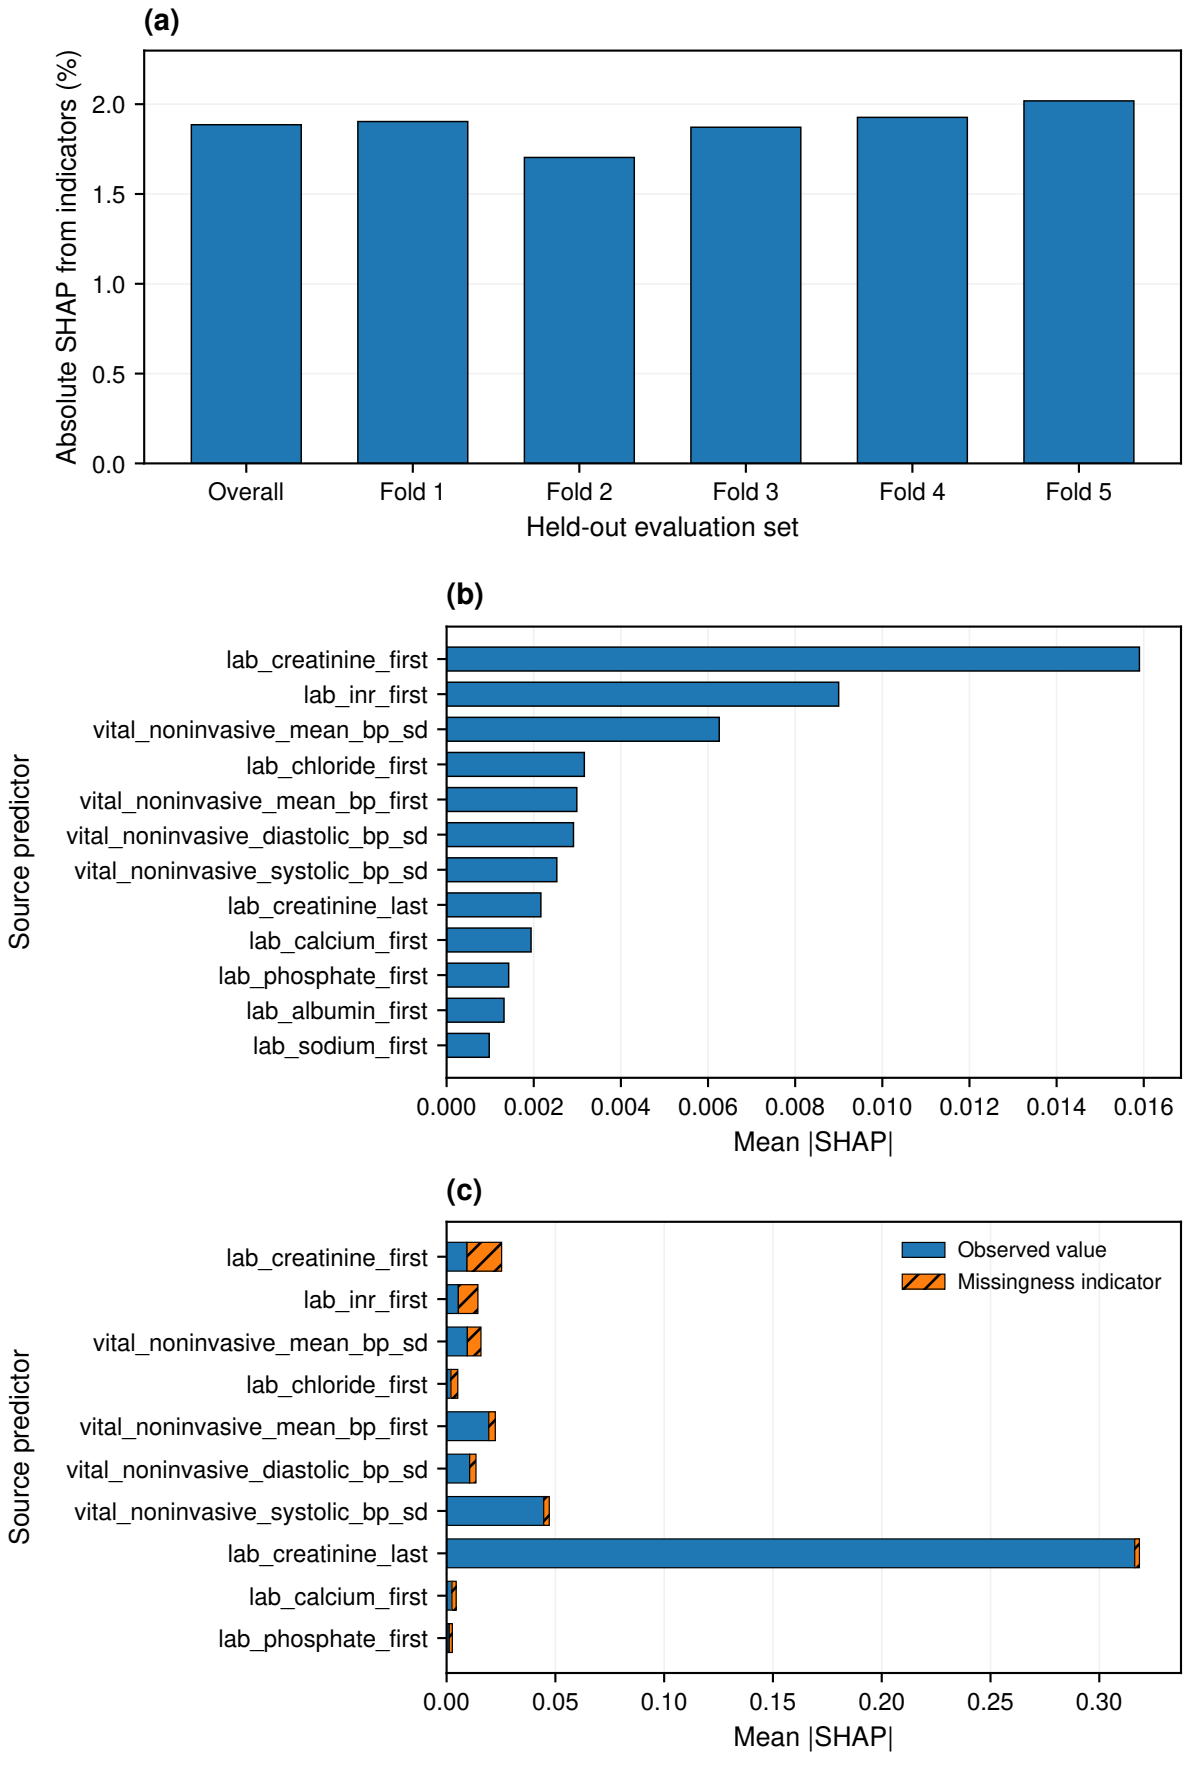
(a)
Absolute SHAP from indicators (%)
0.0
0.5
1.0
1.5
2.0
Overall
Fold 1
Fold 2
Fold 3
Fold 4
Fold 5
Held-out evaluation set
(b)
Source predictor
lab_creatinine_first
lab_inr_first
vital_noninvasive_mean_bp_sd
lab_chloride_first
vital_noninvasive_mean_bp_first
vital_noninvasive_diastolic_bp_sd
vital_noninvasive_systolic_bp_sd
lab_creatinine_last
lab_calcium_first
lab_phosphate_first
lab_albumin_first
lab_sodium_first
0.000
0.002
0.004
0.006
0.008
0.010
0.012
0.014
0.016
Mean |SHAP|
(c)
Source predictor
Observed value
Missingness indicator
lab_creatinine_first
lab_inr_first
vital_noninvasive_mean_bp_sd
lab_chloride_first
vital_noninvasive_mean_bp_first
vital_noninvasive_diastolic_bp_sd
vital_noninvasive_systolic_bp_sd
lab_creatinine_last
lab_calcium_first
lab_phosphate_first
0.00
0.05
0.10
0.15
0.20
0.25
0.30
Mean |SHAP|