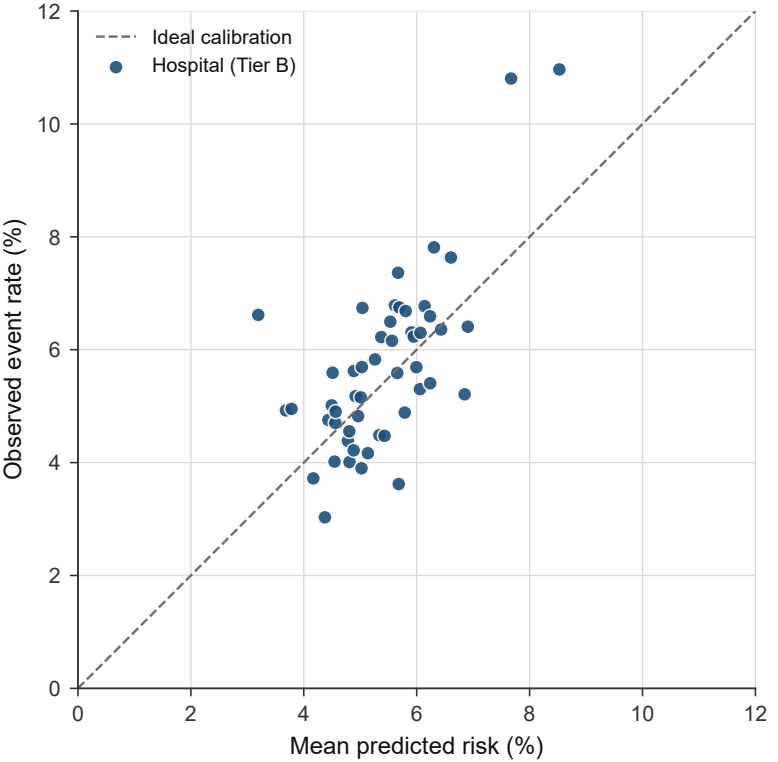
Ideal calibration
Hospital (Tier B)
Observed event rate (%)
Mean predicted risk (%)
0
2
4
6
8
10
12