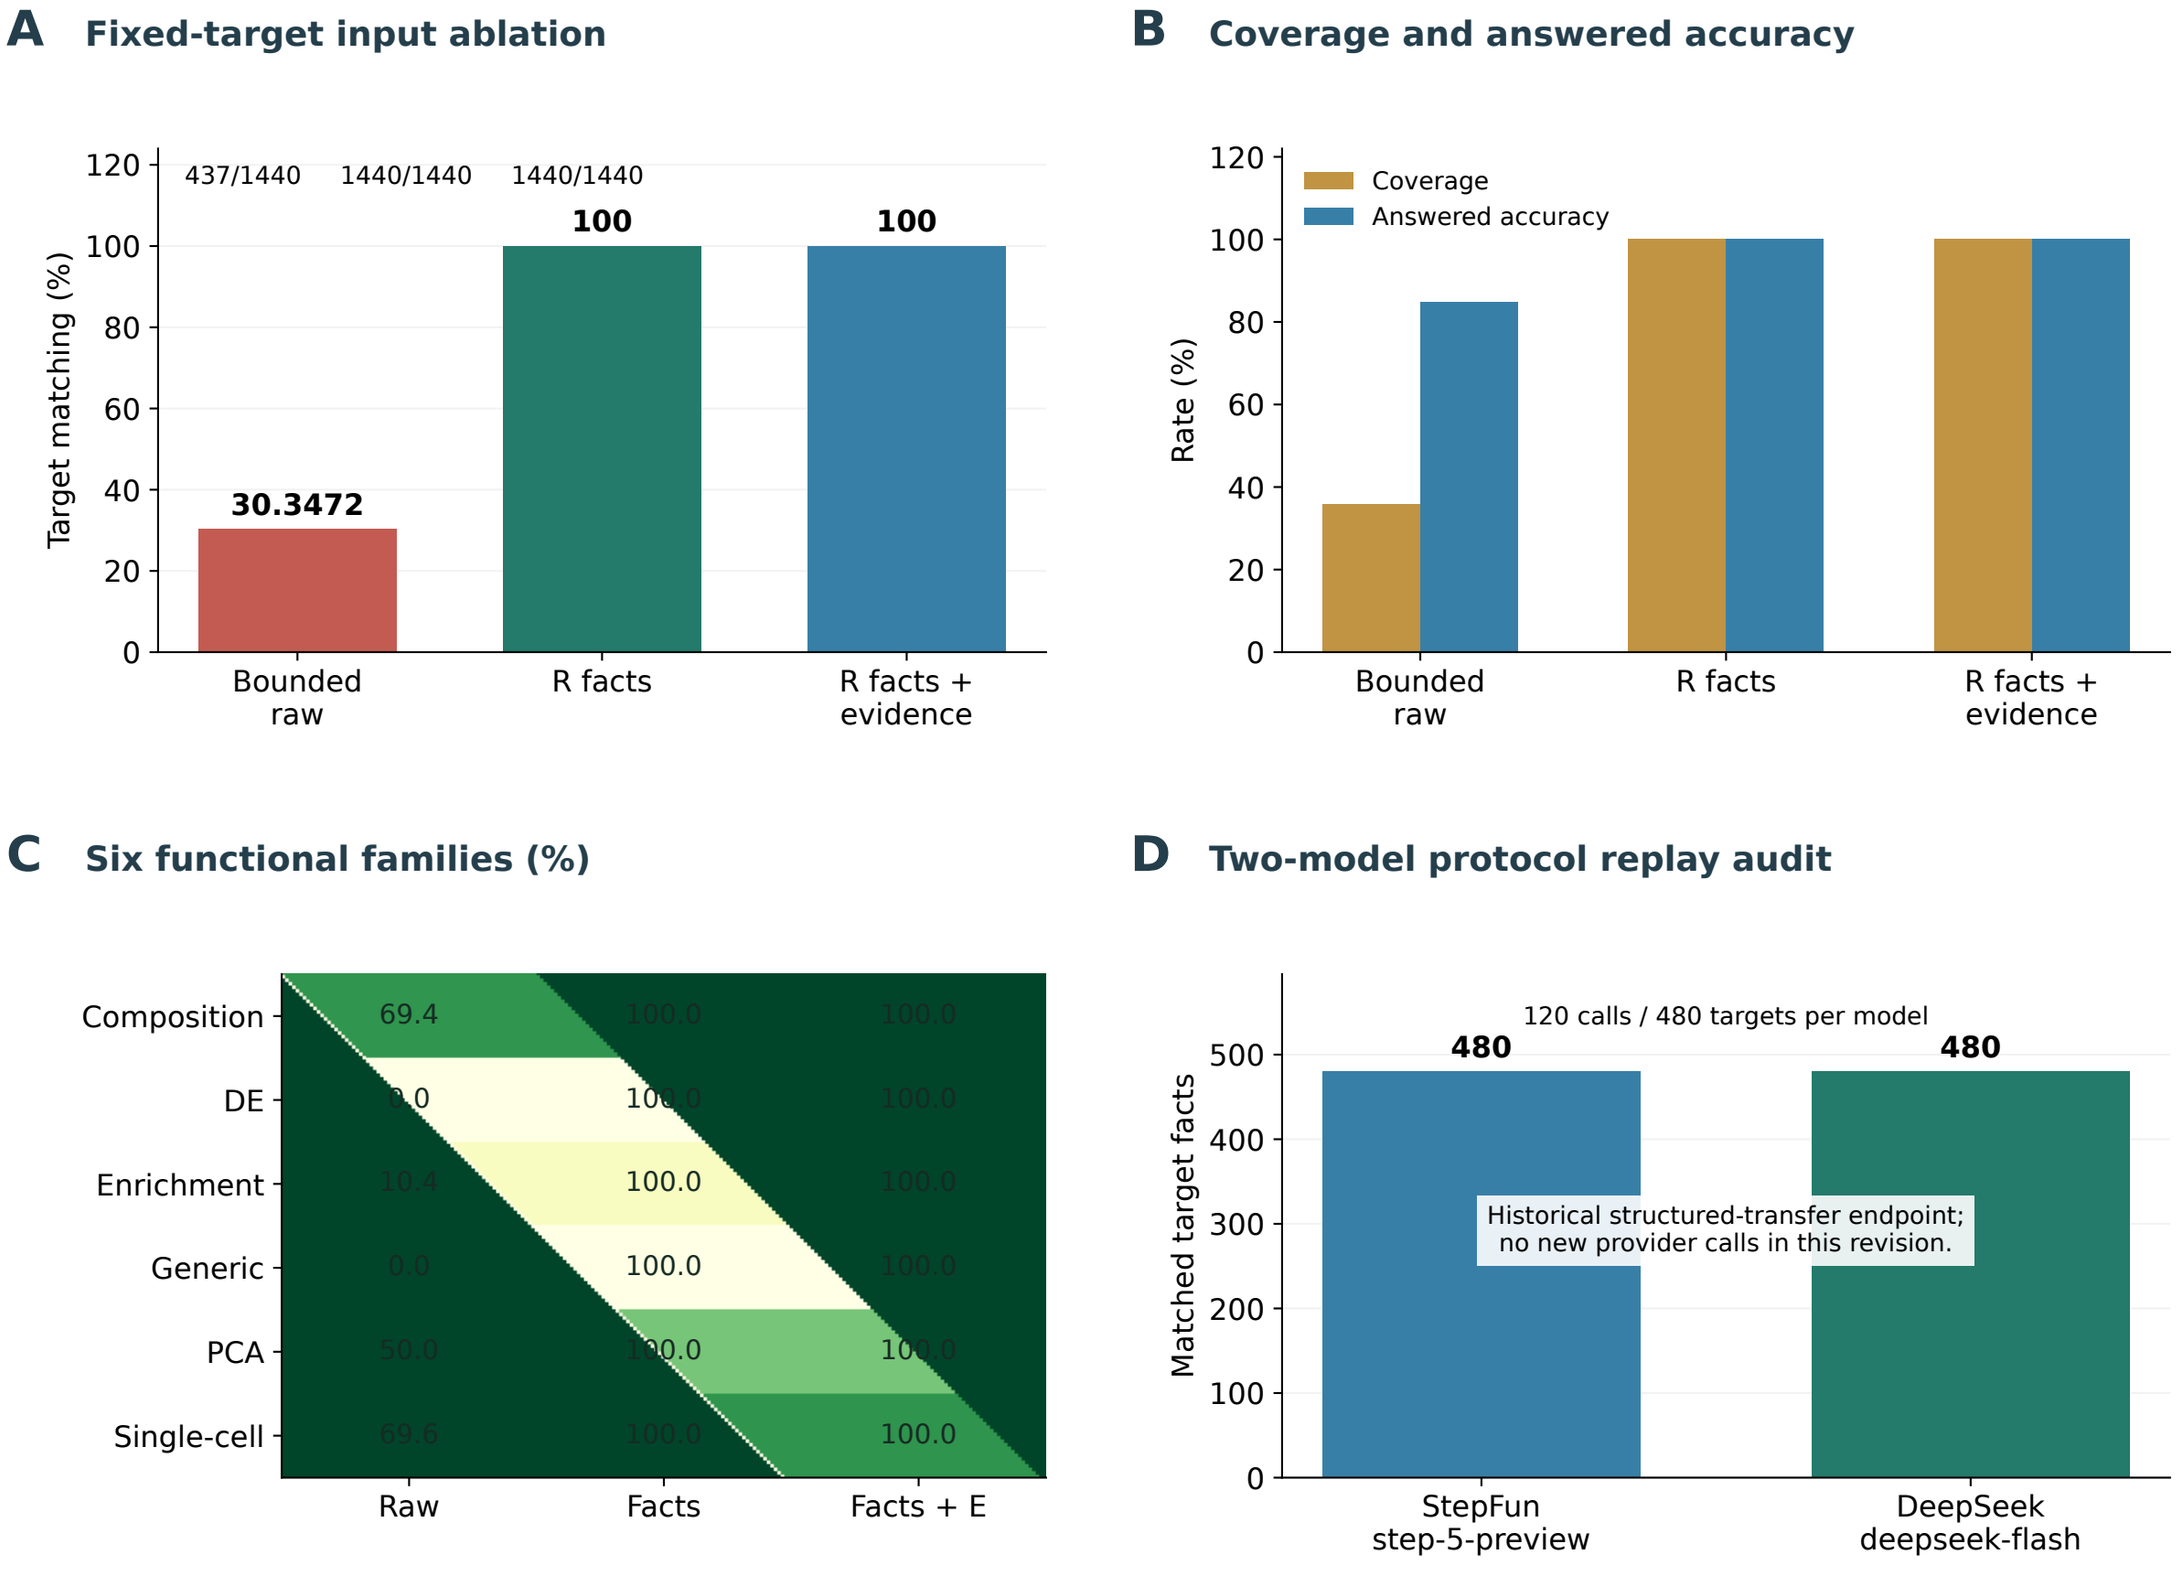

A
Fixed-target input ablation
Target matching (%)
437/1440
1440/1440
1440/1440
30.3472
100
100
Bounded raw
R facts
R facts + evidence
B
Coverage and answered accuracy
Rate (%)
Coverage
Answered accuracy
Bounded raw
R facts
R facts + evidence
C
Six functional families (%)
Composition
DE
Enrichment
Generic
PCA
Single-cell
69.4
100.0
100.0
0.0
100.0
100.0
10.4
100.0
100.0
0.0
100.0
100.0
50.0
100.0
100.0
69.6
100.0
100.0
Raw
Facts
Facts + E
D
Two-model protocol replay audit
120 calls / 480 targets per model
Matched target facts
480
480
Historical structured-transfer endpoint;
no new provider calls in this revision.
StepFun
step-5-preview
DeepSeek
deepseek-flash