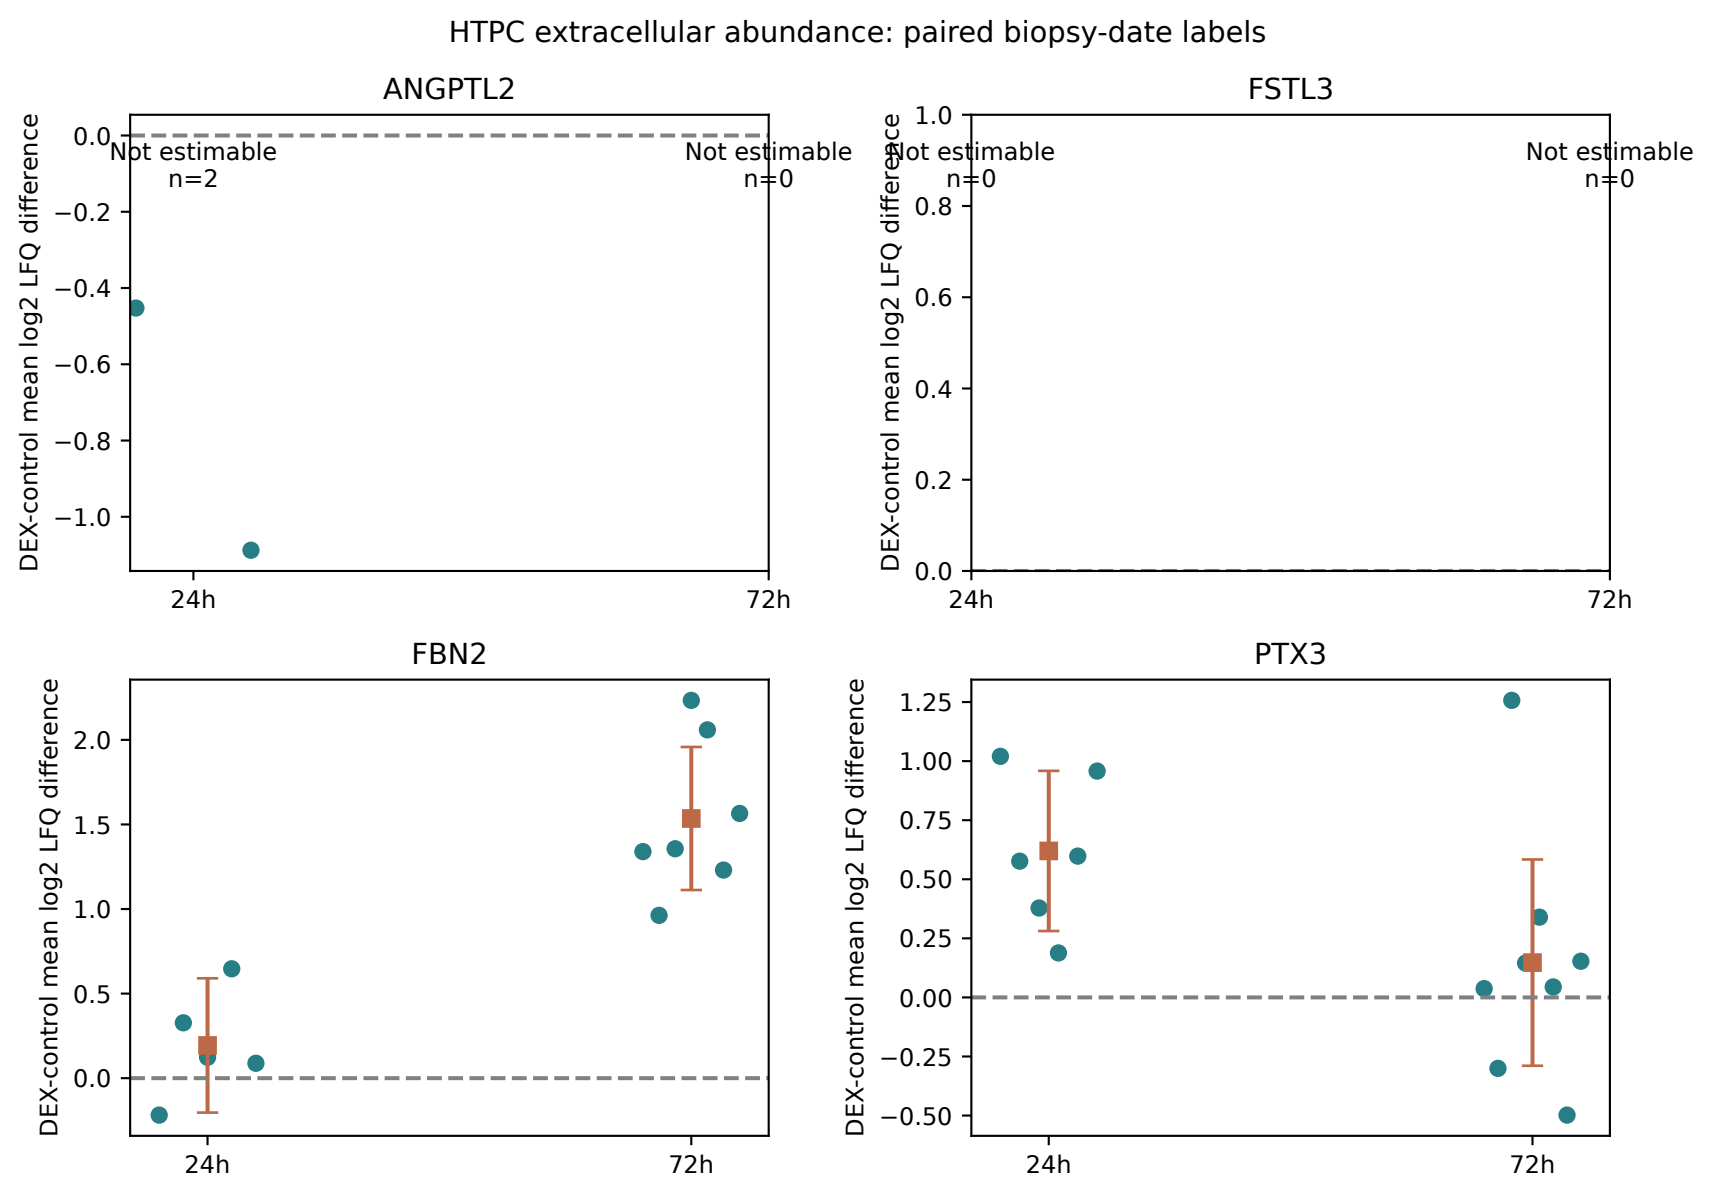
HTPC extracellular abundance: paired biopsy-date labels
ANGPTL2
Not estimable
n=2
Not estimable
n=0
DEX-control mean log2 LFQ difference
0.0
−0.2
−0.4
−0.6
−0.8
−1.0
24h
72h
FSTL3
Not estimable
n=0
Not estimable
n=0
DEX-control mean log2 LFQ difference
1.0
0.8
0.6
0.4
0.2
0.0
24h
72h
FBN2
DEX-control mean log2 LFQ difference
2.0
1.5
1.0
0.5
0.0
24h
72h
PTX3
DEX-control mean log2 LFQ difference
1.25
1.00
0.75
0.50
0.25
0.00
−0.25
−0.50
24h
72h