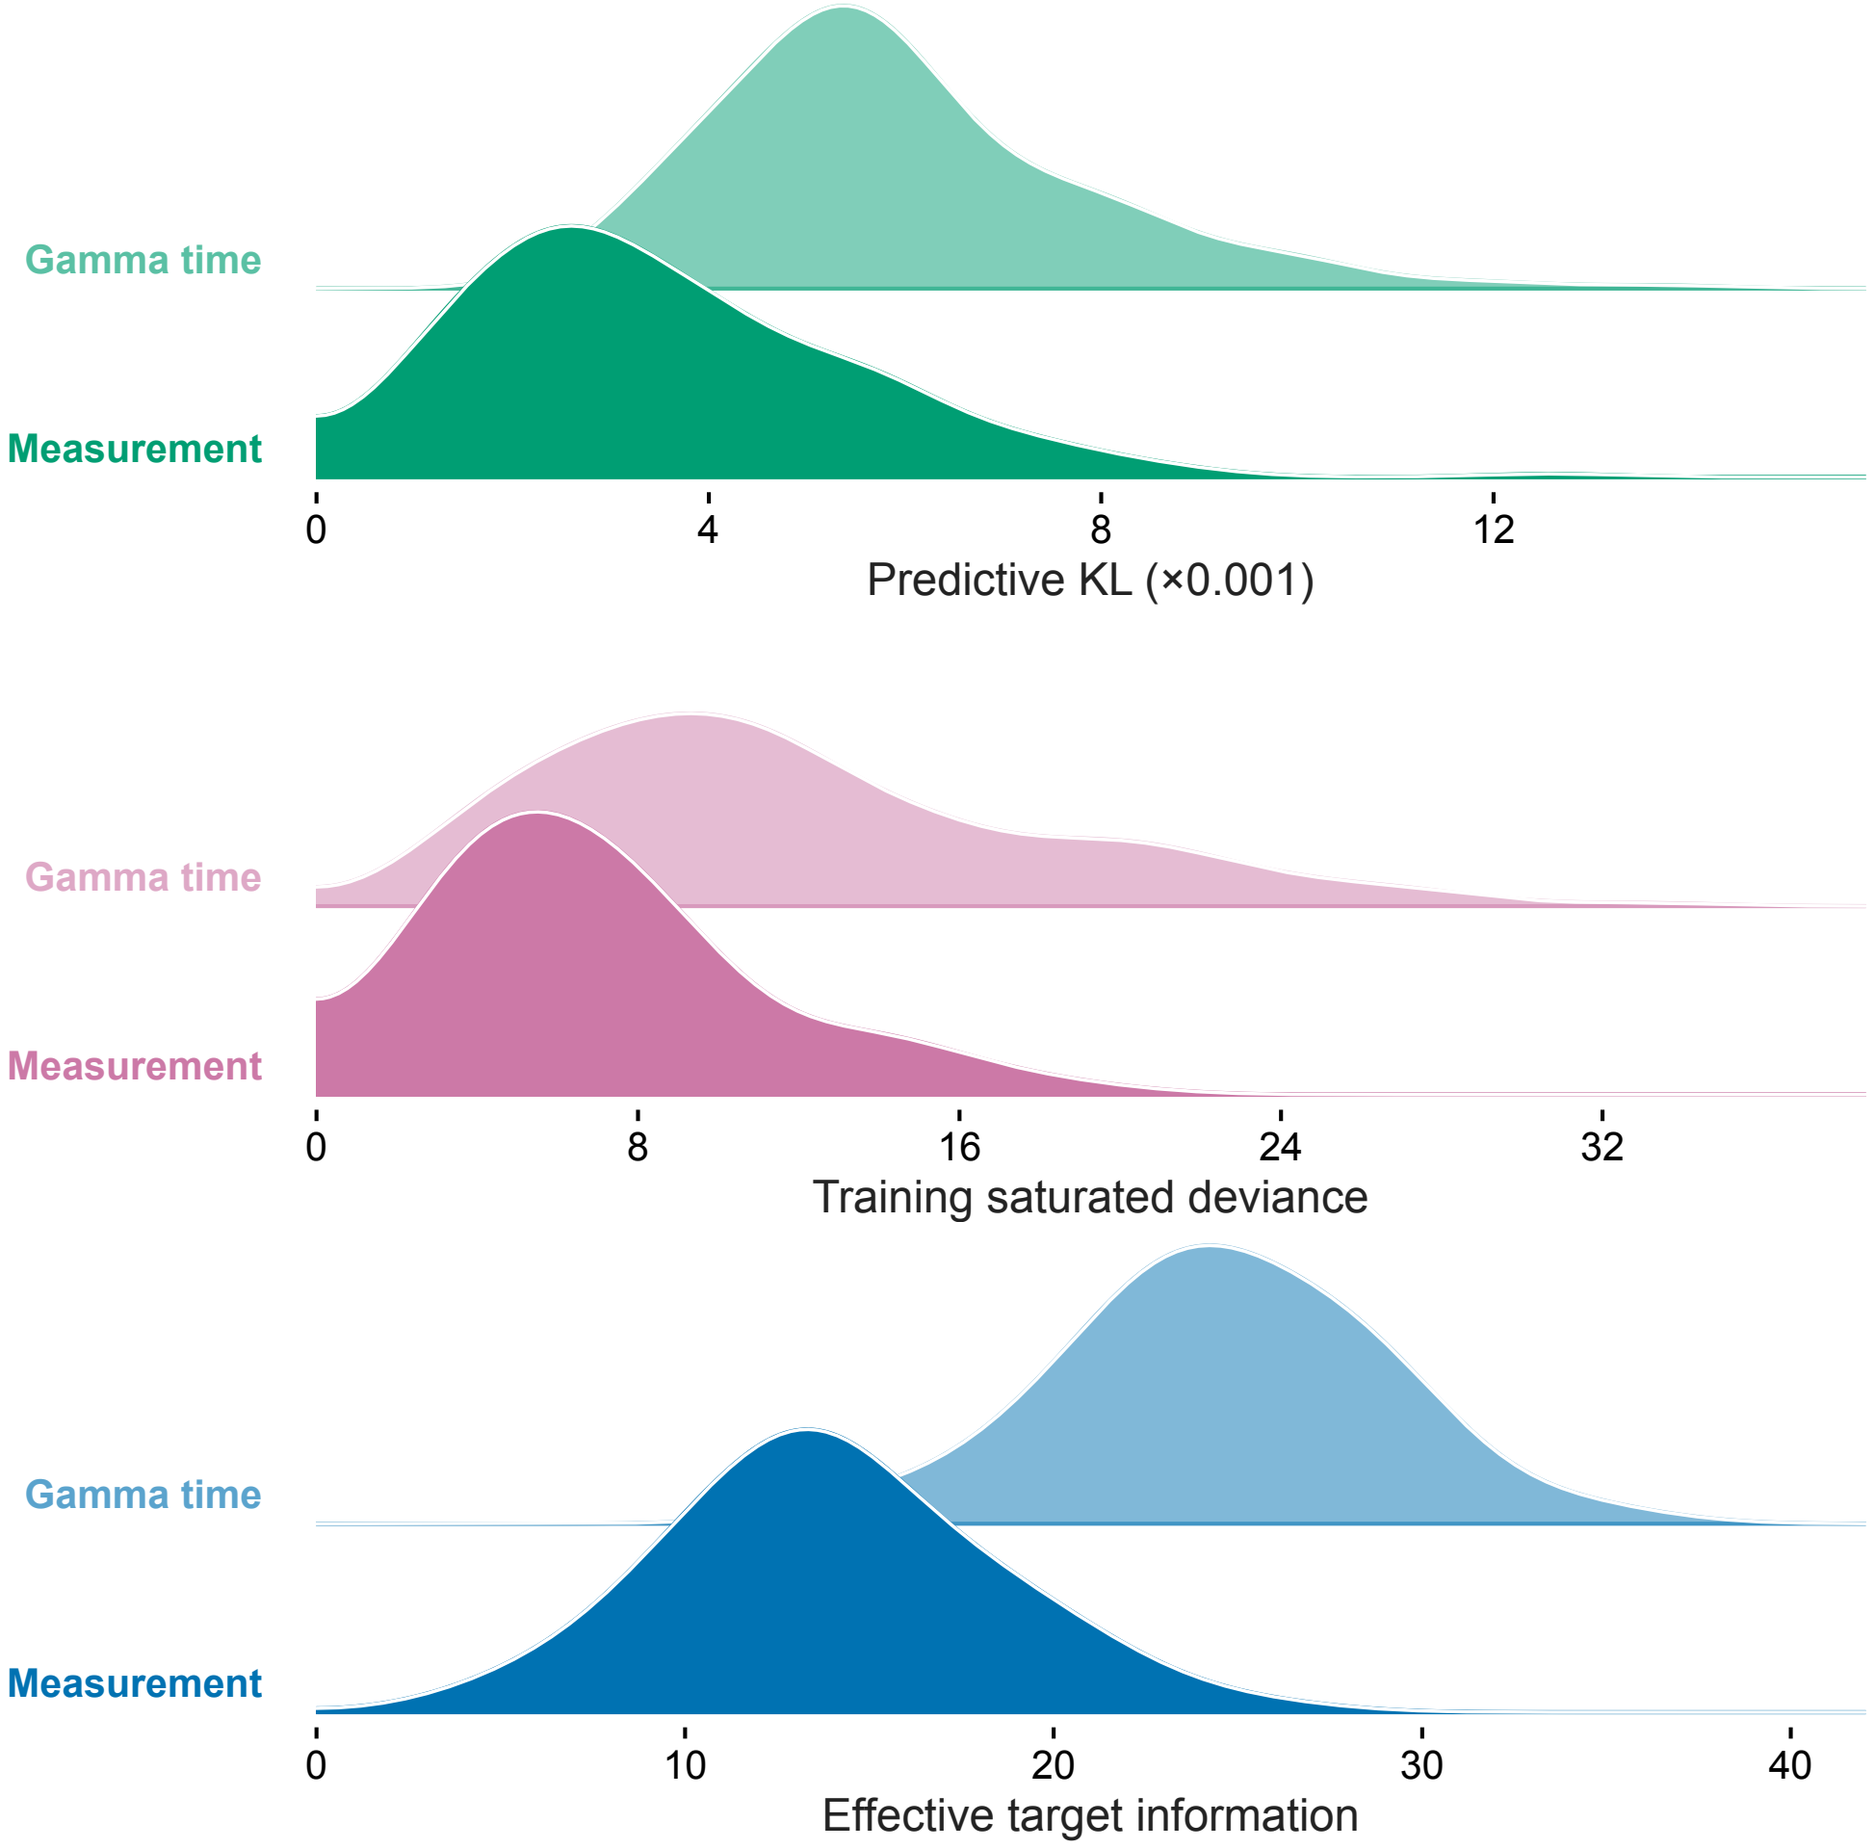

Gamma time
Measurement
0
4
8
12
Predictive KL (×0.001)
Gamma time
Measurement
0
8
16
24
32
Training saturated deviance
Gamma time
Measurement
0
10
20
30
40
Effective target information