

Distributed Risk-Aware Bidding Strategy for Incorporating Renewable Generation into Real-Time Electricity Market

Tommy Truong, Zhihua Qu, and Marwan A. Simaan
University of Central Florida

Abstract—This paper proposes a risk-aware optimization framework in which firms’ sensitivity to uncertainty serves as a tunable coordination variable. We show that, for a class of stochastic market games, there exists a structured relationship between firms’ risk parameters and the resulting Nash equilibrium, such that appropriately chosen risk sensitivities induce Nash equilibria that lie on the Pareto frontier. Based on this insight, we develop a distributed algorithm that allows firms to estimate required aggregate quantities and adapt their risk parameters using only local communication and minimal information exchange. The proposed approach preserves the decentralized nature of the market: firms remain self-interested in their primary decisions, resulting in Pareto-optimal Nash equilibria, and convergence of the distributed algorithm follows from consensus theory under mild connectivity conditions.

Keywords: Risk-aware bidding, Nash equilibrium, Pareto efficiency, stochastic market, distributed optimization, renewable energy

I. INTRODUCTION

Competitive electricity markets operating under uncertainty exhibit a fundamental tension between individual rationality and collective efficiency. Renewable energy operators in particular face this challenge acutely: their generation is stochastic and correlated through shared weather conditions, their output forecasts are uncertain, and their bidding decisions must be submitted before real-time prices are known [1], [2], [3]. When each operator optimizes its own expected profit independently, the resulting Nash equilibrium generally fails to achieve socially optimal outcomes, even when all firms behave rationally [4], [5]. This gap between Nash and Pareto-optimal performance is not merely a theoretical artifact—in markets with many correlated renewable operators, it translates directly into foregone collective profit and inefficient price signals [6], [7].

Existing studies on stochastic Cournot and oligopoly games have examined the impact of uncertainty and risk preferences on equilibrium outcomes, but typically treat risk attitudes as fixed exogenous parameters [8], [9], [10]. Under this assumption, the equilibrium is determined once risk preferences are assigned, leaving no room to steer outcomes. Separately, Pareto efficiency has been studied through centralized optimization or cooperative formulations that require full information sharing [11], [12], [13]. These approaches are impractical in deregulated markets where operators are self-interested and unwilling to disclose private cost and forecast

data. The key question that remains unaddressed is whether Nash equilibrium behavior can be reconciled with Pareto-optimal outcomes *without* centralized coordination or private information disclosure.

This paper answers that question affirmatively by identifying risk sensitivity itself as the coordination variable. We show that, for a class of stochastic renewable energy market games, there exists a structured relationship between the operators’ risk parameters and the resulting Nash equilibrium bidding strategies, such that appropriately chosen risk levels induce Nash equilibria that lie on the Pareto frontier. In this sense, risk is not merely a preference parameter but a mechanism through which self-interested agents can be guided toward efficient collective outcomes without violating incentive compatibility. This perspective connects to the mechanism design literature [14], [15]: rather than redesigning the market structure, the utility prescribes risk parameters that act as a voluntary coordination instrument, inducing Pareto-efficient Nash behavior without coercive transfers or centralized side payments.

The key enabler for a distributed implementation is that the Pareto condition depends only on the *aggregate* risk level across operators, not on individual bidding strategies directly. This means coordination reduces to reaching consensus on a single scalar quantity, which can be accomplished through local communication without revealing private information. Building on this insight, we develop a distributed consensus-based algorithm that allows each operator to estimate the required aggregate quantities and set its risk parameter using only neighborhood communication [16], [17]. Analytical results establish existence and explicit characterization of Pareto-optimal Nash equilibria, and convergence of the distributed algorithm is established under a mild connectivity condition. A numerical example illustrates how risk-aware adaptation shifts equilibrium behavior from inefficient Nash outcomes to Pareto-optimal payoffs, and a sensitivity analysis quantifies the performance impact of physical bid constraints.

The remainder of the paper is organized as follows. Section II formulates the stochastic market model and risk-aware objectives. Section III characterizes the Nash equilibrium under fixed risk parameters. Section IV establishes conditions under which Nash equilibria achieve Pareto efficiency through structured risk allocation. Section V presents a distributed algorithm based on consensus to realize these outcomes. Numerical results are provided in Section VI, followed by

concluding remarks in Section VII.

II. PROBLEM FORMULATION

In this paper, we consider the simple case that all traditional generation assets are owned by a single utility company¹ while renewable generation are operated by individual entities (one of which could be the utility company). And, the utility company and the renewable generation operators are the participants in both day-ahead and real-time electricity markets for profit.

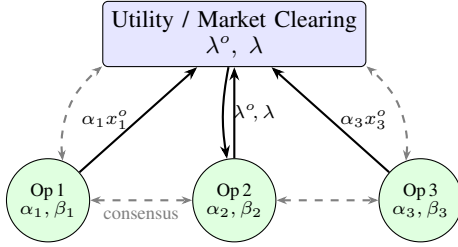


Fig. 1. System and communication structure. Solid: bid submission and price return. Dashed: consensus links for Algorithm 1.

In an electricity market, utility aims to optimize a composite objective function in the form of

$$J(P_g) = a_2 P_g^2 + a_1 P_g + a_0, \quad (1)$$

where a_i are cost coefficients, and P_g is the aggregated power of traditional generation. For simplicity, marginal costs of operating renewables and battery storage sites are modeled as zero, and hence they need not to be included explicitly in objective function (1).

Let Ω be the set of renewable generation operators, with $n = |\Omega|$ being its cardinal. For the day-ahead market, their renewable generations, P_j for $j \in \Omega$, are modeled as stochastic variables, and similarly the grid total load P_L is also modeled as a stochastic variable. Let us form the whole vector of random variables as

$$x = [P_1 \quad \cdots \quad P_n \quad P_L]^T. \quad (2)$$

We assume that probability distribution of random vector x is Gaussian as follows:

$$f(x) = (2\pi)^{-\frac{n+1}{2}} \Sigma^{-\frac{1}{2}} e^{-\frac{1}{2}(x-x^o)^T \Sigma^{-1} (x-x^o)},$$

where $x^o = \mathbb{E}[x]$ is the vector of forecast (for the day-ahead market), and

$$\begin{aligned} \Sigma &= \mathbb{E}[(x - x^o)(x - x^o)^T] \\ &= \begin{bmatrix} \sigma_{11} & \cdots & \sigma_{1n} & \sigma_{1L} \\ \vdots & \cdots & \vdots & \vdots \\ \sigma_{n1} & \cdots & \sigma_{nn} & \sigma_{nL} \\ \sigma_{1L} & \cdots & \sigma_{nL} & \sigma_{LL} \end{bmatrix}, \end{aligned}$$

is the covariance matrix with $\sigma_{ij} = \sigma_{ji}$. In the covariance matrix, the last row and column correspond to covariances

¹The proposed results apply to the general case of multiple utility companies of individual cost functions except for notational complexity.

between the renewable generations and the load while $\sigma_{LL} = \sigma_L^2 > 0$ is the variance of the load. It is known that $\sigma_{ii} = \sigma_i^2 > 0$, $\sigma_{ij} = \rho_{ij}\sigma_i\sigma_j$, $\sigma_{iL} = \rho_{iL}\sigma_i\sigma_L$, where $\rho_{ij}, \rho_{iL} \in [0, 1]$. Typically, $\rho_{ij}, \rho_{iL} \neq 0$ because renewable generations and load are correlated through the projected weather condition.

The Gaussian model is adopted for notational consistency with standard stochastic Cournot frameworks, but the key results of this paper require only that x have finite mean x^o and covariance Σ . The risk penalty $\mathbb{E}[(\lambda - \lambda^o)^2]$ and total profit Π both expand as polynomials in the bidding coefficients with moment-based coefficients determined entirely by x^o and Σ (see (14) and (15)), so Theorems 1–2 and Corollaries 1–5b hold for any joint distribution with finite second moments, including Weibull wind and beta solar distributions common in practice. Gaussianity would be needed only for distributional risk measures beyond variance (e.g., CVaR) or for characterizing higher moments of individual profits, which are deferred to future work.

The day ahead market clears the projected aggregated power generation P_g^o and its associated price λ^o by minimizing $J(P_g^o)$ under the following power balance constraint:

$$P_g^o + \sum_{j=1}^n \alpha_j x_j^o = x_{n+1}^o, \quad (3)$$

where $x_{n+1}^o = P_L^o$, $\alpha_j \in [0, 1]$ if no overbidding is allowed or $\alpha_j \in [0, \infty)$ if overbidding is permitted, and $\alpha_j x_j^o = \alpha_j P_j^o$ represent the bids by the renewable generation operators into the day-ahead market. Similarly, the real-time market clears the aggregated power generation P_g and its associated price λ by minimizing $J(P_g)$ under the following real-time power balance constraint:

$$P_g + \sum_{j=1}^n x_j = x_{n+1}. \quad (4)$$

It is well known that, with global information, day-ahead price λ^o and real-time λ are the dual variables associated with constraints (3) and (4), respectively.

The renewable generation operators aim to maximize the following objectives² individually:

$$J_i = \Pi_i - \beta_i \mathbb{E}[(\lambda - \lambda^o)^2], \quad (5a)$$

where $\beta_i \in \mathbb{R}$,

$$\Pi_i = \lambda^o \alpha_i x_i^o + \mathbb{E}[\lambda(x_i - \alpha_i x_i^o)], \quad (5b)$$

and the pair $\{\alpha_i, \beta_i\}$ represents the bidding strategy of the i -th operator into the electricity markets. Throughout this paper, J_i exclusively denotes the risk-aware objective defined in (5a); the special case $\beta_i = 0$ reduces J_i to pure expected profit maximization and is referred to as the risk-neutral strategy. If $\beta_i = 0$ is chosen, the i -th entity aims to maximize its average profit from the total revenues from participating in the day ahead and real time markets. By selecting $\beta_i > 0$, the i -th

²Strictly speaking, we should use $J'_i = \Pi_i - \beta_i \mathbb{E}[(\Pi_i - \mathbb{E}[\Pi_i])^2]$ which also yields a second-order polynomial in α_i as does (5a) but involves calculations of higher moments. Accordingly, (5a) is adopted instead.

entity also attempts to reduce its profit variation by suppressing variations of real time price λ around day ahead price λ^o . By choosing $\beta_i < 0$, the i th entity tries to maximize its profit by encouraging more variations of real time price λ around day ahead price λ^o . In other words, the i -th entity is risk averse if $\beta_i > 0$ and risk seeking if $\beta_i < 0$.

The objective of this paper is to show the following advantages by introducing the risk aware bidding strategy of $\{\alpha_i, \beta_i\}$: (i) achieving Pareto-optimal Nash equilibria that maximize the total profit $\sum_{i=1}^n \Pi_i$; (ii) enabling distributed implementation without centralized coordination; (iii) maintaining incentive compatibility as firms remain self-interested; and (iv) preserving privacy through minimal information exchange. Power grid congestion is not considered in the paper but can be considered.

III. CENTRALIZED RISK-AWARE SOLUTION UNDER GLOBAL INFORMATION

The electricity markets are bi-level optimization problems linked together by dual variables. At the upper level, they are quadratic optimization problems with equality constraints, that is, the markets perform their economic dispatch with the following Lagrangians:

$$L^o = a_2(P_g^o)^2 + a_1P_g^o + a_0 + \lambda^o \left(x_{n+1}^o - P_g^o - \sum_{j=1}^n \alpha_j x_j^o \right), \quad (6a)$$

$$L = a_2P_g^2 + a_1P_g + a_0 + \lambda \left(x_{n+1} - P_g - \sum_{j=1}^n x_j \right). \quad (6b)$$

Applying the first-order optimality condition to the Lagrangians yields the following solutions for the prices:

$$\lambda^o = 2a_2P_g^o + a_1 = 2a_2 \left(x_{n+1}^o - \sum_{j=1}^n \alpha_j x_j^o \right) + a_1, \quad (7a)$$

$$\lambda = 2a_2P_g + a_1 = 2a_2 \left(x_{n+1} - \sum_{j=1}^n x_j \right) + a_1. \quad (7b)$$

The lower level optimization problems are also quadratic, and the centralized solutions under global information are summarized into the following lemma and theorem. Lemma 1 provides the solution of cooperative optimization when all the entities bind themselves together and act as one. In this case, the best outcome for the group is achieved under the risk neutral strategy.

Lemma 1: Consider the case that all renewable generation entities form a coalition by sharing all the information and setting $\alpha_i = \alpha$ and $\beta_i = \frac{1}{n}\beta$, respectively. Then, for any choice of $\beta \in [-(4a_2)^{-1}, +\infty)$, the optimal bidding strategy to optimize objective function $\sum_i J_i$ with J_i in (5a) is

$$\alpha^* = \frac{1 + 4a_2\beta}{2(1 + 2a_2\beta)}. \quad (8)$$

In addition, by further choosing β_i to optimize $\sum_i \Pi_i$ with Π_i in (5b), the optimal bidding strategy $\{\alpha^*, \beta^*\}$ is given by

$$\alpha^* = \frac{1}{2}, \quad \beta^* = 0. \quad (9)$$

Proof: It follows from (5b) and (7a) that, if $\alpha_i = \alpha$,

$$\begin{aligned} \Pi_r &= \sum_{j=1}^n \Pi_j = \lambda^o \alpha x_r^o + \mathbb{E}[\lambda(x_r - \alpha x_r^o)] \\ \lambda^o &= 2a_2(x_{n+1}^o - \alpha x_r^o) + a_1, \end{aligned}$$

where $x_r = \sum_{j=1}^n x_j$ is the total renewable generation, and $x_r^o = \sum_{j=1}^n x_j^o$. Substituting (7b) into the above equations yields

$$\begin{aligned} \Pi_r &= [2a_2(x_{n+1}^o - \alpha x_r^o) + a_1] \alpha x_r^o \\ &\quad + \mathbb{E}[(2a_2(x_{n+1} - x_r) + a_1)(x_r - \alpha x_r^o)] \\ &= 2a_2\alpha(1 - \alpha)(x_r^o)^2 + a_1x_r^o + 2a_2\mathbb{E}[(x_{n+1}x_r - x_r^2)] \\ &= 2a_2\alpha(1 - \alpha)(x_r^o)^2 + a_1x_r^o \\ &\quad + 2a_2(x_{n+1}^o x_r^o + \sigma_{rL} - (x_r^o)^2 - \sigma_r^2), \end{aligned} \quad (10)$$

where $\mathbf{1}$ is the n -dimensional column vector of 1s and

$$\begin{aligned} \sigma_r^2 &= \mathbb{E}[(x_1 + \dots + x_n - (x_1^o + \dots + x_n^o))^2] \\ &= \mathbb{E}[\mathbf{1}^T(x_r - x_r^o)(x_r - x_r^o)^T \mathbf{1}] \\ &= \mathbf{1}^T \Sigma_r \mathbf{1} = \sum_{i=1}^n \sum_{j=1}^n \sigma_{ij}, \end{aligned}$$

where $x_r = [x_1, \dots, x_n]^T$ is the n -vector of renewable generations and Σ_r is the upper-left $n \times n$ subblock of Σ containing only the renewable-to-renewable covariances σ_{ij} , $i, j \in \{1, \dots, n\}$. On the other hand, it follows from (5a), (7a), and (7b) that, if $\beta_i = \frac{1}{n}\beta$,

$$\begin{aligned} J_r &= \sum_{j \in \Omega} J_j \\ &= \Pi_r - \beta \mathbb{E}[2a_2(x_{n+1} - x_{n+1}^o - x_r + \alpha x_r^o)^2] \\ &= 2a_2\alpha(1 - \alpha)(x_r^o)^2 - 4a_2^2\beta(1 - \alpha)^2(x_r^o)^2 \\ &\quad + a_1x_r^o + 2a_2(x_{n+1}^o x_r^o + \sigma_{rL} - (x_r^o)^2 - \sigma_r^2) \\ &\quad - 4a_2^2\beta(\sigma_L^2 + \sigma_r^2 - 2\sigma_{rL}). \end{aligned}$$

Using the above expression, taking the partial derivative of J_r with respect to α , and setting the partial derivative to zero yield optimal bidding strategy (8).

Substituting solution (8) into (10) and differentiating Π_r with respect to β yields

$$\frac{\partial \Pi_r}{\partial \beta} = -2a_2(x_r^o)^2 \frac{4a_2^2\beta}{(1 + 2a_2\beta)^3},$$

which yields the optimal bidding strategy (9). This completes the proof. $\square$

It follows from (8) that

$$\lim_{\beta \rightarrow -1/(4a_2)} \alpha = 0, \quad \lim_{\beta \rightarrow 0} \alpha = 0.5, \quad \lim_{\beta \rightarrow +\infty} \alpha = 1.$$

Since $\alpha \in [0, 1]$, the design parameter β translates an operator's risk tolerance level into a specific choice of α value.

Although the specific value corresponding to the risk-neutral choice may differ, this translation is applicable to not only cooperative coalition game but also noncooperative games.

The following theorem provides the solution to non-cooperative optimization in which each agent devises its strategy according to its own objective function J_i .

Theorem 1: *For renewable energy generation operators, their oligopoly game always has a Nash equilibrium. Specifically, for any choice of $\beta_i \in [-(4a_2)^{-1}, +\infty)$, the optimal bidding strategy α_i^* to optimize objective J_i in (5a) forms a Nash equilibrium corresponding to the solution to the linear algebraic equation: denoting $\alpha^* = [\alpha_1^* \cdots \alpha_n^*]^T$,*

$$A\alpha^* = B, \quad (11)$$

where $x_r^o = \sum_{j=1}^n x_j^o$, $\eta_i = x_i^o/x_r^o \geq 0$ with $\sum_{i=1}^n \eta_i = 1$, and

$$A = [A_{ij}], \quad A_{ij} = \begin{cases} 2(1 + 2a_2\beta_i)\eta_i & \text{if } i = j \\ (1 + 4a_2\beta_i)\eta_j & \text{if } i \neq j \end{cases},$$

and

$$B = [B_i], \quad B_i = (1 + 4a_2\beta_i).$$

In addition, the total profit $\Pi = \sum_{i=1}^n \Pi_i$ can be maximized by choosing β_j to maximize the following function:

$$g(\alpha^*) = f(\alpha^*)[1 - f(\alpha^*)](x_r^o)^2, \quad (12)$$

where

$$f(\alpha) \triangleq \sum_{i=1}^n \alpha_i \eta_i. \quad (13)$$

Proof: It follows from (5b), (7a), and (7b) that

$$\begin{aligned} \Pi_i &= \left[2a_2 \left(x_{n+1}^o - \sum_{j=1}^n \alpha_j x_j^o \right) + a_1 \right] \alpha_i x_i^o \\ &\quad + \mathbb{E} \left[\left(2a_2 \left(x_{n+1} - \sum_{j=1}^n x_j \right) + a_1 \right) (x_i - \alpha_i x_i^o) \right] \\ &= 2a_2 \sum_{j=1}^n \alpha_i (1 - \alpha_j) x_j^o x_i^o + a_1 x_i^o \\ &\quad + 2a_2 \mathbb{E} \left[\left(x_{n+1} - \sum_{j=1}^n x_j \right) x_i \right] \\ &= 2a_2 \sum_{j=1}^n \alpha_i (1 - \alpha_j) x_j^o x_i^o + a_1 x_i^o \\ &\quad + 2a_2 \left(x_{n+1}^o x_i^o + \sigma_{iL} - \sum_{j=1}^n (x_j^o x_i^o + \sigma_{ij}) \right), \quad (14) \end{aligned}$$

where the identity $\mathbb{E}[x_i x_j] = x_i^o x_j^o + \sigma_{ij}$ is used. On the other hand, it follows from (7a) and (7b) that

$$\begin{aligned} &\mathbb{E}[(\lambda - \lambda^o)^2] \\ &= 4a_2^2 \mathbb{E} \left[\left(x_{n+1} - x_{n+1}^o - \sum_{j=1}^n (x_j - \alpha_j x_j^o) \right)^2 \right] \\ &= 4a_2^2 \left[\sigma_{LL} + 2 \sum_{j=1}^n \sigma_{jL} + 2 \sum_{j=1}^n \sum_{l=1}^n \sigma_{jl} \right. \\ &\quad \left. + \left(\sum_{j=1}^n (1 - \alpha_j) x_j^o \right)^2 \right], \quad (15) \end{aligned}$$

The expression of J_i defined in (5a) becomes explicit in terms of α_i by combining (14) and (15). Taking the partial derivatives of J_i with respect to α_i yields

$$\begin{aligned} \frac{\partial J_i}{\partial \alpha_i} &= 2a_2(1 + 4a_2\beta_i) \sum_{j=1}^n (1 - \alpha_j) x_j^o x_i^o \\ &\quad - 2a_2 \alpha_i (x_i^o)^2, \quad (16a) \end{aligned}$$

$$\frac{\partial^2 J_i}{\partial \alpha_i^2} = -4a_2(1 + 2a_2\beta_i)(x_i^o)^2 < 0 \quad \forall \beta_i \geq -\frac{1}{4a_2}. \quad (16b)$$

Equation (16b) shows that, for each fixed choice of the other players' bids, J_i is strictly concave in α_i . Hence the first-order condition characterizes the unique best response of operator i . Setting (16a) to zero yields

$$(1 + 4a_2\beta_i) \sum_{j=1}^n (1 - \alpha_j) x_j^o - \alpha_i x_i^o = 0, \quad (17)$$

and collecting these best-response equations for all i yields matrix equation (11), whose solution gives the Nash equilibrium.

It follows from (11) that α_i^* are functions of β_j . We know from (14) that

$$\begin{aligned} \Pi &= \sum_i \Pi_i \\ &= 2a_2 \left[g(\alpha) - (x_r^o)^2 + x_{n+1}^o x_r^o \right] + a_1 x_r^o \\ &\quad + 2a_2 \left[\sum_{i=1}^n \sigma_{iL} - \sum_{i=1}^n \sum_{j=1}^n \sigma_{ij} \right], \quad (18) \end{aligned}$$

where

$$g(\alpha) \triangleq \sum_{i=1}^n \alpha_i x_i^o \sum_{j=1}^n (1 - \alpha_j) x_j^o.$$

Hence, Π is maximized if function $g(\cdot)$ is maximized by choosing β_j . Simplifying the above expression of $g(\cdot)$ yields (12). This completes the proof. $\square$

Theorem 1 extends the results in [18] in several ways. First, load uncertainties and correlations among the renewable generations are considered. As a result, we know from (18) that

the degradation of total profit function Π due to uncertainties is

$$\Delta\Pi = 2a_2 \left[\sum_{i=1}^n \sum_{j=1}^n \sigma_{ij} - \sum_{i=1}^n \sigma_{iL} \right],$$

is less as long as there is some correlation (e.g., due to weather) between renewable generation and load variation. Second, risk aware bidding strategies are considered, specifically, theorem 1 allows us to study and compare three classes of bidding strategies: risk neutral, risk adverse, and risk seeking. The latter two correspond to optimization of design parameters β_j .

Theorem 1 shows that the Nash equilibrium in terms of design parameters β_j can be further optimized, and the optimal choices of β_j are the main subject of this paper. To illustrate some of the specifics, let us first consider the two simple cases: $n = 1$ and $n = 2$. And the corresponding results are provided by the subsequent corollaries, followed by the risk neutral strategy for the general case of n operators.

Corollary 1: *If $n = 1$, the optimal coalition (C) bidding strategy becomes the same as that in lemma 1 and with $g^C(\alpha^*) = \frac{1}{4}(x_r^o)^2$.*

Corollary 2: *In the case of duopoly ($n = 2$), the Nash bidding strategies with respect to J_i are:*

$$\alpha_1^* = \frac{(1 + 4a_2\beta_1)}{3 + 4a_2(\beta_1 + \beta_2)}\eta_1^{-1}, \quad (19a)$$

$$\alpha_2^* = \frac{(1 + 4a_2\beta_2)}{3 + 4a_2(\beta_1 + \beta_2)}\eta_2^{-1}, \quad (19b)$$

Furthermore, β_i can be optimized with respect to $(\Pi_1 + \Pi_2)$, and the outcomes are strategically dependent as follows.

- Risk neutral (RN) optimal bidding strategy is $\beta_i^{NR} = 0$ for $i = 1, 2$; and the corresponding optimized profit is:

$$g^{RN}(\alpha_1^*, \alpha_2^*) = \frac{2}{9}(x_r^o)^2. \quad (20)$$

- Risk seeking (RS) optimal bidding strategy and the corresponding enhanced optimal profit are:

$$\beta_1^{RS} + \beta_2^{RS} = -\frac{1}{4a_2}, \quad (21a)$$

$$g^{RS}(\alpha_1^*, \alpha_2^*) = \frac{1}{4}(x_r^o)^2 = g^C(\alpha^*) > g^{RN}(\alpha_1^*, \alpha_2^*). \quad (21b)$$

Proof: It follows from (11) that

$$\begin{aligned} & \begin{bmatrix} 2(1 + 2a_2\beta_1)\eta_1 & (1 + 4a_2\beta_1)\eta_2 \\ (1 + 4a_2\beta_2)\eta_1 & 2(1 + 2a_2\beta_2)\eta_2 \end{bmatrix} \begin{bmatrix} \alpha_1^* \\ \alpha_2^* \end{bmatrix} \\ &= \begin{bmatrix} (1 + 4a_2\beta_1) \\ (1 + 4a_2\beta_2) \end{bmatrix}, \end{aligned}$$

whose solution is given by (19).

It follows from (19) that, when $\beta_i = 0$,

$$\alpha_1^* = \frac{1}{3}\eta_1^{-1}, \quad \alpha_2^* = \frac{1}{3}\eta_2^{-1}.$$

Substituting the above solutions into (13) and (12) yields (20).

To further optimize the risk-aware bidding strategy (19), we rewrite the solution as

$$\alpha_1^* = \theta_1\eta_1^{-1}, \quad \alpha_2^* = \theta_2\eta_2^{-1},$$

where

$$\theta_i = \frac{(1 + 4a_2\beta_i)}{3 + 4a_2(\beta_1 + \beta_2)}. \quad (22)$$

It follows from (13) and (12) that

$$g(\alpha_1^*, \alpha_2^*) = (\theta_1 + \theta_2)[1 - (\theta_1 + \theta_2)](x_r^o)^2,$$

which is maximized to be that in (21b) if

$$\theta_1 + \theta_2 = \frac{1}{2}.$$

Invoking (22) and solving for the optimal values of β_i yields β_i^{RS} in (21a). This completes the proof. $\square$

Corollary 3: *In the general case of $n > 2$, the optimal risk-neutral bidding strategy is*

$$\alpha_i^* = \frac{1}{n+1}\eta_i^{-1}, \quad (23)$$

and the total profit Π in (18) is optimized with

$$g^{RN}(\alpha^*) = \frac{n}{(n+1)^2}(x_r^o)^2.$$

Proof: When $\beta_i = 0$, the matrix equation (11) reduces to

$$[\text{diag}\{\eta_1, \dots, \eta_n\} + \mathbf{1}\eta^T] \alpha = \mathbf{1},$$

where $\eta = [\eta_1 \ \dots \ \eta_n]^T$ and $\mathbf{1} = [1 \ \dots \ 1]^T$. It is simple to verify that the solution is given by (23). And, the corresponding total profit can be calculated in terms of (12) and (13). $\square$

Corollary 3 provides a closed-form Nash solution to the risk-neutral bidding problem, and the solution implicitly assumes that overbidding (that is, $\alpha_i^* > 1$ for some i) is allowed. Physically, operator i is overbidding if it commits to deliver more power than its forecast capacity x_i^o into the day-ahead market, exposing itself to shortfall real-time. It follows that Nash strategy (23) renders no overbidding if and only if

$$\eta_i \geq \frac{1}{n+1} \quad \forall i.$$

Since $\sum_i \eta_i = 1$, we know that

$$\min_i \eta_i \leq \frac{1}{n}.$$

Therefore, Nash strategy (23) does not produce overbidding if

$$\min_i \eta_i \in \left[\frac{1}{n+1}, \frac{1}{n} \right], \quad \max_i \eta_i \leq \frac{2}{n+1}, \quad (24)$$

which implies that the maximum capacity difference among the renewable operators is limited to $1/(n+1)$. Should overbidding be forbidden while condition (24) fail, the bidding strategy is given by the following corollary instead of corollary 3.

Corollary 4: *In the case that overbidding is not permitted, the optimal risk-neutral bidding strategy is*

$$\alpha_i^* = \begin{cases} \frac{1}{n+1-|\Omega_{\text{RN}}|} \eta_i^{-1} \sum_{l \notin \Omega_{\text{RN}}} \eta_l & i \notin \Omega_{\text{RN}} \\ 1 & i \in \Omega_{\text{RN}} \end{cases} \quad (25)$$

where Ω_{RN} is the set of operators who are constrained to overbid, $|\Omega_{\text{RN}}|$ denotes its cardinality, and

$$\Omega_{\text{RN}} = \left\{ j \in \Omega : \eta_j < \frac{1}{n+1} \right\}.$$

Furthermore, the total profit Π in (18) is optimized with

$$g^{\text{RN}}(\alpha^*) = \frac{\sum_{j \notin \Omega_{\text{RN}}} \eta_j}{(n+1-|\Omega_{\text{RN}}|)^2} \left[n - |\Omega_{\text{RN}}| + \sum_{j \in \Omega_{\text{RN}}} \eta_j \right] (x_r^o)^2.$$

Tommy: if you implement (25), some of α_i^* could still be greater than 1. For instance, $n = 10$, $|\Omega_{\text{RN}}| = 5$, and $\eta_i < 1$ for $i \in \Omega_{\text{RN}}$. Then, $\eta_j = 1/12$ yields overbidding.

Proof: For $i \notin \Omega_{\text{RN}}$, it follows from (17) that, with $\beta_i = 0$,

$$\sum_{j=1}^n (1 - \alpha_j) \eta_j - \alpha_i \eta_i = 0.$$

Since $\alpha_j = 1$ for $j \in \Omega_{\text{RN}}$, the above equation becomes

$$\sum_{j \notin \Omega_{\text{RN}}} \alpha_j \eta_j + \alpha_i \eta_i = 1 - \sum_{j \in \Omega_{\text{RN}}} \eta_j = \sum_{l \notin \Omega_{\text{RN}}} \eta_l, \quad \forall i \notin \Omega_{\text{RN}}.$$

Solving these equations yields (25). Next, it follows from (13) that

$$\begin{aligned} f(\alpha^*) &= \sum_{i \notin \Omega_{\text{RN}}} \alpha_i \eta_i + \sum_{j \in \Omega_{\text{RN}}} \eta_j \\ &= \frac{n - |\Omega_{\text{RN}}|}{n + 1 - |\Omega_{\text{RN}}|} + \frac{1}{n + 1 - |\Omega_{\text{RN}}|} \sum_{j \in \Omega_{\text{RN}}} \eta_j, \end{aligned}$$

and

$$g(\alpha^*) = f(\alpha^*) [1 - f(\alpha^*)] (x_r^o)^2,$$

which gives the result in the statement. $\square$

The significant outcome of theorem 1 and its corollaries is that, while the total profit under noncooperative risk neutral Nash equilibrium is typically worse than that of cooperative coalition solution, risk aware Nash strategies could be employed to recover the same profit as the cooperative coalition's. Indeed, corollary 2 provides an infinite number of combinations in risk tolerance levels as long as the aggregate risk tolerance of $(\beta_1 + \beta_2)$ assumes an optimal risk seeking value. In the next section, this result is extended to a centralized solution to the general case of n market participants.

IV. RISK AWARE NASH SOLUTIONS WITH PARETO PAYOFF

The results in Section III establish that, for any fixed choice of the risk parameters $\{\beta_i\}_{i=1}^n$, the noncooperative bidding game among renewable generators admits a unique Nash equilibrium in terms of the bidding coefficients $\{\alpha_i^*\}_{i=1}^n$. However, the resulting Nash equilibrium is generally not Pareto optimal with respect to the total expected profit, and

there are an infinite number choices of risk tolerance level choices that yield the same Pareto solution. In this section, we show that the Nash equilibrium can be systematically shifted to a Pareto-optimal operating point by appropriately selecting the risk parameters $\{\beta_i\}$. Importantly, this Pareto enhancement does not require coordination on the bidding variables α_i themselves, but only on the aggregate risk exposure across agents.

Theorem 2: *There exists a family of risk tolerance levels in $\beta = [\beta_1 \dots \beta_n]^T$ such that the corresponding Nash equilibrium $\alpha^* = [\alpha_1^* \dots \alpha_n^*]^T$ satisfying (11) achieves the maximum aggregate profit:*

$$g^{\text{RS}}(\alpha^*) = \frac{1}{4} (x_r^o)^2 \triangleq g^{\text{max}},$$

where $\alpha^*(\beta)$ denote the corresponding Nash equilibrium strategies. Specifically, any admissible set of risk tolerance levels satisfying

$$f(\alpha^*(\beta)) = \frac{1}{2}, \quad (26)$$

will result in a Pareto-optimal Nash equilibrium. Furthermore, the Pareto optimal total profit is reached if and only if the aggregate risk tolerance satisfies the following condition:

$$\sum_{i=1}^n \beta_i = \frac{1-n}{4a_2}, \quad (27)$$

and the corresponding bidding strategy is

$$\alpha_i^* = \frac{1}{2} (1 + 4a_2 \beta_i) \eta_i^{-1}. \quad (28)$$

Proof: Define the mapping $\Phi : \mathbb{R}^n \rightarrow \mathbb{R}$ as

$$\Phi(\beta) = f(\alpha^*(\beta)),$$

where $\alpha^*(\beta)$ denotes the Nash equilibrium solution of (11). It follows from (11) that $\Phi(\cdot)$ is continuous. To establish existence, we show that $\Phi(\cdot)$ attains values below and above $\frac{1}{2}$:

- It follows from (17) that, as $\beta_i \rightarrow -\frac{1}{4a_2}$ for all i , $\alpha_i^* \rightarrow 0$ and hence $\Phi(\beta) \rightarrow 0 < \frac{1}{2}$.
- It follows from corollary 3 that, when $\beta_i = 0$ for all i , $\alpha_i^* = \frac{1}{n+1} \eta_i^{-1}$ and consequently $\Phi(\mathbf{0}) = f(\alpha^*(\mathbf{0})) = \frac{n}{n+1} > \frac{1}{2}$ for $n \geq 2$.

Therefore, by continuity of $\Phi(\cdot)$ and the intermediate value theorem [19], there exists β^* such that $\Phi(\beta^*) = \frac{1}{2}$, achieving $g = g^{\text{max}}$.

Dividing both sides of (17) by x_r^o and using $\eta_i = x_i^o/x_r^o$ and $\sum_j (1 - \alpha_j^*) x_j^o/x_r^o = 1 - \sum_j \alpha_j^* \eta_j = 1 - f(\alpha^*)$, it follows that, at the Nash equilibrium,

$$\alpha_i^* \eta_i = (1 + 4a_2 \beta_i) (1 - f(\alpha^*)). \quad (29)$$

Summing both sides over all i yields

$$f(\alpha^*) = (1 - f(\alpha^*)) \left(n + 4a_2 \sum_{i=1}^n \beta_i \right),$$

which renders the following result:

$$f(\alpha^*) = \frac{n + 4a_2 \sum_{i=1}^n \beta_i}{1 + n + 4a_2 \sum_{i=1}^n \beta_i}.$$

Therefore, we know that the Pareto optimality condition (26) holds if and only if

$$n + 4a_2 \sum_{i=1}^n \beta_i = 1,$$

which yields (27). Substituting the results in (27) and (26) into (29) yields the bidding strategy (28). $\square$

Under the symmetric ERS allocation of Corollary 5a, every operator strictly prefers the Pareto-optimal Nash equilibrium to the risk-neutral Nash equilibrium. From (14), the deterministic profit of operator i satisfies $\Pi_i = 2a_2 \alpha_i (1 - f)(x_r^o)^2 \eta_i + a_1 x_i^o + C_i$, where C_i collects stochastic terms identical across strategies. Under ERS,

$$\alpha_i^{RS} (1 - f^{RS}) = \frac{1}{2n} \eta_i^{-1} \cdot \frac{1}{2} = \frac{1}{4n} \eta_i^{-1};$$

under risk-neutral Nash,

$$\alpha_i^{RN} (1 - f^{RN}) = \frac{1}{n+1} \eta_i^{-1} \cdot \frac{1}{n+1} = \frac{1}{(n+1)^2} \eta_i^{-1}.$$

Hence

$$\Pi_i^{RS} - \Pi_i^{RN} = 2a_2 \left[\frac{1}{4n} - \frac{1}{(n+1)^2} \right] (x_r^o)^2 > 0 \quad \forall n \geq 2,$$

since $(n+1)^2 - 4n = (n-1)^2 > 0$. All operators gain equally from moving to the Pareto equilibrium, confirming that the proposed coordination mechanism is individually rational. Whether the ERS allocation also forms a Nash equilibrium in the β -parameter space (i.e., no operator benefits from unilateral deviation of β_i) is deferred to future work.

The Pareto optimal condition (26) is a constraint only on the aggregate risk tolerance level; therefore, infinitely many heterogeneous risk allocations $\{\beta_i\}$ yield Pareto-optimal Nash equilibria. If there is only one renewable generator ($n = 1$ or one coalition of all the operators), condition (27) reduces to $\beta_1 = 0$, which confirms, as in corollary 1, that, in the absence of competition, risk-seeking or risk-averse behavior provides no strategic advantage. In the case of duopoly, condition (27) reduces to (21a) in corollary 2. As the number of renewable operators increases, the aggregate risk tolerance $\sum_{i=1}^n \beta_i$ decreases monotonically. In the limit of $n \rightarrow \infty$, it is better to restate condition (27) on a per-agent basis, that is,

$$\frac{1}{n} \sum_{i=1}^n \beta_i = \frac{1-n}{4a_2 n} = -\frac{1}{4a_2} + \frac{1}{4a_2 n} \rightarrow -\frac{1}{4a_2} \text{ as } n \rightarrow \infty,$$

which coincides with the lower bound on β_i as stated in theorem 1. This means that, as the number of renewable operators grows, Pareto optimality forces the *average* risk tolerance level to approach its feasibility lower bound from above. In the large-population limit, aggregate optimal performance is therefore achieved when the collective risk tolerance reaches its lower bound. This reveals an emergent mean-field structure: rather than requiring coordination of individual bidding strategies, Pareto efficiency is recovered through convergence of

the aggregate risk profile to its lower limit. This connection is reminiscent of mean-field game theory [20], [21], in which the strategic interactions of a large population of agents can often be characterized through a single aggregate quantity. Here the average risk tolerance $\frac{1}{n} \sum_i \beta_i$ plays the role of the mean-field state, and Pareto efficiency emerges as this quantity converges to a well-defined limit, without requiring direct coordination of individual bids. Exploring this connection formally—including rigorous mean-field limits and equilibrium uniqueness—is a promising direction for future work.

Should all the renewable entities adopt the same risk tolerance level, constraint (27) is satisfied by choosing

$$\beta_i = \beta_0, \quad \beta_0 = \frac{1-n}{4a_2 n}; \quad \forall i \in \{1, \dots, n\}. \quad (30)$$

Alternatively, we can choose

$$\beta_i = \eta_i \beta_0, \quad \beta_0 = \frac{1-n}{4a_2}; \quad \forall i \in \{1, \dots, n\},$$

under which

$$\alpha_i^* = \frac{1}{2} (1 + (1-n)\eta_i) \eta_i^{-1} =$$

Is this choice better to avoid overbidding?

Note that all the entities employing a common risk seeking level is a fair policy enforceable by the utility and is also supported by the Nash equilibria formed by all the operators. In this special case, theorem 2 reduces to the following corollary. It should be noted that, when implementing equal risk seeking strategy (31) or (33), the renewable operators do not need to know the value of parameter a_2 even though an explicit calculation of equal risk tolerance level in (30) requires the knowledge of a_2 .

Corollary 5 (Equal Risk-Seeking Bidding Strategies): *Under ERS (30), substituting $\beta_i = \beta_0$ into (28) gives*

(a) Unconstrained ERS. *The optimal unconstrained bidding strategy is*

$$\alpha_i^* = \frac{1}{2n} \eta_i^{-1}, \quad (31)$$

and the total profit Π in (18) is maximized with $g^{ERS}(\alpha^) = \frac{1}{4} (x_r^o)^2 = g^{\max}$.*

(b) Constrained ERS with fixed β_0 (clamped bids). *If overbidding is not permitted and operators retain $\beta_i = \beta_0$, let*

$$\Omega_{ERS} = \left\{ j \in \Omega : \eta_j < \frac{1}{2n} \right\} \quad (32)$$

denote the ERS saturation set with $|\Omega_{ERS}|$ its cardinality. The constrained bidding strategy is

$$\alpha_i^* = \begin{cases} \frac{n(1 - \sum_{j \in \Omega_{ERS}} \eta_j)}{(2n - |\Omega_{ERS}|) \eta_i} & i \notin \Omega_{ERS}, \\ 1 & i \in \Omega_{ERS}, \end{cases} \quad (33)$$

and the total profit Π in (18) satisfies

$$g^{ERS}(\alpha^*) = \frac{1}{(2n - |\Omega_{ERS}|)^2} [n - |\Omega_{ERS}| + (2n - |\Omega_{ERS}|) \sum_{j \in \Omega_{ERS}} \eta_j] \times \left[1 - \sum_{j \in \Omega_{ERS}} \eta_j \right] (x_r^o)^2, \quad (34)$$

with $f(\alpha^*) \leq \frac{1}{2}$, so $g^{ERS}(\alpha^*) \leq g^{\max}$ in general.

Proof: Part (a) follows from Theorem 2 with $\beta_i = \beta_0 = (1 - n)/(4a_2n)$ for all i . Substituting into (28) gives $1 + 4a_2\beta_0 = 1/n$, and hence $\alpha_i^* = \frac{1}{2n}\eta_i^{-1}$. It follows that $f(\alpha^*) = \frac{1}{2n} \sum_i 1 = \frac{1}{2}$, confirming $g^{ERS}(\alpha^*) = \frac{1}{4}(x_r^o)^2 = g^{\max}$ via (12).

For part (b), it follows from (17) that, with $\beta_i = \beta_0$ for all i , $\frac{1}{n} \sum_{j=1}^n (1 - \alpha_j^*)\eta_j = \alpha_i^*\eta_i$. Since $\alpha_j^* = 1$ for $j \in \Omega_{ERS}$, this becomes

$$\frac{1}{n} \sum_{j \notin \Omega_{ERS}} \alpha_j^*\eta_j + \alpha_i^*\eta_i = \frac{1 - \sum_{j \in \Omega_{ERS}} \eta_j}{n}, \quad \forall i \notin \Omega_{ERS}.$$

Solving these equations yields (33). It then follows from (13) that

$$f(\alpha^*) = \frac{n - |\Omega_{ERS}|}{2n - |\Omega_{ERS}|} \left(1 - \sum_{j \in \Omega_{ERS}} \eta_j \right) + \sum_{j \in \Omega_{ERS}} \eta_j,$$

and $g^{ERS}(\alpha^*) = f(\alpha^*)[1 - f(\alpha^*)](x_r^o)^2$, which gives (34). $\square$

Verification that Corollary 5b reduces to Corollary 5a (no overbidding).

Assume that no overbidding occurs under the ERS solution. Then the unconstrained solution satisfies $\alpha_i^* \leq 1$ for all i , and hence no agents are clamped. Therefore,

$$\Omega_{ERS} = \emptyset, \quad |\Omega_{ERS}| = 0.$$

From Corollary 5b, for $i \notin \Omega_{ERS}$,

$$\alpha_i^* = \frac{n \left(1 - \sum_{j \in \Omega_{ERS}} \eta_j \right)}{(2n - |\Omega_{ERS}|) \eta_i}.$$

Substituting $\Omega_{ERS} = \emptyset$ gives

$$\sum_{j \in \Omega_{ERS}} \eta_j = 0, \quad |\Omega_{ERS}| = 0,$$

and hence

$$\alpha_i^* = \frac{n(1 - 0)}{(2n - 0) \eta_i} = \frac{n}{2n \eta_i} = \frac{1}{2n} \eta_i^{-1}.$$

This coincides exactly with the unconstrained ERS solution in Corollary 5a:

$$\alpha_i^* = \frac{1}{2n} \eta_i^{-1}.$$

Therefore, Corollary 5b reduces to Corollary 5a when $\Omega_{ERS} = \emptyset$, i.e., when no overbidding constraint is active.

Remark 1. When the no-overbidding constraint is active but the Pareto condition $f(\alpha^*) = \frac{1}{2}$ is additionally required, the common risk parameter must be re-optimized to

$$\beta^{t*} = \frac{1}{4} \left(\frac{1 - 2 \sum_{j \in \Omega_{ERS}} \eta_j}{n - |\Omega_{ERS}|} - 1 \right), \quad (35)$$

valid provided the resulting α^* does not expand Ω_{ERS} beyond the set assumed in its construction. This restores $g^{ERS}(\alpha^*) = g^{\max}$ with no efficiency penalty, and is the case illustrated in Scenario 2 of Section VI-C. The derivation follows by substituting (33) into $f(\alpha^*) = \frac{1}{2}$ and solving for β^{t*} .

In what follows, the Pareto-optimal bidding strategy is cast into a distributed optimization algorithm so that *minimum* information sharing is needed and privacy is protected.

V. DISTRIBUTED RISK AWARE SOLUTIONS

It follows from (18), theorem 1, theorem 2 and corollary 5a that the Pareto optimal total profit

$$\Pi^{\max} = 2a_2 \left[x_{n+1}^o - \frac{3}{4} x_r^o \right] x_r^o + a_1 x_r^o + 2a_2 \left[\sum_{i=1}^n \sigma_{iL} - \sum_{i=1}^n \sum_{j=1}^n \sigma_{ij} \right],$$

is reached provided that the renewable operators use bidding strategy (31). Direct implementation of (31) by the i th operator requires the following information:

- The total of renewable operators participating in the markets, n , which could be either fixed or changing;
- The percentage of renewable generation contributed by the i th operator with respect to the total renewable generation, η_i .

In what follows, n and η_i are determined distributively and iteratively, based on the following lemma [22].

Lemma 2: Consider m agents which employ the following consensus protocol:

$$z_i(k+1) = z_i(k) + \epsilon_i \sum_{j \in \mathcal{N}_i} [z_j(k) - z_i(k)],$$

where $\mathcal{N}_i$ denotes the set of neighbors of the i th agent, and $\epsilon_i > 0$ is the consensus gain satisfying $\epsilon_i < \frac{1}{\max_i |\mathcal{N}_i|}$. Then, as long as the communication topology is connected, the consensus is reached in the sense that

$$\lim_{k \rightarrow \infty} z_i(k) = \frac{1}{m} \sum_{j=1}^m z_j(0), \quad \forall i.$$

The proposed distributed algorithm is given by Algorithm 1. Since every participating renewable operator must communicate with the utility, the communication topology among all the participating operators and the utility is guaranteed to be connected. It follows from Lemma 2, initial conditions $\xi_i(0)$ and $\psi_i(0)$, and protocols (36) and (37) that $\xi_i(k) \rightarrow \frac{1}{n+1}$ and $\psi_i(k) \rightarrow \frac{1}{n+1} x_r^o$. Therefore, the estimate of n , η_i and β_i' can be computed distributively. There is no explicit sharing of private information, and required information is generated through diffusion of the consensus protocols (36) and (37).

Algorithm 1 Distributed Risk-Aware Nash Optimization**Require:**

- 1: • Utility: $\xi_{n+1}(0) = 1$, and $\psi_{n+1}(0) = 0$;
- A participating operator: $\xi_i(0) = 0$, and $\psi_i(0) = x_i^o$.
- A non-participating operator: no sharing or communication
- Convergence threshold: $0 < c \ll 1$.

Ensure: Optimal bid α_i^* for each participating operator i

- 2: Operator i (with $i = 1, \dots, (n+1)$) employs the following distributed **consensus protocols**:

$$\xi_i(k+1) = \xi_i(k) + \epsilon_i \sum_{j \in \mathcal{N}_i} [\xi_j(k) - \xi_i(k)], \quad (36)$$

and

$$\psi_i(k+1) = \psi_i(k) + \epsilon_i \sum_{j \in \mathcal{N}_i} [\psi_j(k) - \psi_i(k)]. \quad (37)$$

- 3: **Once** $\|\xi_i(k) - \xi_i(k-1)\| \leq c$ and $\|\psi_i(k) - \psi_i(k-1)\| \leq c$, operator i locally computes:

- $\hat{n}_i = \frac{1}{\xi_i(k)} - 1$
- $\eta_i = \frac{x_i^o \xi_i(k)}{\psi_i(k)}$
- $\beta'_i = \frac{1 - \hat{n}_i}{4\hat{n}_i}$

- 4: **if** $\eta_i < \frac{1}{2\hat{n}_i}$ **then** $\triangleright$ operator i saturates — Corollary 5b

- 5: Set $\alpha_i^* \leftarrow 1$; seed $\phi_i(0) \leftarrow \eta_i$. Unsaturated operators seed $\phi_j(0) \leftarrow 0$.

- 6: All agents run: $\phi_i(k+1) = \phi_i(k) + \epsilon_i \sum_{j \in \mathcal{N}_i} [\phi_j(k) - \phi_i(k)]$; once converged, recover $\hat{S} = \phi_i^\infty / \xi_i^\infty$, $|\hat{\Omega}|$ known locally.

- 7: Each $j \notin \Omega_{\text{ERS}}$ submits: $\alpha_j^* \leftarrow \frac{\hat{n}_j (1 - \hat{S})}{(2\hat{n}_j - |\hat{\Omega}|) \eta_j}$

- 8: **else** $\triangleright$ no saturation — Pareto bid

- 9: Submit $\alpha_i^* \leftarrow \frac{1 + 4\beta'_i}{2\eta_i}$

- 10: **end if**

Algorithm 1 operates over an *undirected, static* communication graph in which every renewable operator maintains a direct link with the utility, forming a star topology $K_{1,n}$. This structure guarantees connectivity for any $n \geq 1$: since every operator communicates with the utility, the graph is connected by construction and requires no additional peer-to-peer links. The analysis assumes synchronous updates and lossless communication links. Robustness to asynchronous operation, link failures, and dynamic operator participation are important extensions beyond the scope of this paper and are noted as future work.

The consensus protocols (36)–(37) converge geometrically at a rate determined by the algebraic connectivity $\lambda_2(L)$, the second-smallest eigenvalue of the graph Laplacian L . By Theorem 3.3 of [22], the convergence error satisfies $\|z(k) - z^\infty \mathbf{1}\| \leq (1 - \epsilon \lambda_2)^k \|z(0) - z^\infty \mathbf{1}\|$, so the number of iterations to reach ϵ -accuracy scales as $O(\log(1/\epsilon)/\lambda_2)$. For the star graph $K_{1,n}$, the Laplacian eigenvalues are 0, 1 (with multiplicity $n - 1$), and $n + 1$ (with multiplicity 1),

giving $\lambda_2 = 1$ independently of n . Consequently, Algorithm 1 converges at a rate that does not degrade as the number of operators increases, making it well-suited for large-scale markets. With step size $\epsilon < 1/n$, the per-iteration contraction factor is $\rho = 1 - \epsilon < 1$. The same convergence guarantee applies to the ϕ consensus in the constrained branch, which runs over the same star graph at the same geometric rate.

VI. ILLUSTRATIVE EXAMPLE

To demonstrate the proposed analytical and algorithmic results, a three-operator case study is used in which both the centralized solution and the distributed solution are computed and compared across multiple scenarios.

A. Power System Setup

TABLE I
EXAMPLE PARAMETERS

Parameter	Value
n	3
a_2	0.1
a_1	1
a_0	0
x_1^o	120
x_2^o	100
x_3^o	80
x_L^o	400

Consider the day-ahead/real-time electricity markets with three renewable generation operators $i \in \{1, 2, 3\}$ and one conventional generation aggregator. The system parameter settings are provided in Table I. It follows that the objective function is

$$J(P_g) = 0.1P_g^2 + P_g$$

and the day-ahead forecasts be x_1^o, x_2^o, x_3^o for the renewable and $x_4^o = P_L^o$ for the load. Real-time realizations are $x_i \sim \mathcal{N}(x_i^o, \sigma_i^2)$, with individual standard deviations $\sigma_1 = 12$ MW, $\sigma_2 = 10$ MW, $\sigma_3 = 8$ MW (approximately 10% of each forecast), load uncertainty $\sigma_L = 20$ MW, cross-correlation $\rho_{ij} = 0.3$ among renewable operators, and $\rho_{iL} = 0.2$ between each renewable and the load. As seen from (18), the stochastic terms enter Π only as the constant offset $\Delta\Pi = 2a_2[\sum_i \sigma_{iL} - \sum_{i,j} \sigma_{ij}]$, which is identical across all strategies and does not affect the optimization over α_i or β_i . Hence, all optimal bidding strategies and the strategic comparisons reported below are independent of the uncertainty parameters; the profit values in Table II reflect the deterministic component.

B. Analytical and Centralized Nash Solutions

Given table I, renewable operator can choose one of the following strategies:

- Coalition bidding strategy (8)

- the Pareto-optimal Nash strategy (11), that is

$$\alpha_1^* = \frac{(1 + 4a_2\beta_1)\eta_1^{-1}}{4(1 + a_2(\beta_1 + \beta_2 + \beta_3))}, \quad (38a)$$

$$\alpha_2^* = \frac{(1 + 4a_2\beta_2)\eta_2^{-1}}{4(1 + a_2(\beta_1 + \beta_2 + \beta_3))}, \quad (38b)$$

$$\alpha_3^* = \frac{(1 + 4a_2\beta_3)\eta_3^{-1}}{4(1 + a_2(\beta_1 + \beta_2 + \beta_3))}. \quad (38c)$$

Under the coalition strategy of Lemma 1, all operators cooperate and bid $\alpha^* = \frac{1}{2}$ with $\beta^* = 0$, yielding $f = \frac{1}{2}$, $g^C = 22,500 \text{ MW}^2$, and total profit $\Pi^C = 10,800 \text{ \$/hr}$. This serves as the upper benchmark for collective profit.

It follows from (38) that the risk-neutral Nash bidding strategies are $\alpha^* = (\alpha_1^*, \alpha_2^*, \alpha_3^*) = (0.625, 0.75, 0.9375)$, resulting in $f(\alpha^*) = 0.75$, $g(\alpha^*) = 16,875 \text{ MW}^2$, and total profit $\Pi^{RN} = 9,675 \text{ \$/hr}$, which is 10.42% below the coalition benchmark.

On the other hand, risk-seeking Pareto-optimal Nash bidding strategies are also given by (38), in which each operator may choose different β_i as long as constraint (27) is satisfied. Choices of β_i are illustrated in Figure 2. If all renewable operators agree to have the same risk tolerance level, we know from (27) that $\beta_i^* = -\frac{5}{3} \approx -1.667$ (equivalently $\beta_i'^* = a_2\beta_i^* = -\frac{1}{6}$), which yields $\alpha^* = (0.4167, 0.5000, 0.6250)$, resulting in $f(\alpha^*) = 0.5$, $g(\alpha^*) = 22,500 \text{ MW}^2$, and total profit $\Pi^{RS} = 10,800 \text{ \$/hr}$, fully recovering the coalition benchmark.

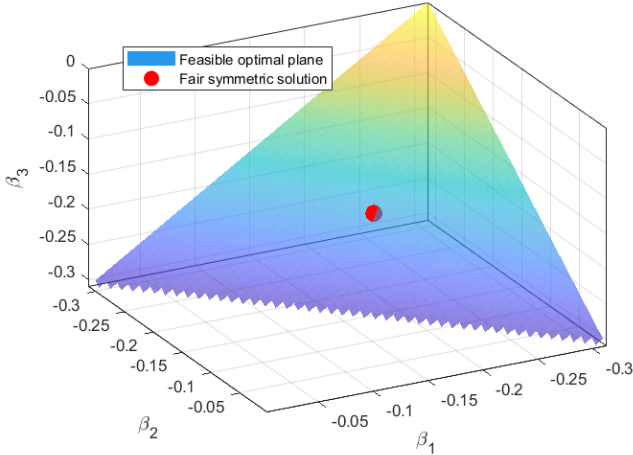


Fig. 2. Feasible risk-seeking Pareto allocations for the example ($n = 3$).

Table II and Figures 3–4 summarize the performance of all four strategies. The risk-neutral Nash equilibrium incurs a 10.42% profit loss relative to the coalition, while the risk-seeking Pareto-optimal Nash equilibrium fully recovers the coalition-level profit through risk coordination alone, without any change in the game structure. The distributed Algorithm 1 exactly reproduces the centralized Pareto-optimal result: each

operator independently estimates $\hat{n}_i = 3$ and $\hat{x}_r^o = 300 \text{ MW}$ from the consensus protocols, computes $\beta_i' = -\frac{1}{6}$, and submits the same bids and achieves the same profit as the centralized symmetric Pareto case.

TABLE II
PERFORMANCE COMPARISON OF BIDDING STRATEGIES ($n = 3$)

Strategy	α^*	f	$g (\text{MW}^2)$	$\sum_i \Pi_i (\text{\$/hr})$
Coalition	(0.50, 0.50, 0.50)	0.50	22,500	10,800
RN Nash	(0.63, 0.75, 0.94)	0.75	16,875	9,675
RS Pareto Nash	(0.42, 0.50, 0.63)	0.50	22,500	10,800
Algo. 1 (Dist.)	(0.42, 0.50, 0.63)	0.50	22,500	10,800

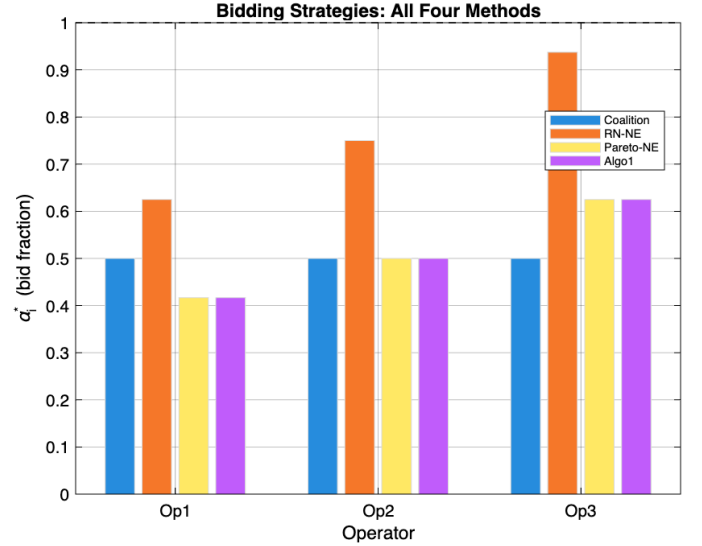


Fig. 3. Bidding strategies α_i^* for all four strategies.

Figure 3 shows that the risk-neutral Nash bids are noticeably more aggressive — particularly for Op 3, whose small capacity share ($\eta_3 = 0.267$) drives α_3^* close to 1. Risk-seeking Pareto coordination uniformly lowers and rebalances the bids toward the coalition optimum, with Algorithm 1 exactly reproducing the centralized result.

Figure 4 confirms that the profit improvement under Pareto coordination is shared across all operators: each Π_i rises relative to the risk-neutral Nash case, so the move from RN to RS is a Pareto improvement in the game-theoretic sense — no operator is made worse off by adopting the risk-seeking strategy. Figure 5 further shows the per-unit perspective: under risk-neutral Nash, the smaller Op 3 earns less per MW of installed capacity, while Pareto coordination through risk-seeking restores equal per-unit returns.

C. Heterogeneous Pareto Risk Allocations

Theorem 2 states that any β satisfying $\sum_i \beta_i' = (1 - n)/4$ achieves Pareto optimality, yielding infinitely many valid heterogeneous allocations. Figure 6 illustrates three such allocations for the base parameters:

- **Symmetric ERS:** $\beta_i' = -\frac{1}{6}$ for all i (Corollary 5a). Bids are $\alpha^* = (0.417, 0.500, 0.625)$, $f = 0.5$, $g = g^{\max}$.

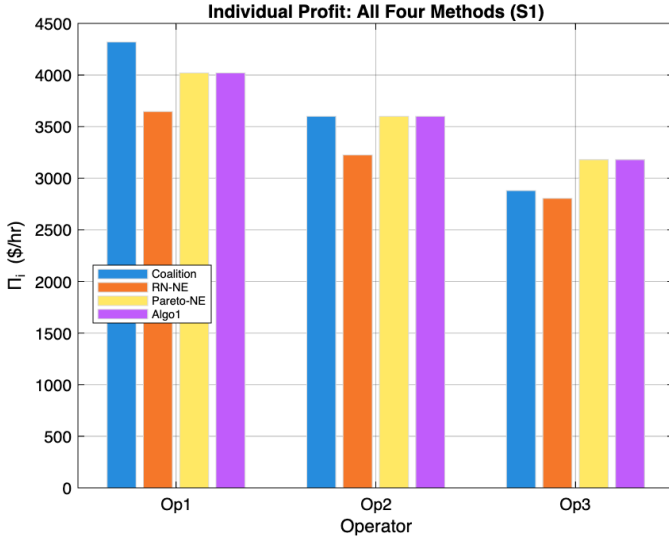


Fig. 4. Individual profits Π_i for all four strategies (Scenario 1).

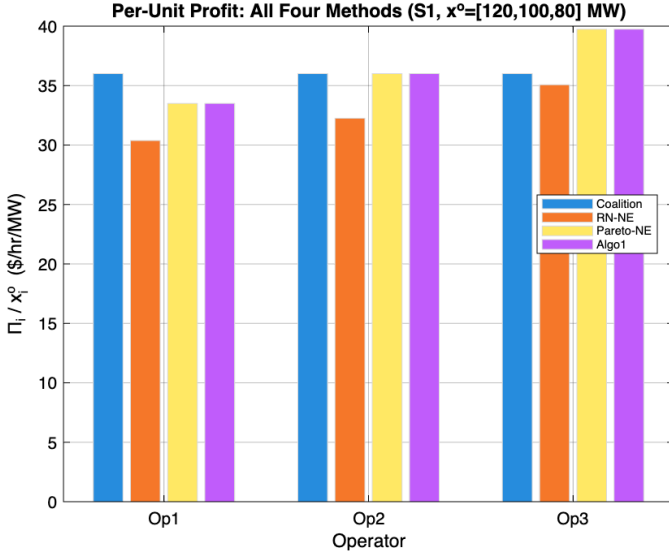


Fig. 5. Per-unit profit Π_i/x_i^o (\$/hr/MW) for all four strategies (Scenario 1). Normalizing by capacity reveals that smaller operators earn disproportionately less per MW under risk-neutral Nash; Pareto coordination through risk-seeking equalizes the per-unit returns across operators.

- **Hetero A:** $\beta' = (-0.10, -0.17, -0.23)$ — Op 3 (smallest share) is most risk-seeking. Bids become $\alpha^* = (0.750, 0.480, 0.150)$, with $f = 0.5$ and $g = g^{\max}$ fully preserved.
- **Hetero B:** $\beta' = (-0.23, -0.17, -0.10)$ — Op 1 is most risk-seeking. Although $\sum_i \beta'_i = -0.5$ satisfies the Pareto aggregate condition, Op 3's low risk tolerance yields $\alpha_3^* \approx 1.12 > 1$, violating the capacity constraint. Clamping reduces f below $\frac{1}{2}$ and incurs an efficiency loss.

Figure 7 shows that Symmetric ERS and Hetero A both achieve $\Pi^{\text{total}} = 10,800$ \$/hr, but distribute profits differently: Hetero A shifts profit toward Op 1 (higher bid) and away

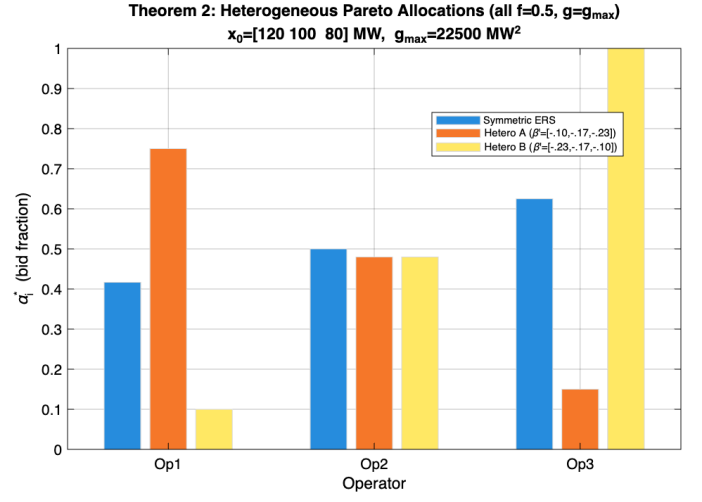


Fig. 6. Bidding strategies under three risk allocations all satisfying $\sum \beta'_i = -\frac{1}{2}$. Hetero B triggers overbidding at Op 3 and is infeasible without clamping.

from Op 3 (lower bid). This gives a regulator or cooperative agreement a mechanism to adjust equity without sacrificing aggregate efficiency — a direct consequence of the infinite-solution structure of Theorem 2.

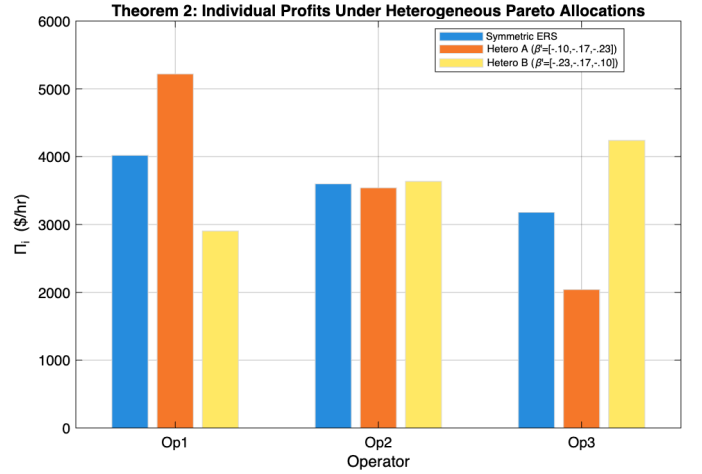


Fig. 7. Individual profits Π_i under the three allocations. Symmetric ERS and Hetero A achieve identical total profit but different per-operator splits.

D. Overbidding Impact

From (32), overbidding occurs for operator i at the ERS optimum whenever $\eta_i < \frac{1}{2n}$. For the original parameters in Table I, $\eta_i \in \{0.40, 0.33, 0.27\}$ all exceed $\frac{1}{6}$, so $\Omega_{\text{ERS}} = \emptyset$ and no overbidding occurs; Scenario 1 in Table III confirms that the symmetric Pareto allocation $\beta'^* = -\frac{1}{6}$ achieves $f = 0.5$ and $g = g^{\max}$.

To illustrate the constrained branch of Corollary 5b, we introduce *Scenario 2* by setting $x_3^o = 30$ MW, giving $x_r^o = 250$ MW and $\eta_3 = 0.12 < \frac{1}{2n} = \frac{1}{6}$. Operator 3 belongs to $\Omega_{\text{ERS}} = \{3\}$: its unconstrained bid at $\beta' = -\frac{1}{6}$ equals $\frac{1}{2n\eta_3} \approx 1.39 > 1$.

Table III compares two policies for Scenario 2. If overbidding is permitted, Op 3 bids $\alpha_3^* \approx 1.39$; the Pareto condition still holds ($f = 0.5$, $g = g^{\max}$), so there is no efficiency loss, only a feasibility violation. Remark 1 provides the no-overbidding Pareto-restoring alternative: prescribing β'^* via (35) so that the constraint binds exactly without any efficiency loss. With $|\Omega_{\text{ERS}}| = 1$ and $\sum_{j \in \Omega_{\text{ERS}}} \eta_j = 0.12$, solving $f(\alpha^*) = \frac{1}{2}$ gives

$$w^* = \frac{1 - 2\eta_3}{n - |\Omega_{\text{ERS}}|} = \frac{1 - 0.24}{2} = 0.38,$$

$$\beta'^* = \frac{w^* - 1}{4} \approx -0.155,$$

yielding $\alpha^* = (0.396, 0.475, 1.000)$, $f = 0.500$, $g = g^{\max} = 15,625 \text{ MW}^2$. The overbidding constraint is binding at Op 3 exactly, and no efficiency loss occurs.

TABLE III
OVERBIDDING SCENARIO COMPARISON ($n = 3$, $a_2 = 0.1$, $x_L^o = 400 \text{ MW}$)

Scenario	Ω_{ERS}	β^*	α_1^*	α_2^*	α_3^*	f	$g (\text{MW}^2)$	$\sum \Pi_i (\$/\text{hr})$	loss
S1: original (no overbid)	$\emptyset$	-0.167	0.417	0.500	0.625	0.500	22,500	10,800	0%
S2: unclamped (overbid)	$\{3\}$	-0.167	0.347	0.417	1.389	0.500	15,625	10,875	0%
S2: opt. β'^* (Cor. 5b)	$\{3\}$	-0.155	0.396	0.475	1.000	0.500	15,625	10,875	0%

S2: $x_3^o = 30 \text{ MW}$, $x_r^o = 250 \text{ MW}$; loss = $g^{\max}$ gap.

Figure 8 applies all six strategies to Scenario 2 ($x_3^o = 30 \text{ MW}$, $\eta_3 = 0.12$), the same capacity configuration examined analytically above. Under these parameters, $\eta_3 < \frac{1}{2n} = \frac{1}{6}$, so the unconstrained symmetric Pareto bid for Op 3 is $\alpha_3^* = \frac{1}{6\eta_3} \approx 1.39 > 1$ — a feasibility violation. The risk-neutral Nash equilibrium is even more aggressive ($\alpha_3^* \approx 2.08$). Algorithm 1 detects this through its if-else saturation check, sets $\alpha_3^* = 1$, and re-optimizes β'^* for Ops 1 and 2 via the ϕ consensus, landing the Algo 1 bar *exactly* at the $\alpha = 1$ boundary and recovering $f = \frac{1}{2}$. Also shown is a heterogeneous- β deviation scenario ($\beta' = [-0.20, -0.15, -0.05]$, “Unclamped OB”) and its simple per-operator clamp (“No-overbid”), which can push Op 3 far above 1 without the principled re-optimization that Algo 1 performs.

Figures 9 and 10 show the profit consequences under Scenario 2. Coalition and Algo 1 achieve the same total profit ($f = 0.5$, $g = g^{\max} = 15,625 \text{ MW}^2$), with Op 3 receiving a smaller absolute share due to its reduced capacity. Pareto-NE produces the same aggregate outcome analytically but is infeasible ($\alpha_3^* > 1$). Unclamped overbidding overshoots $f = 0.5$, reducing aggregate efficiency, while the simple per-operator clamp partially recovers it without restoring the Pareto target.

Remark 2. Overbidding at the ERS optimum is not an artifact of deviating from β^* , but a structural consequence of small renewable share: operator i overbids whenever $\eta_i < \frac{1}{2n}$, regardless of the chosen common β' . In such cases, the re-optimized β'^* of Remark 1 reallocates bids so that the capacity-limited operator is fully dispatched ($\alpha_i^* = 1$) while the remaining operators restore $f = \frac{1}{2}$, recovering $g^{\max}$ with no efficiency penalty.

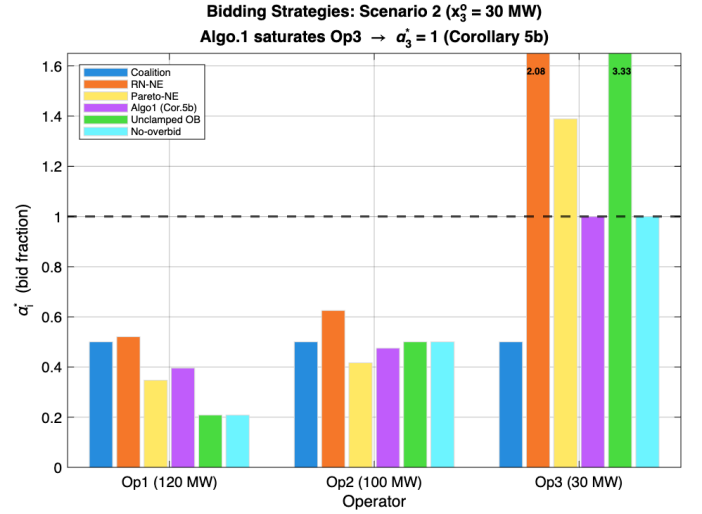


Fig. 8. Bidding strategies α_i^* under Scenario 2 ($x_3^o = 30 \text{ MW}$). The dashed line marks $\alpha = 1$; both the unconstrained Pareto-NE and RN-NE overbid at Op 3, while Algorithm 1 (Corollary 5b saturation branch) places α_3^* exactly at 1. Bars for RN-NE and Unclamped OB at Op 3 extend beyond the y -axis clip; their values are annotated.

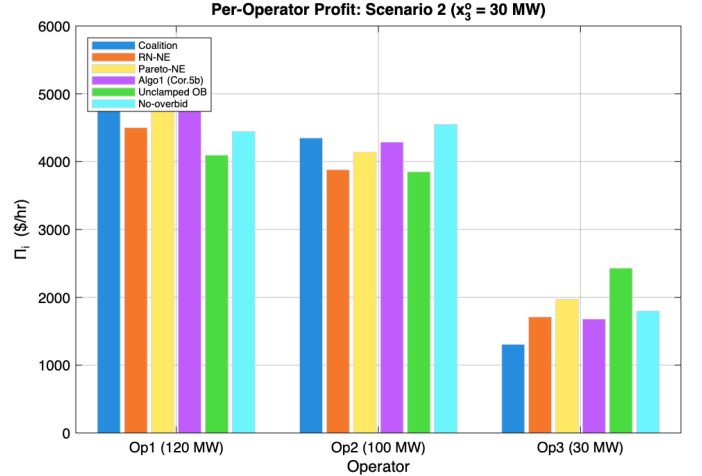


Fig. 9. Per-operator profit Π_i under Scenario 2 for all six strategies. Coalition and Algo 1 achieve the same total profit at $f = 0.5$; risk-neutral and unclamped strategies overshoot $f = \frac{1}{2}$, reducing aggregate efficiency.

E. Constrained Risk-Neutral Nash (Corollary 4)

To isolate the value of risk coordination under capacity constraints, consider Scenario 2 capacities ($x_3^o = 30 \text{ MW}$, $x_r^o = 250 \text{ MW}$) with all operators risk-neutral ($\beta_i = 0$) and overbidding forbidden. Since $\eta_3 = 0.12 < \frac{1}{n+1} = 0.25$, Corollary 4 applies with $\Omega_{\text{RN}} = \{3\}$. Op 3 is clamped to $\alpha_3^* = 1$ and the remaining operators are re-solved:

$$\alpha_i^* = \frac{1 - \sum_{j \in \Omega_{\text{RN}}} \eta_j}{(n + 1 - |\Omega_{\text{RN}}|) \eta_i} = \frac{0.88}{3\eta_i}, \quad i \in \{1, 2\},$$

yielding $\alpha^* = (0.611, 0.733, 1.000)$, $f = 0.707$, and $g \approx 12,946 \text{ MW}^2$.

Figure 11 compares the three strategies for Scenario 2. The unconstrained RN naturally drives Op 3 to $\alpha_3^* \approx 2.08$

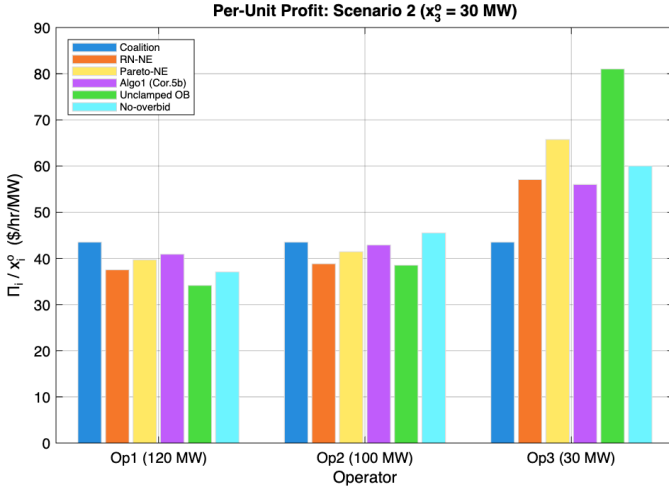


Fig. 10. Per-unit profit Π_i/x_i^o under Scenario 2. Algorithm 1 achieves per-unit equity comparable to the Coalition benchmark; unclamped overbidding distorts Op 3's per-unit revenue upward at the expense of the other operators.

(overbidding); Corollary 4 enforces feasibility by re-solving the equilibrium, but $f = 0.707 \gg \frac{1}{2}$ leaves market efficiency at only $\approx 83\%$ of $g^{\max} = 15,625 \text{ MW}^2$. This quantifies the efficiency cost of foregoing risk coordination: even when overbidding is eliminated, risk-neutral operation incurs a persistent market efficiency loss that risk-seeking coordination avoids.

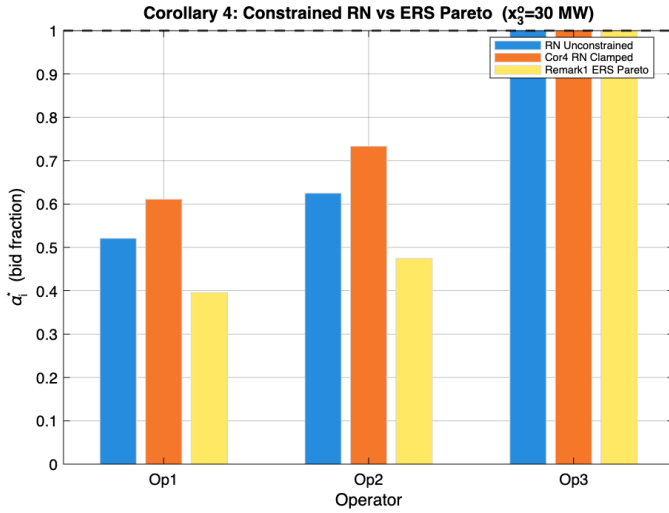


Fig. 11. Corollary 4: bidding strategies under unconstrained RN and constrained RN (Cor. 4 clamped) for Scenario 2 ($x_3^o = 30 \text{ MW}$). Constrained RN enforces feasibility but leaves $f = 0.707 \gg \frac{1}{2}$, incurring a persistent efficiency loss relative to risk-seeking coordination.

F. Multiple Operator Saturation (Corollary 5b)

To validate the generality of Corollary 5b beyond $|\Omega_{\text{ERS}}| = 1$, we set $x^o = (210, 45, 45) \text{ MW}$ so that $\eta_2 = \eta_3 = 0.15 < \frac{1}{2n} = \frac{1}{6}$, giving $|\Omega_{\text{ERS}}| = 2$. Under unconstrained ERS both Op 2 and Op 3 would bid $\alpha \approx 1.11 > 1$; while $f = 0.5$ still holds analytically, the bids are infeasible.

With $S = \sum_{j \in \Omega_{\text{ERS}}} \eta_j = 0.30$ and $2n - |\Omega_{\text{ERS}}| = 4$, the Corollary 5b constrained bids are

$$\alpha_1^* = \frac{n(1-S)}{(2n - |\Omega_{\text{ERS}}|)\eta_1} = \frac{3 \times 0.70}{4 \times 0.70} = 0.75, \quad \alpha_2^* = \alpha_3^* = 1,$$

giving $f = 0.825$ and $g \approx 13,001 \text{ MW}^2$ — a larger efficiency gap than the single-saturation case, as expected, confirming that the efficiency penalty under fixed β_0 grows with $|\Omega_{\text{ERS}}|$.

G. Solutions under Distributed Algorithms

Figures 12–13 show convergence of the consensus states. The initial conditions follow Algorithm 1: the utility sets $\xi_4(0) = 1$, $\psi_4(0) = 0$; each operator sets $\xi_i(0) = 0$, $\psi_i(0) = x_i^o$. All agents converge to the common average $\xi_i(k) \rightarrow \frac{1}{4}$ and $\psi_i(k) \rightarrow \frac{x_r^o}{4} = 75 \text{ MW}$. From these converged values, each operator i locally computes the quantities shown in Table IV, confirming that every operator independently recovers the correct $\hat{n}_i = 3$, η_i , and $\beta'_i = -\frac{1}{6}$ without any additional communication.

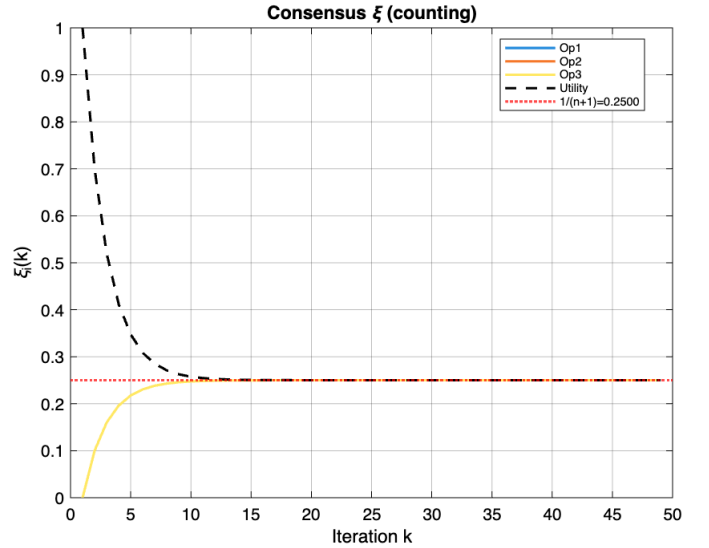


Fig. 12. Algorithm 1 consensus trajectory for ξ_i .

TABLE IV
QUANTITIES COMPUTED LOCALLY BY EACH OPERATOR AFTER
CONSENSUS CONVERGENCE

Op.	ξ_i^∞	$\hat{n}_i$	η_i	β'_i
1	0.25	3	$2/5$	$-1/6$
2	0.25	3	$1/3$	$-1/6$
3	0.25	3	$4/15$	$-1/6$

Remark 3. The convergence rate of Algorithm 1 on the star graph $K_{1,n}$ is $O(\log(1/\varepsilon))$ per consensus round, independent of the number of operators n . This follows from the algebraic connectivity $\lambda_2(L) = 1$ of $K_{1,n}$, which is established in Section V and does not degrade as n grows.

The constrained extension of Algorithm 1 is validated on Scenarios 2 and 6. In Scenario 2, Op 3 locally detects $\hat{\eta}_3 = 0.12 < \frac{1}{6}$ and seeds $\phi_3(0) = 0.12$; in Scenario 6,

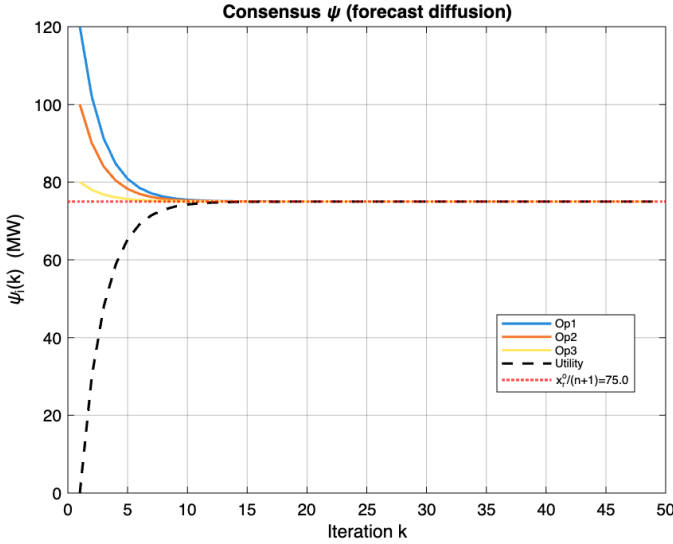


Fig. 13. Algorithm 1 consensus trajectory for ψ_i .

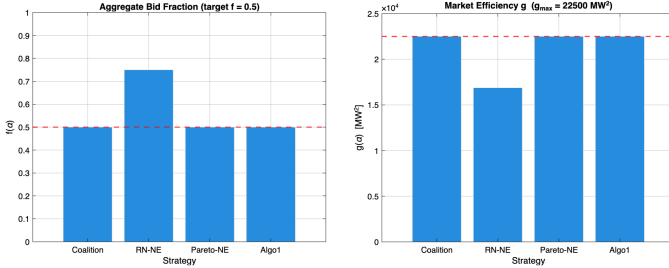


Fig. 14. Aggregate bid fraction f (left) and market efficiency g (right) for all four strategies.

Ops 2 and 3 each seed $\phi_i(0) = 0.15$. In both cases the ϕ consensus converges and the recovered $\hat{S}$ yields bids α^* indistinguishable from the centralized Remark 1 solution, confirming that saturation information is correctly propagated without any central coordinator.

H. Scalability Discussion

The numerical example above uses $n = 3$ operators to keep the exposition concrete. The theoretical results, however, are fully general: Theorems 1–2 and Corollaries 1–5b hold for any $n \geq 1$, and Algorithm 1 requires no modification as n grows. Three structural properties support scalability. First, from Remark 3, the convergence rate of Algorithm 1 is $O(\log(1/\epsilon))$ per consensus round on the star graph, independent of n . Second, each operator performs only local computations (a single division and two multiplications after consensus), so per-operator complexity does not grow with n . Third, the overbidding threshold $\eta_i < 1/(2n)$ becomes more stringent as n increases, so in large markets with many similarly-sized operators the unconstrained formula (31) applies without any clamping. Simulation studies at larger scale ($n \in \{10, 50\}$) are deferred to future work, where they will also address sensitivity of the Pareto condition to heterogeneous capacity distributions and transient operator participation.

VII. CONCLUSION

This paper presented a risk-aware bidding framework in which the risk sensitivity parameter β_i acts as a coordination variable for renewable generation operators in electricity markets. We showed that the noncooperative game admits structured Nash equilibria and that, by appropriate risk allocation, these equilibria can recover Pareto-efficient aggregate outcomes. In particular, the analysis established explicit relationships between risk parameters, bidding coefficients, and market efficiency.

A distributed consensus-based implementation was developed for the one-shot strategy, allowing each operator to estimate required aggregate quantities using only local communication. The illustrative example confirmed that the distributed Algorithm 1 reproduces the targeted bidding behavior without centralized disclosure of private forecasts or cost data. When the no-overbidding constraint is active, a minor extension using a third consensus protocol allows each operator to determine its constrained bid locally after recovering the aggregate saturation quantities $\sum_{j \in \Omega_{ERS}} \eta_j$ and $\sum_{j \notin \Omega_{ERS}} w_j$ through neighborhood communication alone.

A detailed overbidding analysis established per-operator saturation thresholds from (32) and showed that operators with smaller capacity shares saturate first under a common risk parameter. The individual profit analysis revealed that the no-overbidding projection shifts $f(\alpha)$ below $\frac{1}{2}$ and reduces the payoff of all operators through the shared market-clearing term, not only those whose bids are clamped. This individual-level effect, quantified via (5b) and illustrated numerically in the constrained Scenario 2 study, demonstrates that the performance impact of feasibility constraints is collective rather than local.

Overall, the results demonstrate that risk-aware design can align self-interested bidding with improved collective efficiency while preserving decentralization and privacy. Future work will incorporate network congestion and locational pricing, extend to non-Gaussian uncertainty structures and time-varying operator participation, and analyze robustness under communication delay, packet loss, and adversarial behavior.

REFERENCES

- [1] Y. Dvorkin, “A chance-constrained stochastic electricity market,” *IEEE Transactions on Power Systems*, vol. 35, no. 4, pp. 2993–3003, 2020.
- [2] S. Wong and J. Fuller, “Pricing energy and reserves using stochastic optimization in an alternative electricity market,” *IEEE Transactions on Power Systems*, vol. 22, no. 2, pp. 631–638, 2007.
- [3] R. Mieth and Y. Dvorkin, “Distribution electricity pricing under uncertainty,” *IEEE Transactions on Power Systems*, vol. 35, no. 3, pp. 2325–2338, 2020.
- [4] B. Zhang, R. Johari, and R. Rajagopal, “Competition and efficiency of coalitions in cournot games with uncertainty,” *IEEE Transactions on Control of Network Systems*, vol. 3, no. 4, pp. 318–332, 2016.
- [5] C.-Y. Lee and A. L. Johnson, “Measuring efficiency in imperfectly competitive markets: An example of rational inefficiency,” *Journal of Optimization Theory and Applications*, vol. 164, no. 2, pp. 702–722, 2015.
- [6] M. Asplund, “Risk-averse firms in oligopoly,” *International Journal of Industrial Organization*, vol. 20, no. 7, pp. 995–1012, 2002.
- [7] A. Wambach, “Bertrand competition under cost uncertainty,” *Economics Letters*, vol. 64, no. 2, pp. 221–225, 1999.

- [8] H. Cheng, "Bertrand vs. cournot equilibrium with risk averse firms and cost uncertainty," *Economic Theory*, vol. 20, no. 3, pp. 555–577, 2002.
- [9] Y. Sakai, "The impact of risk aversion on information transmission between firms," *Journal of Economics*, vol. 49, no. 2, pp. 111–137, 1989.
- [10] N. Gülpinar and F. S. Oliveira, "Analysis of relationship between forward and spot markets in oligopolies under demand and cost uncertainties," *Computational Management Science*, vol. 11, no. 3, pp. 267–283, 2014.
- [11] B. Hobbs, M. Rothkopf, R. O'Neill, and H. Chao, "An individual welfare maximization algorithm for electricity markets," in *Proceedings of the 34th Annual Hawaii International Conference on System Sciences*, 2001, pp. 1–8.
- [12] J. Zhao, Z. Y. Dong, Z. Liu, and J. Zhu, "Social welfare maximization auction for electricity markets with elastic demand," in *IEEE PES General Meeting*, 2010, pp. 1–7.
- [13] W. Su, J. Wang, and J. Roh, "Integrated generation–consumption dispatch based on compensation mechanism considering demand response behavior," *Journal of Modern Power Systems and Clean Energy*, vol. 6, no. 3, pp. 489–501, 2018.
- [14] L. Hurwicz, "Optimality and informational efficiency in resource allocation processes," in *Mathematical Methods in the Social Sciences*, K. J. Arrow, S. Karlin, and P. Suppes, Eds. Stanford, CA: Stanford University Press, 1960, pp. 27–46.
- [15] R. B. Myerson, "Incentive compatibility and the bargaining problem," *Econometrica*, vol. 47, no. 1, pp. 61–73, 1979.
- [16] D. K. Molzahn, F. Dörfler, H. Sandberg, S. H. Low, S. Chakrabarti, R. Baldick, and J. Lavaei, "A survey of distributed optimization and control algorithms for electric power systems," *IEEE Transactions on Smart Grid*, vol. 8, no. 6, pp. 2941–2962, 2017.
- [17] T. Yang, X. Yi, J. Wu, Y. Yuan, D. Wu, Z. Meng, Y. Hong, H. Wang, Z. Lin, and K. H. Johansson, "A survey of distributed optimization," *Annual Reviews in Control*, vol. 47, pp. 278–305, 2019.
- [18] Y. Xia, J. H. Chow, and M. K. Marwali, "A game-theoretic analysis of wind power generator bidding strategies in electricity markets," in *2017 IEEE Power & Energy Society General Meeting*, 2017, pp. 1–5.
- [19] W. Rudin, *Principles of Mathematical Analysis*. Auckland: McGraw Hill, 1976.
- [20] M. Huang, R. P. Malhamé, and P. E. Caines, "Large population stochastic dynamic games: closed-loop McKean–Vlasov systems and the Nash certainty equivalence principle," *Communications in Information and Systems*, vol. 6, no. 3, pp. 221–252, 2006.
- [21] J.-M. Lasry and P.-L. Lions, "Mean field games," *Japanese Journal of Mathematics*, vol. 2, no. 1, pp. 229–260, 2007.
- [22] Z. Qu, *Cooperative Control of Dynamical Systems*. London: Springer Verlag, 2009.