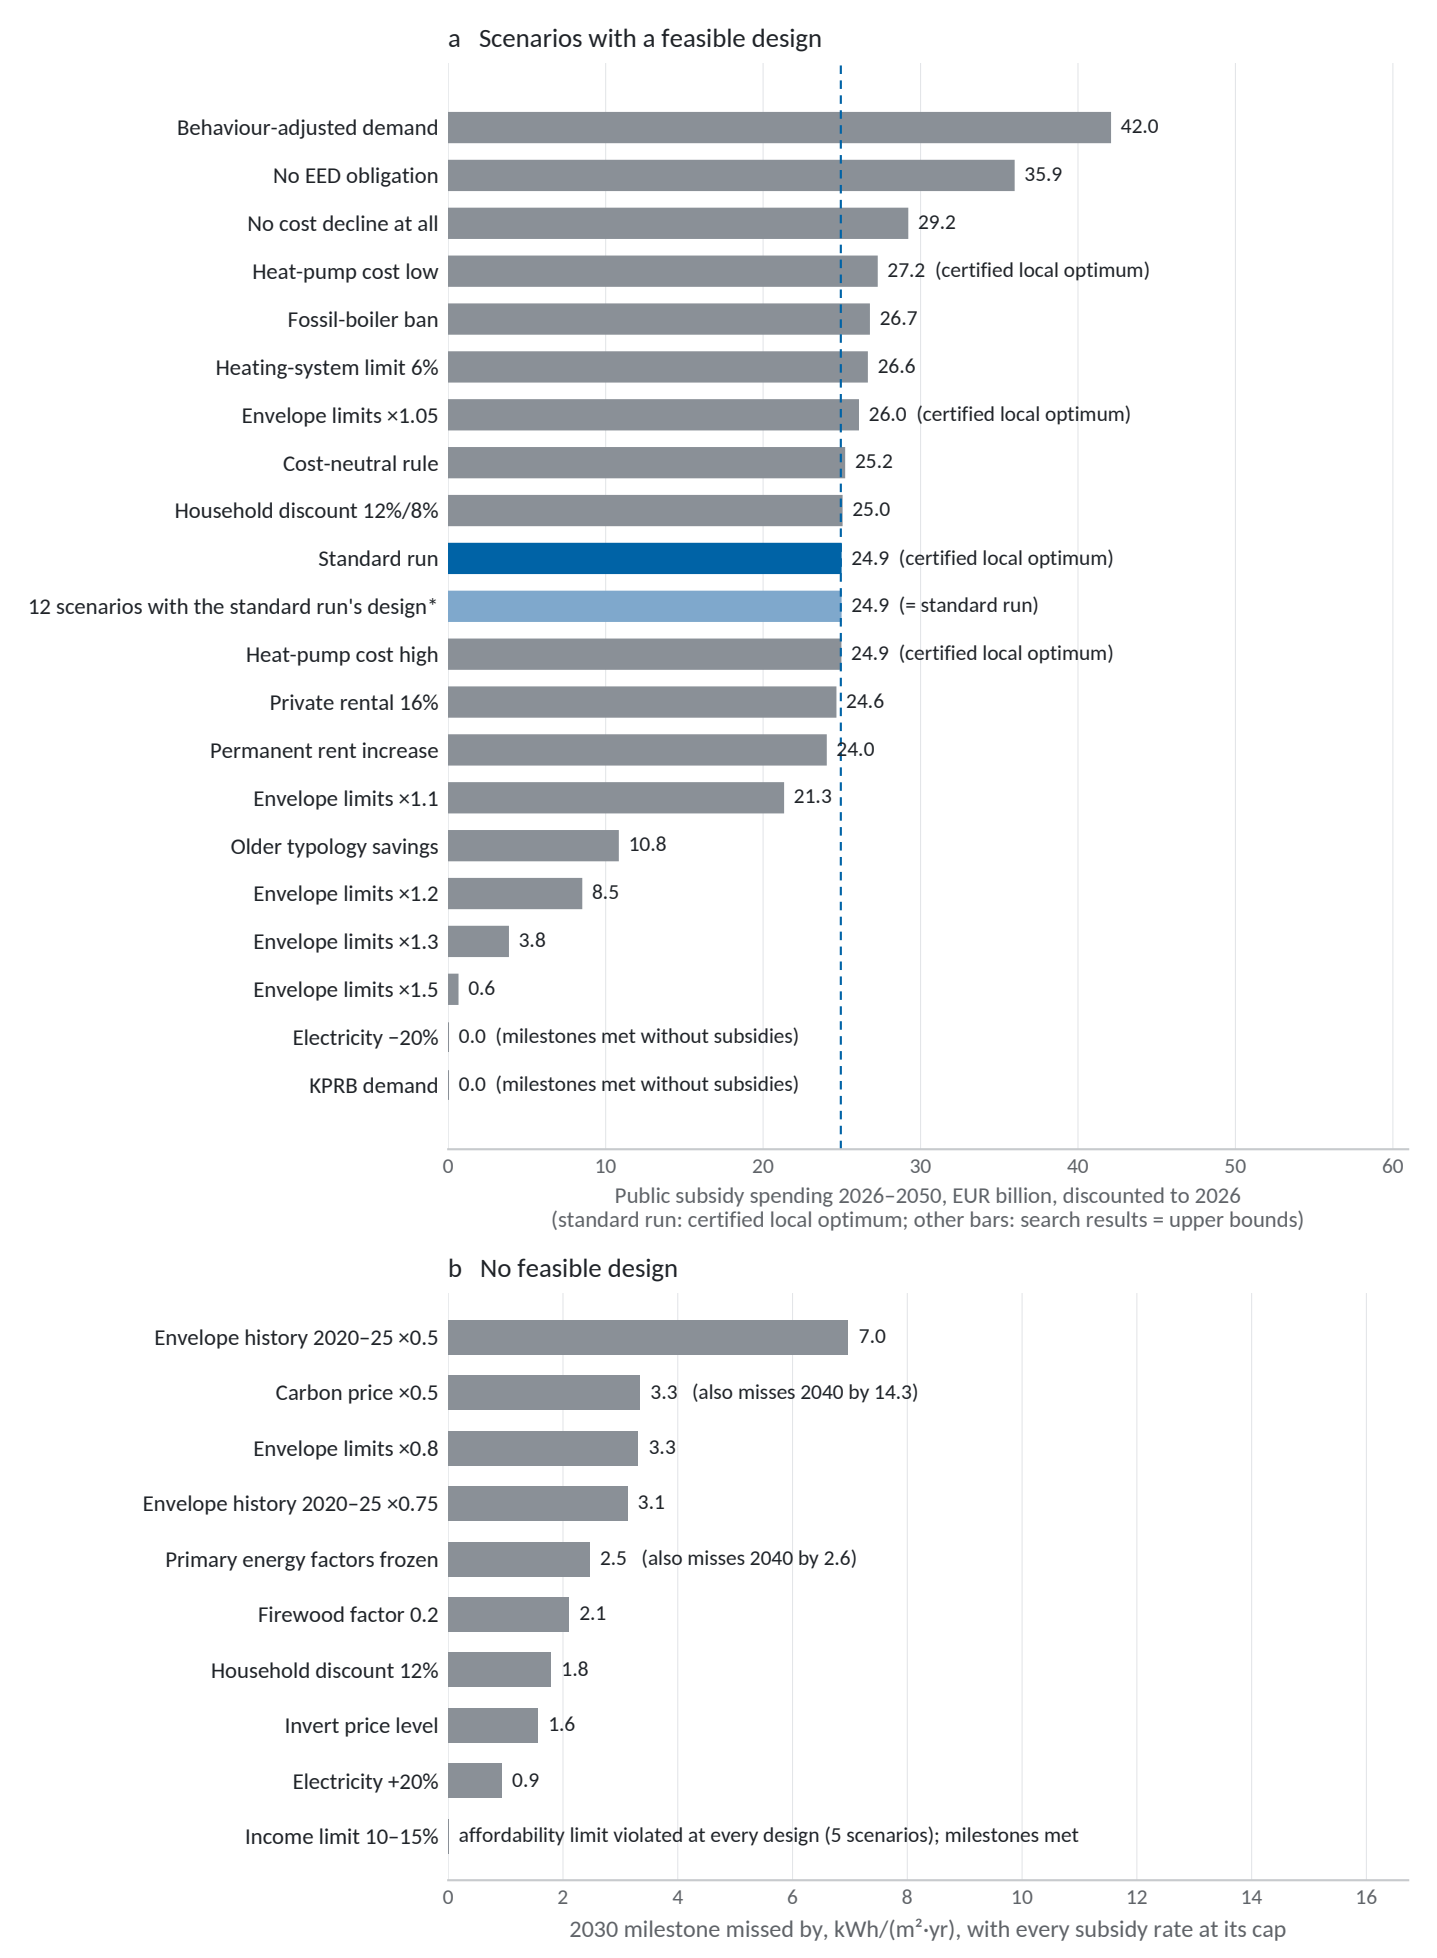
a Scenarios with a feasible design
Behaviour-adjusted demand
42.0
No EED obligation
35.9
No cost decline at all
29.2
Heat-pump cost low
27.2 (certified local optimum)
Fossil-boiler ban
26.7
Heating-system limit 6%
26.6
Envelope limits ×1.05
26.0 (certified local optimum)
Cost-neutral rule
25.2
Household discount 12%/8%
25.0
Standard run
24.9 (certified local optimum)
12 scenarios with the standard run's design*
24.9 (= standard run)
Heat-pump cost high
24.9 (certified local optimum)
Private rental 16%
24.6
Permanent rent increase
24.0
Envelope limits ×1.1
21.3
Older typology savings
10.8
Envelope limits ×1.2
8.5
Envelope limits ×1.3
3.8
Envelope limits ×1.5
0.6
Electricity −20%
0.0 (milestones met without subsidies)
KPRB demand
0.0 (milestones met without subsidies)
0
10
20
30
40
50
60
Public subsidy spending 2026–2050, EUR billion, discounted to 2026
(standard run: certified local optimum; other bars: search results = upper bounds)
b No feasible design
Envelope history 2020–25 ×0.5
7.0
Carbon price ×0.5
3.3 (also misses 2040 by 14.3)
Envelope limits ×0.8
3.3
Envelope history 2020–25 ×0.75
3.1
Primary energy factors frozen
2.5 (also misses 2040 by 2.6)
Firewood factor 0.2
2.1
Household discount 12%
1.8
Invert price level
1.6
Electricity +20%
0.9
Income limit 10–15%
affordability limit violated at every design (5 scenarios); milestones met
0
2
4
6
8
10
12
14
16
2030 milestone missed by, kWh/(m²·yr), with every subsidy rate at its cap