

Safety Administration

Safety summary

General information

F-signatures	
Collective F-Signature	2BC94038
Collective F-SW-Signature	2BC94037
Collective F-HW-Signature	00000001
F-Communication Address Signature	----
Current compilation	
Safety program state	The offline safety program is consistent.
Compilation time	8/5/2026 8:00:57 PM (UTC +2:00)
Used versions	
STEP 7	STEP 7 Professional V21
Safety	STEP 7 Safety V21
Access protection	
Safety-related project data	The safety program is protected by password
F-CPU	Access control at runtime is disabled.
Important note	Note that the settings regarding access protection only reflect the current settings while creating this safety summary. They can be changed later without any effect to the F-signature or compilation time stamp. Refer to the UMAC configuration for current valid access protection on the F-CPU.

Notes

Location	Note	Additional info
General information	The response time of your safety function also depends on the cycle time of the F-OB and the runtime of the F-runtime group. When using distributed F-I/O modules, the response time also depends on the PROFINET/PROFIBUS parameter assignment. The configuration and parameter assignment of the standard system also has an effect on the response time of your safety function. Note that the configuration and parameter assignment of the standard system is not subject to the access protection of the safety program and does not change the Collective F-Signature.	Note the warning "S085" in the manual and in the STEP 7 Safety online help.

Safety program settings

Safety mode can be disabled	No
Assignment of F-system block numbers	F-system managed
Safety system version	V2.8
Variable F-communication IDs enabled	No

System library elements used in safety program

Instructions (STEP 7 Safety)	
Name	Used version
TON	V1.4

Safety information: 2BC94038 Consistent; STEP 7 Safety V21;

Totally Integrated Automation Portal		
Information on F-runtime group		
RTG1		
Fail-safe organization block		
Name	FOB_RTG1 [OB123]	
Event class	Cyclic interrupt	
Cycle time	100000 µs	
Phase shift	0 µs	
Priority	12	
Main safety block		
Name	Main_Safety_RTG1 [FB1]	
I-DB for main safety block	Main_Safety_RTG1_DB [DB1]	
F-runtime group parameters		
Name	F-runtime group 1	
Warn cycle time of the F-runtime group	110000 µs	
Maximum cycle time of the F-runtime group	120000 µs	
DB for F-runtime group communication	--	
F-runtime group information DB	RTG1SysInfo	
Pre/Post processing		
FC for pre processing	--	
FC for post processing	--	
Safety information: 2BC94038 Consistent; STEP 7 Safety V21;		

Totally Integrated Automation Portal																										
F-blocks in safety program <table><tr><th>Block name [Block number]</th><th>Function in safety program</th><th>Used and compiled in F-RTG</th><th>Signature</th></tr><tr><td>FOB_RTG1 [OB123]</td><td>F-OB [system-protected]</td><td>RTG1</td><td>710F1667</td></tr><tr><td>F_Forklift_Safety [FB2]</td><td>F-FB</td><td>RTG1</td><td>2519226C</td></tr><tr><td>Main_Safety_RTG1 [FB1]</td><td>F-FB</td><td>RTG1</td><td>C61EF568</td></tr><tr><td>InstF_Forklift_Safety [DB3]</td><td>F-IDB</td><td>RTG1</td><td>95EC8180</td></tr><tr><td>Main_Safety_RTG1_DB [DB1]</td><td>F-IDB</td><td>RTG1</td><td>27E959F6</td></tr></table> Know-how protected F-blocks in the safety program The safety program does not contain any know-how protected F-blocks. F-compliant PLC data types in the safety program The safety program does not contain any F-compliant PLC data types (UDT). Named value data types used in the safety program The safety program does not contain any named value data types (NVT). Constants in the safety program The safety program does not contain any constants. Safety information: 2BC94038 Consistent; STEP 7 Safety V21;			Block name [Block number]	Function in safety program	Used and compiled in F-RTG	Signature	FOB_RTG1 [OB123]	F-OB [system-protected]	RTG1	710F1667	F_Forklift_Safety [FB2]	F-FB	RTG1	2519226C	Main_Safety_RTG1 [FB1]	F-FB	RTG1	C61EF568	InstF_Forklift_Safety [DB3]	F-IDB	RTG1	95EC8180	Main_Safety_RTG1_DB [DB1]	F-IDB	RTG1	27E959F6
Block name [Block number]	Function in safety program	Used and compiled in F-RTG	Signature																							
FOB_RTG1 [OB123]	F-OB [system-protected]	RTG1	710F1667																							
F_Forklift_Safety [FB2]	F-FB	RTG1	2519226C																							
Main_Safety_RTG1 [FB1]	F-FB	RTG1	C61EF568																							
InstF_Forklift_Safety [DB3]	F-IDB	RTG1	95EC8180																							
Main_Safety_RTG1_DB [DB1]	F-IDB	RTG1	27E959F6																							

Totally Integrated Automation Portal		
Data from the standard user program		
Absolute address	Symbolic operand	F-runtime group
--	"SafetyInputStandIn".ZoneDeviceCircuitClosed	RTG1
--	"SafetyInputStandIn".ResetButtonPressed	RTG1
--	"SafetyInputStandIn".EStopCircuitClosed	RTG1
--	"SafetyInputStandIn".StandInHeartbeat	RTG1
Block name [Block number]		
Network		
Main_Safety_RTG1 [FB1]		
1		
Main_Safety_RTG1 [FB1]		
1		
Main_Safety_RTG1 [FB1]		
1		
Main_Safety_RTG1 [FB1]		
1		
Parameters for safety-related CPU-CPU communications via RCVDP, SENDDP		
No safety-related CPU-CPU communication via RCVDP, SENDDP is configured.		
Safety information: 2BC94038 Consistent; STEP 7 Safety V21;		

Totally Integrated Automation Portal		
Communications via Flexible F-Link No communications via Flexible F-Link are defined for the safety program.		
Safety information: 2BC94038 Consistent; STEP 7 Safety V21;		

Totally Integrated Automation Portal		
Communications via OPC UA Safety No communications via OPC UA Safety are defined for the Safety program.		
Safety information: 2BC94038 Consistent; STEP 7 Safety V21;		

Hardware configuration of F-I/O

F-CPU information	
Short designation	CPU 1513F-1 PN
Article number	6ES7 513-1FM03-0AB0
Firmware version	V3.1
Central F-source address	1
F-destination address range (PROFIsafe address type 1)	--
F-destination address range (PROFIsafe address type 2)	--
F-destination address range (PROFIsafe address type 3)	--

There is no hardware configured.

Supplementary information

Safety summary created on	8/5/2026 8:03:55 PM (UTC +2:00)	Page numbers for safety summary	From 1 - 1 to 1 - 7
---------------------------	---------------------------------	---------------------------------	---------------------


Safety Administration / Fail-safe user blocks

Main_Safety_RTG1

Main_Safety_RTG1 Properties							
General							
Name	Main_Safety_RTG1	Number	1	Type	FB	Language	FBD
Numbering	Manual						
Information							
Title		Author		Comment		Family	
Version	0.1	User-defined ID					

Name	Data type	Default value	Retain	Accessible from HMI/OPC UA/Web API	Writ-able from HMI/ OPC UA/ Web API	Visible in HMI engi-neering	Setpoint	Supervi-sion	Comment
Input									
Output									
InOut									
Static									
Temp									
Constant									

Network 1:

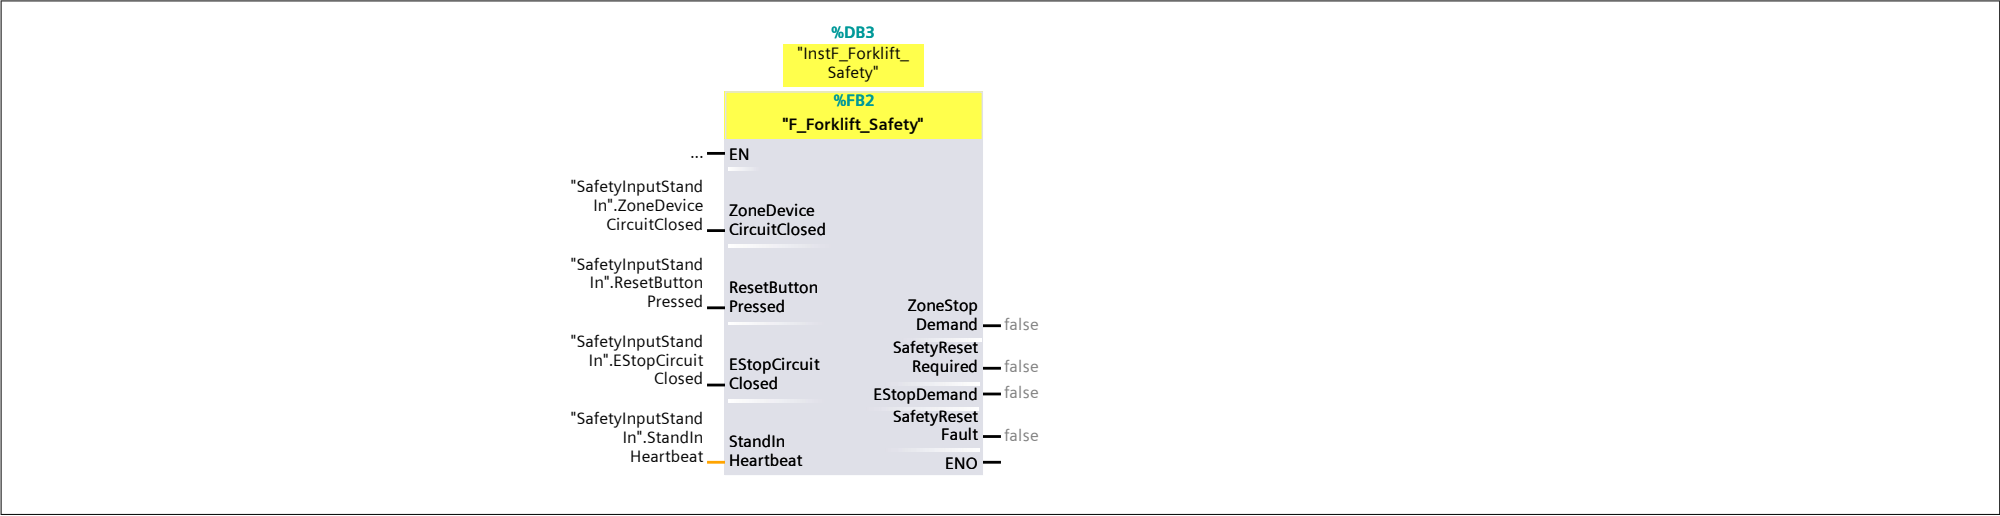

Totally Integrated Automation Portal

Safety Administration / Fail-safe user blocks

F_Forklift_Safety

F_Forklift_Safety Properties

General

Name

F_Forklift_Safety

Number

2

Type

FB

Language

FBD

Numbering

Automatic

Information

Title

Author

Comment

Family

Version

0.1

User-defined ID

Name	Data type	Default value	Retain	Accessible from HMI/OPC UA/Web API	Writ-able from HMI/ OPC UA/ Web API	Visible in HMI engi-neering	Setpoint	Supervi-sion	Comment
▼ Input									
ZoneDeviceCircuitClosed	Bool	false	Non-retain	True	True	True	False		
ResetButtonPressed	Bool	false	Non-retain	True	True	True	False		
EStopCircuitClosed	Bool	false	Non-retain	True	True	True	False		
StandInHeartbeat	Int	0	Non-retain	True	True	True	False		
▼ Output									
ZoneStopDemand	Bool	false	Non-retain	True	True	True	False		
SafetyResetRequired	Bool	false	Non-retain	True	True	True	False		
EStopDemand	Bool	false	Non-retain	True	True	True	False		
SafetyResetFault	Bool	false	Non-retain	True	True	True	False		
InOut									
▼ Static									
CauseGone	Bool	false	Non-retain	True	True	True	False		
ResetSeenOpen	Bool	false	Non-retain	True	True	True	False		
ResetPressArmed	Bool	false	Non-retain	True	True	True	False		
ResetRise	Bool	false	Non-retain	True	True	True	False		
ResetHoldValid	Bool	false	Non-retain	True	True	True	False		
ResetPulse	Bool	false	Non-retain	True	True	True	False		
ResetMemory	Bool	false	Non-retain	True	True	True	False		
ResetFall	Bool	false	Non-retain	True	True	True	False		
▼ ResetHoldMinTimer	TON			True	True	True	False		
▼ Input									
IN	Bool	false	Non-retain	True	True	True	False		Start input
PT	Time	T#0ms	Non-retain	True	True	True	False		Duration of the on-delay, must be positive
▼ Output									
Q	Bool	false	Non-retain	True	True	True	False		Output that is set after expi-ration of time PT
ET	Time	T#0ms	Non-retain	True	True	True	False		Current time value
InOut									
Static									
▼ ResetHoldMaxTimer	TON			True	True	True	False		
▼ Input									
IN	Bool	false	Non-retain	True	True	True	False		Start input
PT	Time	T#0ms	Non-retain	True	True	True	False		Duration of the on-delay, must be positive
▼ Output									
Q	Bool	false	Non-retain	True	True	True	False		Output that is set after expi-ration of time PT
ET	Time	T#0ms	Non-retain	True	True	True	False		Current time value
InOut									
Static									
▼ F_IEC_Timer_Instance	TON			True	True	True	False		
▼ Input									
IN	Bool	false	Non-retain	True	True	True	False		Start input
PT	Time	T#0ms	Non-retain	True	True	True	False		Duration of the on-delay, must be positive
▼ Output									
Q	Bool	false	Non-retain	True	True	True	False		Output that is set after expi-ration of time PT
ET	Time	T#0ms	Non-retain	True	True	True	False		Current time value
InOut									
Static									
HeartbeatChanged	Bool	false	Non-retain	True	True	True	False		
HeartbeatSeen	Bool	false	Non-retain	True	True	True	False		
▼ StandInStaleTimer	TON			True	True	True	False		
▼ Input									

Safety information: 2BC94038 Consistent; STEP 7 Safety V21;

Totally Integrated Automation Portal											
Name	Data type	Default value	Retain	Accessible from HMI/OPC UA/Web API	Writ-able from HMI/OPC UA/ Web API	Visible in HMI engi-neering	Setpoint	Supervi-sion			Comment
IN	Bool	false	Non-retain	True	True	True	False				Start input
PT	Time	T#0ms	Non-retain	True	True	True	False				Duration of the on-delay, must be positive
▼ Output											
Q	Bool	false	Non-retain	True	True	True	False				Output that is set after expi-ration of time PT
ET	Time	T#0ms	Non-retain	True	True	True	False				Current time value
InOut											
Static											
StandInValid	Bool	false	Non-retain	True	True	True	False				
EStopClosedValid	Bool	false	Non-retain	True	True	True	False				
ZoneClosedValid	Bool	false	Non-retain	True	True	True	False				
ResetPressedValid	Bool	false	Non-retain	True	True	True	False				
HeartbeatMemory	Int	0	Non-retain	True	True	True	False				
Temp											
▼ Constant											
RESET_HOLD_MIN	Time	T#200ms									
RESET_HOLD_MAX	Time	T#3s									
STANDIN_STALE_MAX	Time	T#1000ms									

Network 1:

Network 2:


Network 3:

Network 4:


Network 5:

Network 6:


Safety information: 2BC94038 Consistent; STEP 7 Safety V21;

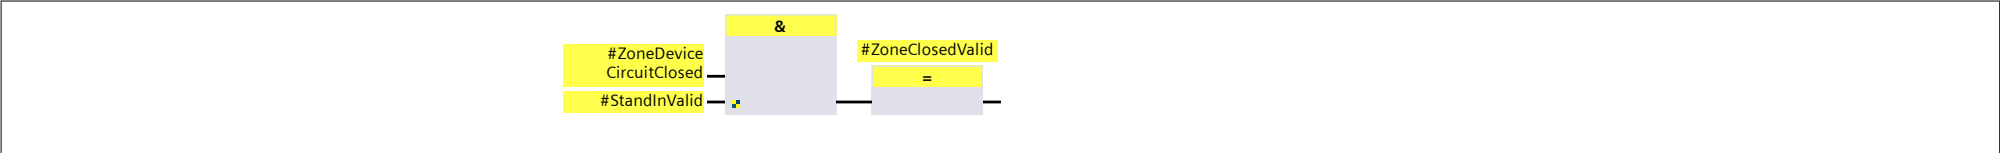


Network 7:

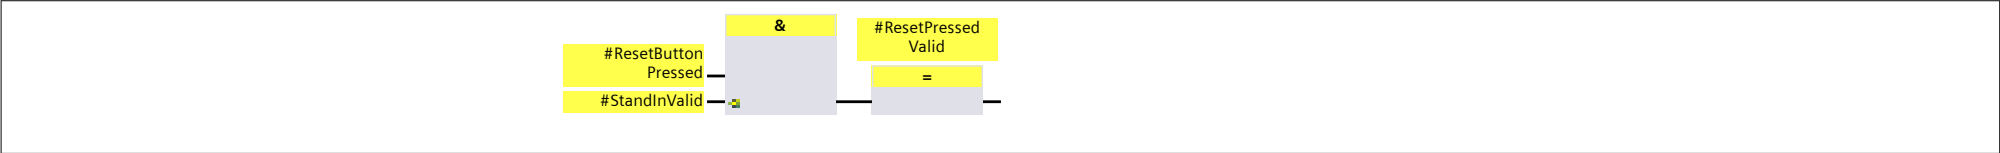

Network 8:

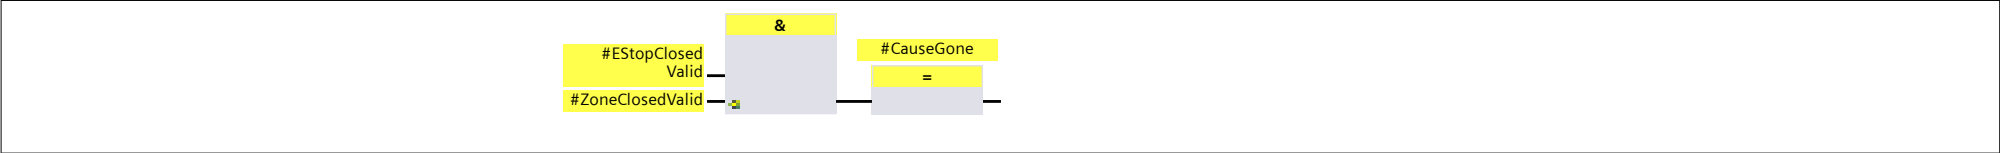


Network 9:

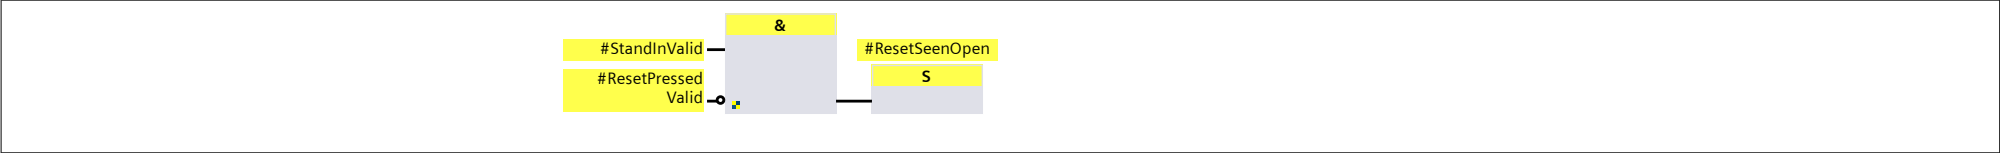


Network 10:




Network 11:

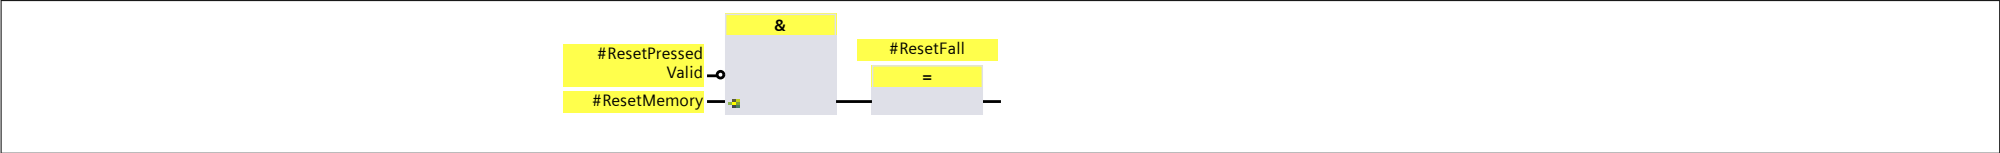

Network 12:

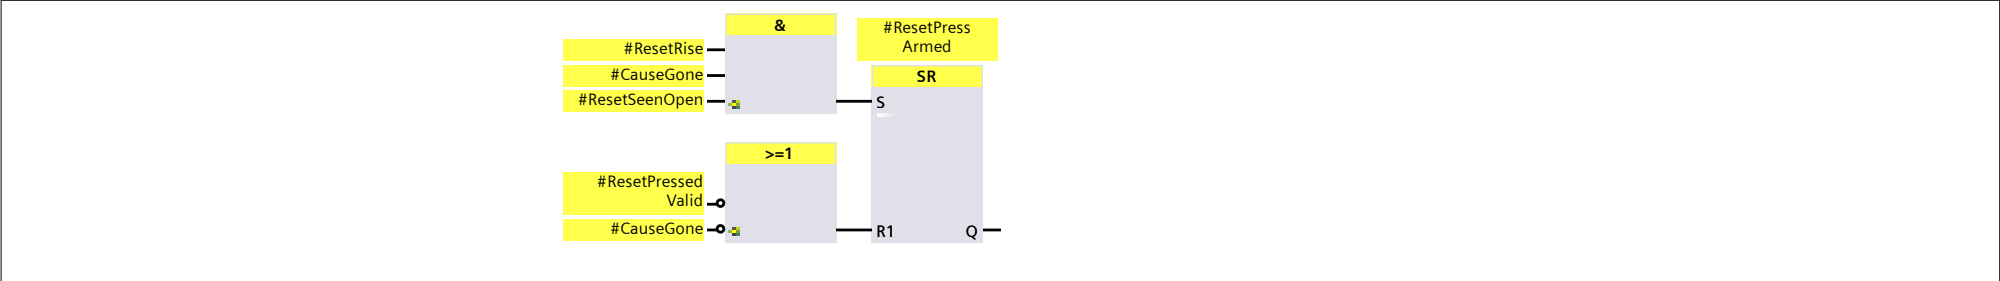


Network 13:

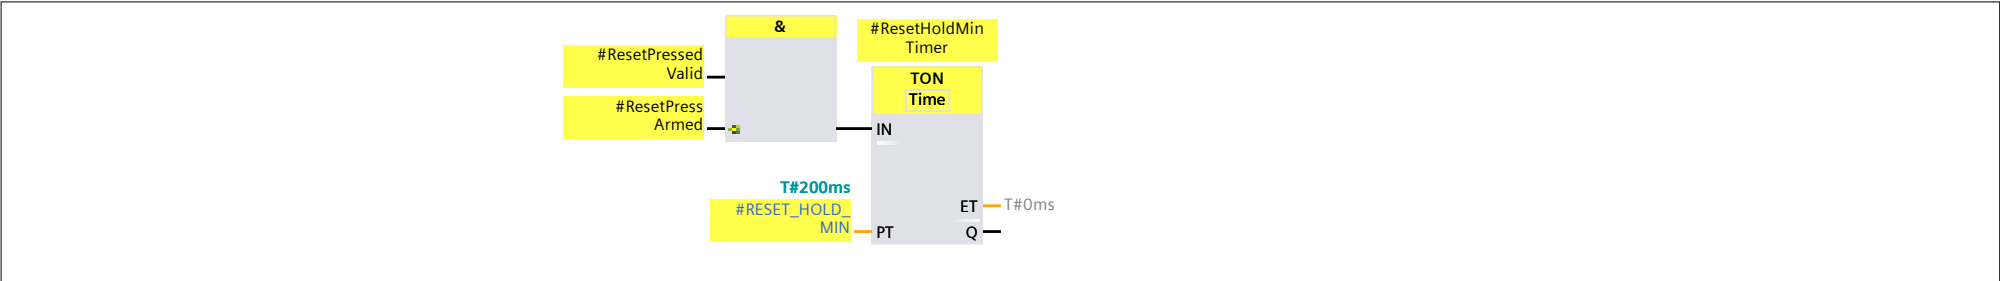


Network 14:




Network 15:

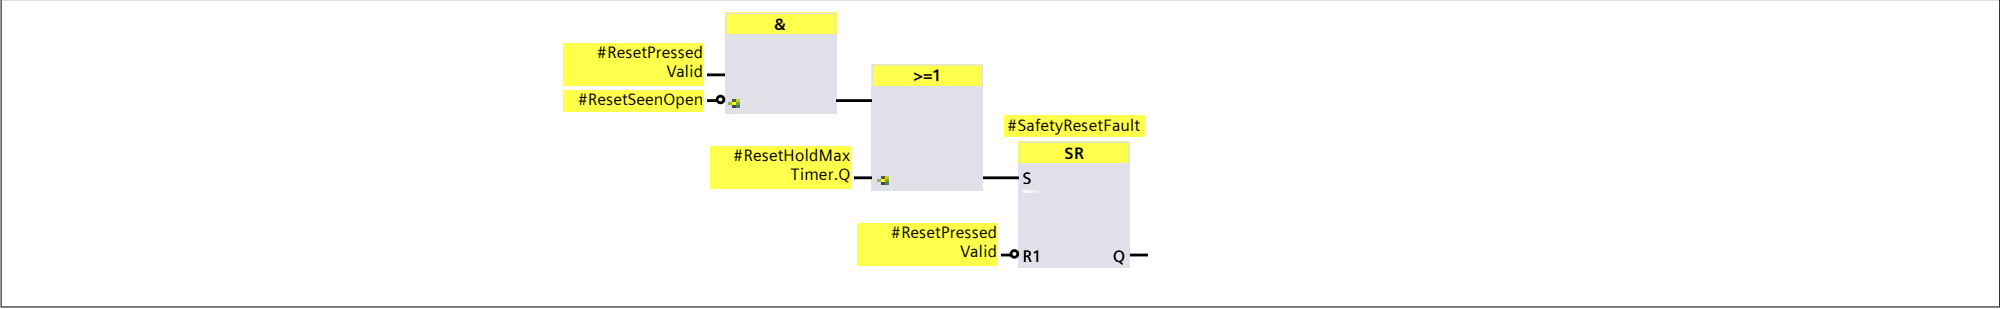

Network 16:

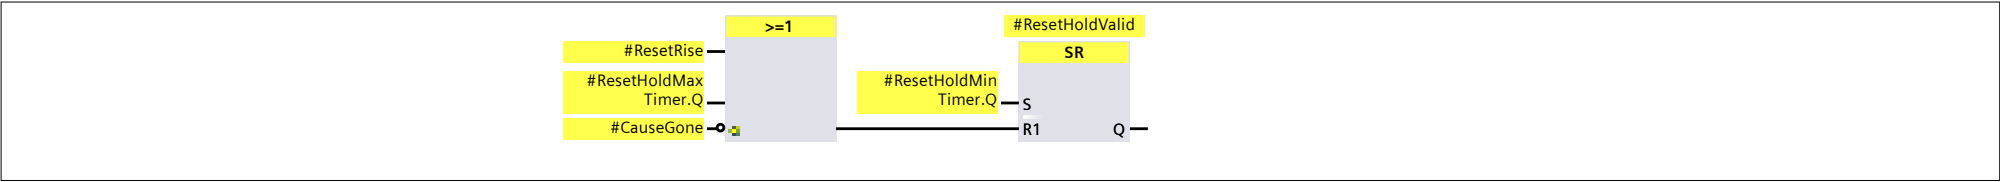

Network 17:

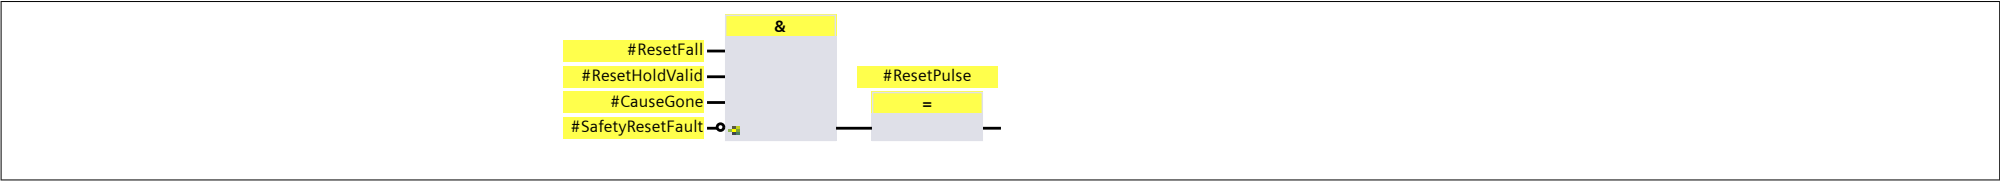


Network 18:



Network 19:




Network 20:

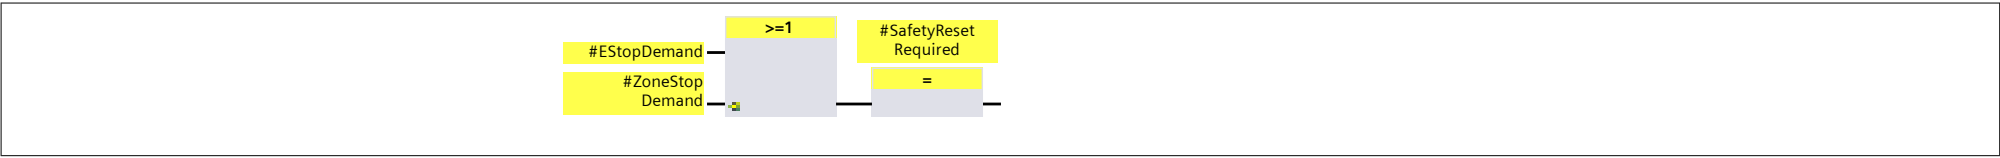

Network 21:



Network 22:

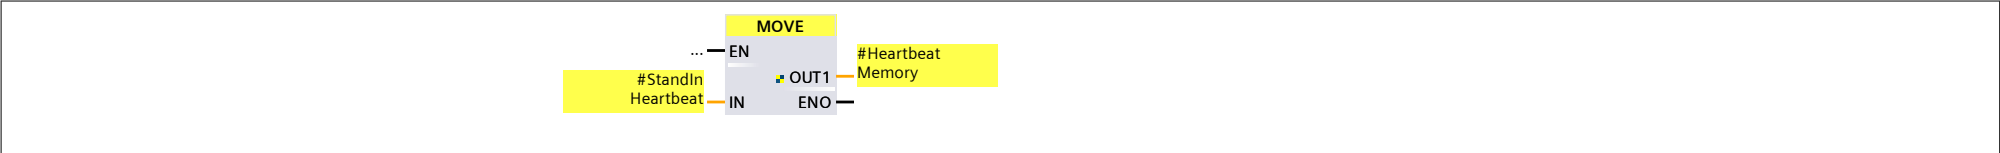

Totally Integrated Automation Portal

Safety Administration / Fail-safe user blocks

Main_Safety_RTG1_DB

Main_Safety_RTG1_DB Properties

General

Name	Main_Safety_RTG1_DB	Number	1	Type	DB	Language	DB
Numbering	Automatic						

Information

Title		Author		Comment		Family	
Version	0.1	User-defined ID	FUSI				

Name	Data type	Start value	Retain	Accessible from HMI/OPC UA/Web API	Writ-able from HMI/ OPC UA/ Web API	Visible in HMI engi-neering	Setpoint	Supervi-sion	Comment
Input									
Output									
InOut									
Static									

Safety information: 2BC94038 Consistent; STEP 7 Safety V21;

Totally Integrated Automation Portal

Safety Administration / Fail-safe user blocks

InstF_Forklift_Safety

InstF_Forklift_Safety Properties

General

Name	InstF_Forklift_Safety	Number	3	Type	DB	Language	DB
Numbering	Automatic						

Information

Title		Author		Comment		Family	
Version	0.1	User-defined ID					

Name	Data type	Start value	Retain	Accessible from HMI/OPC UA/Web API	Writ-able from HMI/ OPC UA/ Web API	Visible in HMI engi-neering	Setpoint	Supervi-sion	Comment
▼ Input									
ZoneDeviceCircuitClosed	Bool	false	False	True	True	True	False		
ResetButtonPressed	Bool	false	False	True	True	True	False		
EStopCircuitClosed	Bool	false	False	True	True	True	False		
StandInHeartbeat	Int	0	False	True	True	True	False		
▼ Output									
ZoneStopDemand	Bool	false	False	True	True	True	False		
SafetyResetRequired	Bool	false	False	True	True	True	False		
EStopDemand	Bool	false	False	True	True	True	False		
SafetyResetFault	Bool	false	False	True	True	True	False		
InOut									
▼ Static									
CauseGone	Bool	false	False	True	True	True	False		
ResetSeenOpen	Bool	false	False	True	True	True	False		
ResetPressArmed	Bool	false	False	True	True	True	False		
ResetRise	Bool	false	False	True	True	True	False		
ResetHoldValid	Bool	false	False	True	True	True	False		
ResetPulse	Bool	false	False	True	True	True	False		
ResetMemory	Bool	false	False	True	True	True	False		
ResetFall	Bool	false	False	True	True	True	False		
▼ ResetHoldMinTimer	TON		False	True	True	True	False		
▼ Input									
IN	Bool	false	False	True	True	True	False		Start input
PT	Time	T#0ms	False	True	True	True	False		Duration of the on-delay, must be positive
▼ Output									
Q	Bool	false	False	True	True	True	False		Output that is set after expiration of time PT
ET	Time	T#0ms	False	True	True	True	False		Current time value
InOut									
Static									
▼ ResetHoldMaxTimer	TON		False	True	True	True	False		
▼ Input									
IN	Bool	false	False	True	True	True	False		Start input
PT	Time	T#0ms	False	True	True	True	False		Duration of the on-delay, must be positive
▼ Output									
Q	Bool	false	False	True	True	True	False		Output that is set after expiration of time PT
ET	Time	T#0ms	False	True	True	True	False		Current time value
InOut									
Static									
▼ F_IEC_Timer_Instance	TON		False	True	True	True	False		
▼ Input									
IN	Bool	false	False	True	True	True	False		Start input
PT	Time	T#0ms	False	True	True	True	False		Duration of the on-delay, must be positive
▼ Output									
Q	Bool	false	False	True	True	True	False		Output that is set after expiration of time PT
ET	Time	T#0ms	False	True	True	True	False		Current time value
InOut									
Static									
HeartbeatChanged	Bool	false	False	True	True	True	False		
HeartbeatSeen	Bool	false	False	True	True	True	False		
▼ StandInStaleTimer	TON		False	True	True	True	False		
▼ Input									

Safety information: 2BC94038 Consistent; STEP 7 Safety V21;

Name	Data type	Start value	Retain	Accessible from HMI/OPC UA/Web API	Writ-able from HMI/OPC UA/ Web API	Visible in HMI engi-neering	Setpoint	Supervi-sion	Comment
IN	Bool	false	False	True	True	True	False		Start input
PT	Time	T#0ms	False	True	True	True	False		Duration of the on-delay, must be positive
▼ Output									
Q	Bool	false	False	True	True	True	False		Output that is set after expiration of time PT
ET	Time	T#0ms	False	True	True	True	False		Current time value
InOut									
Static									
StandInValid	Bool	false	False	True	True	True	False		
EStopClosedValid	Bool	false	False	True	True	True	False		
ZoneClosedValid	Bool	false	False	True	True	True	False		
ResetPressedValid	Bool	false	False	True	True	True	False		
HeartbeatMemory	Int	0	False	True	True	True	False		