


Electrode 1 Voltage Reconstruction



Lambda: FALSE
10th percentile of R2 (mean across time windows): 0.797073716938451
Largest eigenvalue norm: 1.00166930171187
MSE: 9.36103303879201e-05

subj105 Electrodes with Fragility > 0.5:
6, RPP7, RPP8, RST1, RST6, RST7, RST8, EKG1, RBT1, RBT2, RBT3, RPT5, RPT6, LSI3, LSI4, LSI5, LSI6, LSI7, LSI8, LDI1, LDI3, LDI4, LDI5, LDI6, LDI7, LDI8

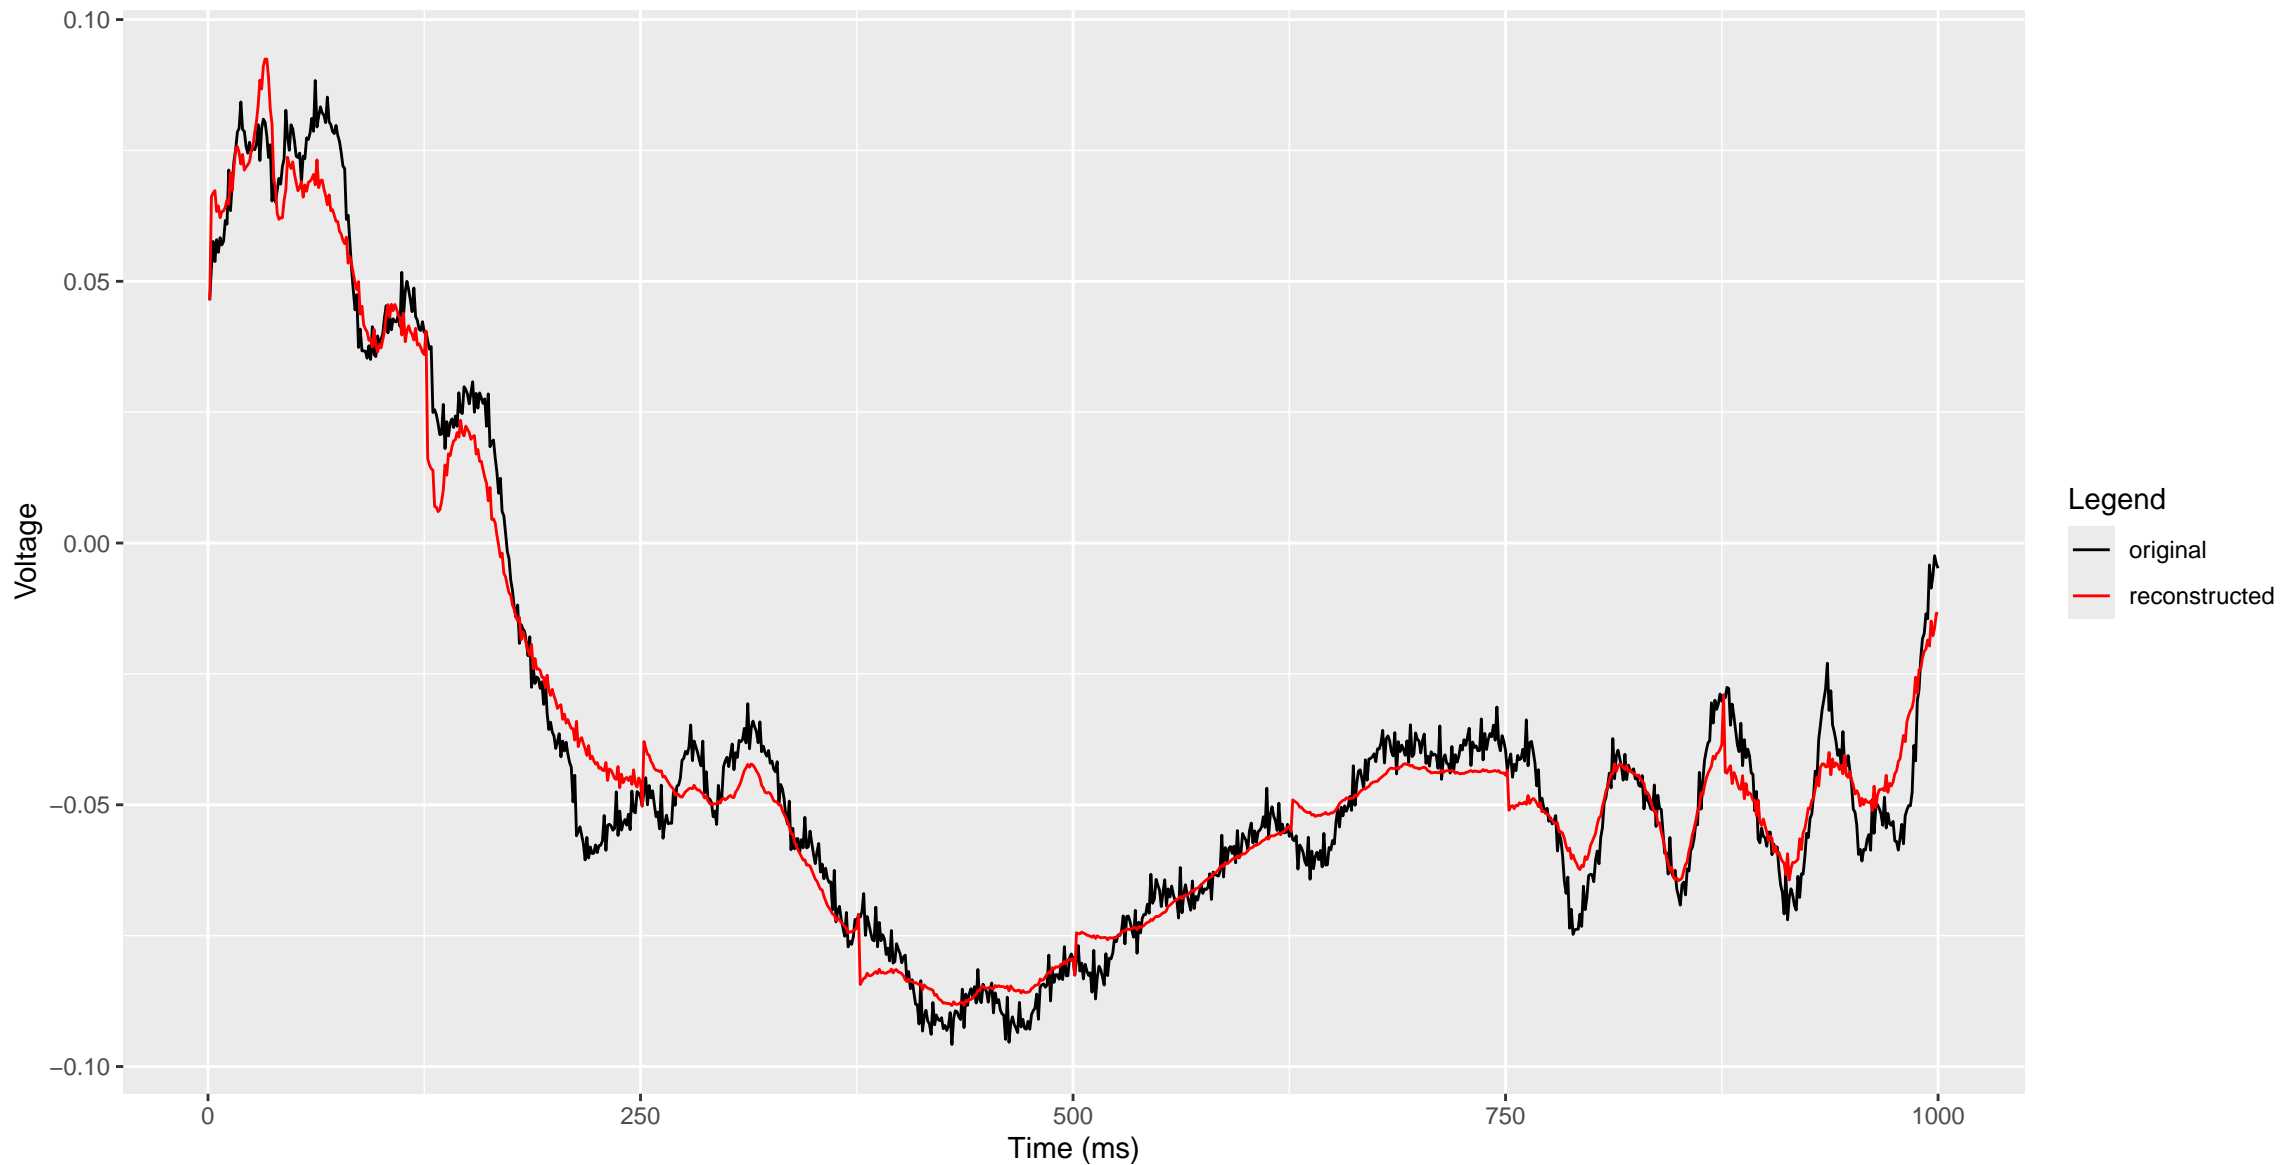