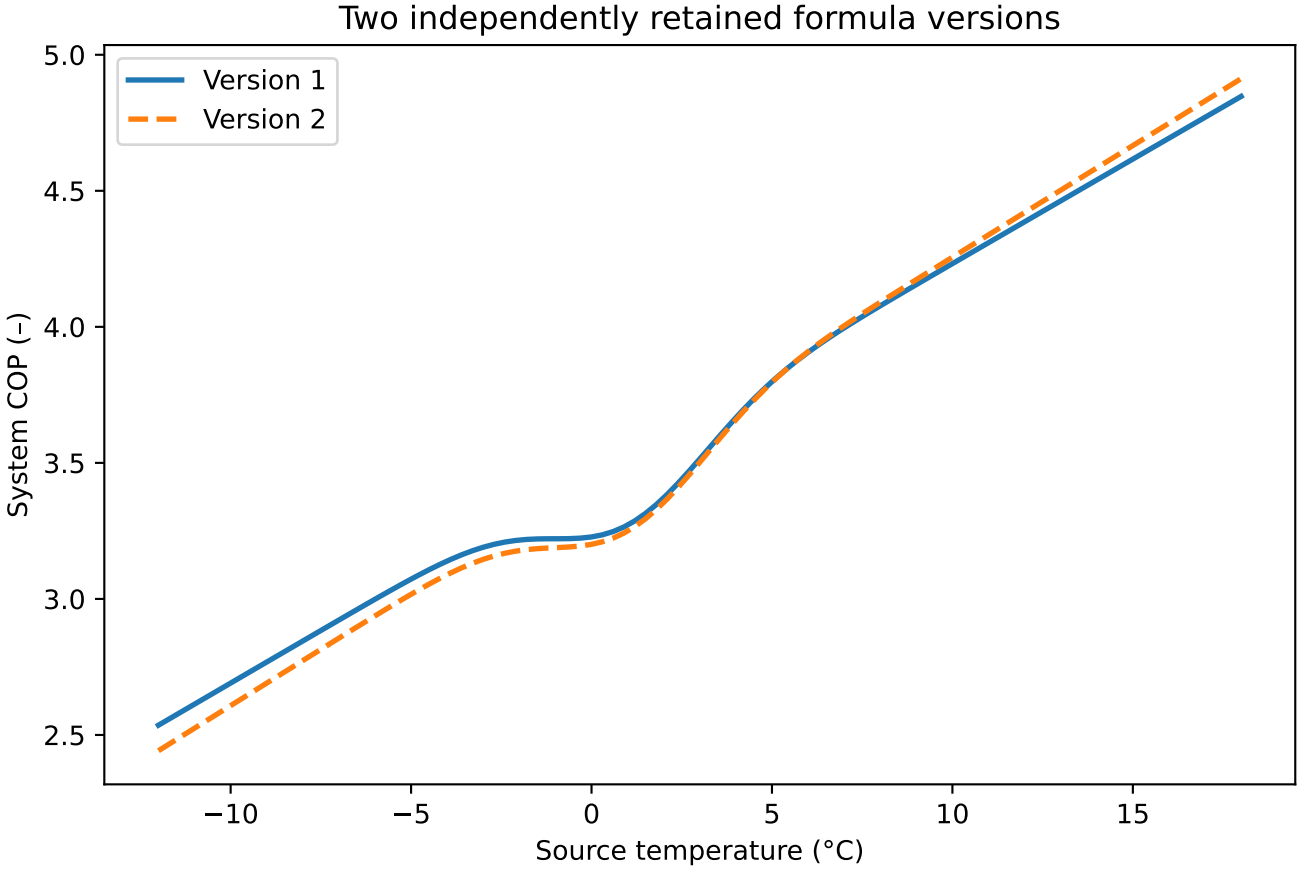
Two independently retained formula versions
Version 1
Version 2
System COP (–)
Source temperature (°C)
5.0
4.5
4.0
3.5
3.0
2.5
−10
−5
0
5
10
15