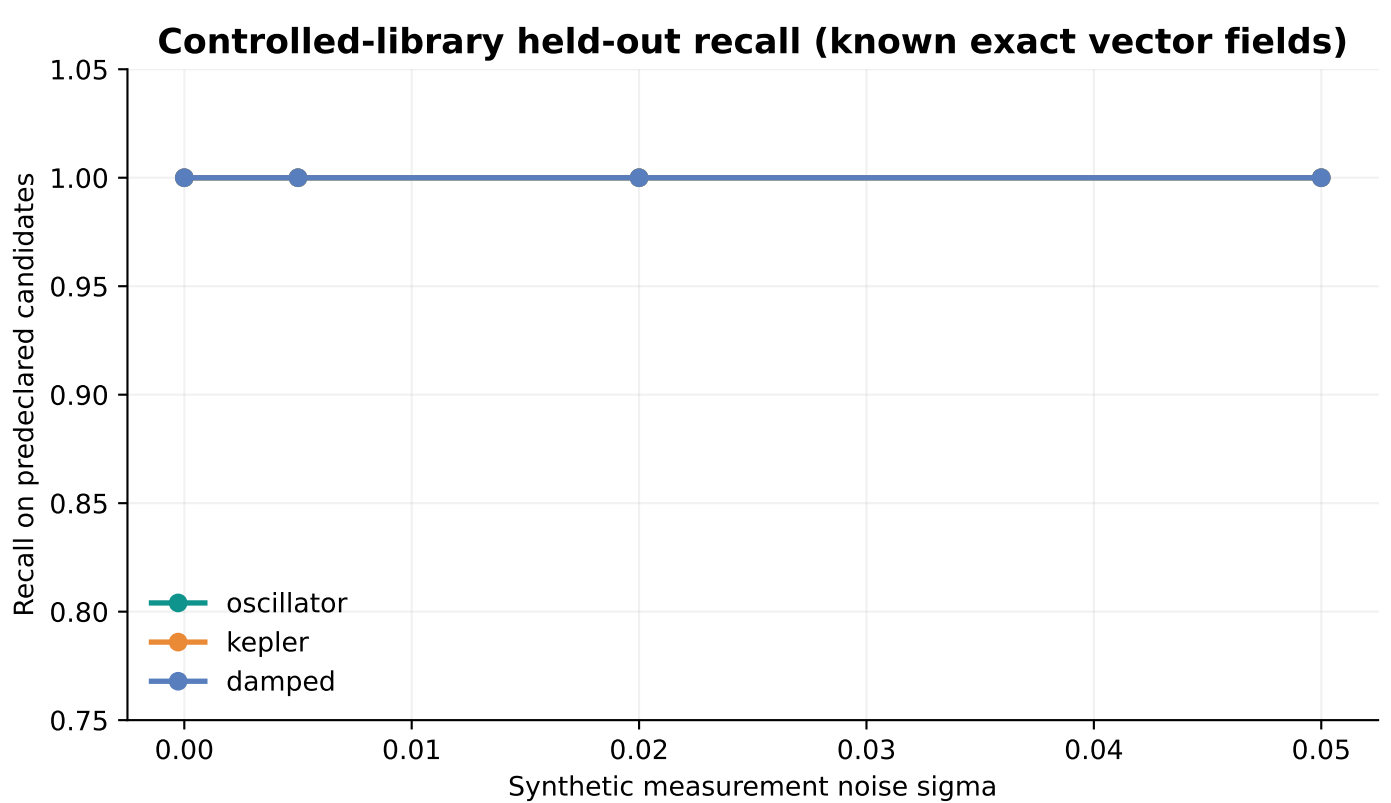
Controlled-library held-out recall (known exact vector fields)
Recall on predeclared candidates
1.05
1.00
0.95
0.90
0.85
0.80
0.75
oscillator
kepler
damped
0.00
0.01
0.02
0.03
0.04
0.05
Synthetic measurement noise sigma