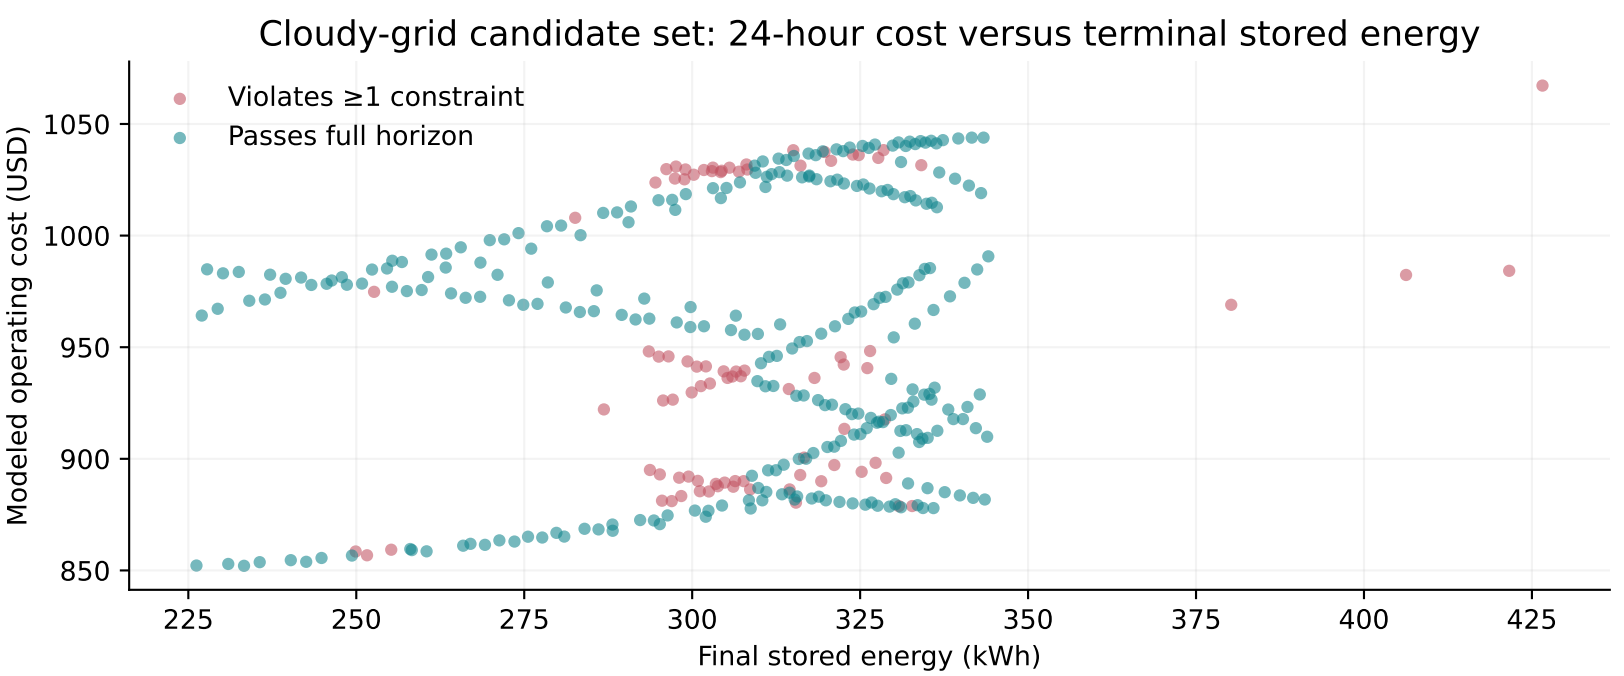
Cloudy-grid candidate set: 24-hour cost versus terminal stored energy
Violates ≥1 constraint
Passes full horizon
Modeled operating cost (USD)
1050
1000
950
900
850
225
250
275
300
325
350
375
400
425
Final stored energy (kWh)