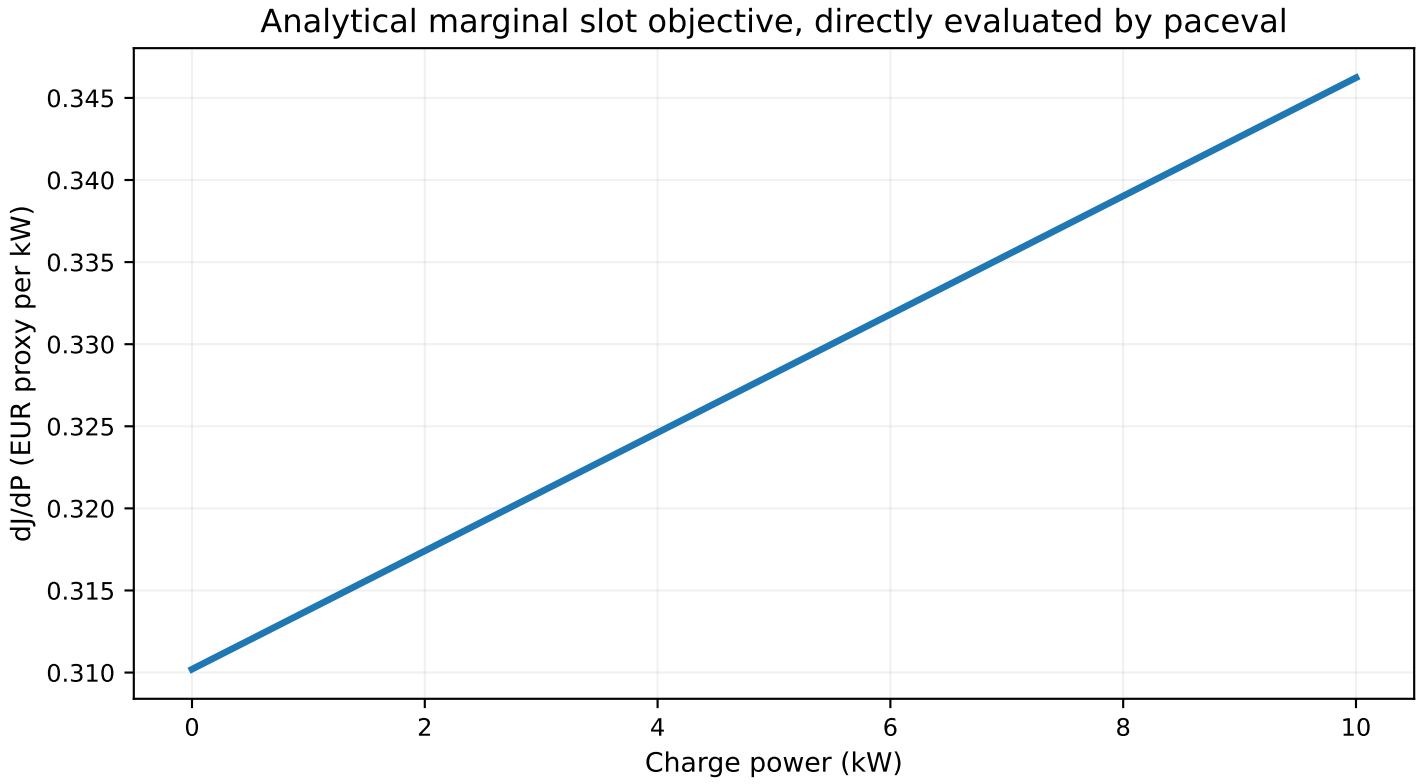
Analytical marginal slot objective, directly evaluated by paceval
dJ/dP (EUR proxy per kW)
0.345
0.340
0.335
0.330
0.325
0.320
0.315
0.310
0
2
4
6
8
10
Charge power (kW)