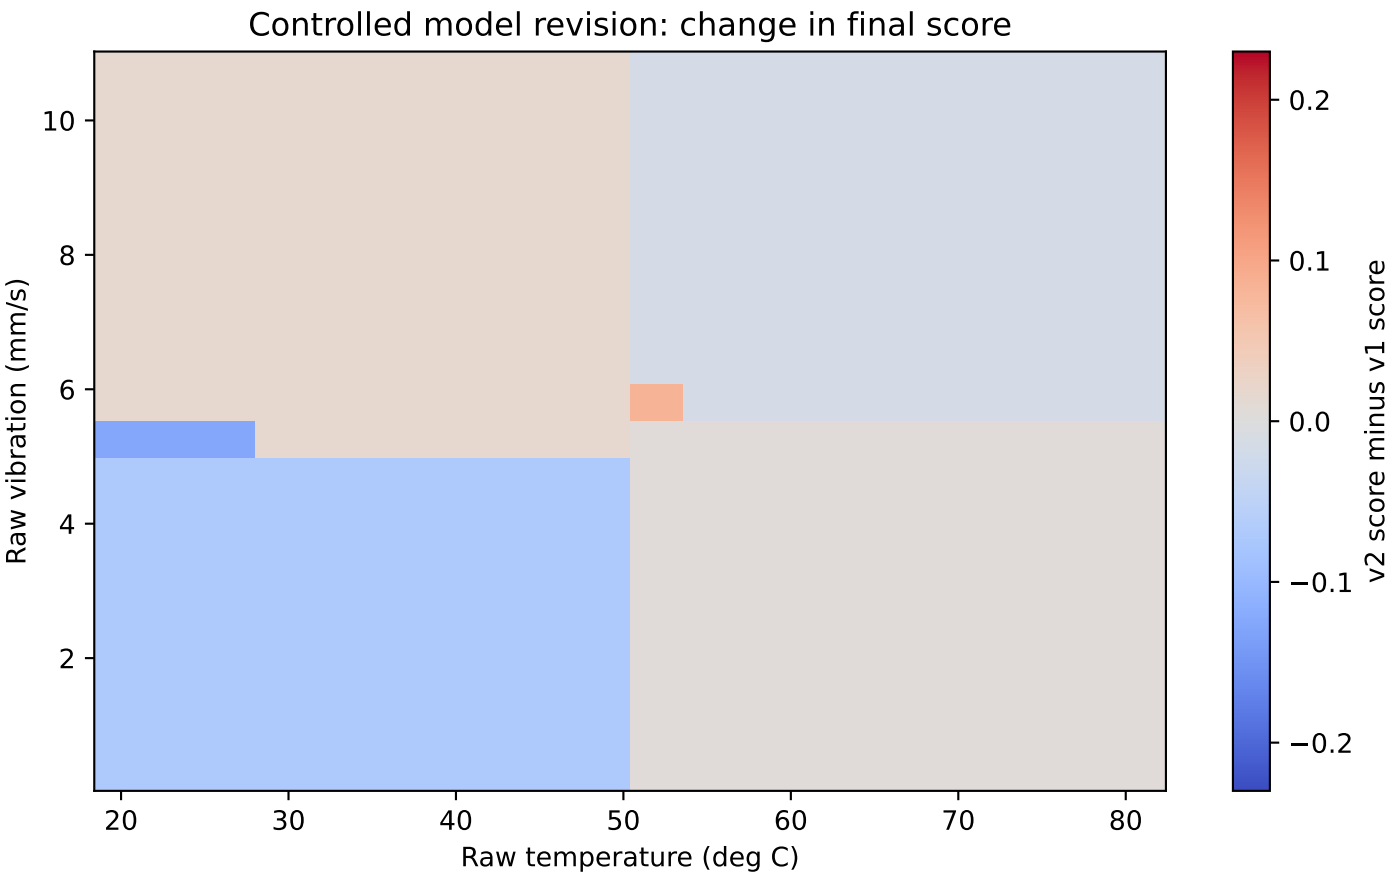
Controlled model revision: change in final score
Raw vibration (mm/s)
10
8
6
4
2
20
30
40
50
60
70
80
Raw temperature (deg C)
0.2
0.1
0.0
−0.1
−0.2
v2 score minus v1 score