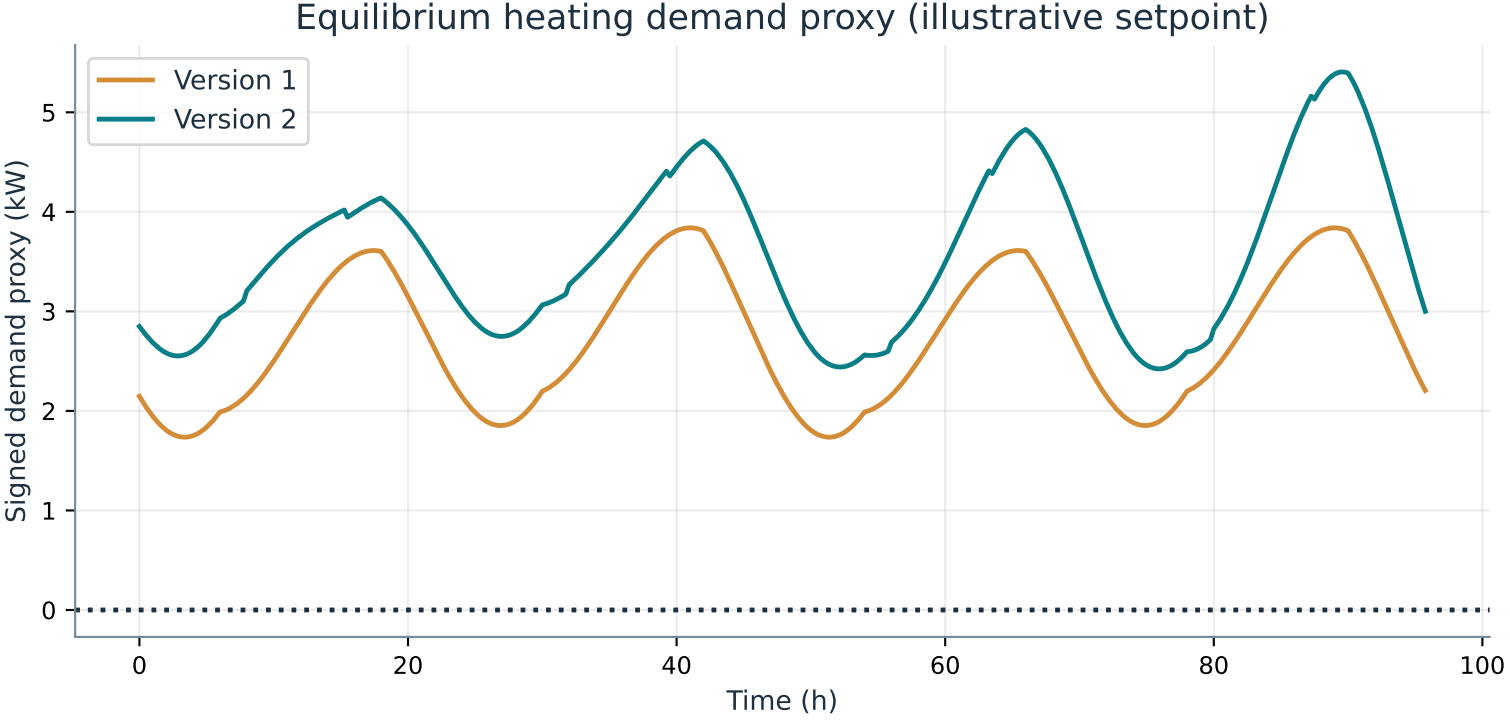
Equilibrium heating demand proxy (illustrative setpoint)
Version 1
Version 2
Signed demand proxy (kW)
0
1
2
3
4
5
0
20
40
60
80
100
Time (h)