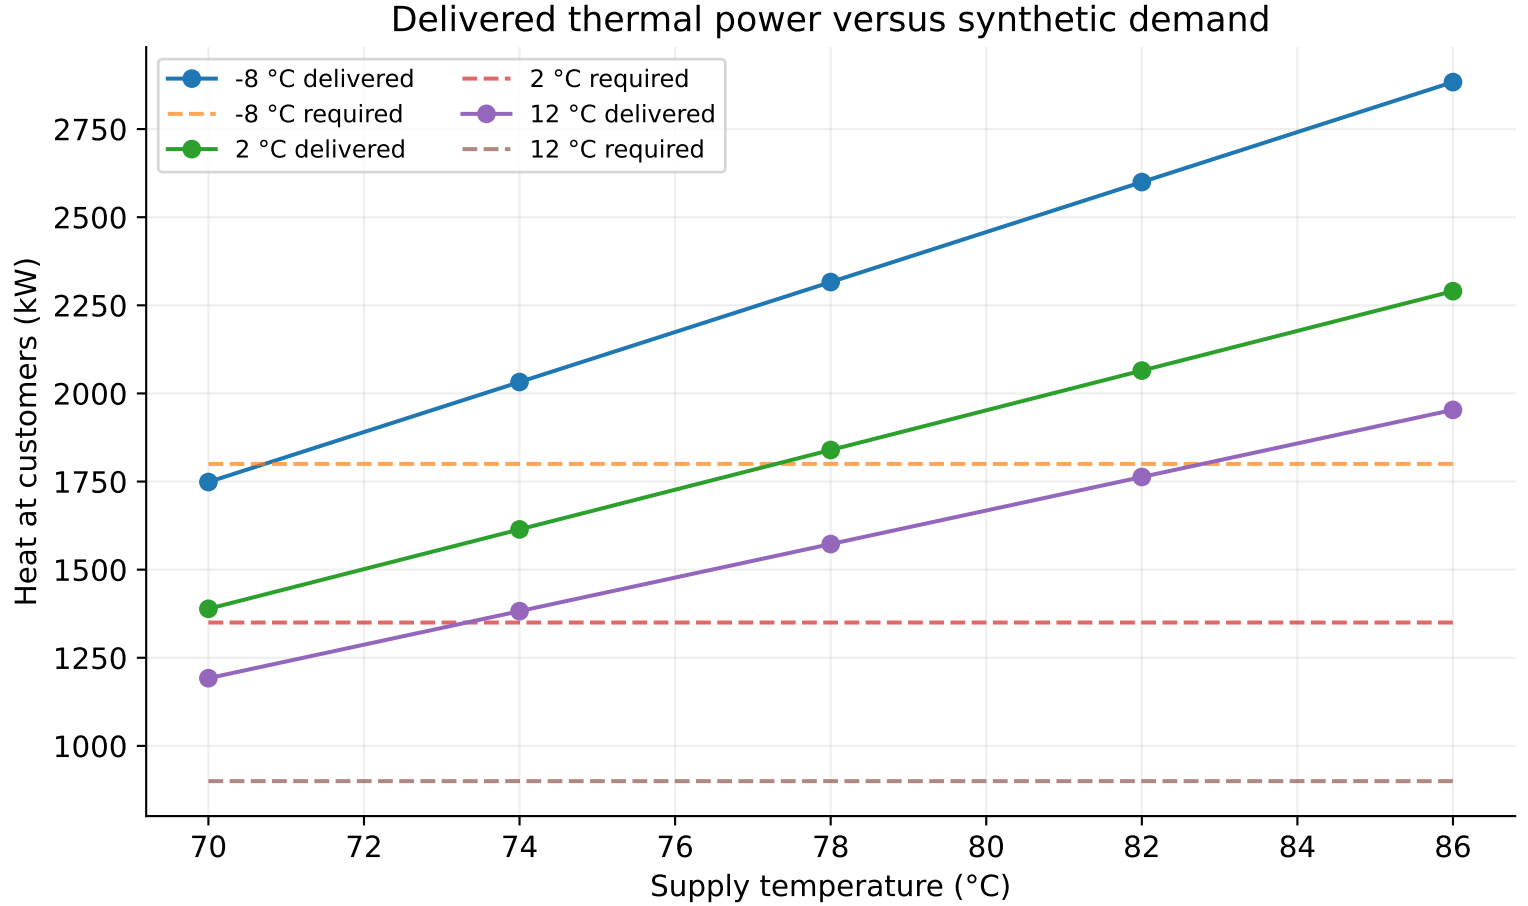
Delivered thermal power versus synthetic demand
-8 °C delivered
-8 °C required
2 °C delivered
2 °C required
12 °C delivered
12 °C required
Heat at customers (kW)
2750
2500
2250
2000
1750
1500
1250
1000
70
72
74
76
78
80
82
84
86
Supply temperature (°C)