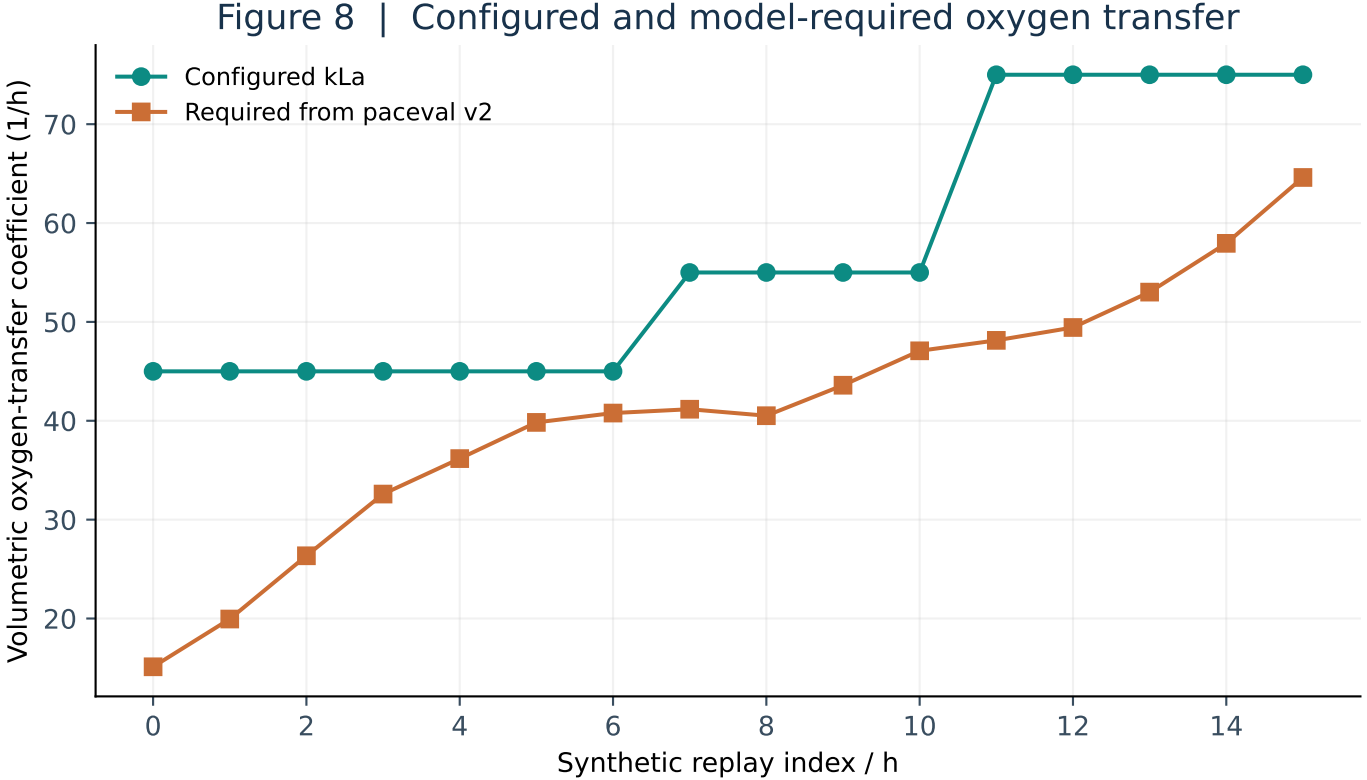
Figure 8 | Configured and model-required oxygen transfer
Configured kLa
Required from paceval v2
Volumetric oxygen-transfer coefficient (1/h)
70
60
50
40
30
20
0
2
4
6
8
10
12
14
Synthetic replay index / h