

GRÁFICO TENSÃO - BENCHMARK - VITORIA/ES

BENCHMARK - BENCHMARK 500kVA - 380/220V - INT: 10s - REV00

FAIXA ADEQUADA $350 \leq TL \leq 399$ - ANEEL PRODIST MÓDULO 8

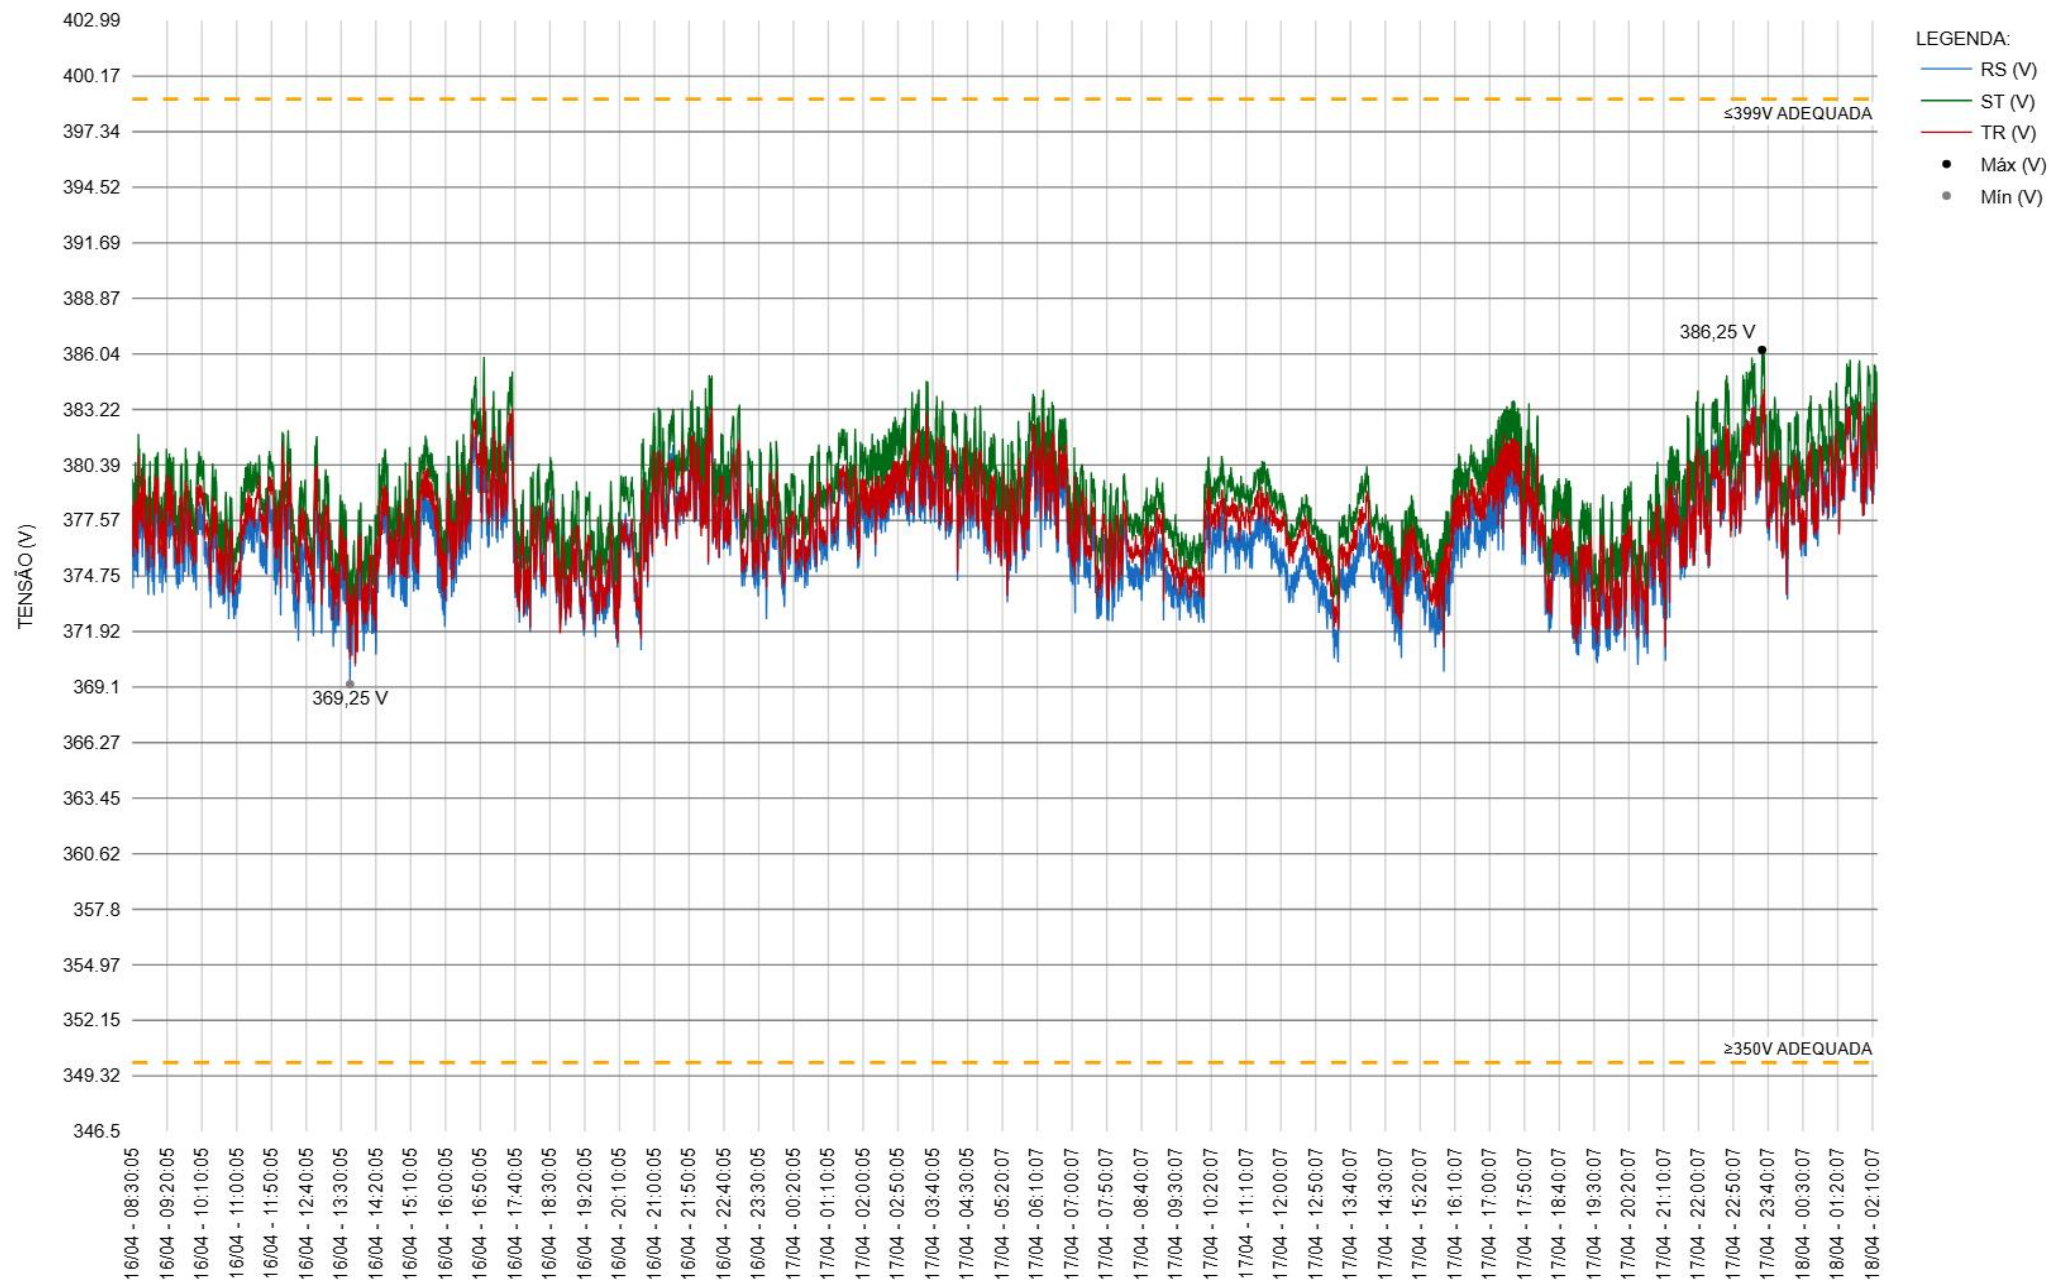


GRÁFICO CORRENTE - BENCHMARK - VITORIA/ES

BENCHMARK - BENCHMARK 500kVA - 380/220V - INT: 10s - REV00


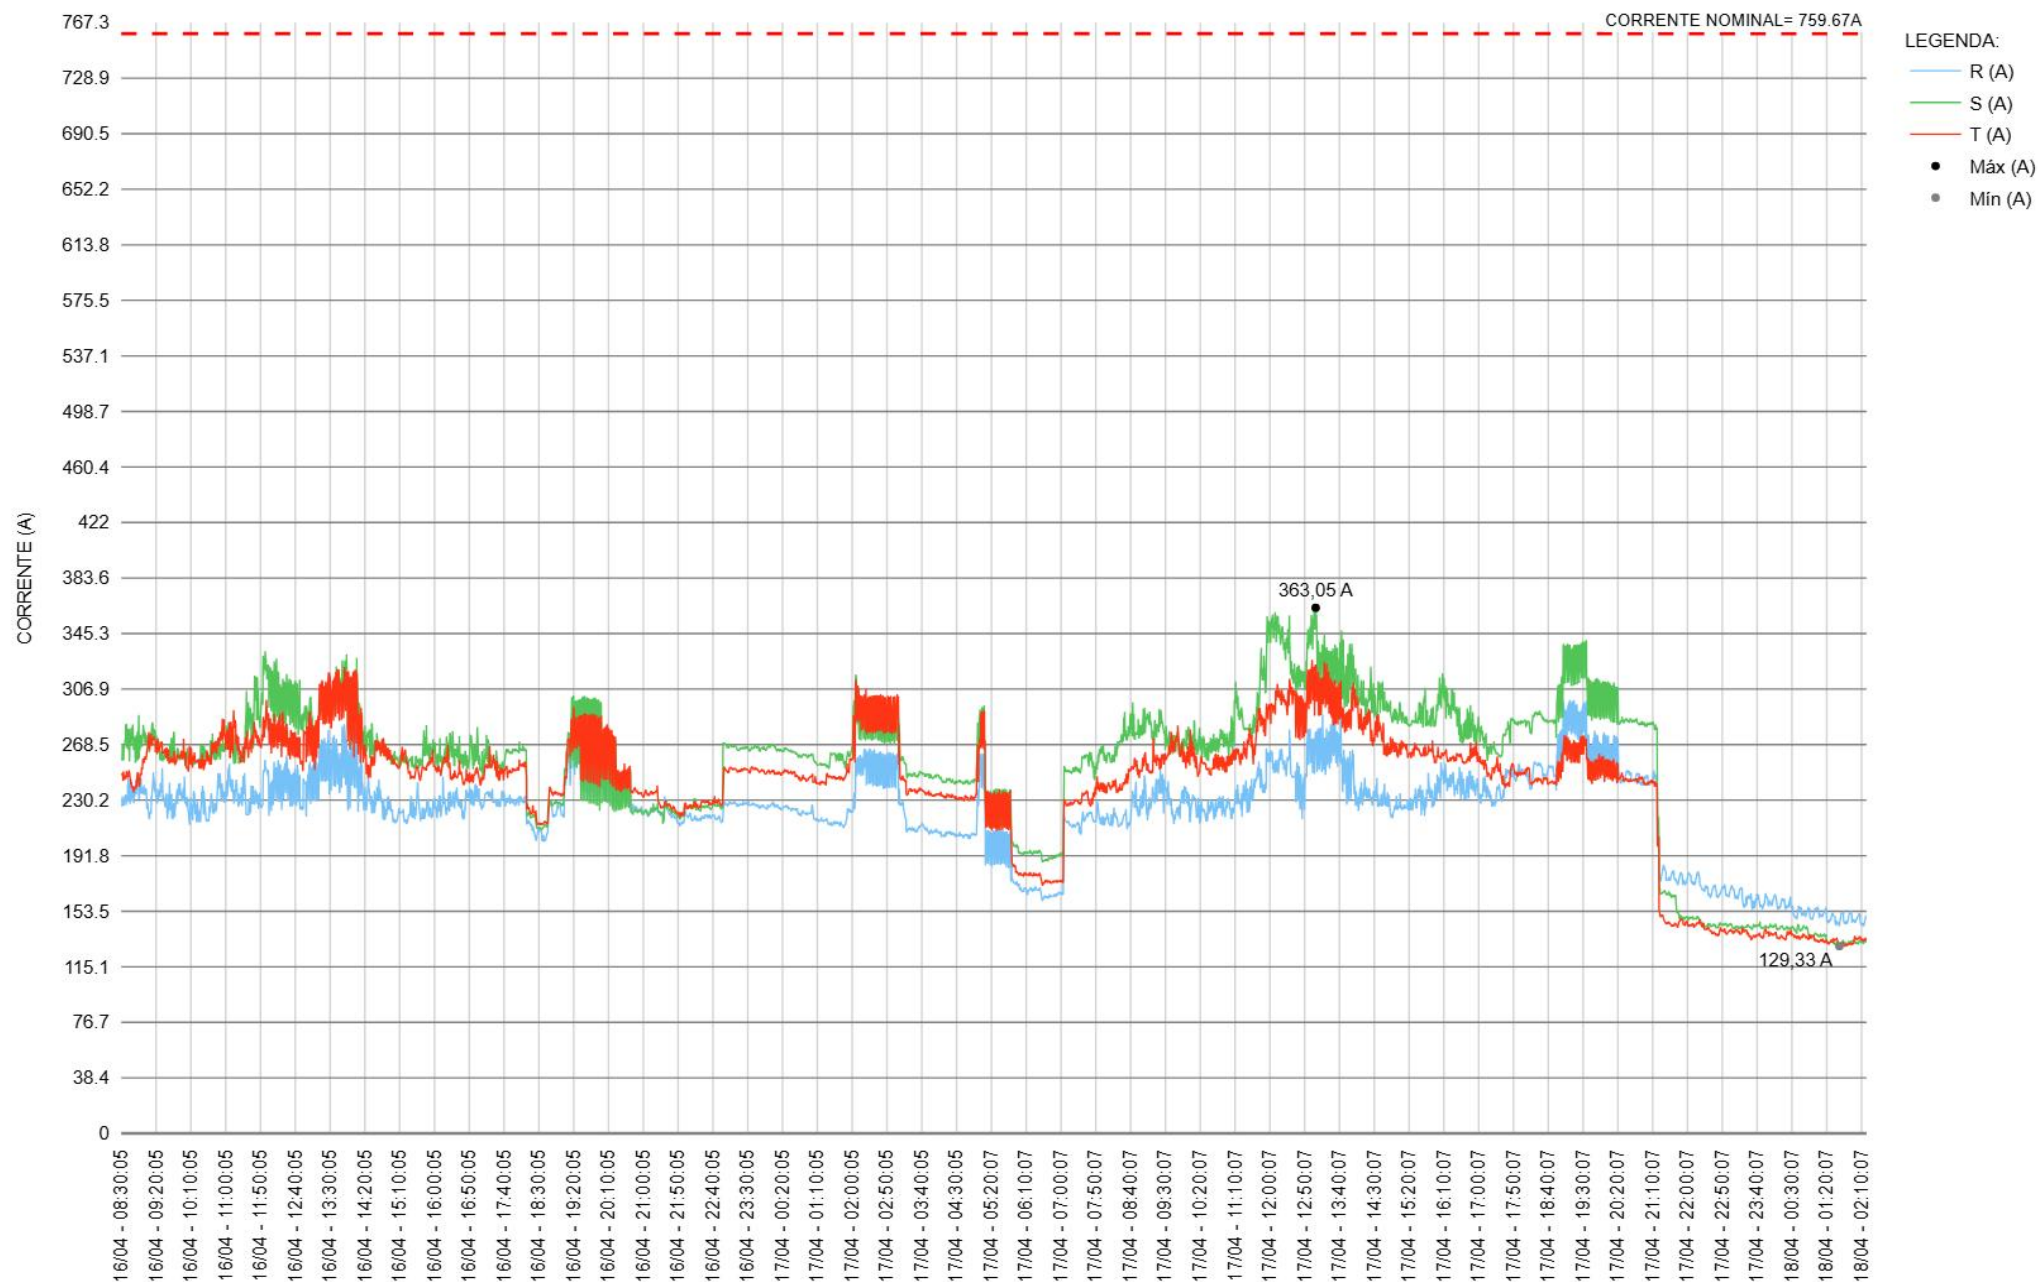


GRÁFICO POTÊNCIA ATIVA - BENCHMARK - VITORIA/ES

BENCHMARK - BENCHMARK 500kVA - 380/220V - INT: 10s - REV00

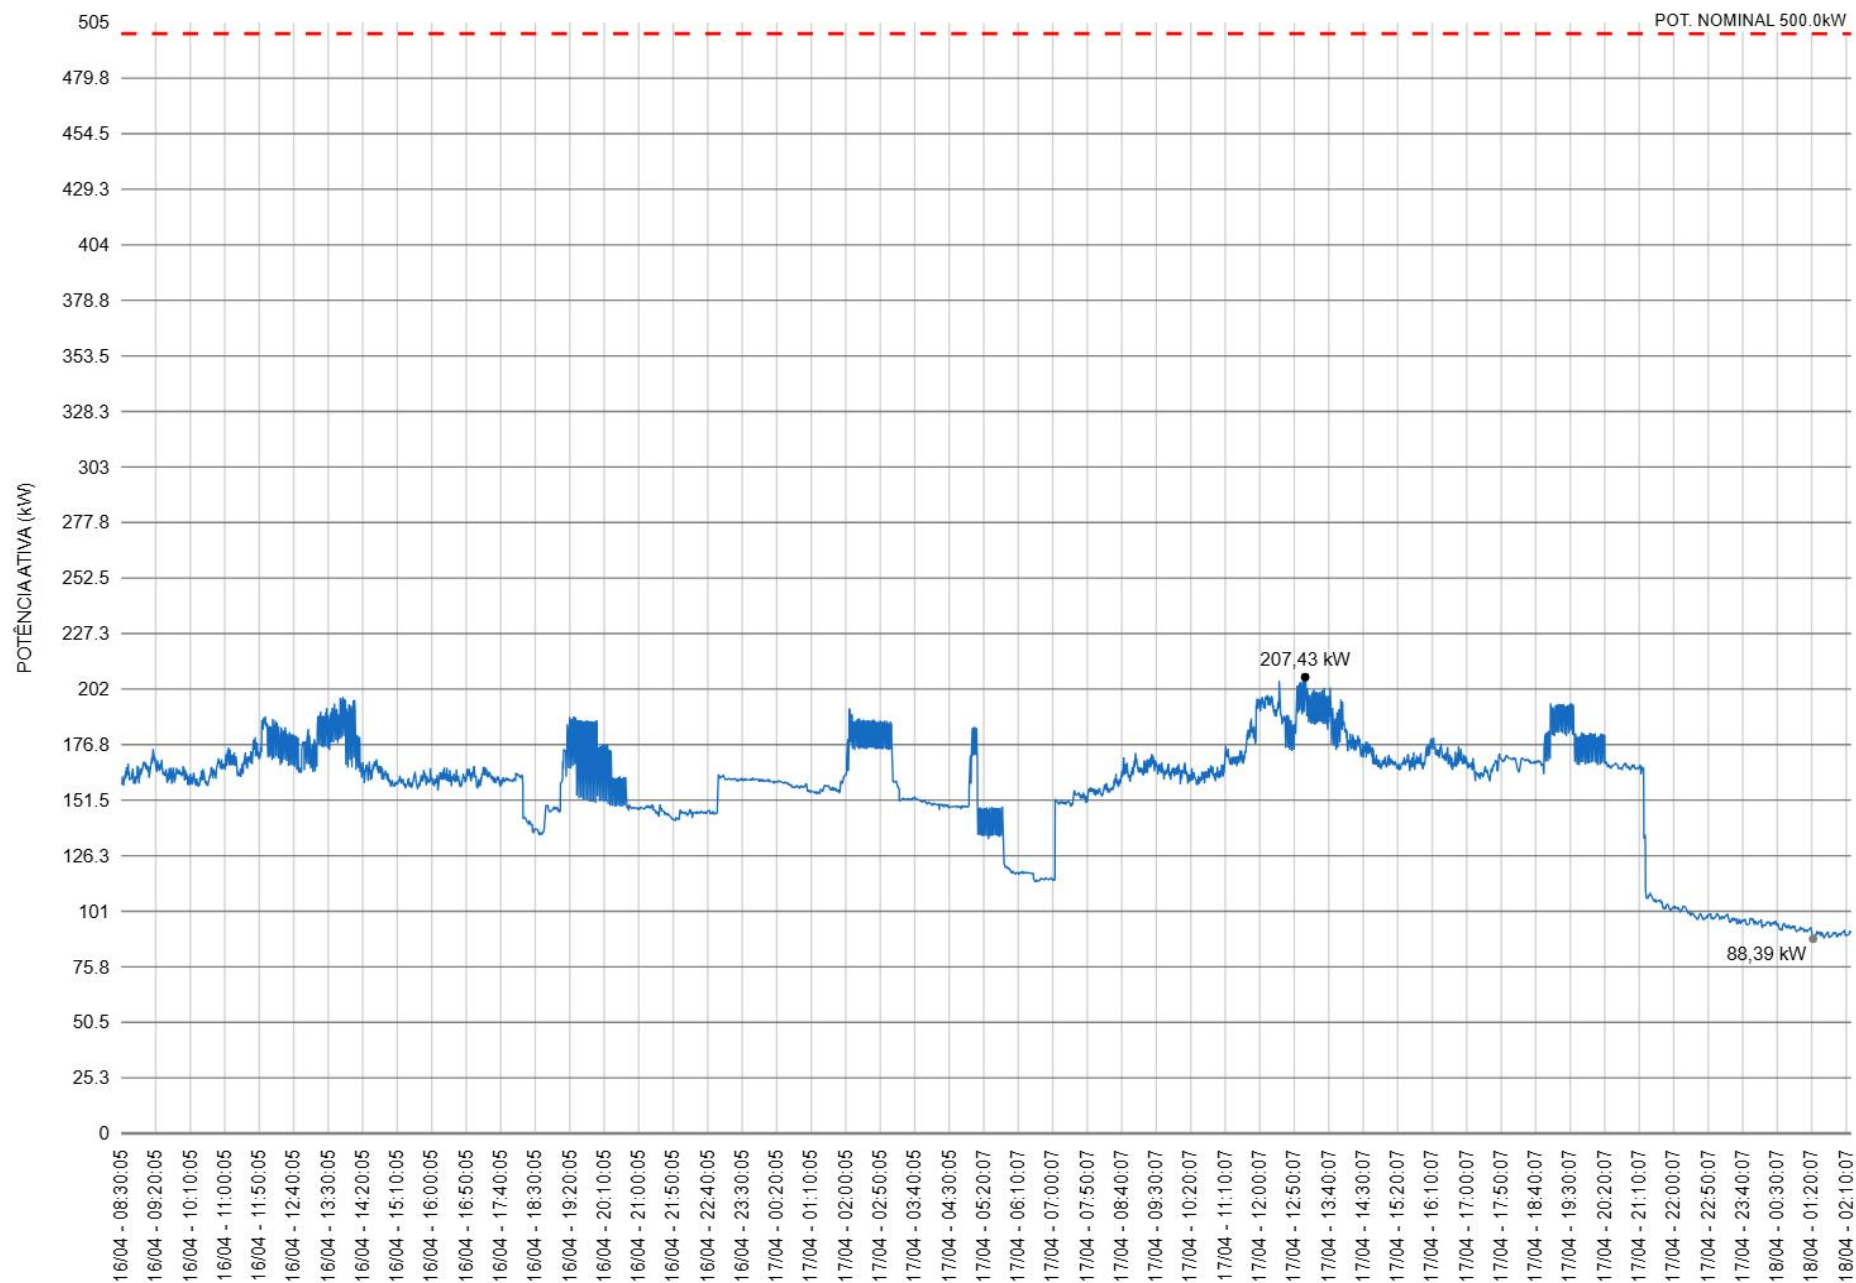


LEGENDA:

- kW 3F
- Máx (kW)
- Min (kW)

GRÁFICO POTÊNCIA APARENTE - BENCHMARK - VITORIA/ES

BENCHMARK - BENCHMARK 500kVA - 380/220V - INT: 10s - REV00

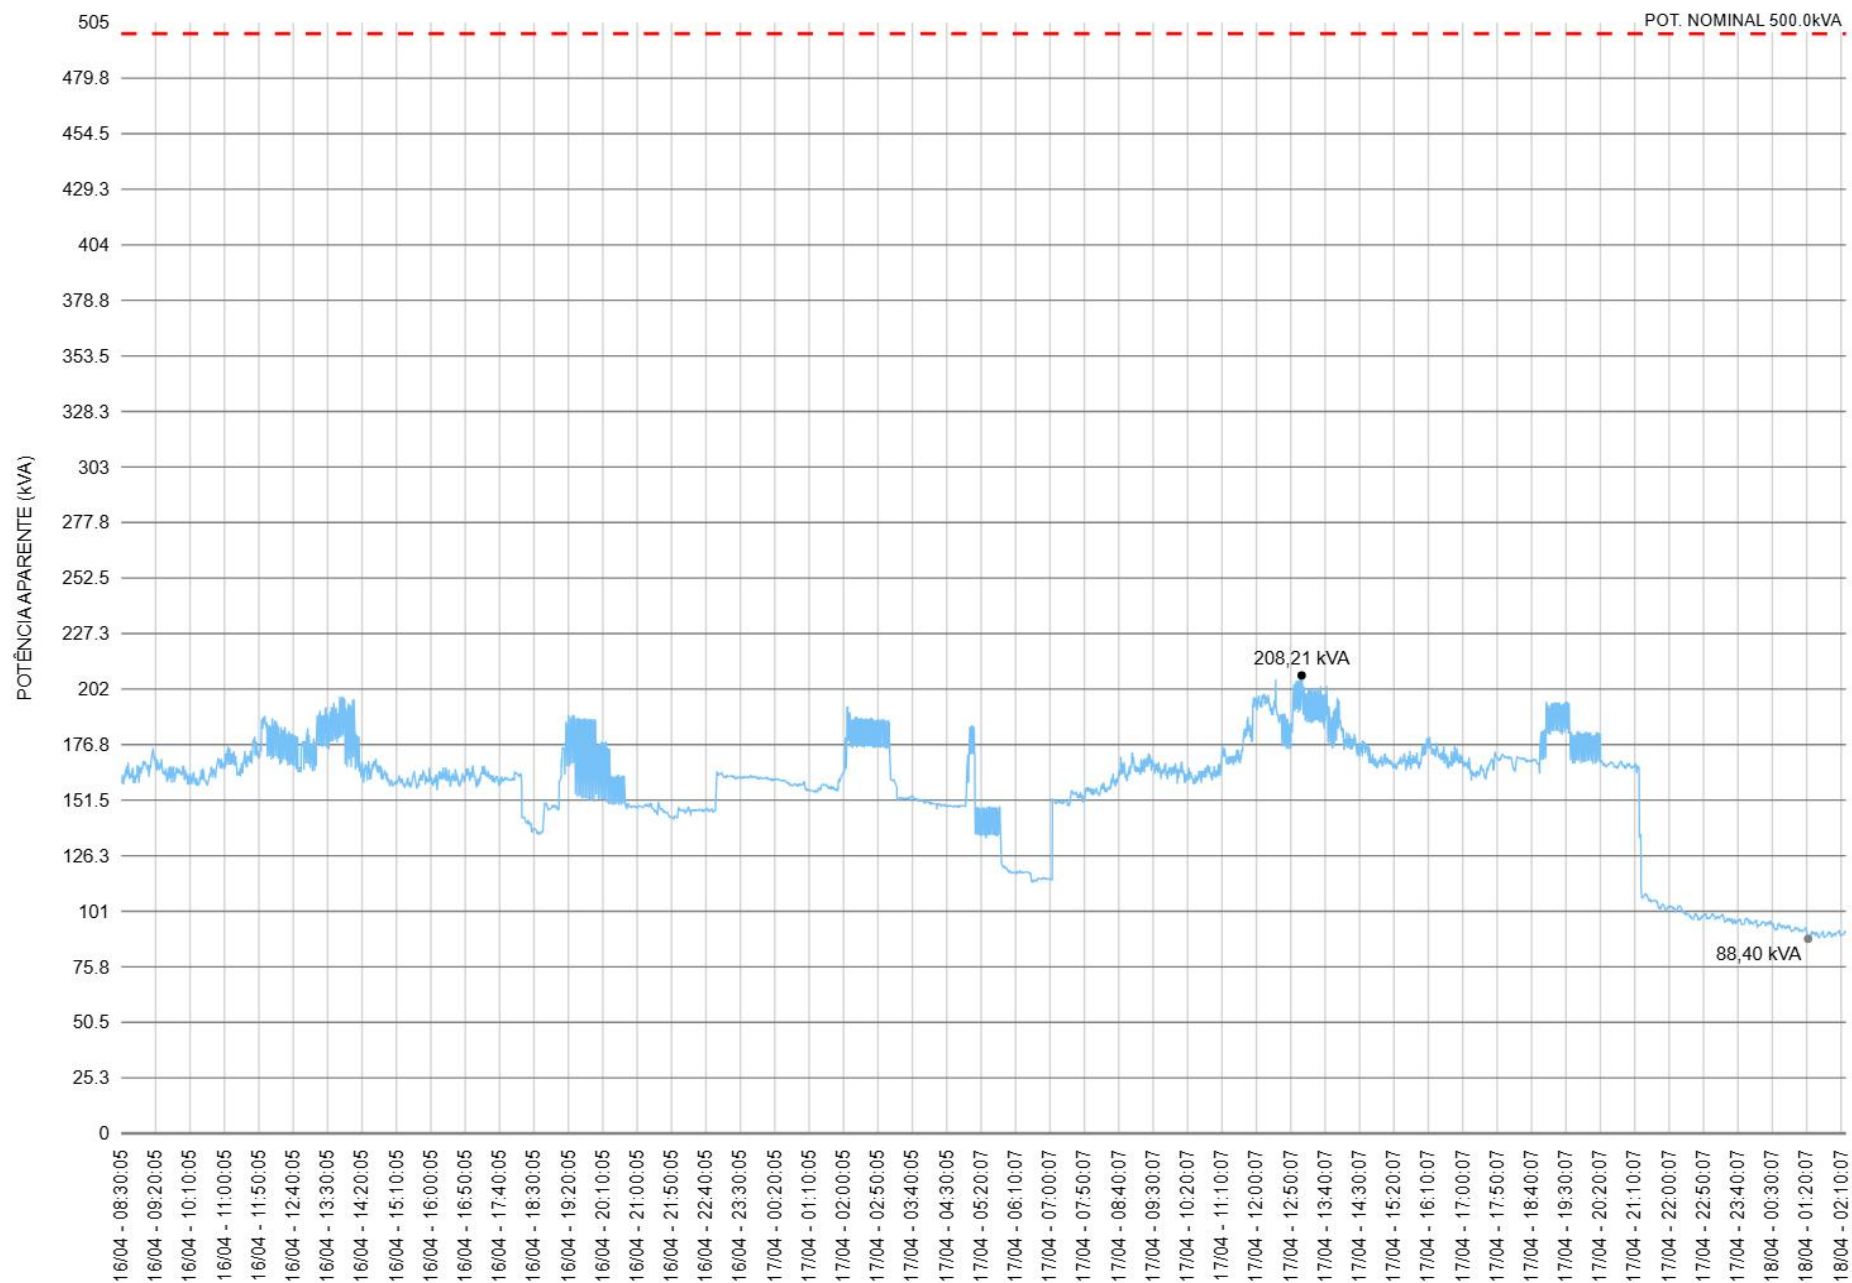

LEGENDA:

- kVA 3F
- Máx (kVA)
- Mín (kVA)

GRÁFICO FATOR DE POTÊNCIA - BENCHMARK - VITORIA/ES

BENCHMARK - BENCHMARK 500kVA - 380/220V - INT: 10s - REV00

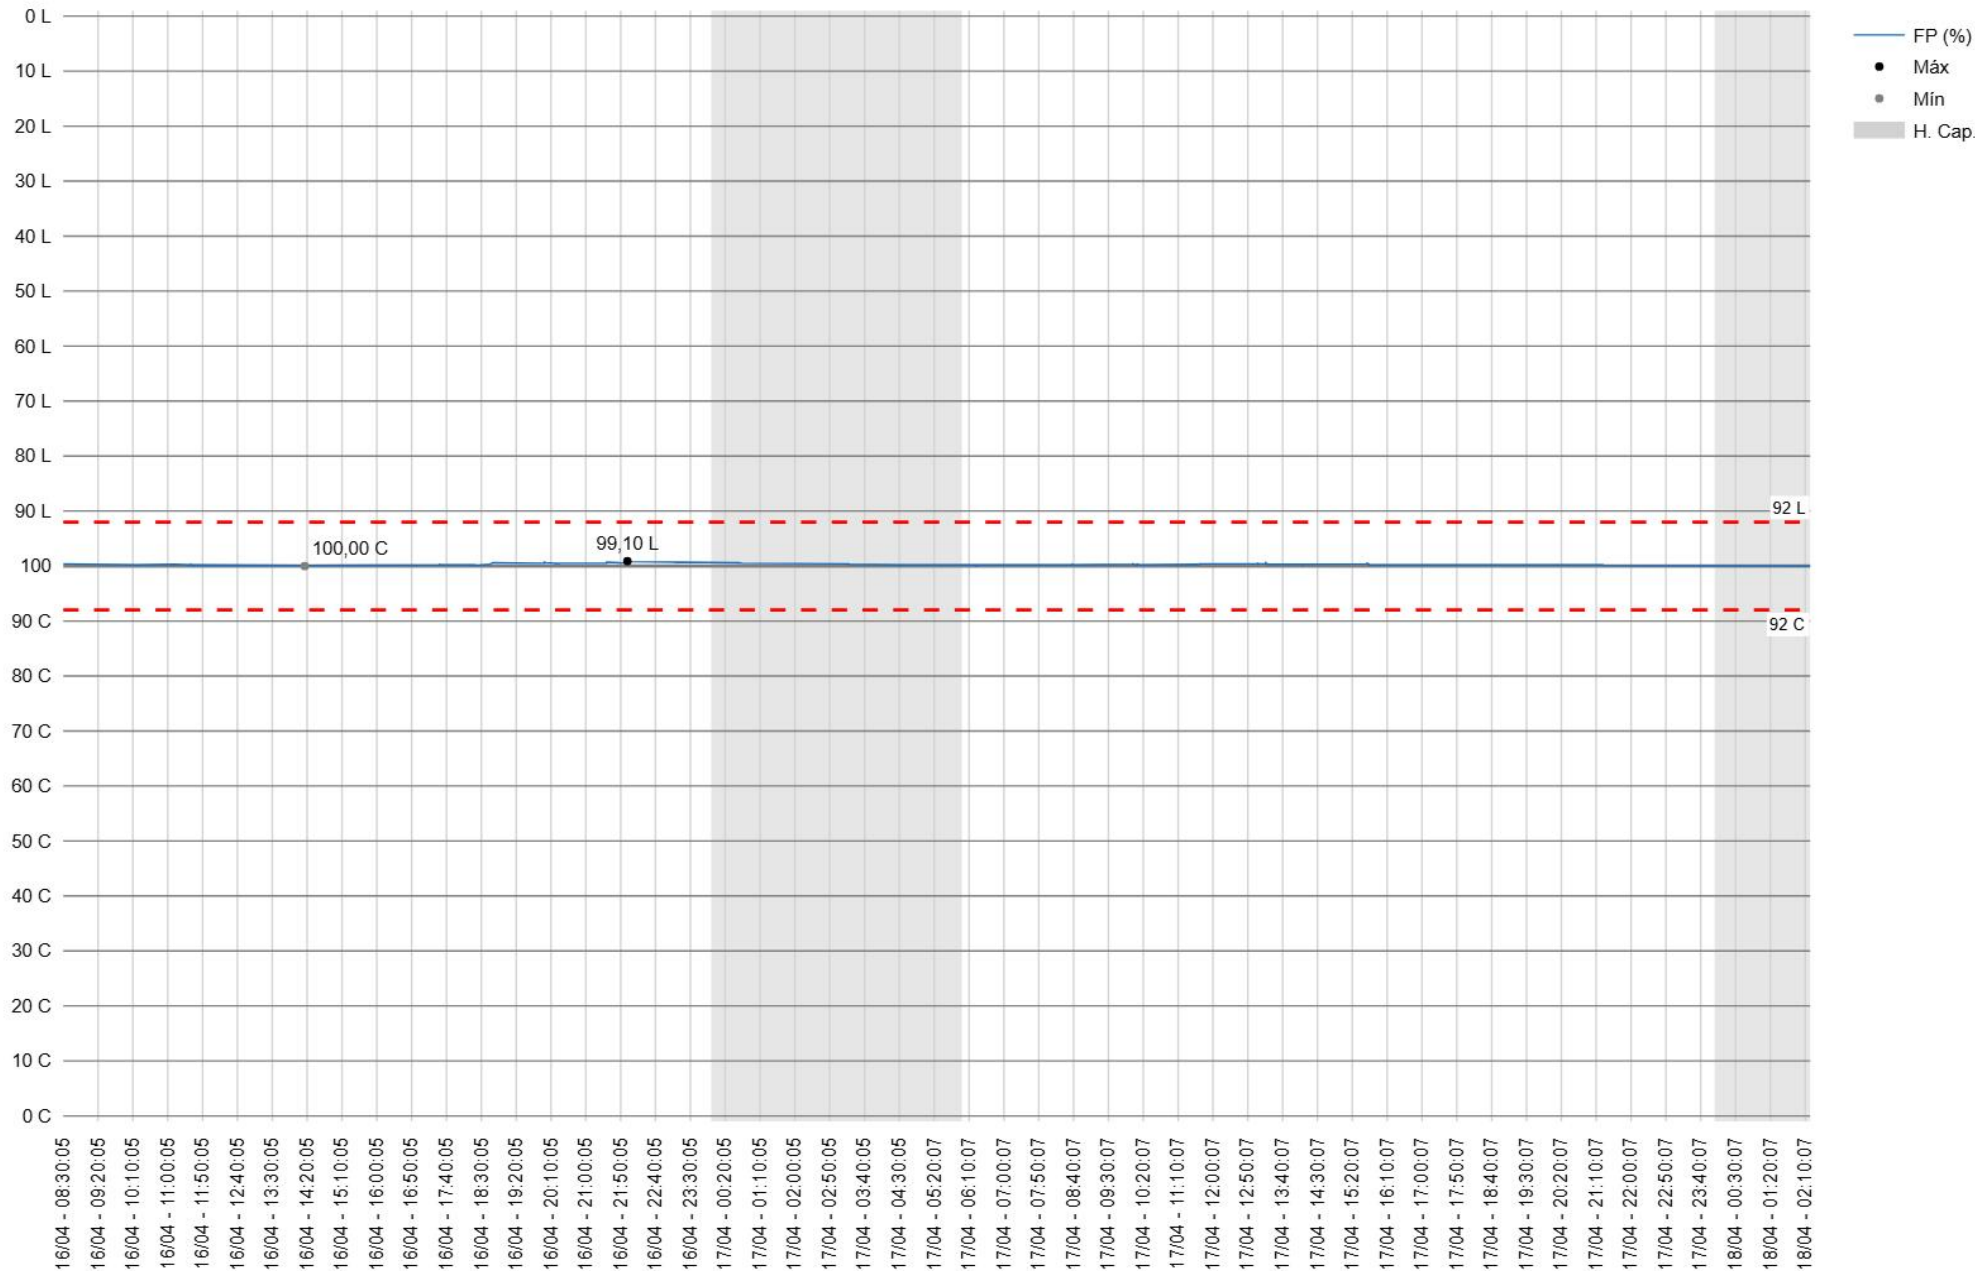


GRÁFICO DHT TENSÃO - BENCHMARK - VITORIA/ES

BENCHMARK - BENCHMARK 500kVA - 380/220V - INT: 10s - REV00

LIMITE 10% - ANEEL PRODIST MÓDULO 8

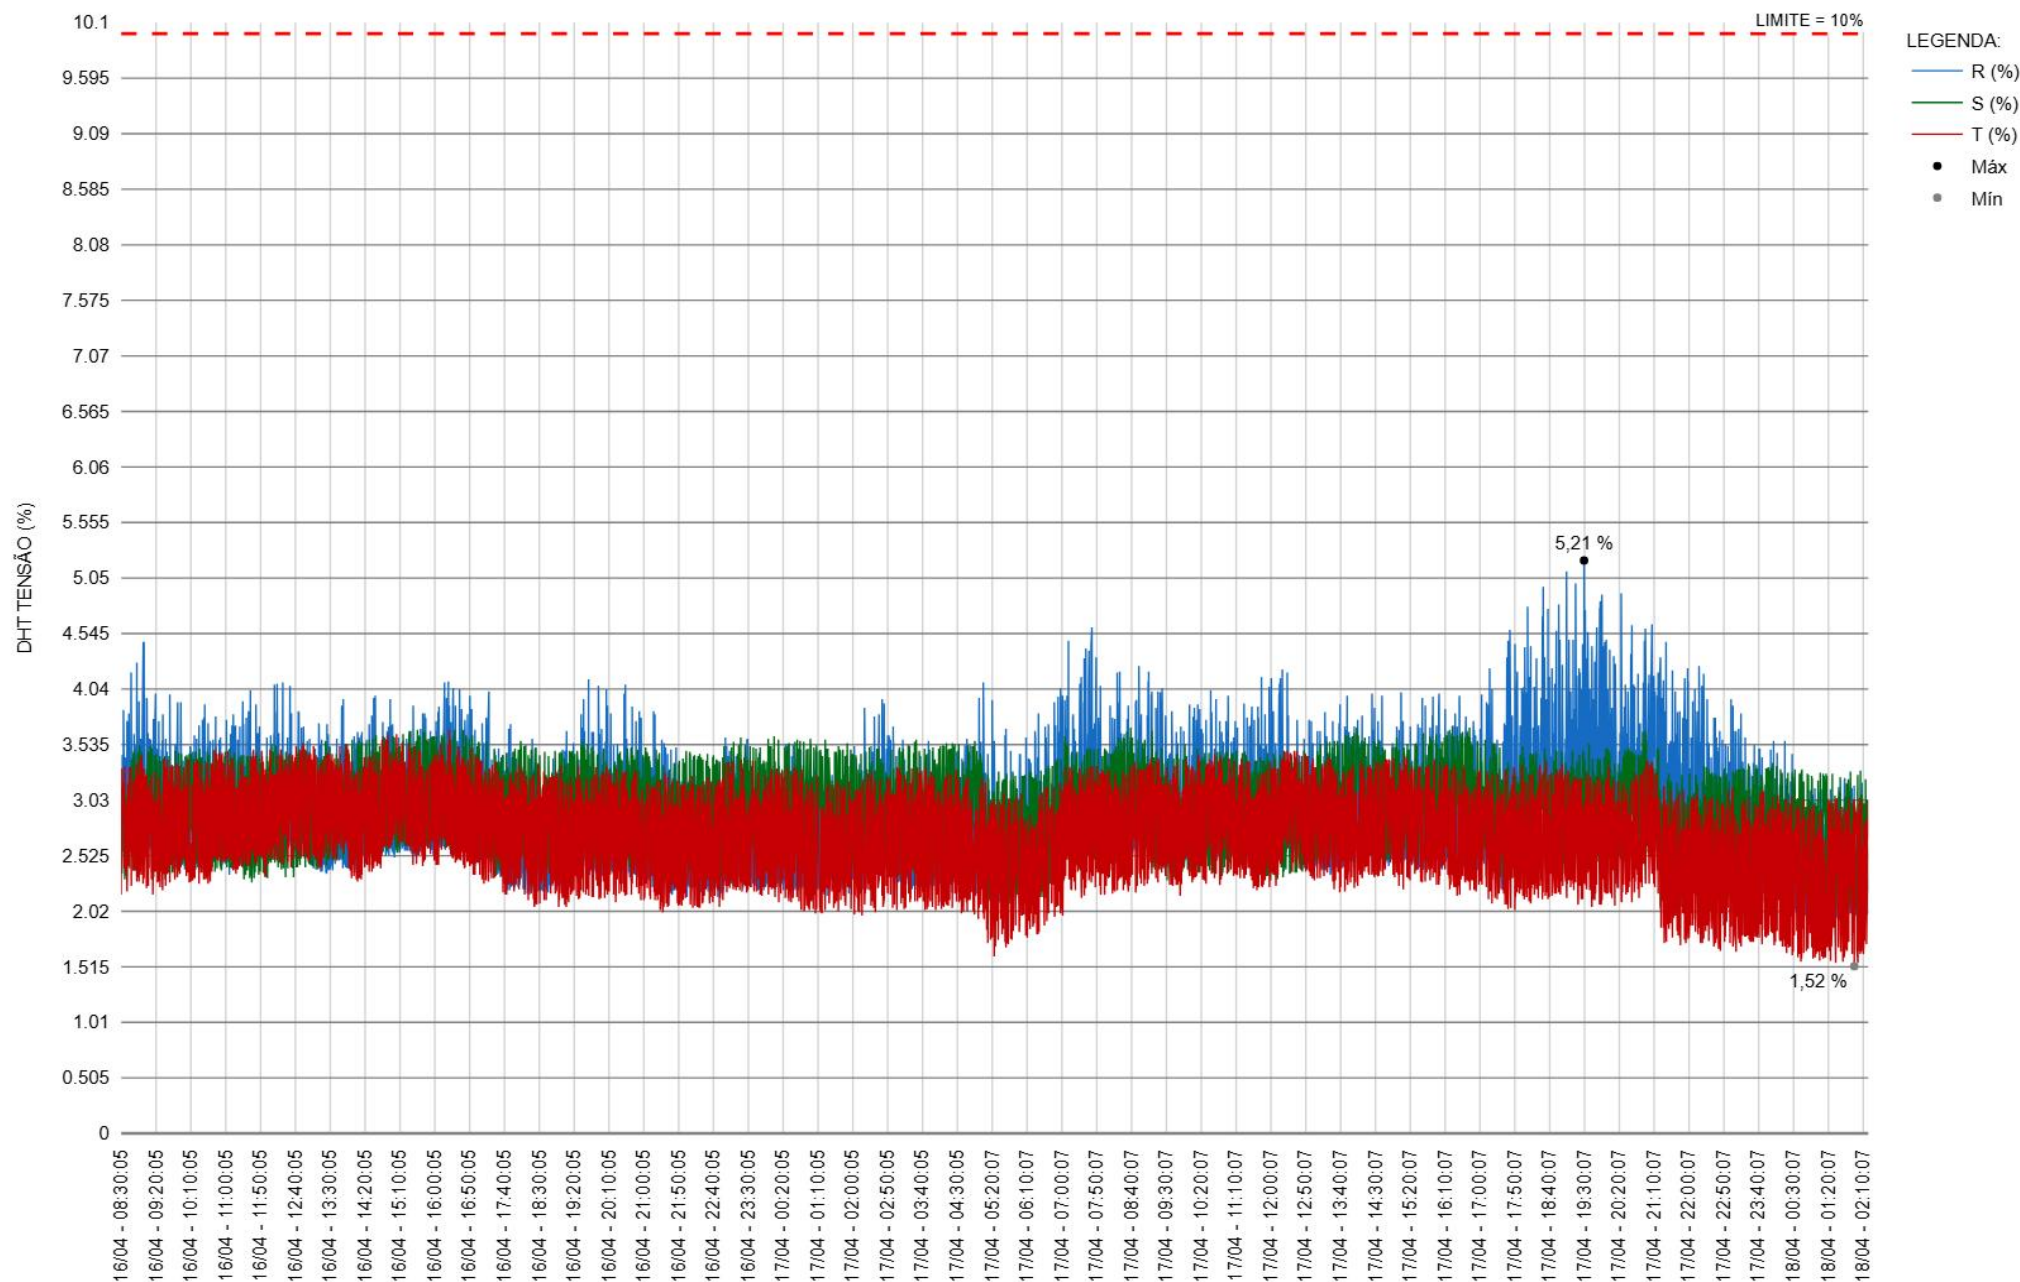


GRÁFICO DHT CORRENTE - BENCHMARK - VITORIA/ES

BENCHMARK - BENCHMARK 500kVA - 380/220V - INT: 10s - REV00

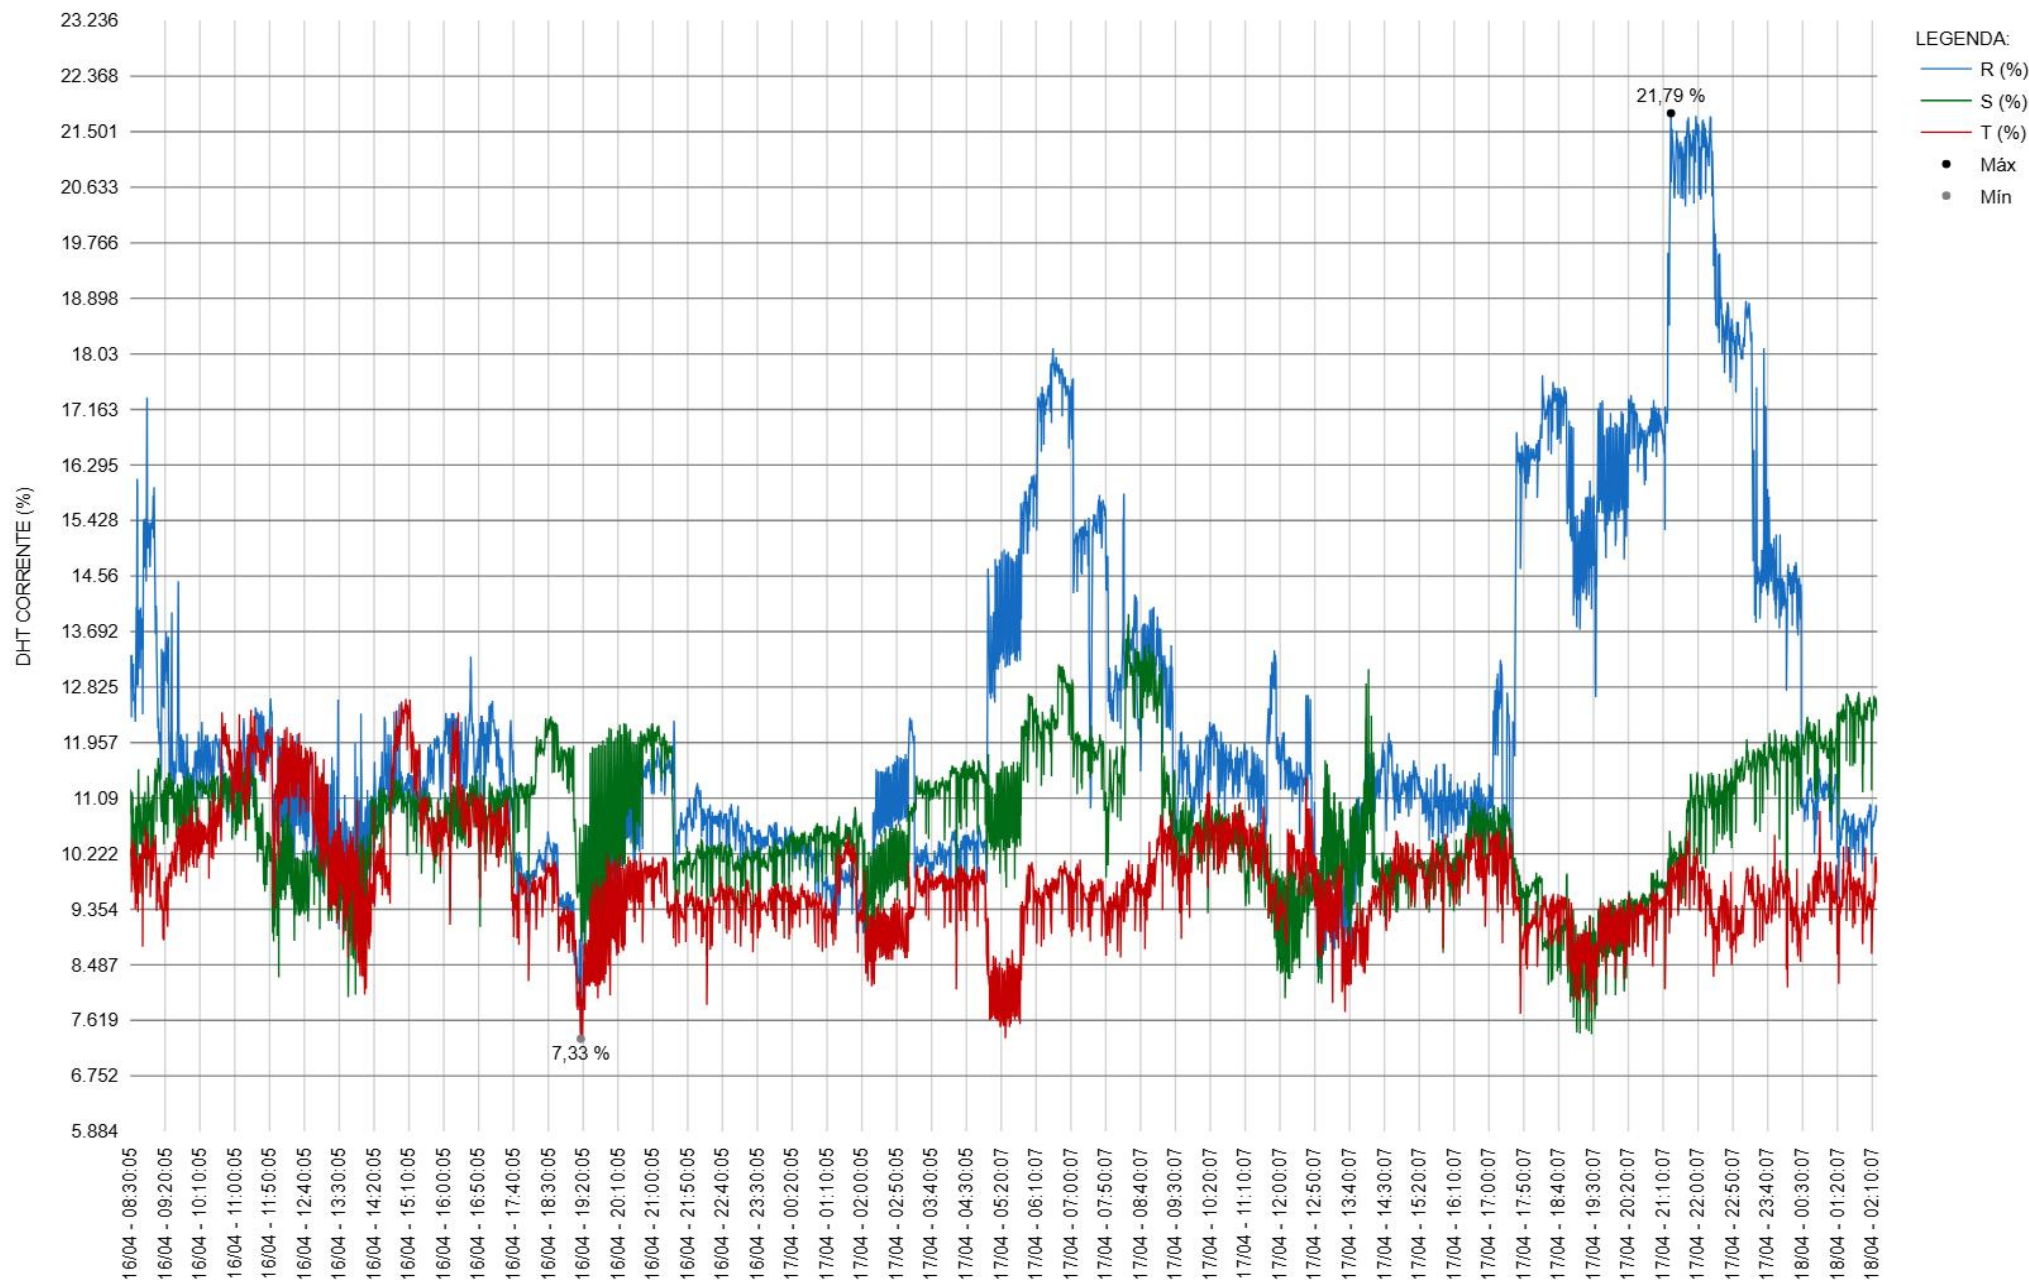


GRÁFICO DESEQUILÍBRIO DE TENSÃO - BENCHMARK - VITORIA/ES

BENCHMARK - BENCHMARK 500kVA - 380/220V - INT: 10s - REV00

LIMITE 3% - ANEEL PRODIST MÓDULO 8

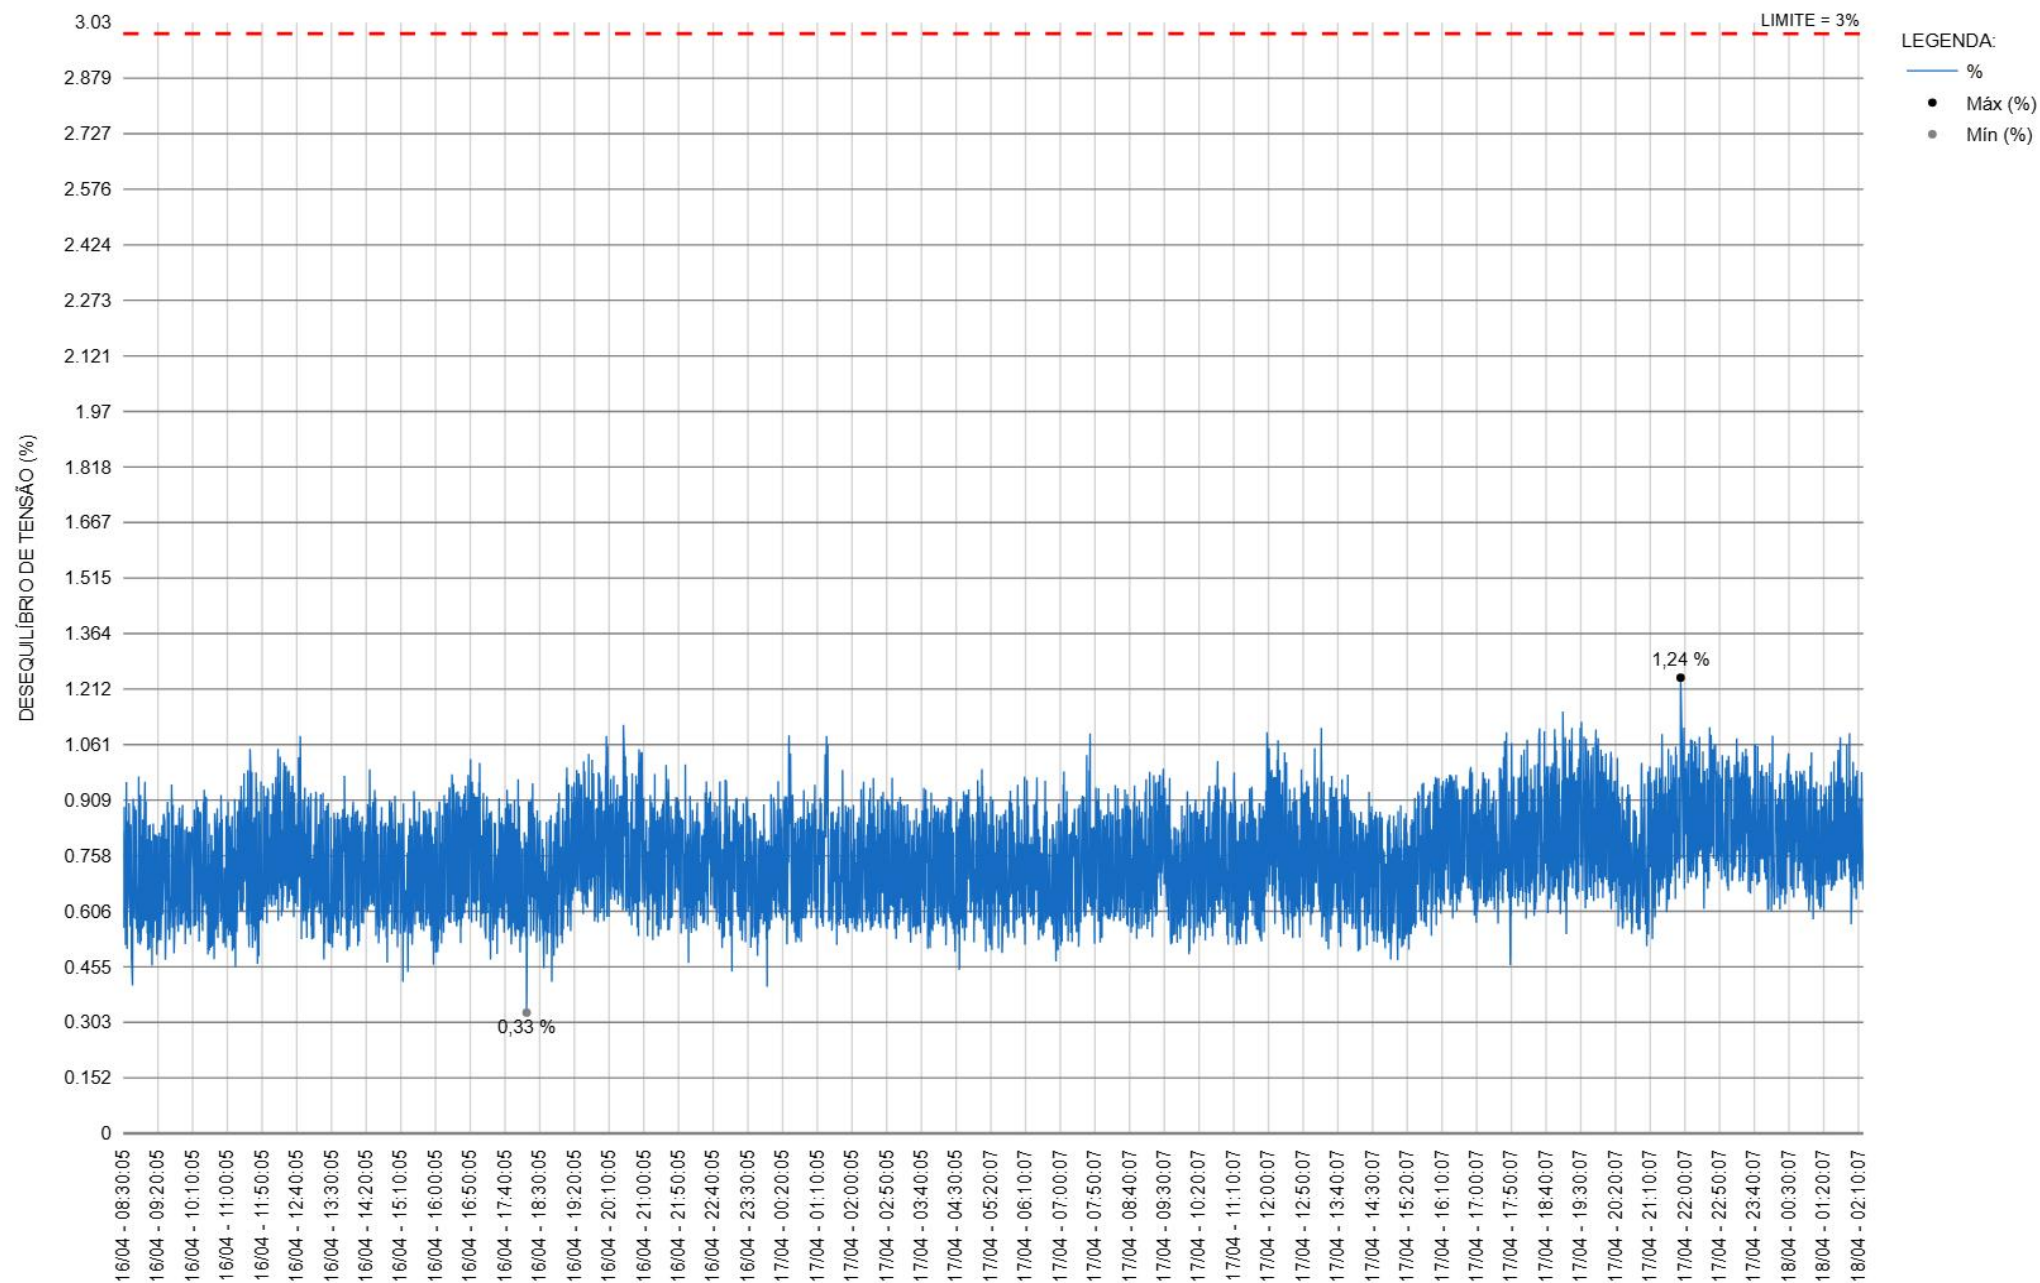


GRÁFICO DESEQUILÍBRIO DE CORRENTE - BENCHMARK - VITORIA/ES

BENCHMARK - BENCHMARK 500kVA - 380/220V - INT: 10s - REV00

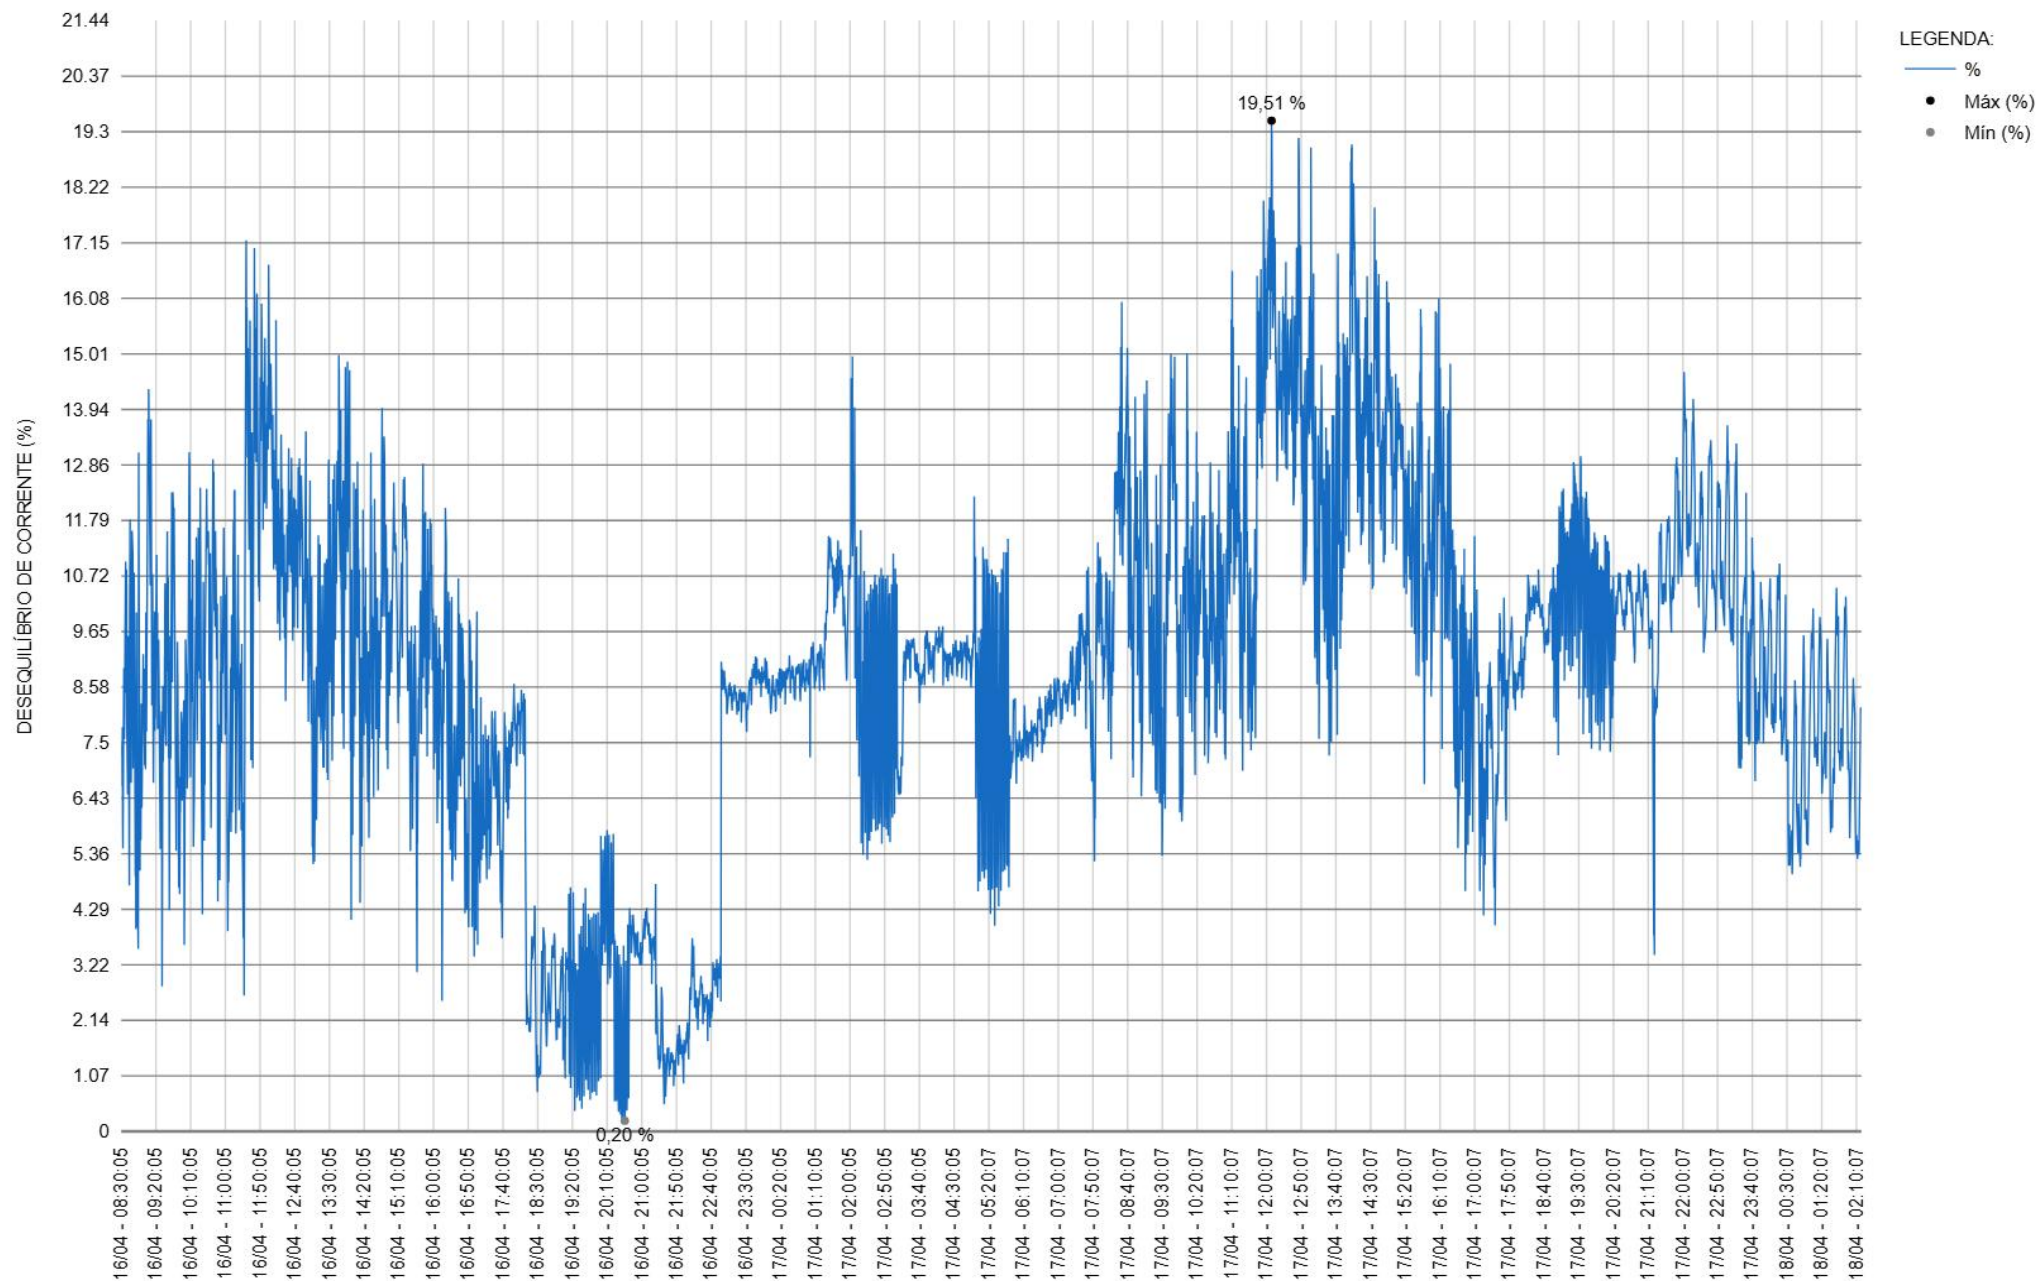


GRÁFICO CONSUMO DE ENERGIA - BENCHMARK - VITORIA/ES

BENCHMARK - BENCHMARK 500kVA - 380/220V - INT: 10s - REV00

CONSUMO TOTAL: 6523,83 kWh

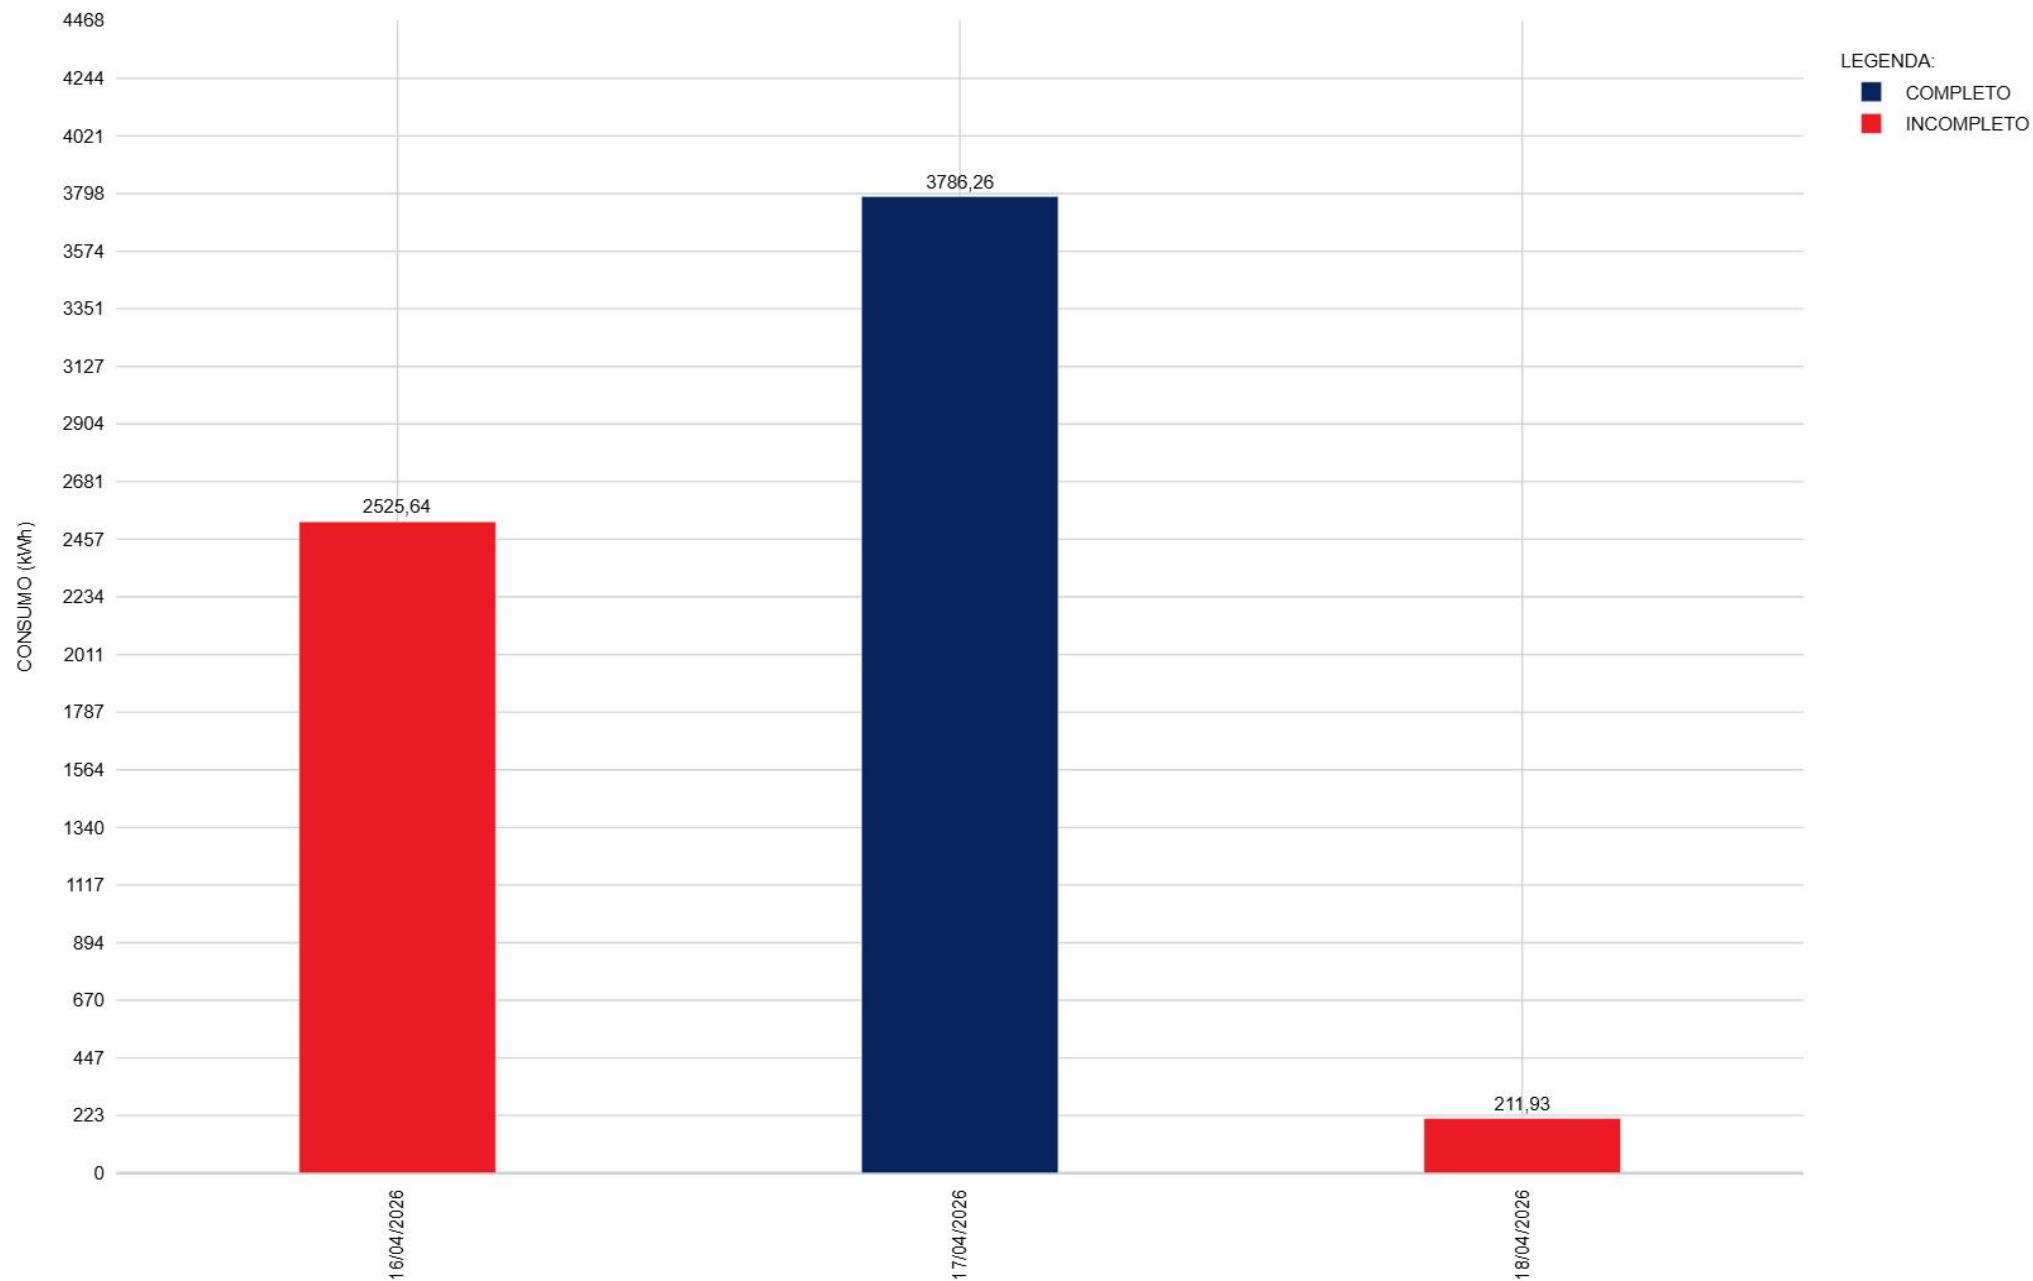


GRÁFICO TENSÃO & CORRENTE - BENCHMARK - VITORIA/ES

BENCHMARK - BENCHMARK 500kVA - 380/220V - INT: 10s - REV00

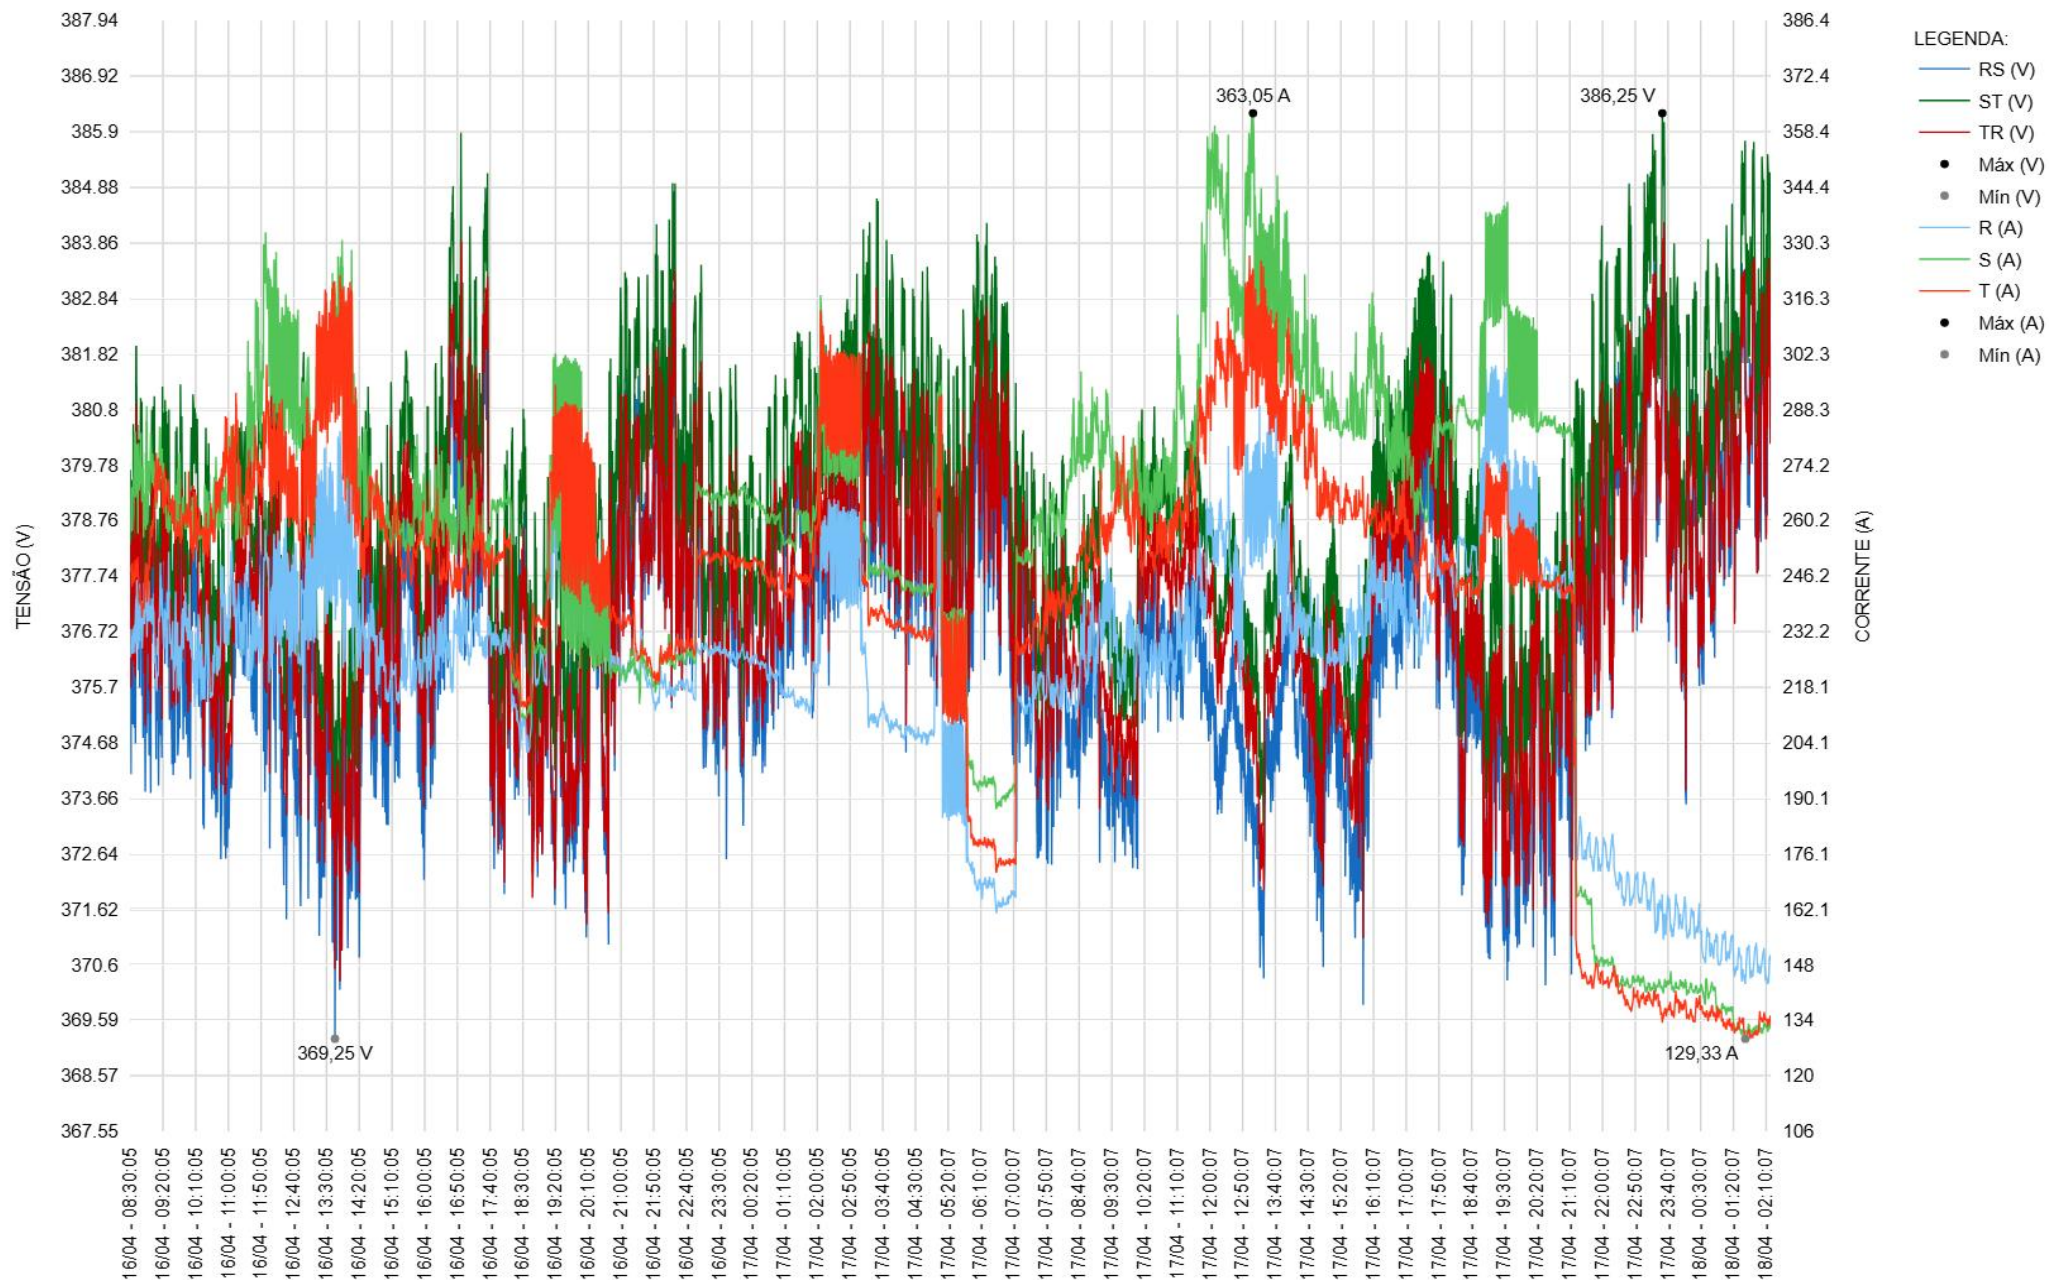


GRÁFICO POT. ATIVA & POT. APARENTE - BENCHMARK - VITORIA/ES



BENCHMARK - BENCHMARK 500kVA - 380/220V - INT. 10s - REV00

