



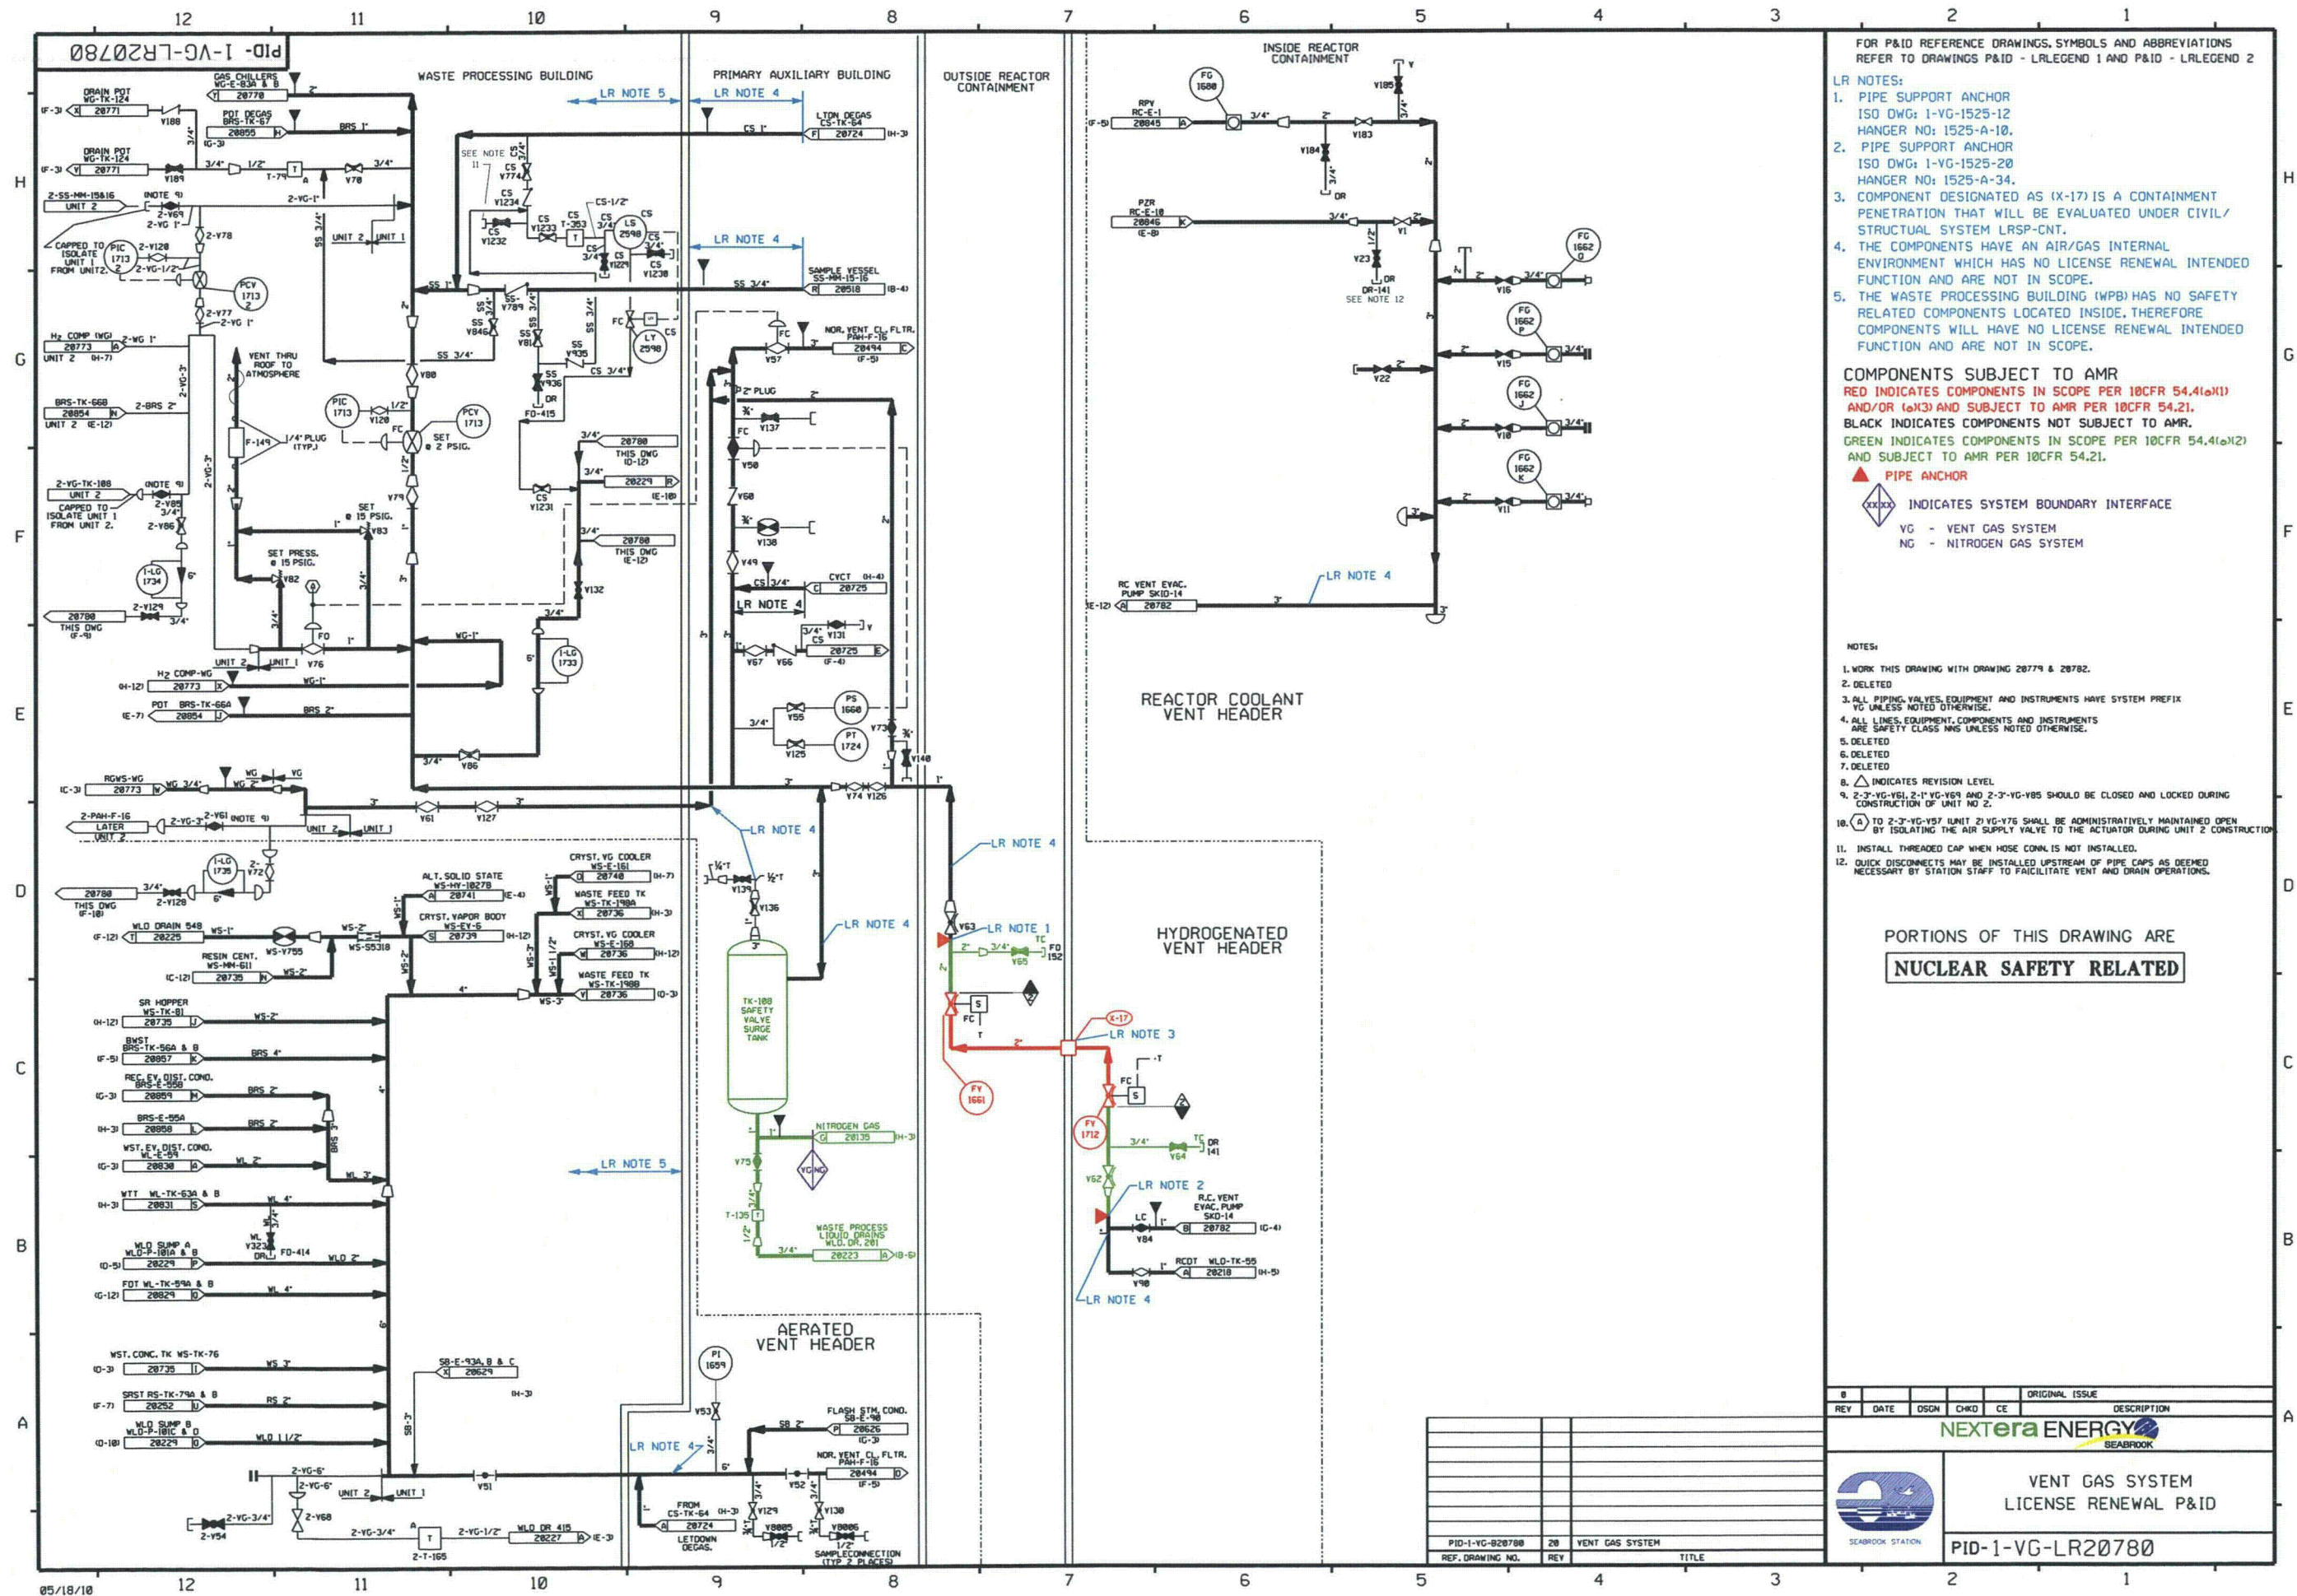

PID-1-VSL-LR20775

H
G
F
E
D
C
B
A

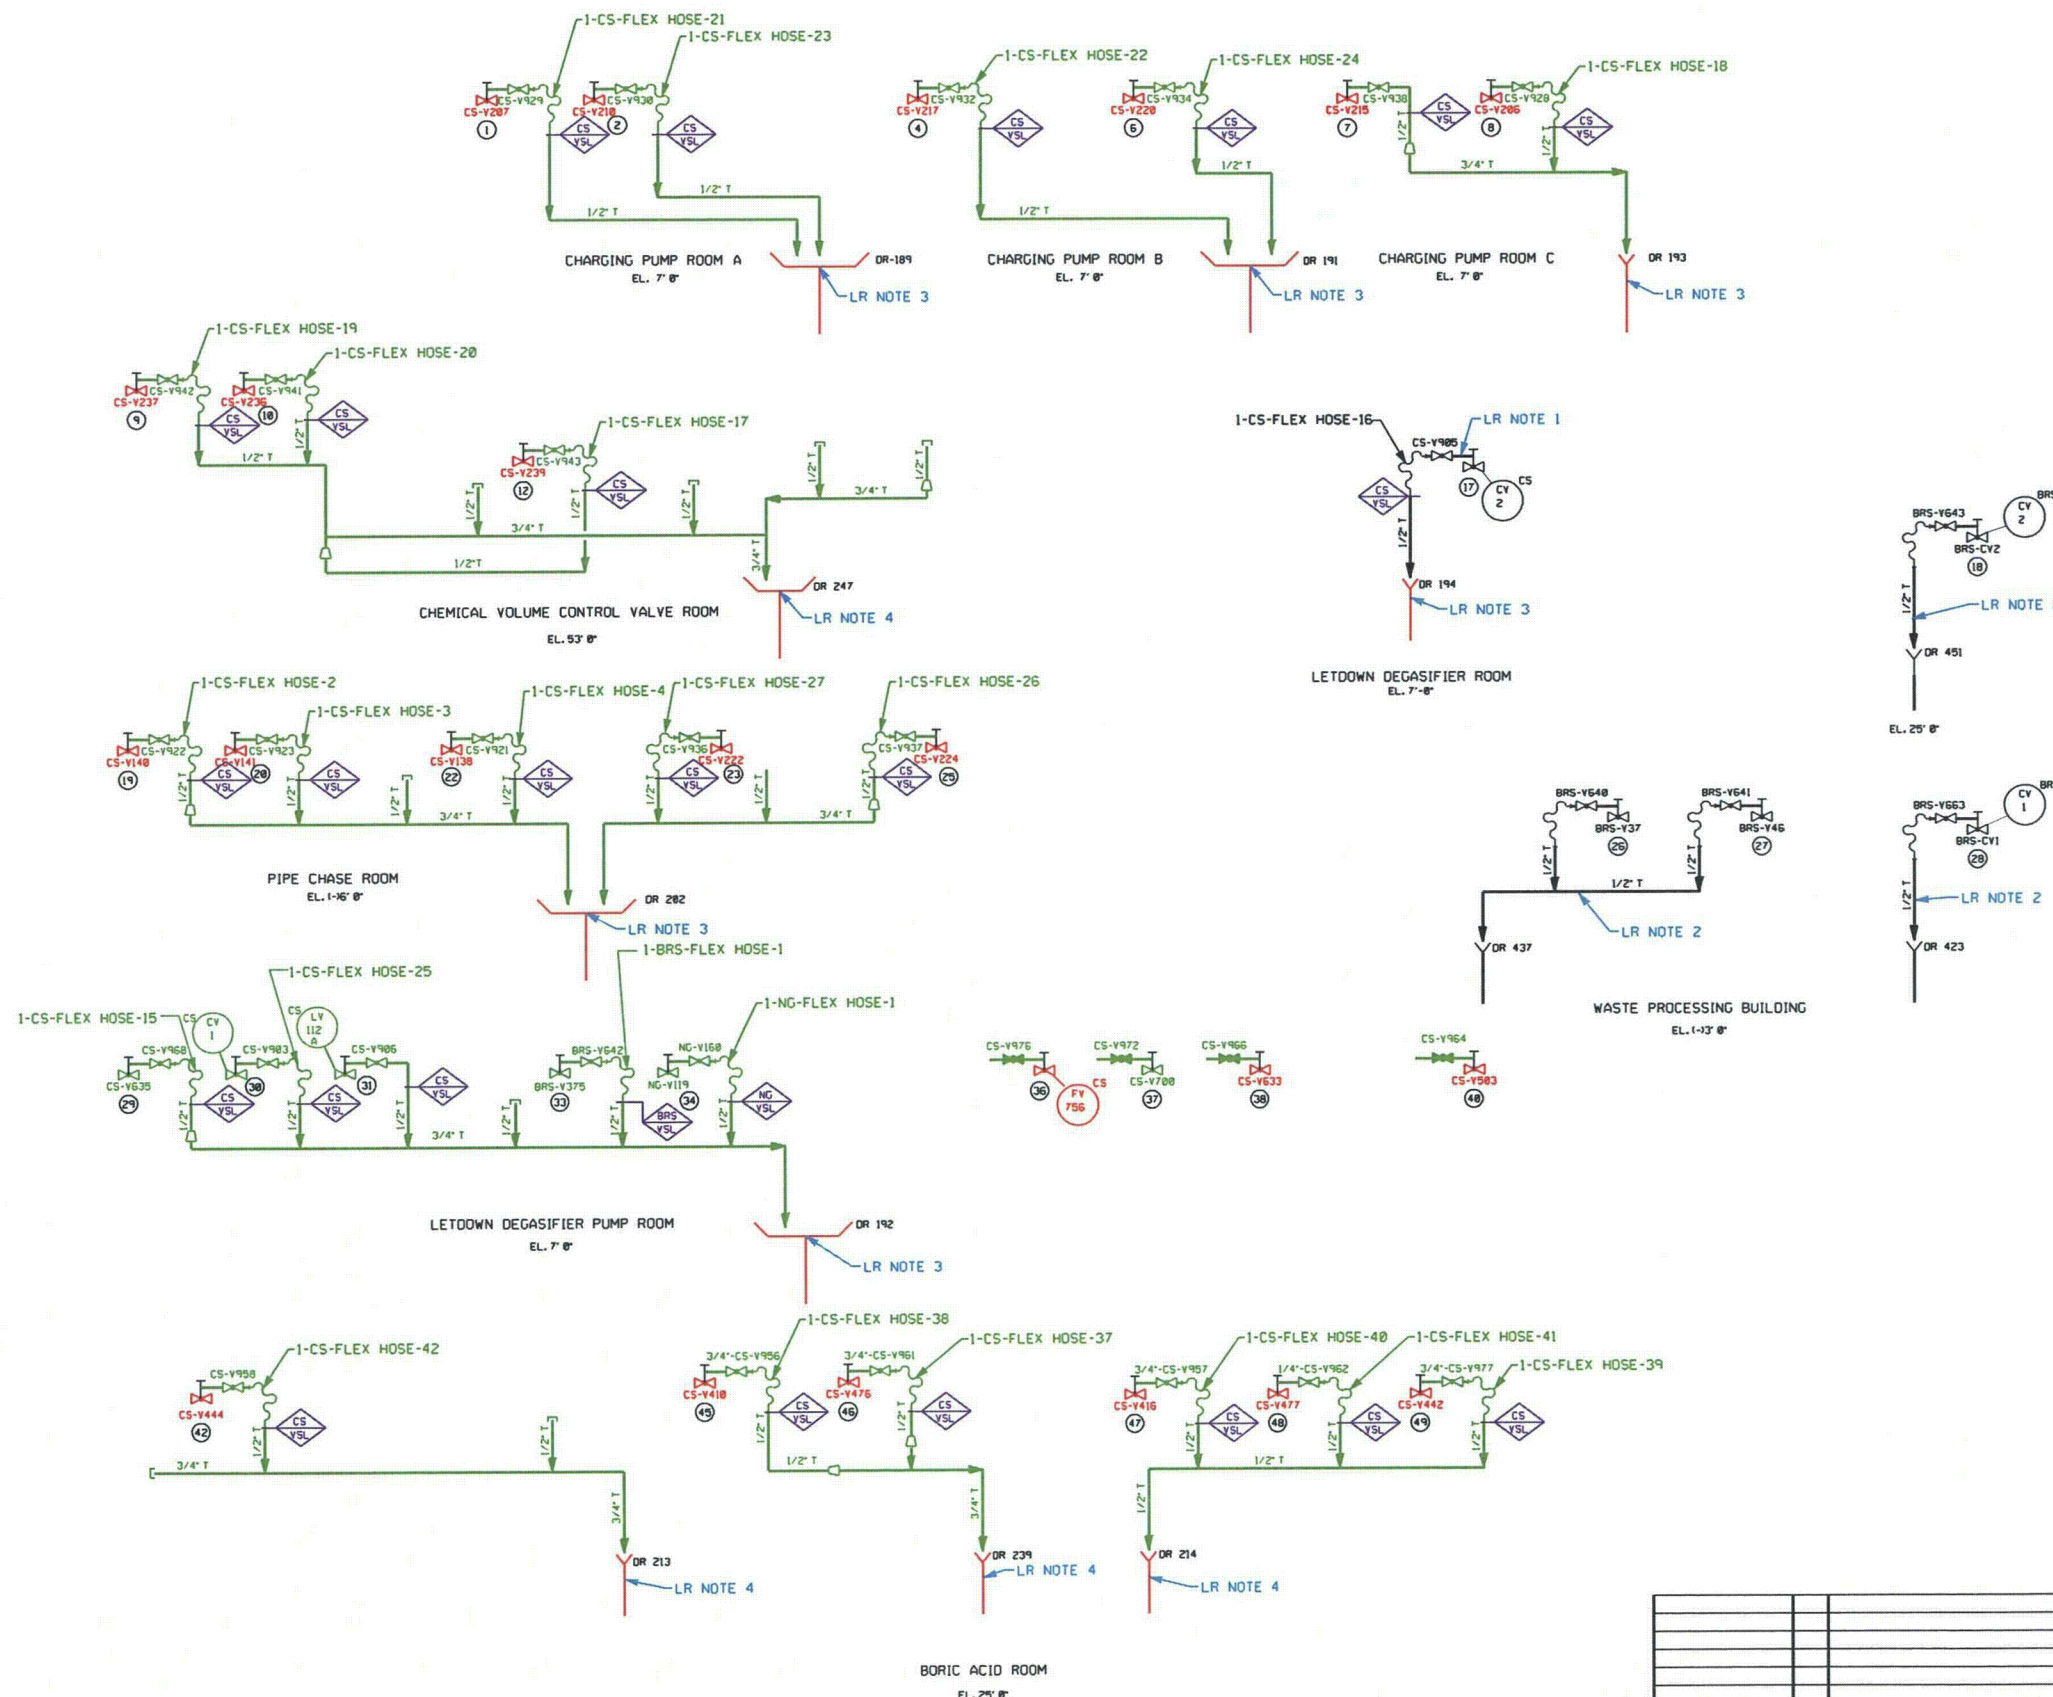

FOR P&ID REFERENCE DRAWINGS, SYMBOLS AND ABBREVIATIONS REFER TO DRAWINGS P&ID - LRLEGEND 1 AND P&ID - LRLEGEND 2

◇ FLEX HOSE TO BE REPLACED WITH TUBING LOOP PER DCR 784.

- LR NOTES:
- COMPONENTS HAVE INTERNAL ENVIRONMENT OF AIR/GAS SO THEY HAVE NO LICENSE RENEWAL (LR) INTENDED FUNCTION AND THEREFORE ARE NOT IN SCOPE.
 - THE WASTE PROCESSING BUILDING (WPB) HAS NO SAFETY RELATED COMPONENTS LOCATED INSIDE, THEREFORE COMPONENTS WILL HAVE NO LICENSE RENEWAL INTENDED FUNCTION AND ARE NOT IN SCOPE.
 - FLOOR DRAINS IN RED ARE IN SCOPE FOR CRITERION (a)(3) FIRE PROTECTION AND ALSO SHOWN ON PID-1-WLD-LR20233.
 - FLOOR DRAINS IN RED ARE IN SCOPE FOR CRITERION (a)(3) FIRE PROTECTION AND ALSO SHOWN ON PID-1-WLD-LR20222.
 - THE VALVE STEM LEAK OFF (VSL) CONSISTS OF PIPING COMPONENTS. FLEX HOSES AND VALVES ARE SCOPED AND SCREENED IN THEIR INDIVIDUAL SYSTEMS.

COMPONENTS SUBJECT TO AMR
 RED INDICATES COMPONENTS IN SCOPE PER 10CFR 54.4(a)(1) AND/OR (a)(3) AND SUBJECT TO AMR PER 10CFR 54.21.
 BLACK INDICATES COMPONENTS NOT SUBJECT TO AMR.
 GREEN INDICATES COMPONENTS IN SCOPE PER 10CFR 54.4(a)(2) AND SUBJECT TO AMR PER 10CFR 54.21.

▲ PIPE ANCHOR
 ◇ INDICATES SYSTEM BOUNDARY INTERFACE
 VSL - VALVE STEM LEAK-OFF SYSTEM
 CS - CHEMICAL & VOLUME CONTROL SYSTEM
 NG - NITROGEN GAS SYSTEM
 BRS - BORON RECOVERY SYSTEM

- VALVE TABULATION -					
NO.	-P & ID NO.	NO.	-P & ID NO.	NO.	-P & ID NO.
①	-CS-20725 (B-8)	19	-CS-20722 (C-7)	37	-CS-20724 (E-11)
②	-CS-20725 (B-12)	20	-CS-20722 (C-6)	38	-CS-20724 (G-11)
④	-CS-20725 (C-8)	22	-CS-20722 (C-5)	40	-CS-20724 (G-12)
⑥	-CS-20725 (C-12)	23	-CS-20725 (D-12)	42	-CS-20729 (D-4)
7	-CS-20725 (E-10)	25	-CS-20725 (D-12)	44	-CS-20729 (D-4)
8	-CS-20725 (D-6)	26	-BRS-20857 (C-4)	45	-CS-20729 (E-10)
9	-CS-20725 (G-7)	27	-BRS-20857 (C-6)	46	-CS-20729 (D-11)
10	-CS-20725 (G-7)	28	-BRS-20855 (E-10)	47	-CS-20729 (E-8)
12	-CS-20725 (G-5)	29	-CS-20724 (D-10)	48	-CS-20729 (D-7)
13	-CS-20725 (E-6)	30	-CS-20724 (B-7)	49	-CS-20729 (D-9)
15	-CS-20725 (F-7)	31	-CS-20724 (D-9)		
16	-CS-20725 (F-7)	33	-CS-20724 (H-11)		
17	-CS-20724 (H-5)	34	-NG-20135 (F-4)		
18	-BRS-20855 (G-5)	36	-CS-20724 (G-11)		

- NOTES:
- WORK THIS DRAWING WITH DRAWINGS 20774, 20775 & 20777.
 - WORK THIS DRAWING WITH DRAWINGS 20774, 20775 & 20777.
 - ALL LINES, EQUIPMENT, COMPONENTS AND INSTRUMENTS HAVE SYSTEM PREFIX VSL UNLESS NOTED.
 - DELETED
 - DESIGNATES FLEX HOSE
 - PIPING/INSTRUMENTATION BREAK TYPICAL FOR ALL LEAK-OFF VALVES, UNLESS NOTED OTHERWISE.
 - INDICATES REVISION LEVEL
 - SEE VALVE TABULATION
 - PRESSURE CLASS OF LEAKOFF TUBING/FITTINGS AND FIRST DOWNSTREAM VALVE IS THE SAME AS PRESSURE CLASS OF PARENT VALVE. VALVE LEAKOFF PIPING, TUBING AND LEAKOFF VALVES ARE SAFETY CLASS MNS.

REV	DATE	DSGN	CHKD	CE	DESCRIPTION
1					ORIGINAL ISSUE
2					
3					
4					
5					
6					
7					
8					
9					
10					
11					
12					



VALVE STEM LEAK-OFF
 PRIMARY AUXILIARY BUILDING AND
 WASTE PROCESSING BUILDING
 DETAIL
 LICENSE RENEWAL P&ID
 PID-1-VSL-LR20775

PID-1-VSL-20775	12	VALVE STEM LEAK-OFF PAB & WASTE PROC BLDG DET
REF. DRAWING NO.	REV	TITLE

PID-1-VSL-LR20776

FOR P&ID REFERENCE DRAWINGS, SYMBOLS AND ABBREVIATIONS
REFER TO DRAWINGS P&ID - LRLEGEND 1 AND P&ID - LRLEGEND 2

LR NOTES:

1. FLOOR DRAINS IN RED ARE IN SCOPE FOR CRITERION (a)(3) FIRE PROTECTION AND ALSO SHOWN ON PID-1-WLD-LR20221.
2. FLOOR DRAINS IN RED ARE IN SCOPE FOR CRITERION (a)(3) FIRE PROTECTION AND ALSO SHOWN ON PID-1-WLD-LR20223.
3. THE VALVE STEM LEAK OFF (VSL) CONSISTS OF PIPING COMPONENTS, FLEX HOSES AND VALVES ARE SCOPED AND SCREENED IN THEIR INDIVIDUAL SYSTEMS.

COMPONENTS SUBJECT TO AMR

RED INDICATES COMPONENTS IN SCOPE PER 10CFR 54.4(a)(1) AND/OR (a)(3) AND SUBJECT TO AMR PER 10CFR 54.21.

BLACK INDICATES COMPONENTS NOT SUBJECT TO AMR.

GREEN INDICATES COMPONENTS IN SCOPE PER 10CFR 54.4(a)(2) AND SUBJECT TO AMR PER 10CFR 54.21.

PIPE ANCHOR


INDICATES SYSTEM BOUNDARY INTERFACE
VSL - VALVE STEM LEAK-OFF SYSTEM
CS - CHEMICAL & VOLUME CONTROL SYSTEM
RH - RESIDUAL HEAT REMOVAL SYSTEM

- VALVE TABULATION -		
NO.	-P & ID NO.	NO.
1	-RH-20662 IG-12)	19
2	-RH-20662 IA-12)	20
3	-RH-20663 IG-12)	21
4	-RH-20663 IA-12)	22
5	-RH-20662 IE-9)	23
6	-RH-20663 IH-8)	24
7	-RH-20662 ID-8)	25
8	-RH-20662 IF-9)	26
9	-RH-20663 IF-9)	27
10	-RH-20663 ID-8)	28
11	-RH-20663 IE-9)	29
12	-RH-20663 IG-8)	30
13	-RH-20663 IF-8)	31
14	-WLD-20222 IG-5)	32
15	-CS-20722 IC-7)	33
16	-CS-20722 IC-8)	34
17	-RH-20662 IE-5)	35
18	-RH-20662 IE-5)	36
19	-CS-20723 IB-8)	37
20	-CS-20723 IB-8)	38
21	-RH-20662 IB-7)	39
22	-RH-20663 IB-7)	40
23	-CS-20723 IB-4)	41
24	-CS-20726 IF-9)	42
25	-CS-20726 IF-9)	43
26	-CS-20726 IF-8)	44
27	-CS-20726 IF-8)	45
28	-CS-20726 IF-7)	46
29	-CS-20726 IF-4)	47
30	-CS-20726 IF-4)	48
31	-CS-20726 IF-3)	49
32	-CS-20726 IF-3)	50
33	-CS-20726 IF-8)	51
34	-CS-20723 IH-4)	52
35	-CS-20725 ID-7)	53


NOTES:


1. WORK THIS DRAWING WITH DRAWINGS 20774, 20775 & 20777.
2. ALL LINES, EQUIPMENT, COMPONENTS, AND INSTRUMENTS HAVE SYSTEM PREFIX VSL UNLESS NOTED.
3. ALL LINES, EQUIPMENT, COMPONENTS, AND INSTRUMENTS ARE SAFETY CLASS N UNLESS NOTED.
4. - DESIGNATES FLEX HOSE.
5. PIPING INSTRUMENTATION BREAK TYPICAL FOR ALL LEAKOFF VALVES UNLESS NOTED.
6. - INDICATES REVISION LEVEL.
7. - SEE VALVE TABULATION.
8. PRESSURE CLASS OF LEAKOFF TUBING, FITTINGS, AND FIRST DOWNSTREAM VALVE IS THE SAME AS PRESSURE CLASS OF PARENT VALVE. VALVE LEAKOFF PIPING, TUBING AND LEAKOFF VALVES ARE SAFETY CLASS N.

REV	DATE	DSGN	CHRD	CE	DESCRIPTION
0					ORIGINAL ISSUE
NEXTERA ENERGY SEABROOK VALVE STEM LEAK-OFF PRIMARY AUXILIARY BUILDING AND EQUIPMENT VAULT DETAILS LICENSE RENEWAL P&ID PID-1-VSL-LR20776					

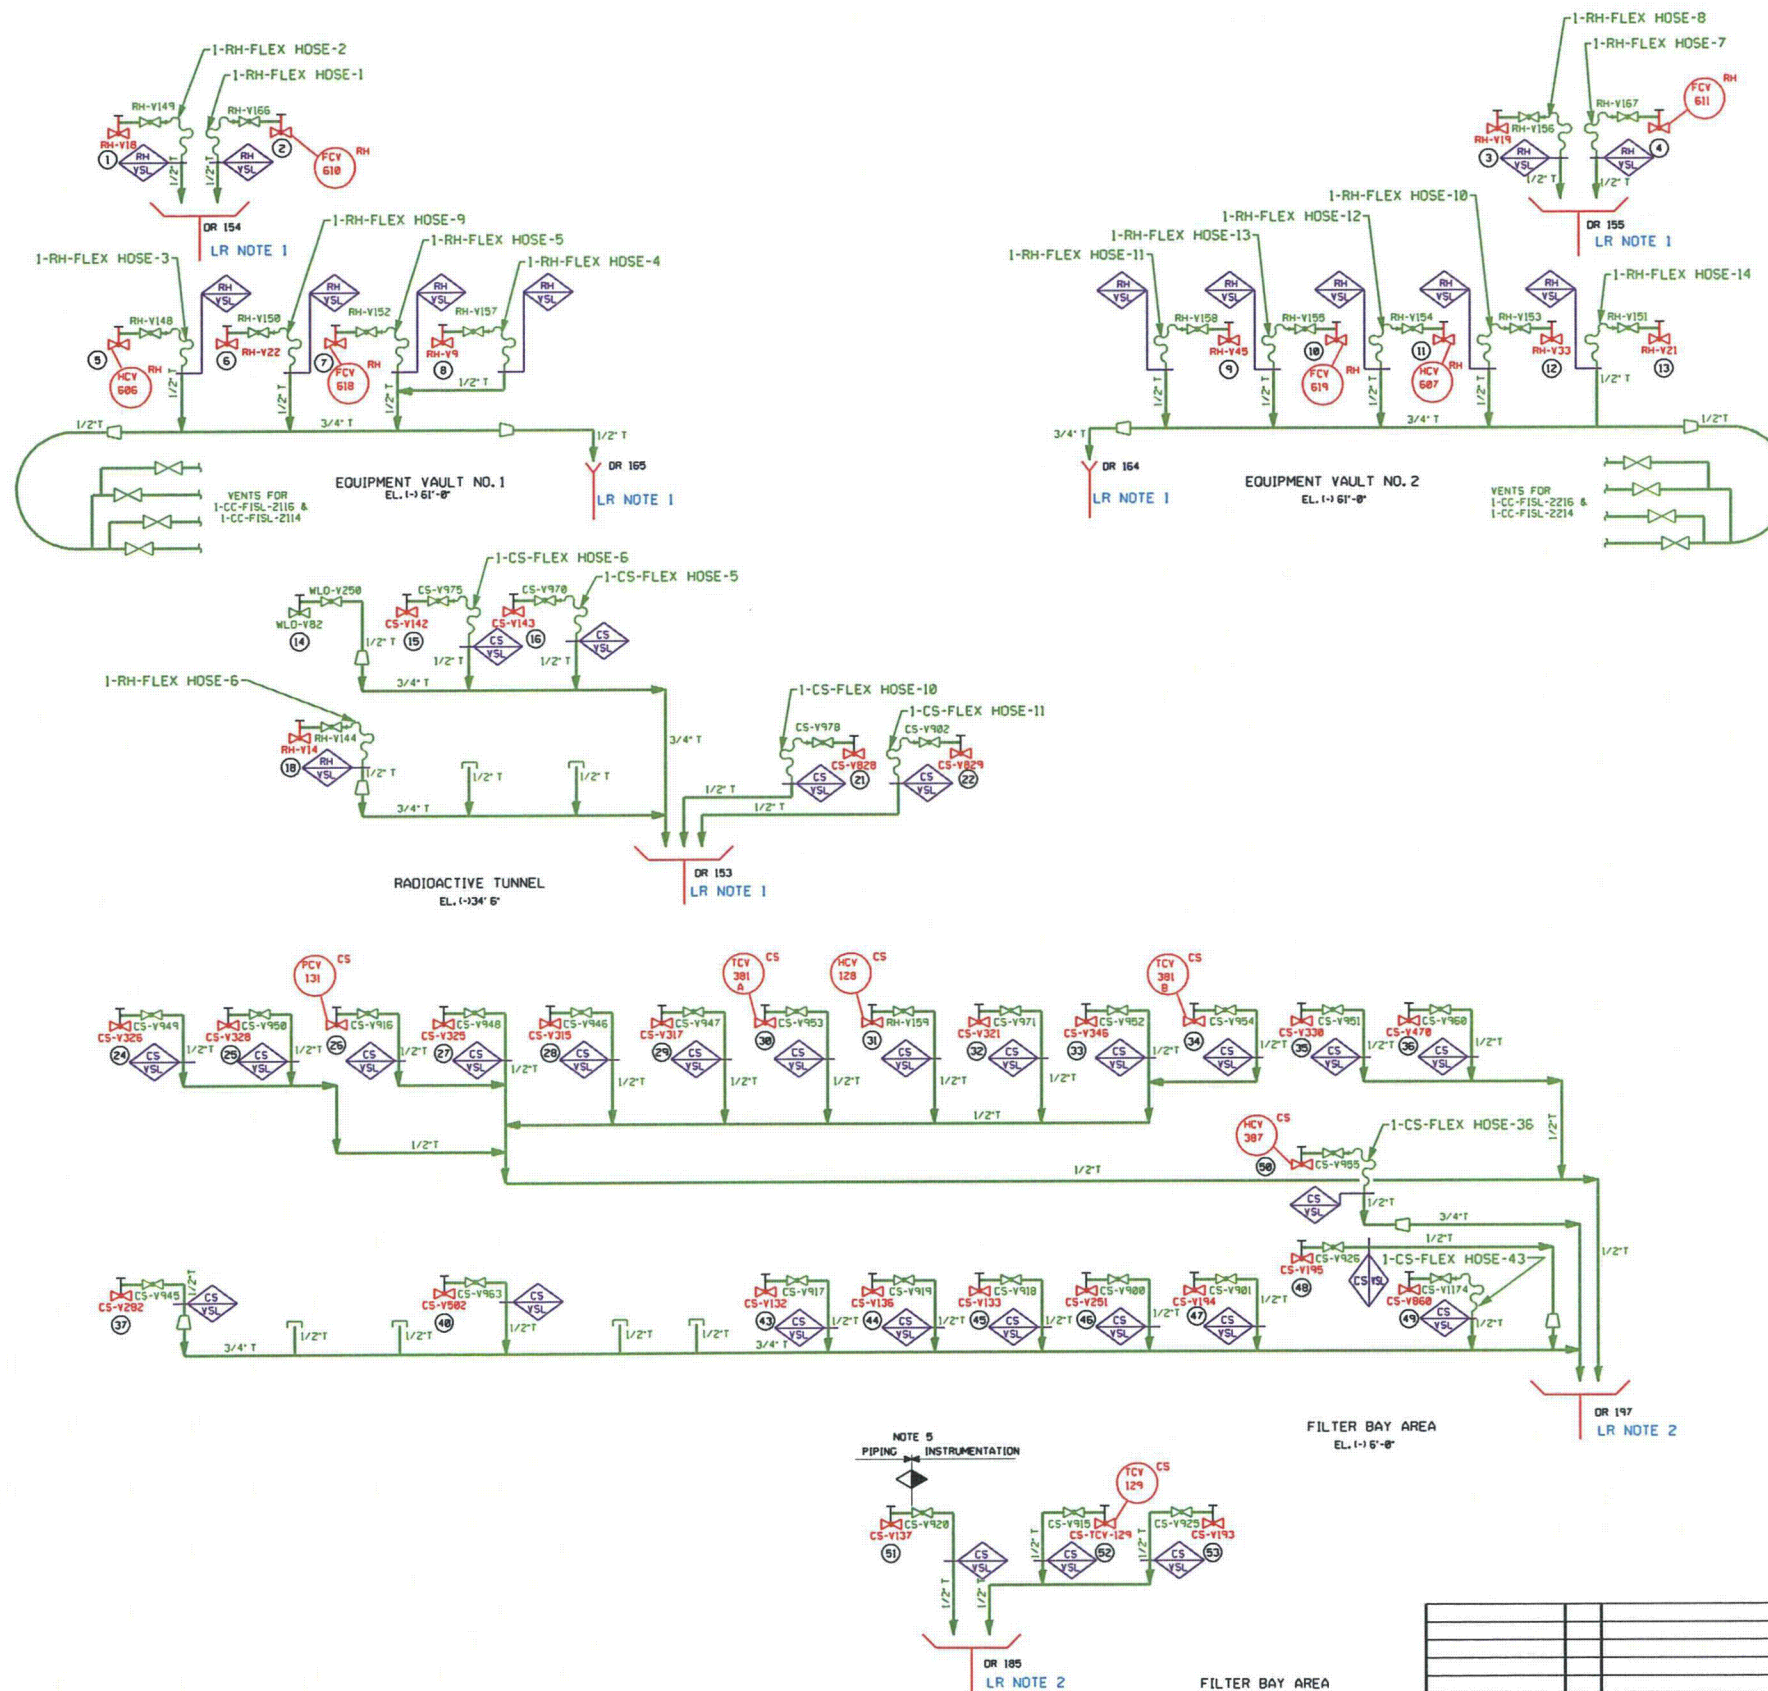

NOTE 5
PIPING INSTRUMENTATION

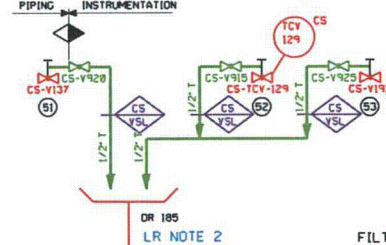

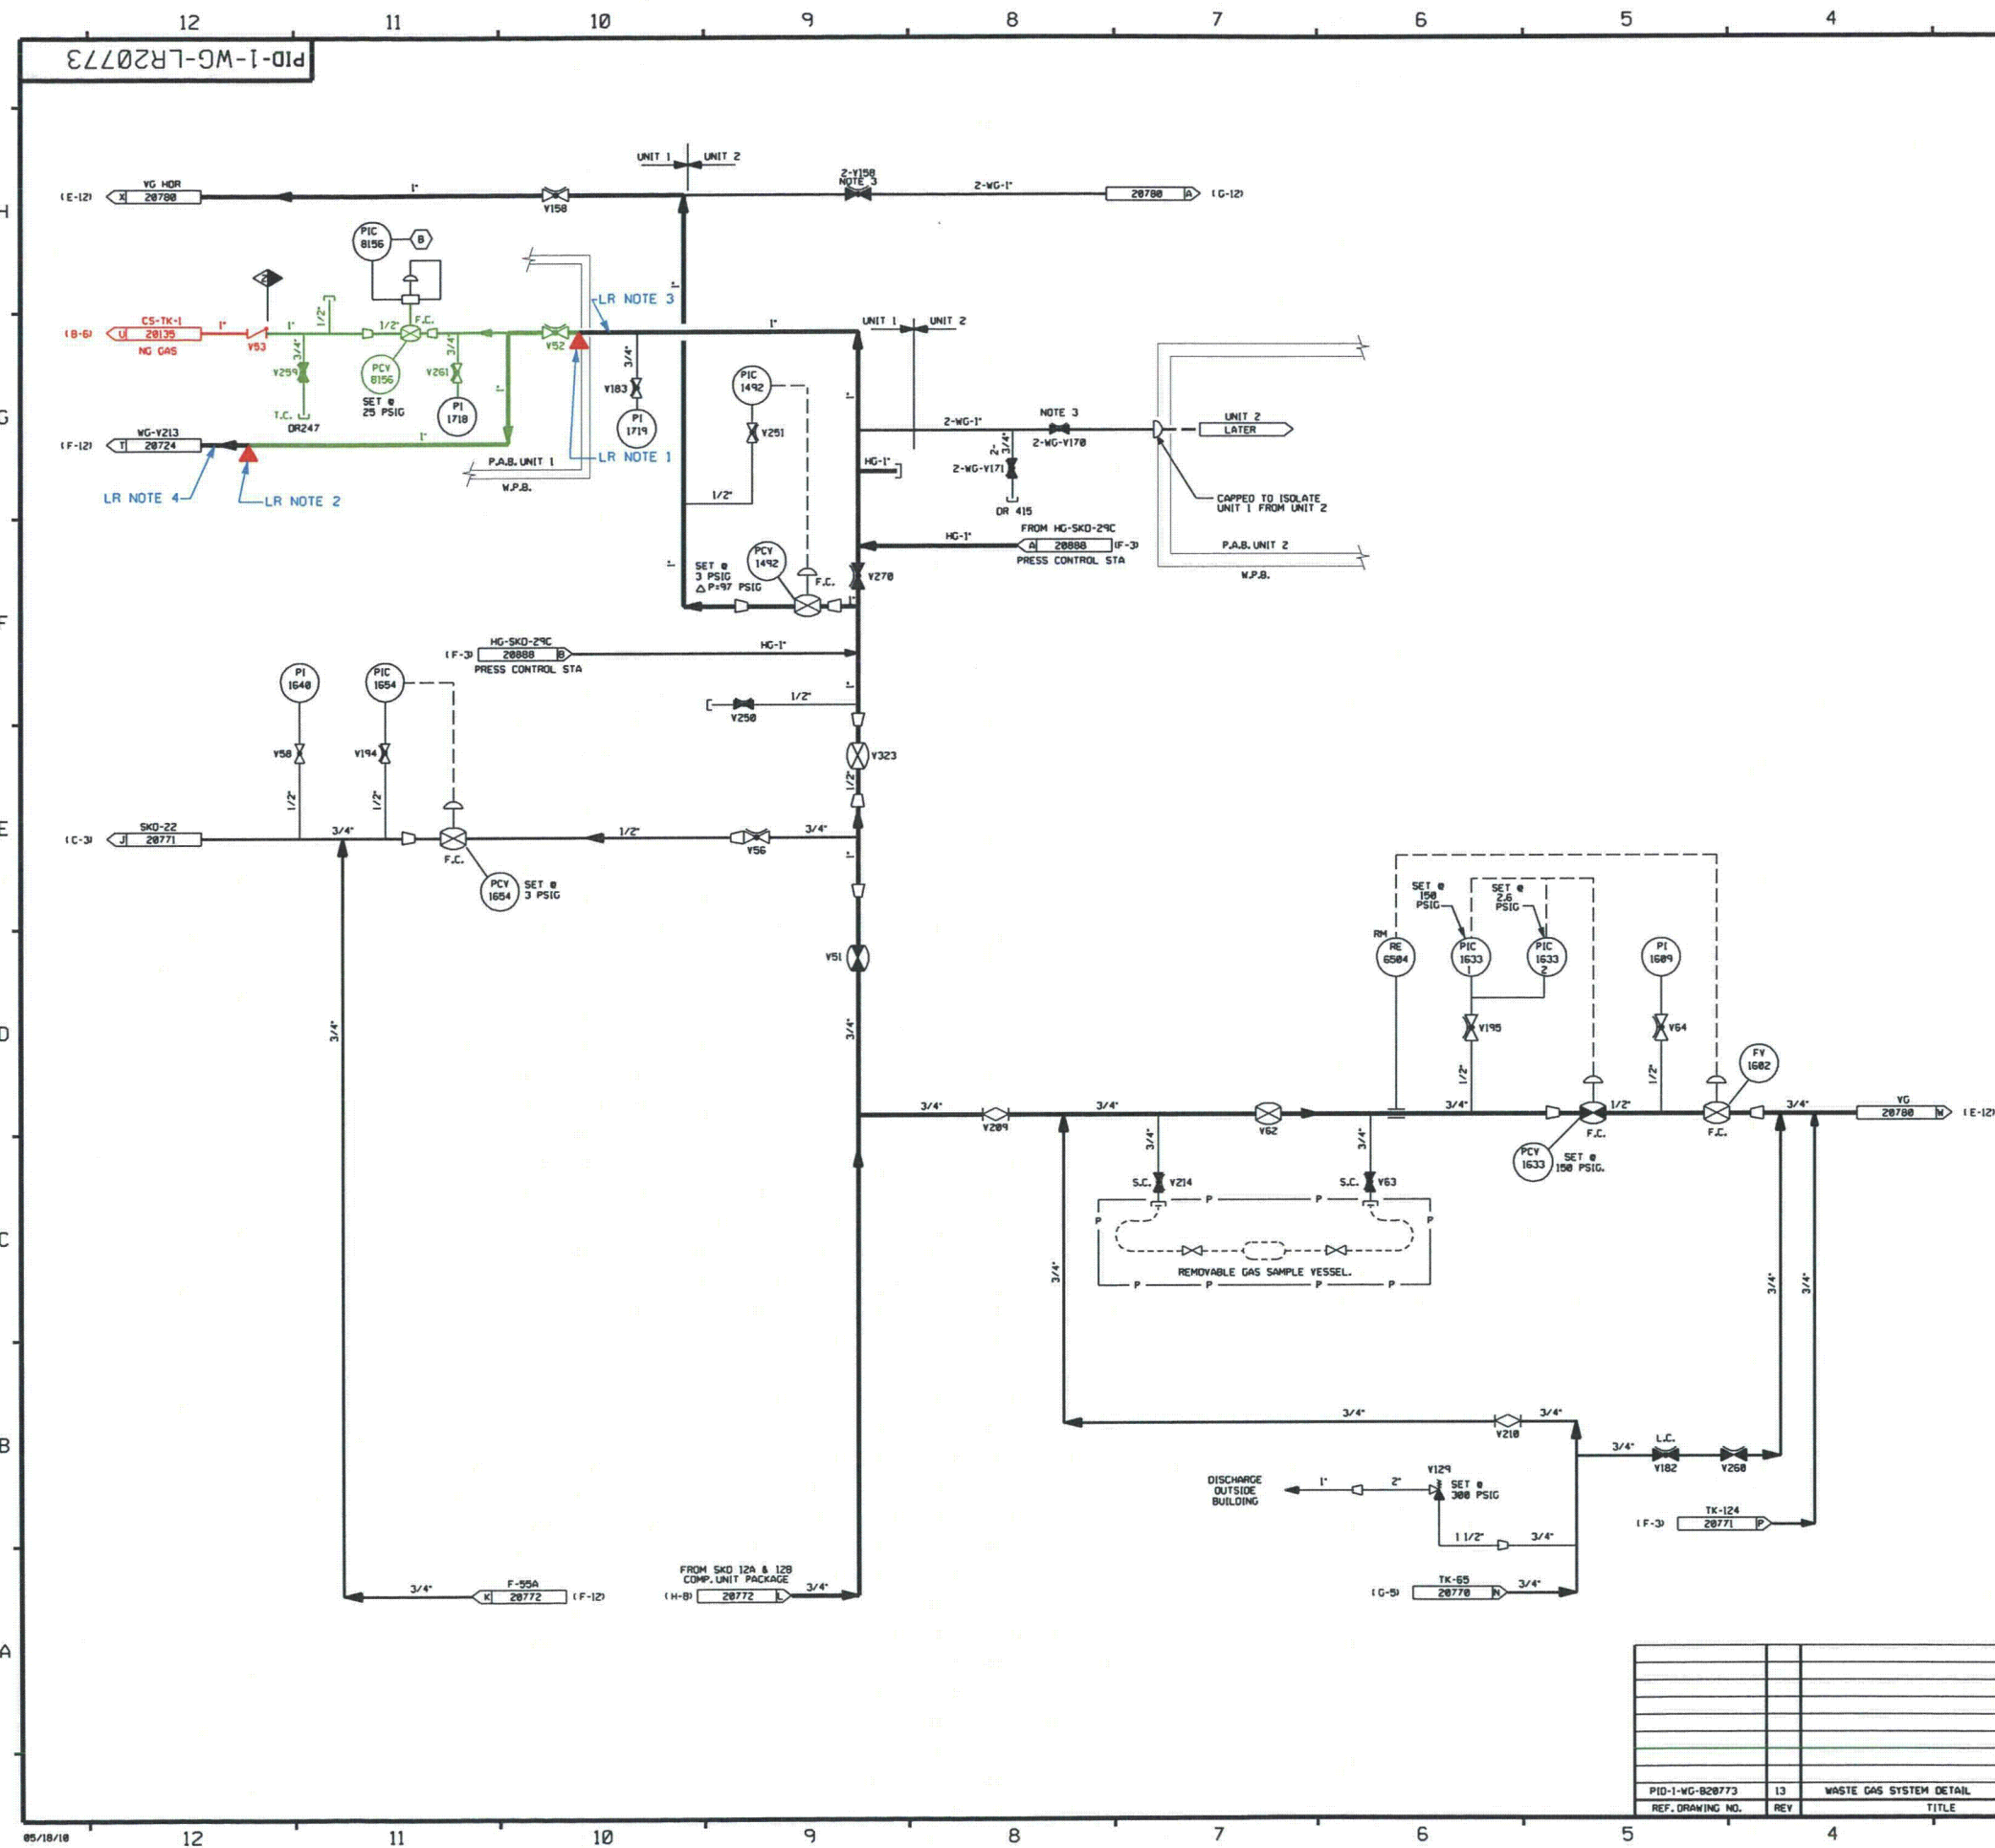

FOR P&ID REFERENCE DRAWINGS, SYMBOLS AND ABBREVIATIONS
REFER TO DRAWINGS P&ID - LRLEGEND 1 AND P&ID - LRLEGEND 2

- LR NOTES:
1. PIPE SUPPORT ANCHOR
ISO NO.: 9763-D-800567-644.00A
HANGER NO.: 567-A-23
 2. PIPE SUPPORT ANCHOR
ISO NO.: 9763-D-800567-644.00A
HANGER NO.: 582-A-04
 3. COMPONENTS DOWNSTREAM OF ANCHOR HAVE AN ENVIRONMENT OF AIR/GAS AND HAVE NO LICENSE RENEWAL(LR) INTENDED FUNCTION SO THEY ARE NOT SCOPE.
 4. COMPONENTS UPSTREAM OF ANCHOR HAVE AN ENVIRONMENT OF AIR/GAS AND HAVE NO LR INTENDED FUNCTION SO THEY ARE NOT SCOPE.

COMPONENTS SUBJECT TO AMR
RED INDICATES COMPONENTS IN SCOPE PER 10CFR 54.4(a)(1)
AND/OR (a)(3) AND SUBJECT TO AMR PER 10CFR 54.21.
BLACK INDICATES COMPONENTS NOT SUBJECT TO AMR.
GREEN INDICATES COMPONENTS IN SCOPE PER 10CFR 54.4(a)(2)
AND SUBJECT TO AMR PER 10CFR 54.21.

▲ PIPE ANCHOR
◆ INDICATES SYSTEM BOUNDARY INTERFACE

- NOTES:
1. WORK THIS DRAWING WITH DRAWINGS 20758, 20770, 20771, & 20772.
 2. ALL PIPING, EQUIPMENT, COMPONENTS, & INSTRUMENTS HAVE SYSTEM PREFIX 1-WG-UNLESS NOTED OTHERWISE.
 3. THIS VALVE TO BE LOCKED CLOSED DURING UNIT 2 CONSTRUCTION.
 4. ALL PIPING & INSTRUMENTS ARE SAFETY CLASS UNLESS OTHERWISE NOTED.
 5. △ INDICATES REVISION LEVEL.
 6. DELETED
 7. INSTRUMENT REFERENCES:
⑤ FROM CS-PT-115 ON P&ID CS-20725

PORTIONS OF THIS DRAWING ARE
NUCLEAR SAFETY RELATED

ORIGINAL ISSUE					DESCRIPTION	
REV	DATE	DSGN	CHKD	CE		
						NEXTERA ENERGY SEABROOK
						WASTE GAS SYSTEM DETAIL LICENSE RENEWAL P&ID
						PID- 1-WG-LR20773

PID-1-WG-B20773	13	WASTE GAS SYSTEM DETAIL
REF. DRAWING NO.	REV	TITLE