

PID-1-WLD-LR20218

FOR P&ID REFERENCE DRAWINGS, SYMBOLS AND ABBREVIATIONS
REFER TO DRAWINGS P&ID - LRLEGEND 1 AND P&ID - LRLEGEND 2

- LR NOTES:
1. COMPONENT DESIGNATED AS X-32 IS A CONTAINMENT PENETRATION THAT WILL BE EVALUATED UNDER THE CIVIL STRUCTURAL LRSP-CNT.
 2. COMPONENTS HAVE AN INTERNAL ENVIRONMENT OF AIR/GAS SO THEY HAVE NO LICENSE RENEWAL INTENDED FUNCTION AND ARE NOT IN SCOPE.
 3. CAPILLARY TUBING IS PART OF THE INSTRUMENT AND CONSIDERED AN ACTIVE COMPONENT PER NEI 95-10.

COMPONENTS SUBJECT TO AMR
RED INDICATES COMPONENTS IN SCOPE PER 10CFR 54.4(a)(1) AND/OR (a)(3) AND SUBJECT TO AMR PER 10CFR 54.21.
BLACK INDICATES COMPONENTS NOT SUBJECT TO AMR.
GREEN INDICATES COMPONENTS IN SCOPE PER 10CFR 54.4(a)(2) AND SUBJECT TO AMR PER 10CFR 54.21.

PIPE ANCHOR
 XXXX INDICATES SYSTEM BOUNDARY INTERFACE

RC - REACTOR COOLANT SYSTEM
 NG - NITROGEN GAS SYSTEM
 CS - CHEMICAL & VOLUME CONTROL SYSTEM
 RMW - REACTOR WATER MAKE-UP SYSTEM
 WLD - WASTE PROCESSING LIQUID DRAINS SYSTEM
 SI - SAFETY INJECTION SYSTEM

- NOTES:
1. WORK THIS DRAWING WITH DRAWINGS 20216 & 20219 THRU 20229.
 2. ALL LINES, EQUIPMENT, COMPONENTS, AND INSTRUMENTS HAVE SYSTEM PREFIX UNLESS NOTED OTHERWISE.
 3. VALVES V69 THRU V73 ARE REACH ROD OPERATED.
 4. ALL LINES, EQUIPMENT, COMPONENTS, AND INSTRUMENTS ARE SAFETY CLASS UNLESS NOTED OTHERWISE.
 5. Δ INDICATES REVISION LEVEL
 6. REFER TO DRAWING YSL-20774 FOR VALVE LEAKOFFS.


PORTIONS OF THIS DRAWING ARE
NUCLEAR SAFETY RELATED

REV	DATE	DSGN	CHKD	CE	DESCRIPTION
1					ORIGINAL ISSUE
					
					
WASTE PROCESSING LIQUID DRAINS REACTOR COOLANT SYSTEM LICENSE RENEWAL P&ID					
PID-1-WLD-LR20218					

REV	DATE	DSGN	CHKD	CE	DESCRIPTION
1					ORIGINAL ISSUE
2					
3					
4					
5					
6					
7					
8					
9					
10					
11					
12					

05/18/10

PID-1-WLD-LR20219

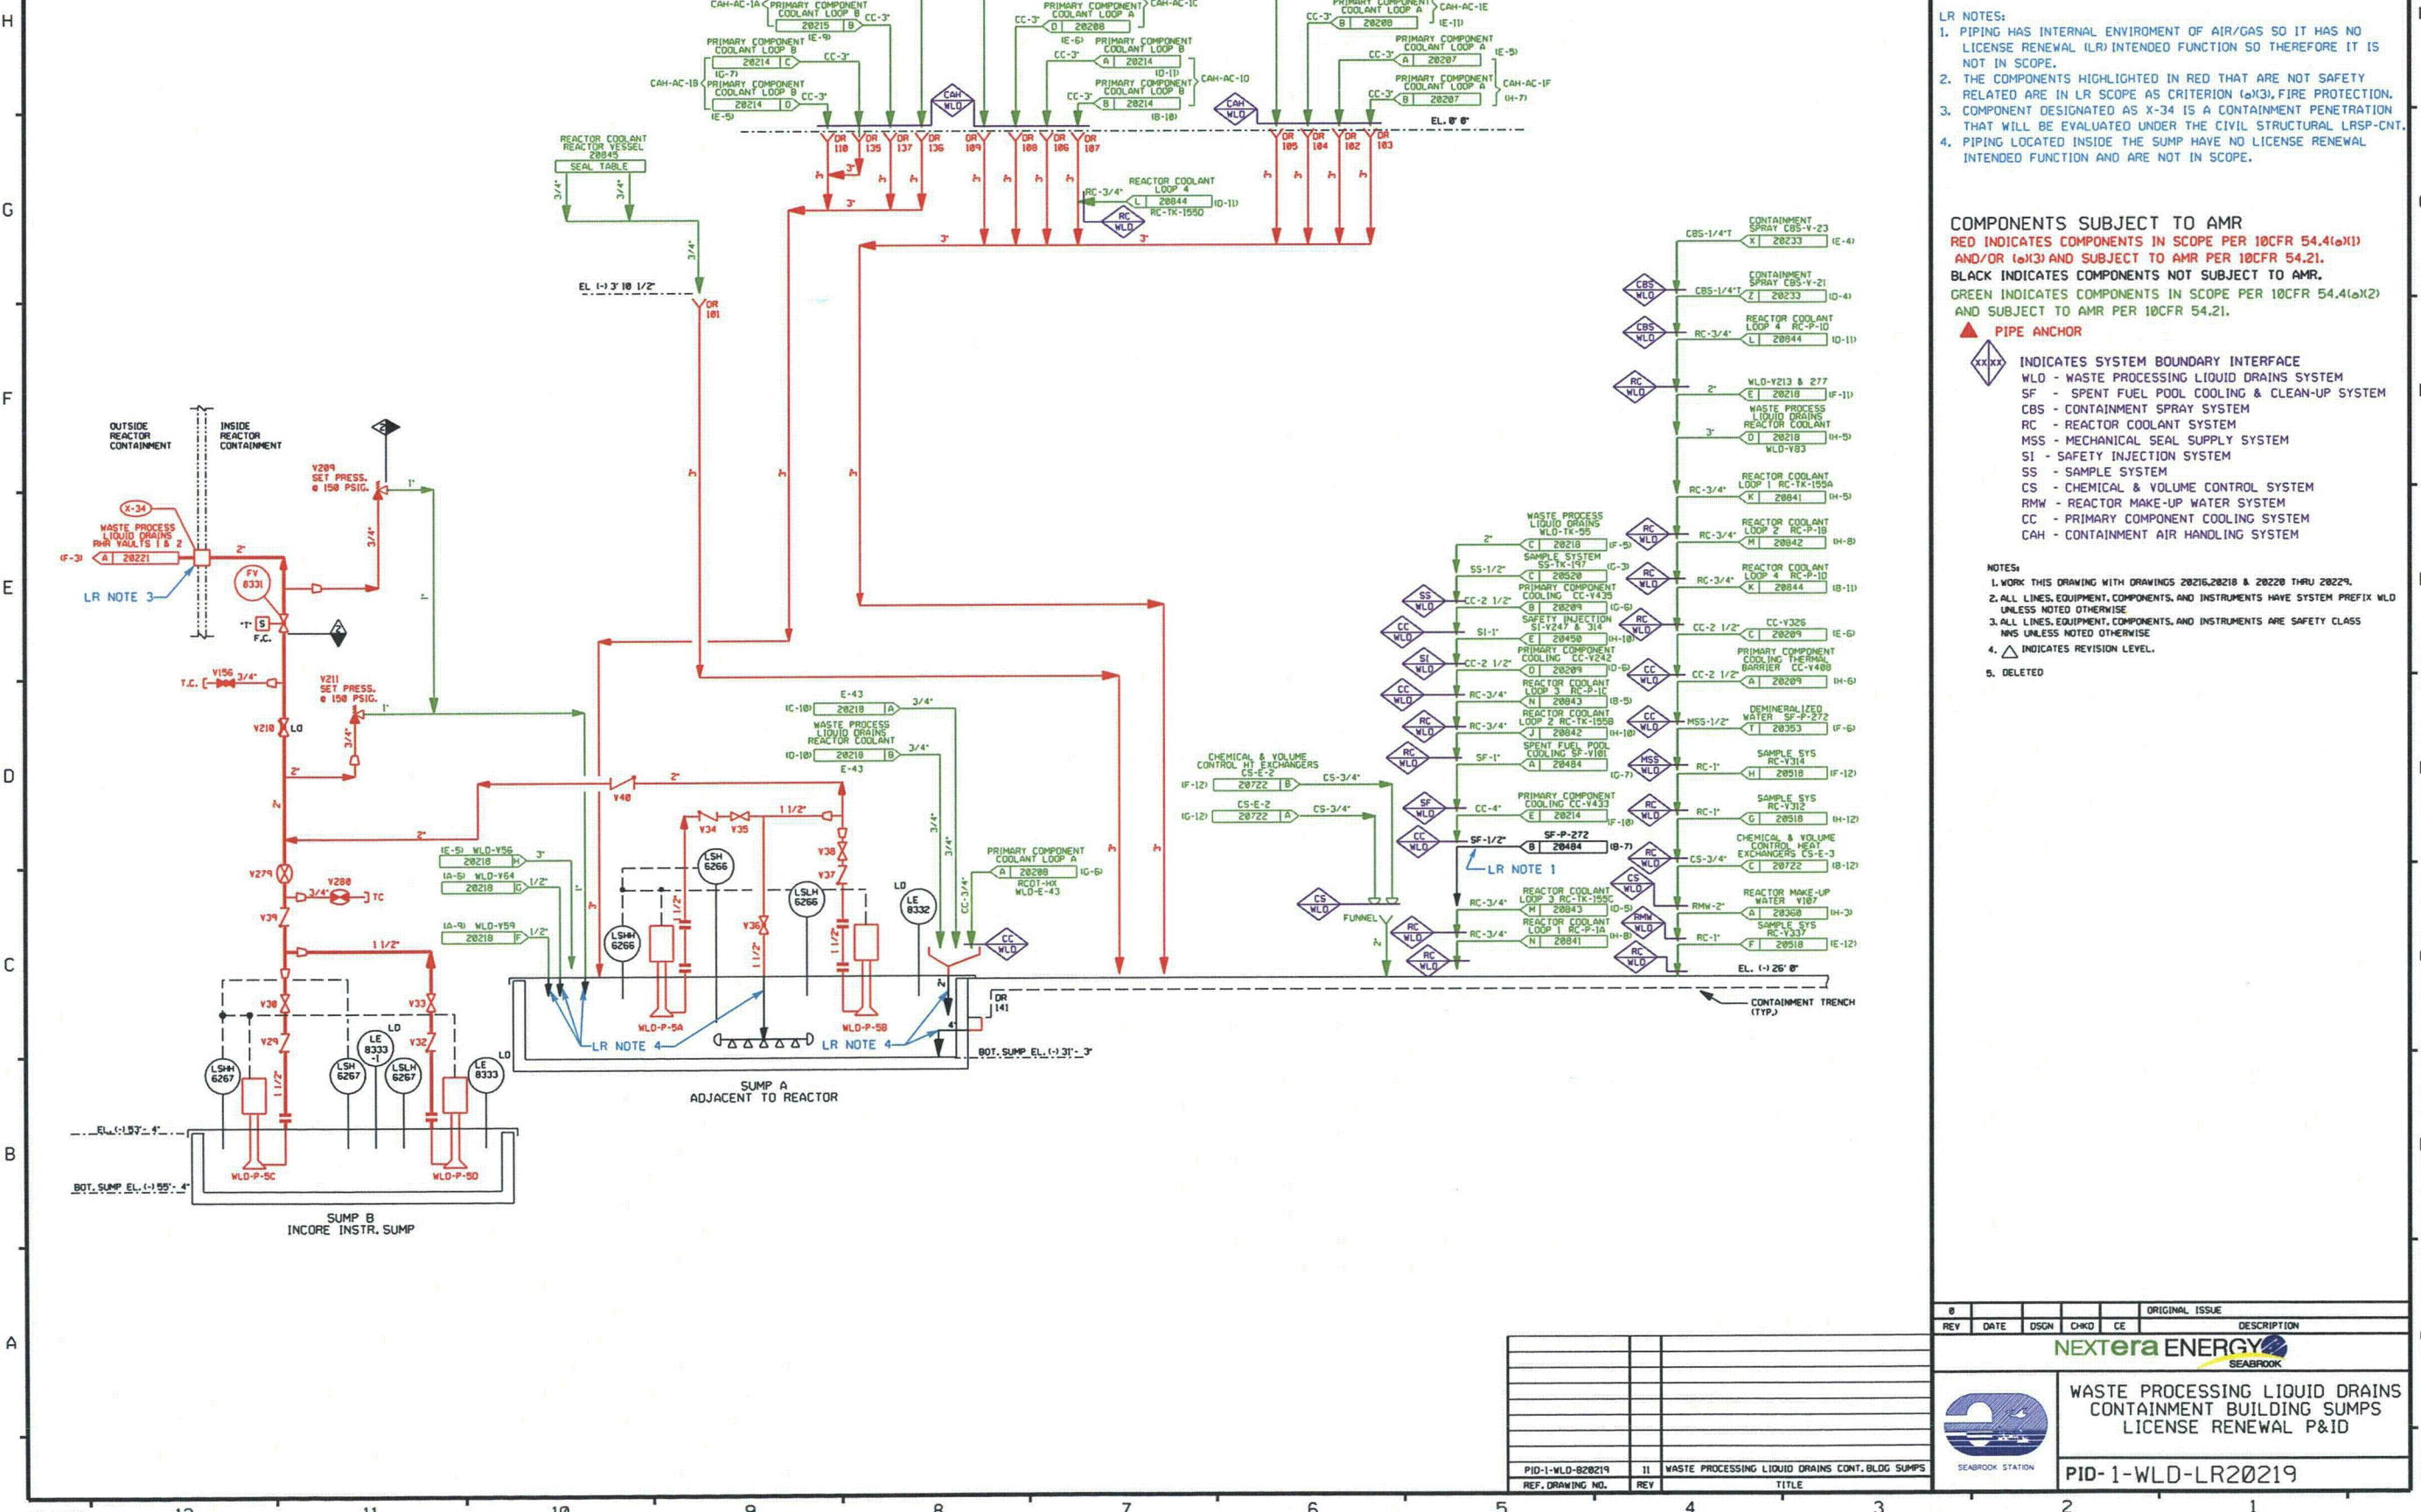

REV	DATE	DSGN	CHKD	CE	DESCRIPTION
1					ORIGINAL ISSUE
WASTE PROCESSING LIQUID DRAINS CONTAINMENT BUILDING SUMPS LICENSE RENEWAL P&ID					
PID-1-WLD-LR20219					

PID-1-WLD-LR20220

FOR P&ID REFERENCE DRAWINGS, SYMBOLS AND ABBREVIATIONS
REFER TO DRAWINGS P&ID - LRLEGEND 1 AND P&ID - LRLEGEND 2

LR NOTES:

1. PIPING INSIDE THE SUMP HAS NO LICENSE RENEWAL (LR) INTENDED FUNCTION, THEREFORE THE PIPING IS NOT IN SCOPE.
2. PIPING HAS AN INTERNAL ENVIRONMENT OF AIR/GAS SO IT HAS NO LR INTENDED FUNCTION AND IS NOT IN SCOPE.
3. THE COMPONENTS HIGHLIGHTED IN RED THAT ARE NOT SAFETY RELATED ARE IN LR SCOPE AS CRITERION (a)(3), FIRE PROTECTION.

COMPONENTS SUBJECT TO AMR

RED INDICATES COMPONENTS IN SCOPE PER 10CFR 54.4(a)(1)
AND/OR (a)(3) AND SUBJECT TO AMR PER 10CFR 54.21.
BLACK INDICATES COMPONENTS NOT SUBJECT TO AMR.
GREEN INDICATES COMPONENTS IN SCOPE PER 10CFR 54.4(a)(2)
AND SUBJECT TO AMR PER 10CFR 54.21.


PIPE ANCHOR

INDICATES SYSTEM BOUNDARY INTERFACE

WLD - WASTE PROCESSING LIQUID DRAINS SYSTEM
SF - SPENT FUEL POOL COOLING AND CLEAN-UP SYSTEM
DM - DEMINERALIZED WATER SYSTEM
CC - PRIMARY COMPONENT COOLING SYSTEM
FAH - FUEL STORAGE BUILDING AIR HANDLING SYSTEM

NOTES:

1. WORK THIS DRAWING WITH DRAWINGS 20216, 20218, 20219, & 20221 THRU 20229.
2. ALL LINES, EQUIPMENT, COMPONENTS, AND INSTRUMENTS HAVE SYSTEM PREFIX WLD UNLESS NOTED OTHERWISE.
3. ALL LINES, EQUIPMENT, COMPONENTS, AND INSTRUMENTS ARE SAFETY CLASS NMS.

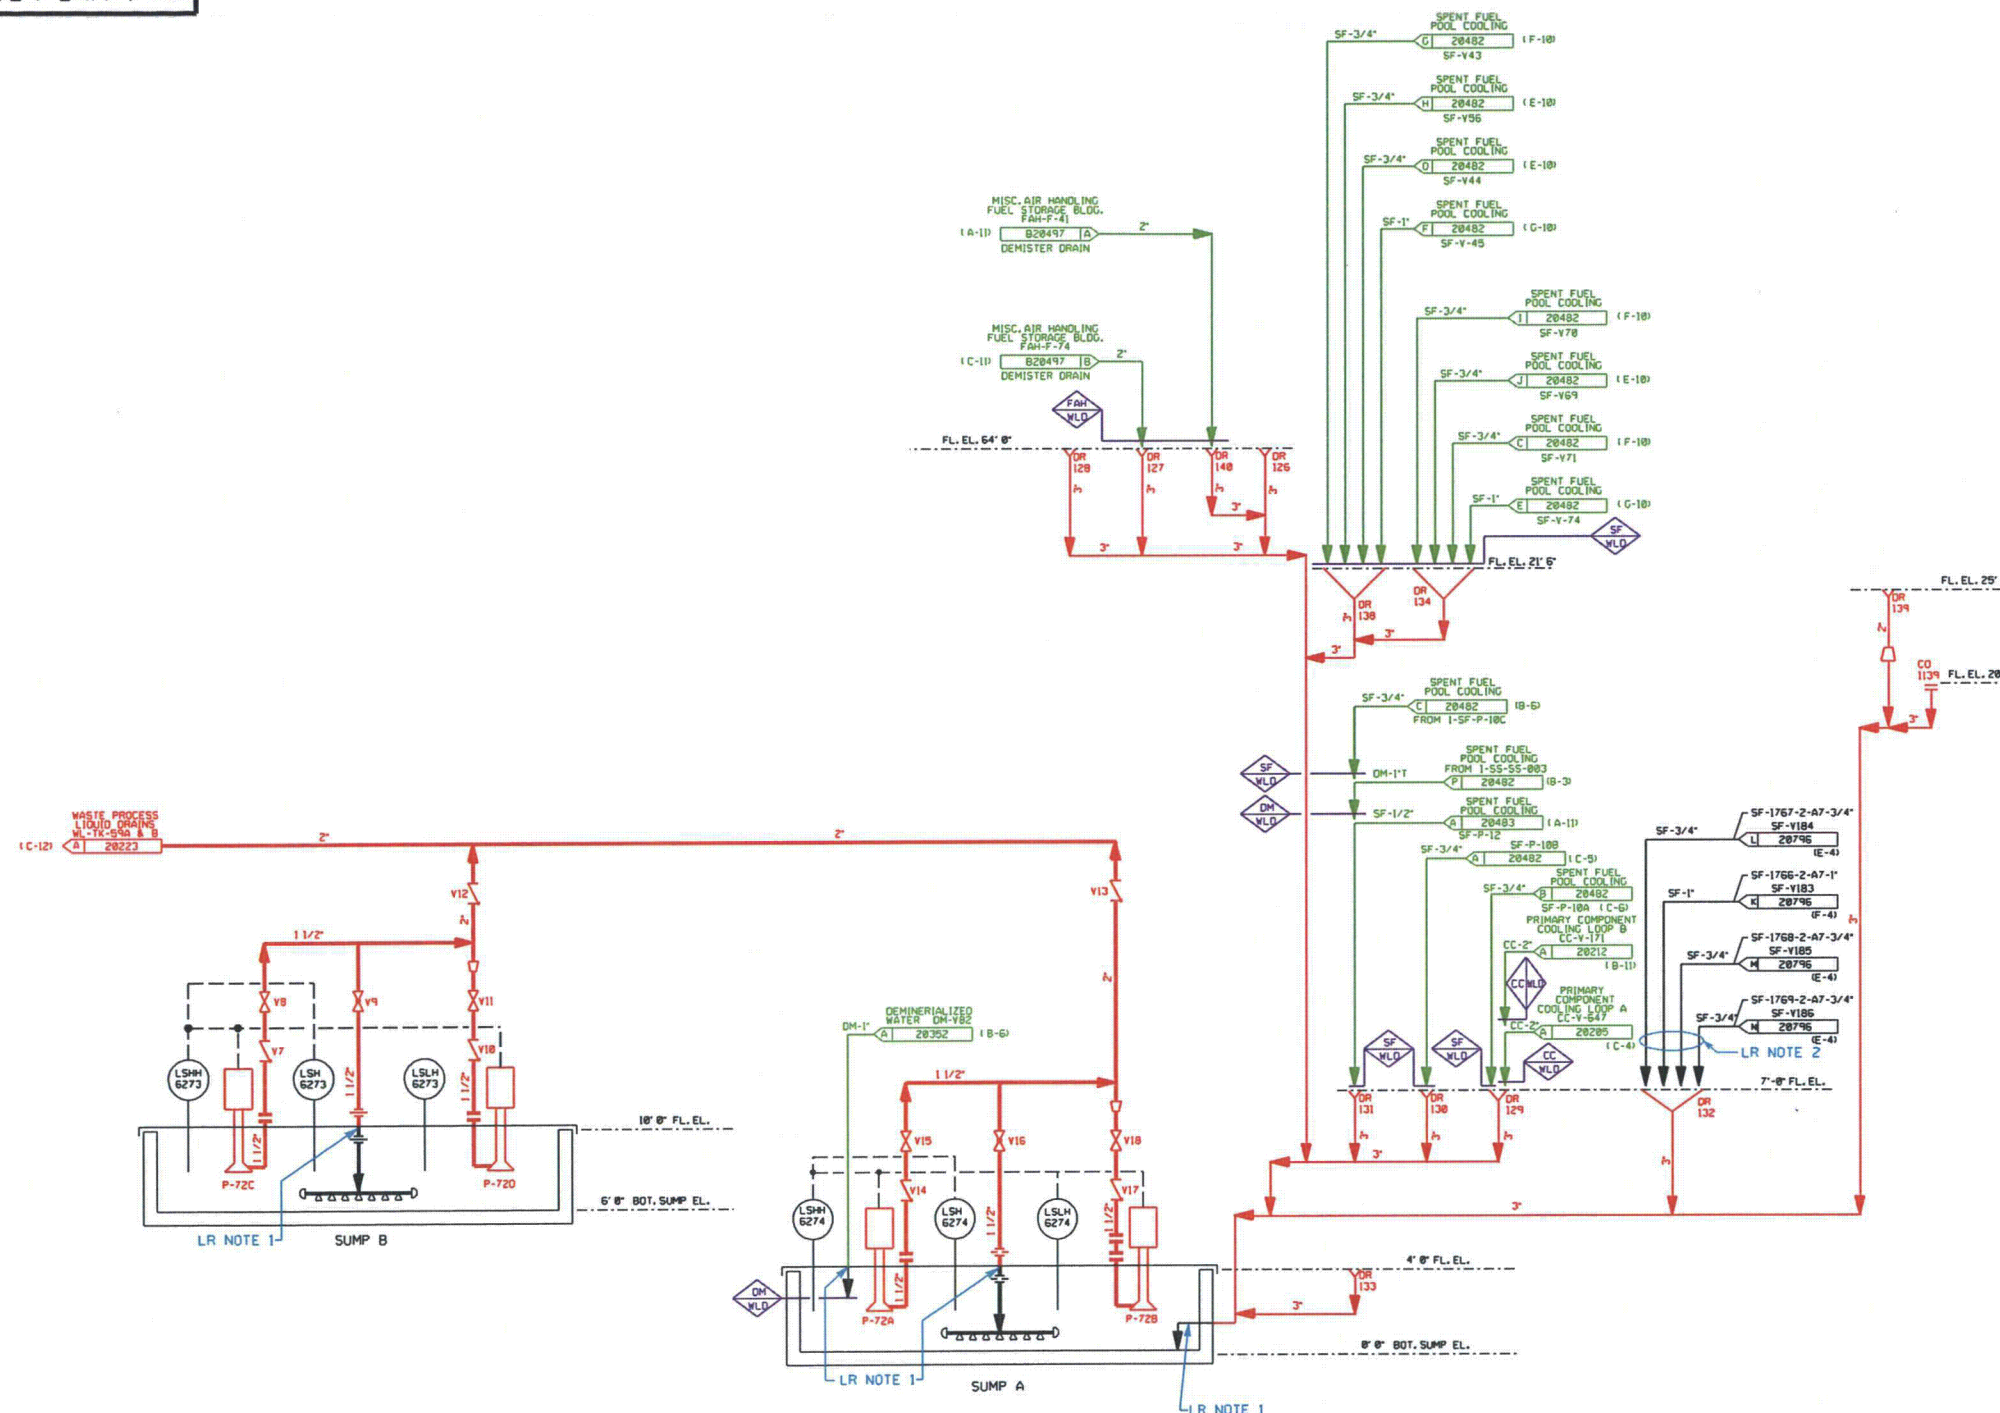

8				ORIGINAL ISSUE	DESCRIPTION
REV	DATE	DSGN	CHKD	CE	
NEXTera ENERGY					
SEABROOK					
WASTE PROCESSING LIQUID DRAINS FUEL STORAGE BUILDING LICENSE RENEWAL P&ID					
PID- 1-WLD-LR20220					

 SEABROOK STATION	
---	--




SEABROOK STATION

REV	DATE	DSGN	CHKD	CE	DESCRIPTION
1					
2					
3					
4					
5					
6					
7					
8					
9					
10					
11					
12					

05/18/10

PID-1-WLD-LR20221

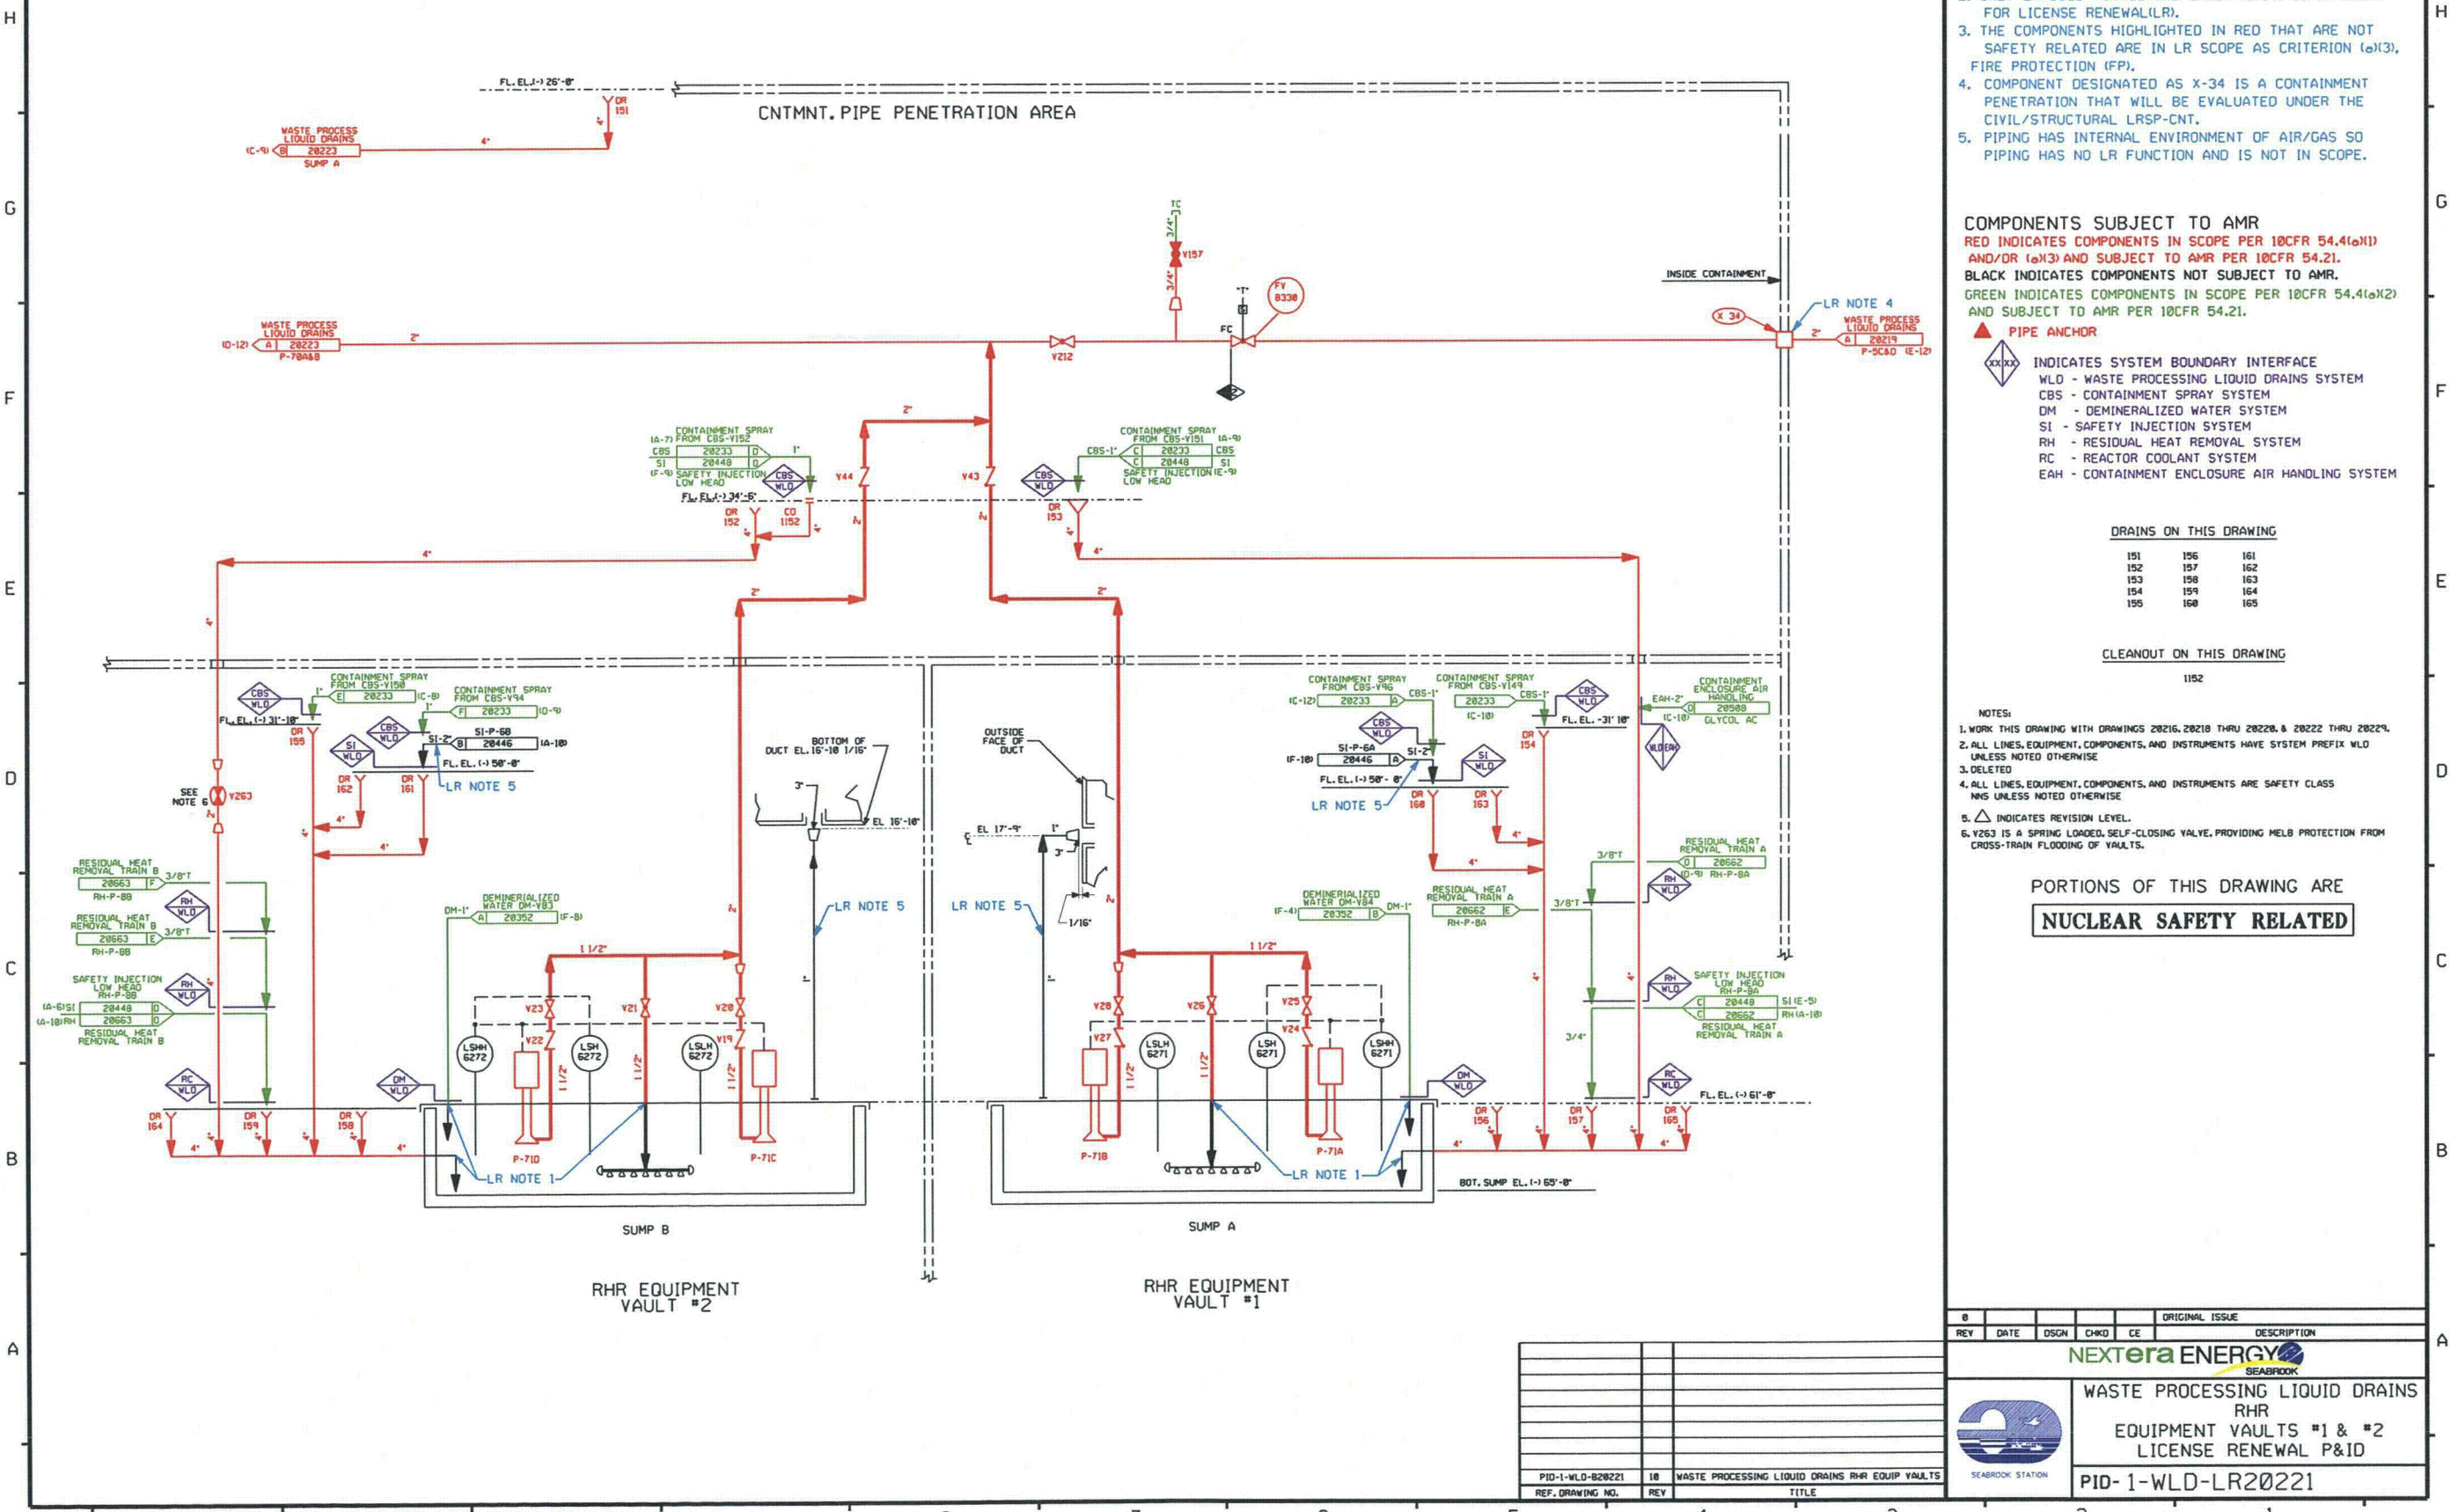

FOR P&ID REFERENCE DRAWINGS, SYMBOLS AND ABBREVIATIONS
REFER TO DRAWINGS P&ID - LRLEGEND 1 AND P&ID - LRLEGEND 2

- LR NOTES:
1. PIPING LOCATED INSIDE THE SUMP HAS NO LICENSE RENEWAL INTENDED FUNCTION, THEREFORE THE PIPING IS NOT IN SCOPE.
 2. ONLY EXPOSED FUNNEL AND DRAIN PIPING IS IN SCOPE FOR LICENSE RENEWAL(LR).
 3. THE COMPONENTS HIGHLIGHTED IN RED THAT ARE NOT SAFETY RELATED ARE IN LR SCOPE AS CRITERION (a)(3), FIRE PROTECTION (FP).
 4. COMPONENT DESIGNATED AS X-34 IS A CONTAINMENT PENETRATION THAT WILL BE EVALUATED UNDER THE CIVIL/STRUCTURAL LRSP-CNT.
 5. PIPING HAS INTERNAL ENVIRONMENT OF AIR/GAS SO PIPING HAS NO LR FUNCTION AND IS NOT IN SCOPE.

COMPONENTS SUBJECT TO AMR
RED INDICATES COMPONENTS IN SCOPE PER 10CFR 54.4(a)(1) AND/OR (a)(3) AND SUBJECT TO AMR PER 10CFR 54.21.
BLACK INDICATES COMPONENTS NOT SUBJECT TO AMR.
GREEN INDICATES COMPONENTS IN SCOPE PER 10CFR 54.4(a)(2) AND SUBJECT TO AMR PER 10CFR 54.21.

▲ PIPE ANCHOR

◇ INDICATES SYSTEM BOUNDARY INTERFACE
WLD - WASTE PROCESSING LIQUID DRAINS SYSTEM
CBS - CONTAINMENT SPRAY SYSTEM
DM - DEMINERALIZED WATER SYSTEM
SI - SAFETY INJECTION SYSTEM
RH - RESIDUAL HEAT REMOVAL SYSTEM
RC - REACTOR COOLANT SYSTEM
EAH - CONTAINMENT ENCLOSURE AIR HANDLING SYSTEM

DRAINS ON THIS DRAWING

151	156	161
152	157	162
153	158	163
154	159	164
155	160	165

CLEANOUT ON THIS DRAWING

1152

- NOTES:
1. WORK THIS DRAWING WITH DRAWINGS 20216, 20218 THRU 20220, & 20222 THRU 20224.
 2. ALL LINES, EQUIPMENT, COMPONENTS, AND INSTRUMENTS HAVE SYSTEM PREFIX WLD UNLESS NOTED OTHERWISE.
 3. DELETED
 4. ALL LINES, EQUIPMENT, COMPONENTS, AND INSTRUMENTS ARE SAFETY CLASS UNLESS NOTED OTHERWISE.
 5. △ INDICATES REVISION LEVEL.
 6. Y263 IS A SPRING LOADED, SELF-CLOSING VALVE, PROVIDING MELB PROTECTION FROM CROSS-TRAIN FLOODING OF VAULTS.

PORTIONS OF THIS DRAWING ARE
NUCLEAR SAFETY RELATED

REV	DATE	DSGN	CHKD	CE	DESCRIPTION
0					ORIGINAL ISSUE
WASTE PROCESSING LIQUID DRAINS RHR EQUIPMENT VAULTS #1 & #2 LICENSE RENEWAL P&ID					
PID-1-WLD-LR20221					

REF. DRAWING NO.	REV	TITLE
PID-1-WLD-B20221	10	WASTE PROCESSING LIQUID DRAINS RHR EQUIP VAULTS

PID-1-WLD-LR20222

FOR P&ID REFERENCE DRAWINGS, SYMBOLS AND ABBREVIATIONS
REFER TO DRAWINGS P&ID - LRLEGEND 1 AND P&ID - LRLEGEND 2

- LR NOTES:
1. THE COMPONENTS HIGHLIGHTED IN RED THAT ARE NOT SAFETY RELATED ARE IN LR SCOPE AS CRITERION (a)(3), FIRE PROTECTION (FP).
 2. COMPONENT DESIGNATED AS X-32 IS A CONTAINMENT PENETRATION THAT WILL BE EVALUATED UNDER THE CIVIL/STRUCTURAL LRSP-CNT.
 3. PIPE SUPPORT ANCHOR
ISO NO.: 802102-2-565.80
HANGER NO.: 2102-A-72
CALC NO.: MCD 565.80-CALC.
 4. PIPING HAS AN INTERNAL ENVIRONMENT OF AIR/GAS SO THE PIPING HAS NO LICENSE RENEWAL INTENDED FUNCTION AND IS NOT IN SCOPE.

COMPONENTS SUBJECT TO AMR
RED INDICATES COMPONENTS IN SCOPE PER 10CFR 54.4(a)(1) AND/OR (a)(3) AND SUBJECT TO AMR PER 10CFR 54.21.
BLACK INDICATES COMPONENTS NOT SUBJECT TO AMR.
GREEN INDICATES COMPONENTS IN SCOPE PER 10CFR 54.4(a)(2) AND SUBJECT TO AMR PER 10CFR 54.21.

▲ PIPE ANCHOR

INDICATES SYSTEM BOUNDARY INTERFACE
WLD - WASTE PROCESSING LIQUID DRAINS
CS - CHEMICAL & VOLUME CONTROL SYSTEM
SF - SPENT FUEL POOL COOLING & CLEAN-UP SYSTEM
SB - STEAM GENERATOR BLOWDOWN SYSTEM
SS - SAMPLE SYSTEM
MSS - MECHANICAL SEAL SUPPLY SYSTEM
CC - PRIMARY COMPONENT COOLING SYSTEM
SW - SERVICE WATER SYSTEM
DG - DIESEL GENERATORS

- NOTES:
1. WORK THIS DRAWING WITH DRAWINGS 20216, 20218 THRU 20221, & 20223 THRU 20229.
 2. ALL LINES, EQUIPMENT, COMPONENTS, AND INSTRUMENTATION HAVE SYSTEM PREFIX WLD UNLESS NOTED OTHERWISE.
 3. ALL LINES, EQUIPMENT, COMPONENTS, AND INSTRUMENTATION ARE SAFETY CLASS NMS UNLESS NOTED OTHERWISE.
 4. ▲ INDICATES REVISION LEVEL.
 5. REFER TO DRAWING YSL-20774 FOR VALVE LEAKOFF.
 6. THIS DRAIN HAS A GAS CONTAINMENT DEVICE ADDED PER MMD 96-555.

PORTIONS OF THIS DRAWING ARE
NUCLEAR SAFETY RELATED

REV	DATE	OSDN	CHKD	CE	DESCRIPTION
0					ORIGINAL ISSUE
					
					
WASTE PROCESSING LIQUID DRAINS PRIMARY AUXILIARY BLDG. SHT. 1 OF 2 LICENSE RENEWAL P&ID					
PID-1-WLD-LR20222					

