

PID-1-WLD-LR20223

FOR P&ID REFERENCE DRAWINGS, SYMBOLS AND ABBREVIATIONS
REFER TO DRAWINGS P&ID - LRLEGEND 1 AND P&ID - LRLEGEND 2

COMPONENTS SUBJECT TO AMR
RED INDICATES COMPONENTS IN SCOPE PER 10CFR 54.4(a)(1)
AND/OR (a)(3) AND SUBJECT TO AMR PER 10CFR 54.21.
BLACK INDICATES COMPONENTS NOT SUBJECT TO AMR.
GREEN INDICATES COMPONENTS IN SCOPE PER 10CFR 54.4(a)(2)
AND SUBJECT TO AMR PER 10CFR 54.21.
▲ PIPE ANCHOR
◇ INDICATES SYSTEM BOUNDARY INTERFACE
WLD - WASTE PROCESSING LIQUID DRAINS SYSTEM
SF - SPENT FUEL POOL COOLING & CLEAN-UP SYSTEM
VG - VENT GAS SYSTEM
EAH - CONTAINMENT ENCLOSURE AIR HANDLING SYSTEM
CS - CHEMICAL & VOLUME CONTROL SYSTEM
ASC - AUXILIARY STEAM CONDENSATE SYSTEM
DM - DEMINERALIZED WATER SYSTEM
CC - PRIMARY COMPONENT COOLING SYSTEM

DRAINS ON THIS DRAWING

176	183	191	198	205	238
177	184	192	199	206	
178	185	193	200	209	
179	186	194	201	218	
180	188	195	202	227	
181	189	196	203	228	
182	190	197	204	229	

CLEANOUTS ON THIS DRAWING

1176	1193	1446 UNIT *2
1177	1196	
1181	1203	
1182	1205	

- NOTES:
1. WORK THIS DRAWING WITH DRAWINGS 20216, 20218 THRU 20222, & 20224 THRU 20229.
 2. ALL LINES, EQUIPMENT, COMPONENTS, & INSTRUMENTS HAVE SYSTEM PREFIX WLD UNLESS NOTED OTHERWISE.
 3. ALL LINES, EQUIPMENT, COMPONENTS, & INSTRUMENTS ARE SAFETY CLASS NNS, UNLESS NOTED OTHERWISE.
 4. Δ INDICATES REVISION LEVEL.


- LR NOTES:
1. PIPING LOCATED INSIDE THE SUMP HAS NO LICENSE RENEWAL INTENDED FUNCTION, THEREFORE THE PIPING IS NOT IN SCOPE.
 2. PRIMARY AUXILIARY BUILDING SUMP AND VENT LINE TO MAH DUCT LINE. SINCE THIS VENT LINE HAS AN AIR INTERNAL ENVIRONMENT AND IT IS NOT SAFETY RELATED, NOT IN SCOPE FOR (a)(2) AND NOT IN SCOPE FOR LICENSE RENEWAL(LR).
 3. THE SUMP IS COVERED BY A STEEL DECKING PLATE WHICH PREVENTS POTENTIAL SPRAY FROM EXISTING SUMP.
 4. ONLY EXPOSED (a)(2) FUNNEL AND DRAIN PIPING IS IN SCOPE FOR LICENSE RENEWAL(LR).
 5. THE COMPONENTS HIGHLIGHTED IN RED THAT ARE NOT SAFETY RELATED ARE IN LR SCOPE AS CRITERION (a)(3), FIRE PROTECTION (FP).
 6. PIPING HAS INTERNAL ENVIRONMENT OF AIR/GAS SO THE PIPING HAS NO LICENSE RENEWAL INTENDED FUNCTION AND IS NOT IN SCOPE.

REV	DATE	DSGN	CHKD	CE	DESCRIPTION
0					ORIGINAL ISSUE



WASTE LIQUID DRAINS
PRIMARY AUXILIARY BLDG.
SHT. 2 OF 2
LICENSE RENEWAL P&ID

PID-1-WLD-LR20223

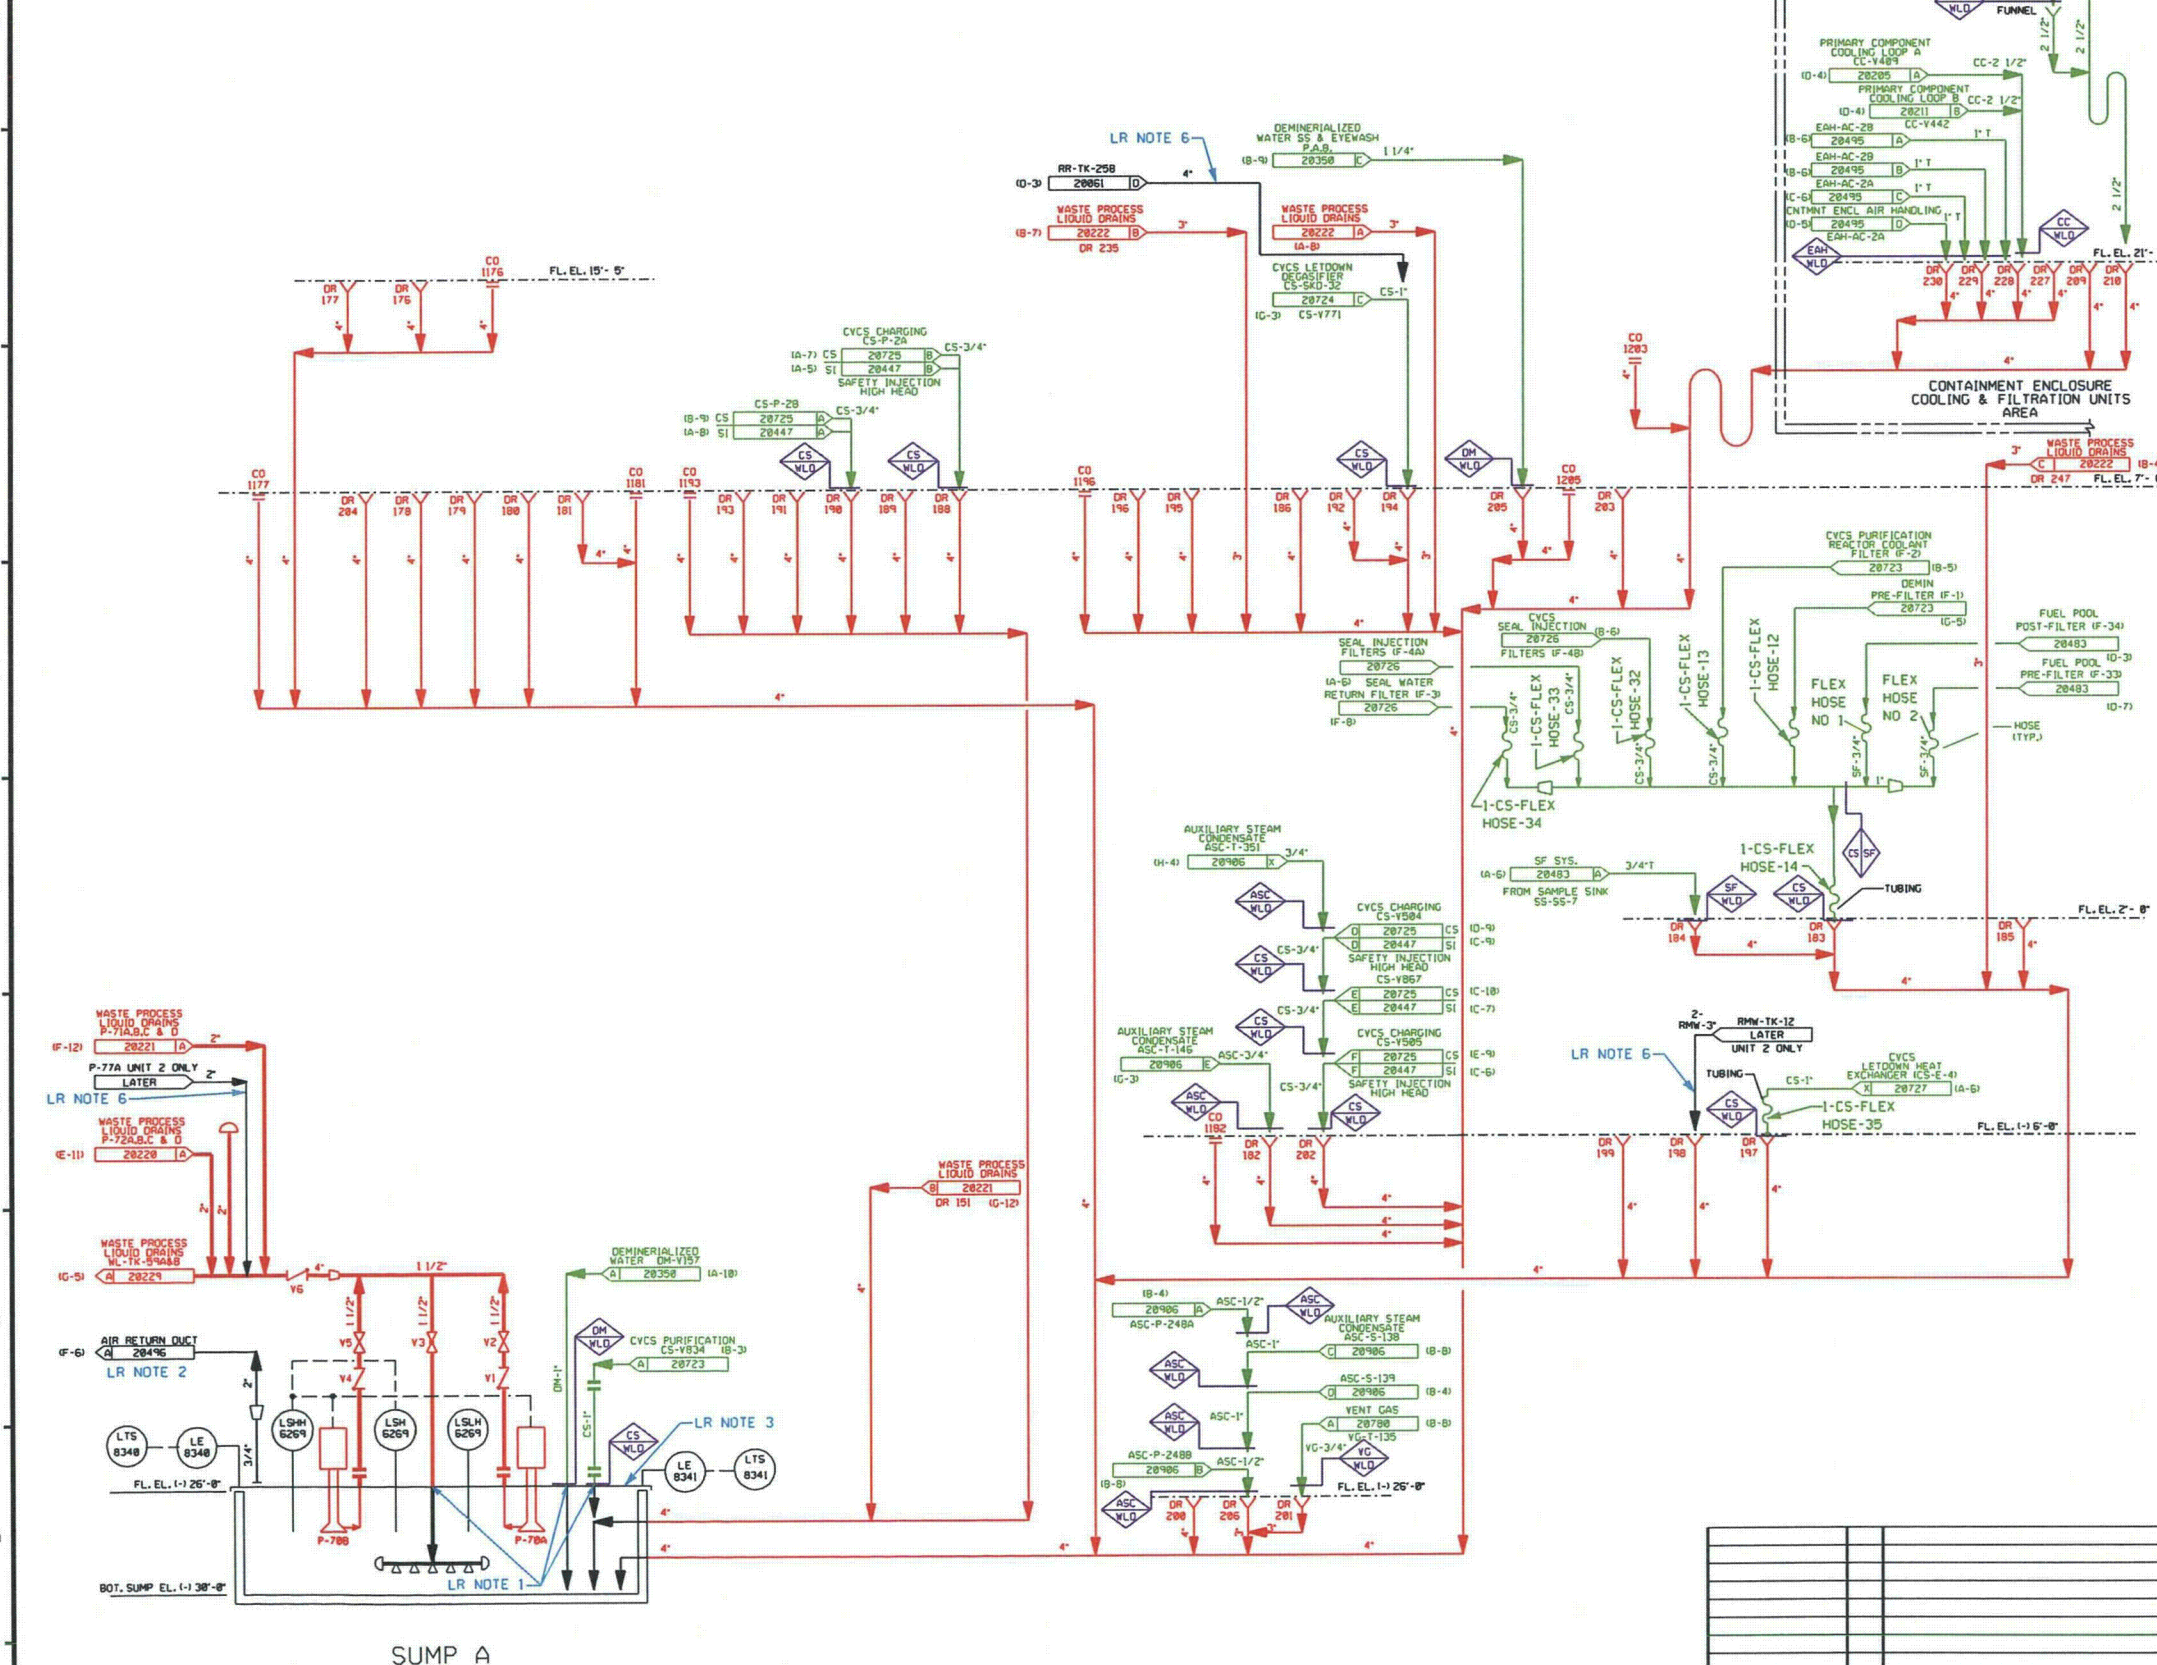

PID-1-WLD-LR20228

FOR P&ID REFERENCE DRAWINGS, SYMBOLS AND ABBREVIATIONS
REFER TO DRAWINGS P&ID - LRLEGEND 1 AND P&ID - LRLEGEND 2

LR NOTES:

1. THE COMPONENTS HIGHLIGHTED IN RED ARE IN LR SCOPE AS CRITERION (a)(3), FIRE PROTECTION (FP).
2. ALL COMPONENTS HIGHLIGHTED IN BLACK ARE LOCATED IN THE WASTE PROCESSING BUILDING WHICH CONTAINS NO SAFETY RELATED COMPONENTS THEREFORE THESE COMPONENTS HAVE NO LICENSE RENEWAL INTENDED FUNCTION AND ARE NOT IN SCOPE.

COMPONENTS SUBJECT TO AMR

RED INDICATES COMPONENTS IN SCOPE PER 10CFR 54.4(a)(1) AND/OR (a)(3) AND SUBJECT TO AMR PER 10CFR 54.21.

BLACK INDICATES COMPONENTS NOT SUBJECT TO AMR.

GREEN INDICATES COMPONENTS IN SCOPE PER 10CFR 54.4(a)(2) AND SUBJECT TO AMR PER 10CFR 54.21.

▲ PIPE ANCHOR

XXXX INDICATES SYSTEM BOUNDARY INTERFACE

INSTRUMENTATION IDENTIFICATION

(A) TO WLD-LT-8305 & WLD-P-141 ON DWG. B20224.

NOTES:

1. WORK THIS DRAWING WITH DRAWINGS 20216, 20218, THRU 20227 & 20229.
2. ALL LINES, EQUIPMENT, COMPONENTS, AND INSTRUMENTS HAVE SYSTEM PREFIX WLD UNLESS NOTED OTHERWISE.
3. FLOW RESTRICTION PIPE SECTION.
4. SEE DWG. DM-20353 FOR DM SUPPLY TO MECHANICAL SEALS.
5. ALL LINES, EQUIPMENT, COMPONENTS, AND INSTRUMENTS ARE SAFETY CLASS N.
6. △ INDICATES REVISION LEVEL.

