


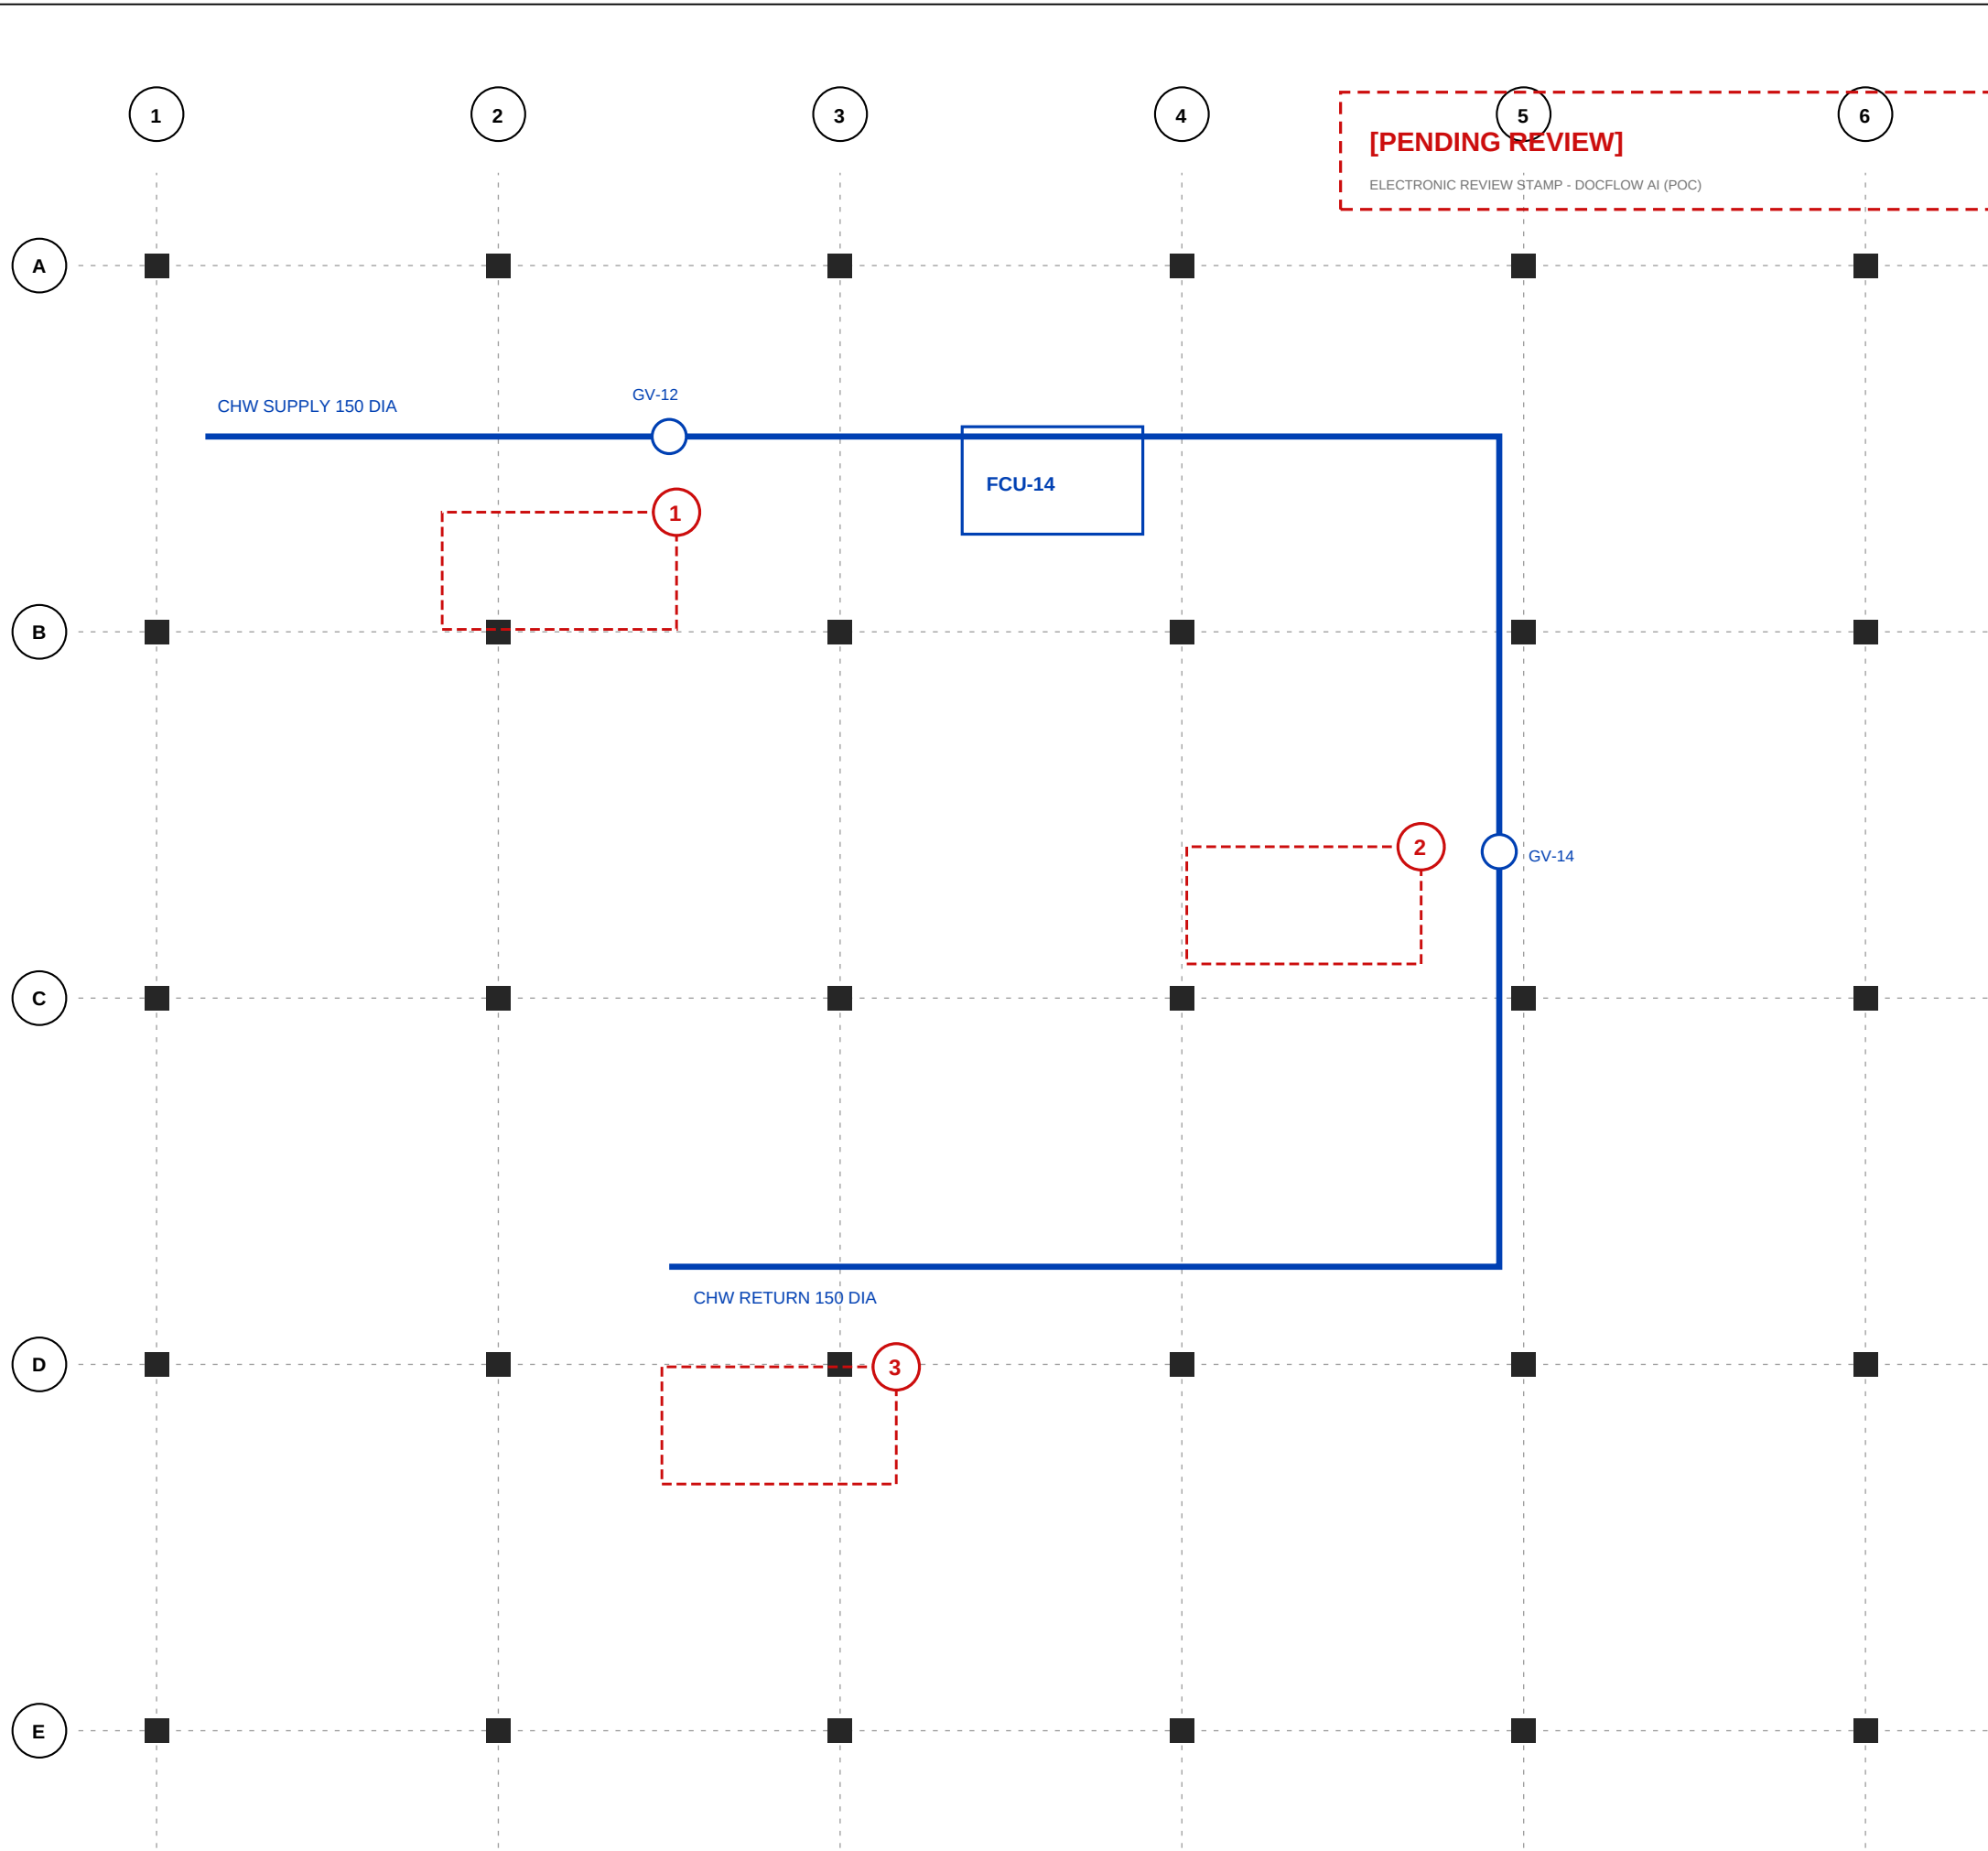

REVIEW COMMENTS / INLINE MARKUPS

- 1

Priya Nair (Document Controller)
2026-07-06 10:14
Rev C received via transmittal TRN-2026-0198. Routed to MEP review. Supersedes Rev B.
- 2

Rajesh Iyer (Reviewer/Approver)
2026-07-09 16:40
Riser shaft clash at L14 flagged in Rev B appears resolved. Verifying insulation spec against MEP-SPC-0031 before sign-off.
- 3

Suresh Patel (Contractor/Subcontractor)
2026-07-10 09:05
Insulation updated to 32mm nitrile as per Code 2 comment on Rev B. See sheet 7 note 4.

Markers 1-3 correspond to clouded areas on the drawing.

SP ENGINEERING (MAIN CONTRACTOR)		
CoolAir HVAC Systems (Subcontractor)		
PROJECT: SPCL		
TITLE		
Chilled Water Piping Layout ? Tower B, Levels 12?18		
DOCUMENT NO.	REV	SCALE
SPCL-MEP-DWG-0452-C	C	NTS
TYPE	DATE	
Drawing / MEP	2026-07-06	
STATUS		
[PENDING REVIEW]		
FILE: SPCL-MEP-DWG-0452-C.pdf		