


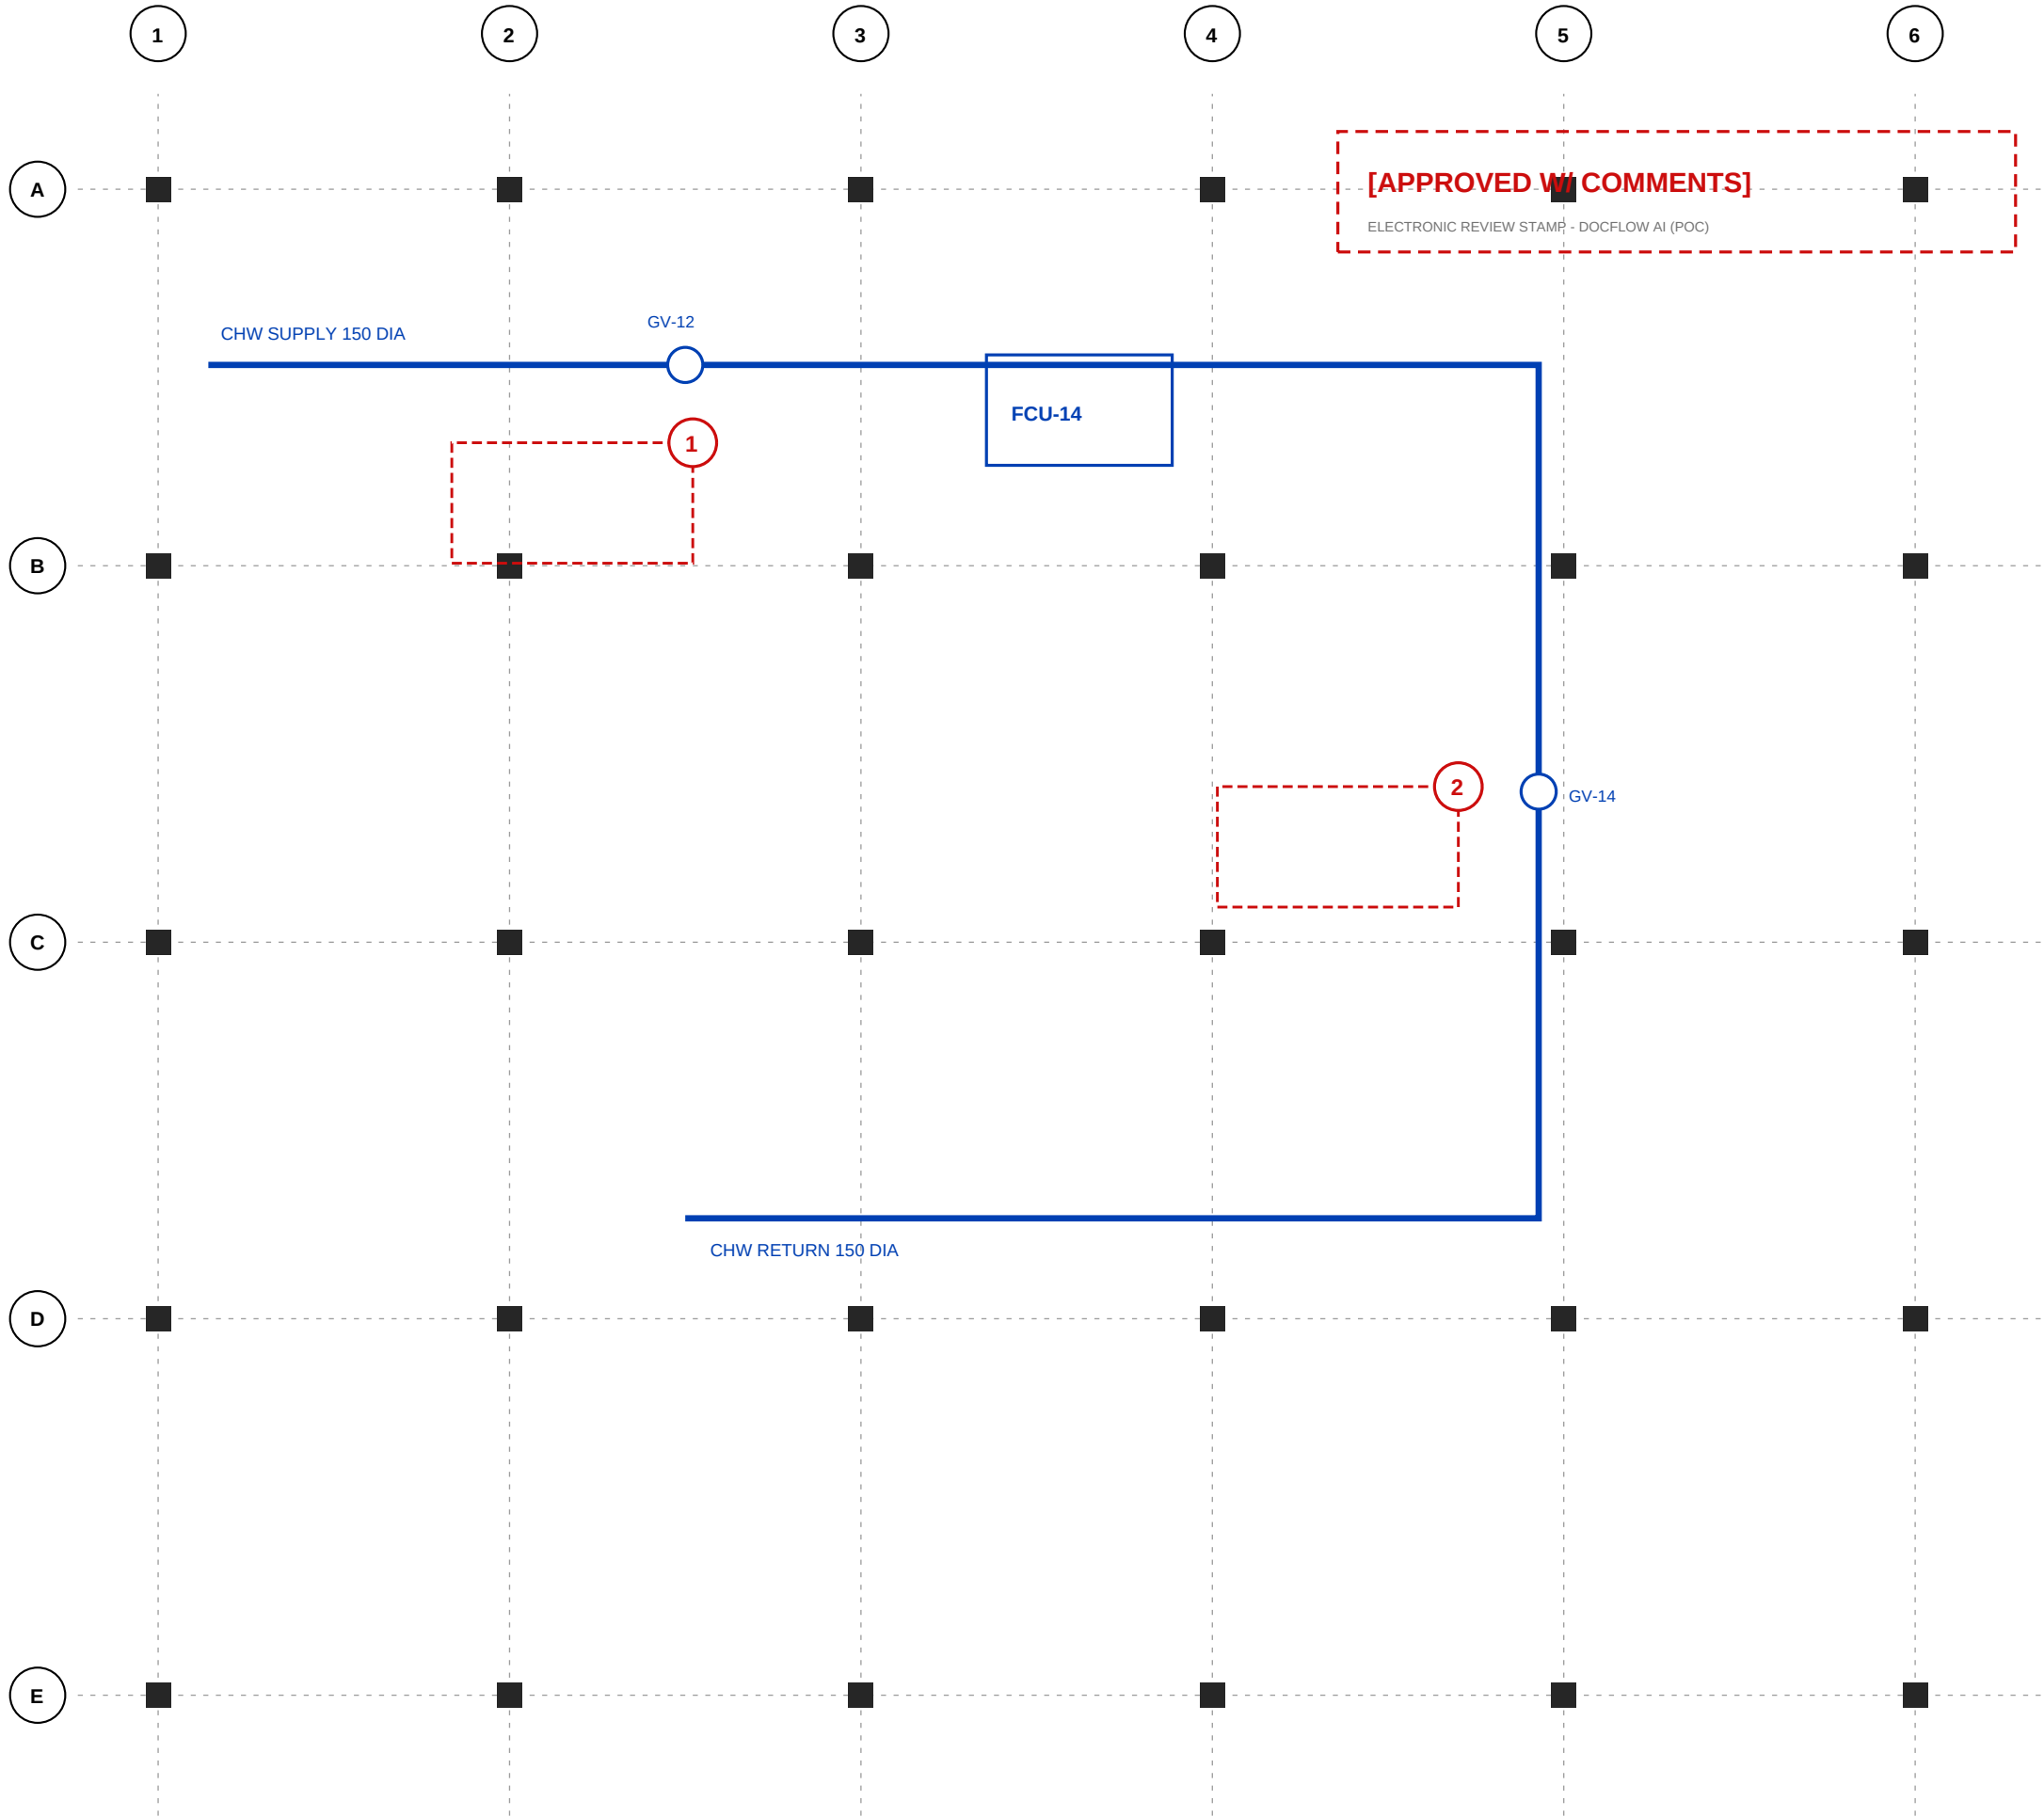

[APPROVED W/ COMMENTS]

ELECTRONIC REVIEW STAMP - DOCFLOW AI (POC)

REVIEW COMMENTS / INLINE MARKUPS

- 1

Rajesh Iyer (Reviewer/Approver)

2026-06-19 13:45

Code 2. Approved with comments: submit type test certificates for L14+ units before delivery; confirm refrigerant pipe lengths within manufacturer limits for roof-mounted condensers.
- 2

Suresh Patel (Contractor/Subcontractor)

2026-06-20 10:30

Noted. Test certificates to follow under separate submittal by 30-Jul.

Markers 1-3 correspond to clouded areas on the drawing.

SP ENGINEERING (MAIN CONTRACTOR)		
CoolAir HVAC Systems (Subcontractor)		
PROJECT: SPCL		
TITLE		
Material Approval Request - VRF Outdoor Units (Daikin VRV-X)		
DOCUMENT NO.	REV	SCALE
SPCL-MEP-MAR-0203-A	A	NTS
TYPE	DATE	
Submittal/MAR / MEP	2026-06-08	
STATUS		
[APPROVED W/ COMMENTS]		
FILE: VRV-X-datasheets.pdf		