Kuppam Solar Site · KUP-SOLAR-001

Operational | Solar PV | 45 MW · 72% SOC

BOB Active | Data: Live | Mode: Balanced | Run simulation | Configure BOB | ...

Andhra Pradesh, India · Commissioned 2021 · Snapshot 01 Oct 2026, 14:32 IST

Snapshot 01 Oct 2026, 14:32 IST · Source freshness: site sensors 12s, weather 24s, battery 8s, grid 15s

Condition	Ambient	Module Temp	Solar	Wind Speed
Partly Cloudy	34.2°C	48.1°C	847 W/m² ↑	12.4 km/h NNW
Humidity	**Clouds**	**UV Index**	**Next 3h**	**Last updated**
45%	15% — Clear	8.2 High	↗ Clearing	30s ago

Solar Generation	Local Demand	Battery	Grid
84% of capacity	100% covered	Discharging at 6 MW	No import
38 MW	**44 MW**	**72%**	**0 MW import**
Forecast 46 MW · 8 MW below forecast	Critical demand fully covered	Min reserve 55% · End 2:49 PM	Connected · No import

Balance statement


Solar 38 MW + Battery discharge 6 MW = demand 44 MW. Grid import is 0 MW. Surplus/export is 0 MW. Battery SOC is 72%.

Generation is below forecast

Solar output is 8 MW below forecast due to increased cloud cover. BOB is discharging the battery. Grid import is 0 MW. Local demand remains fully covered.

Live generation and demand

2 Alerts | 5 Sources Live | Snapshot 01 Oct 2026, 14:32 IST

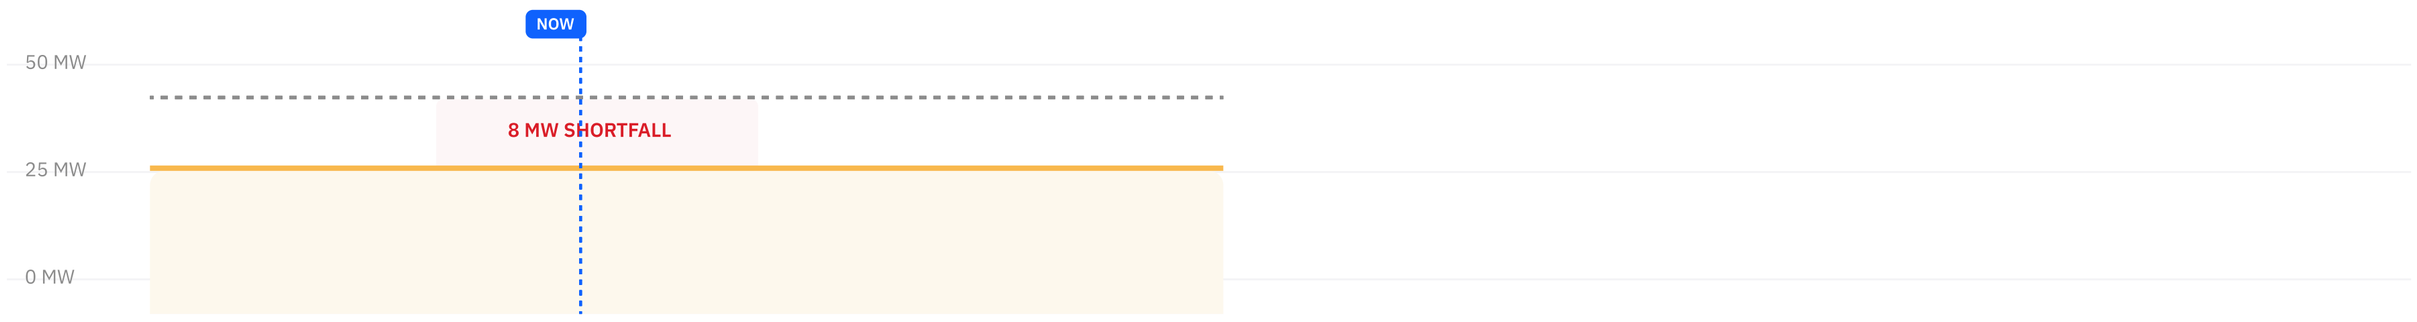

Current	Forecast	Shortfall	Peak today
38 MW	46 MW	8 MW	43 MW

Conditions affecting generation

Cloud cover	42% (from 18%)
Irradiance	847 W/m²
Temperature	34.2°C / 48.1°C
Wind	12.4 km/h NNW

Cloud cover increased from 18% to 42%, reducing output. Expected to improve by 3:00 PM.

Active alerts

- Solar output 8 MW below forecast
- Cloud cover advisory until 3:00 PM

Data sources

- Site sensors • Live 12 seconds
- Weather • Live 24 seconds
- Battery • Live 8 seconds
- Grid • Live 15 seconds
- Forecast • Recent 6 minutes

5 of 5 sources available

View connections

Energy flow

Live

Generation		Consumption	
Solar	38 MW	Local Demand	44 MW
Battery	6 MW	Surplus / Export	0 MW
Grid Import	0 MW	Total	44 MW
Total	44 MW		

Renewable share 100%

Battery storage

72% charged

Available Capacity 72%

Total Capacity	20 MWh
Available energy	14.4 MWh
Reserve limit	55% (11 MWh)
Usable	3.4 MWh
Current action	Discharging at 6 MW
Duration remaining	12 of 15 minutes

BOB initiated discharge at 2:34 PM. Will stop at 2:49 PM or if battery reaches 55%.