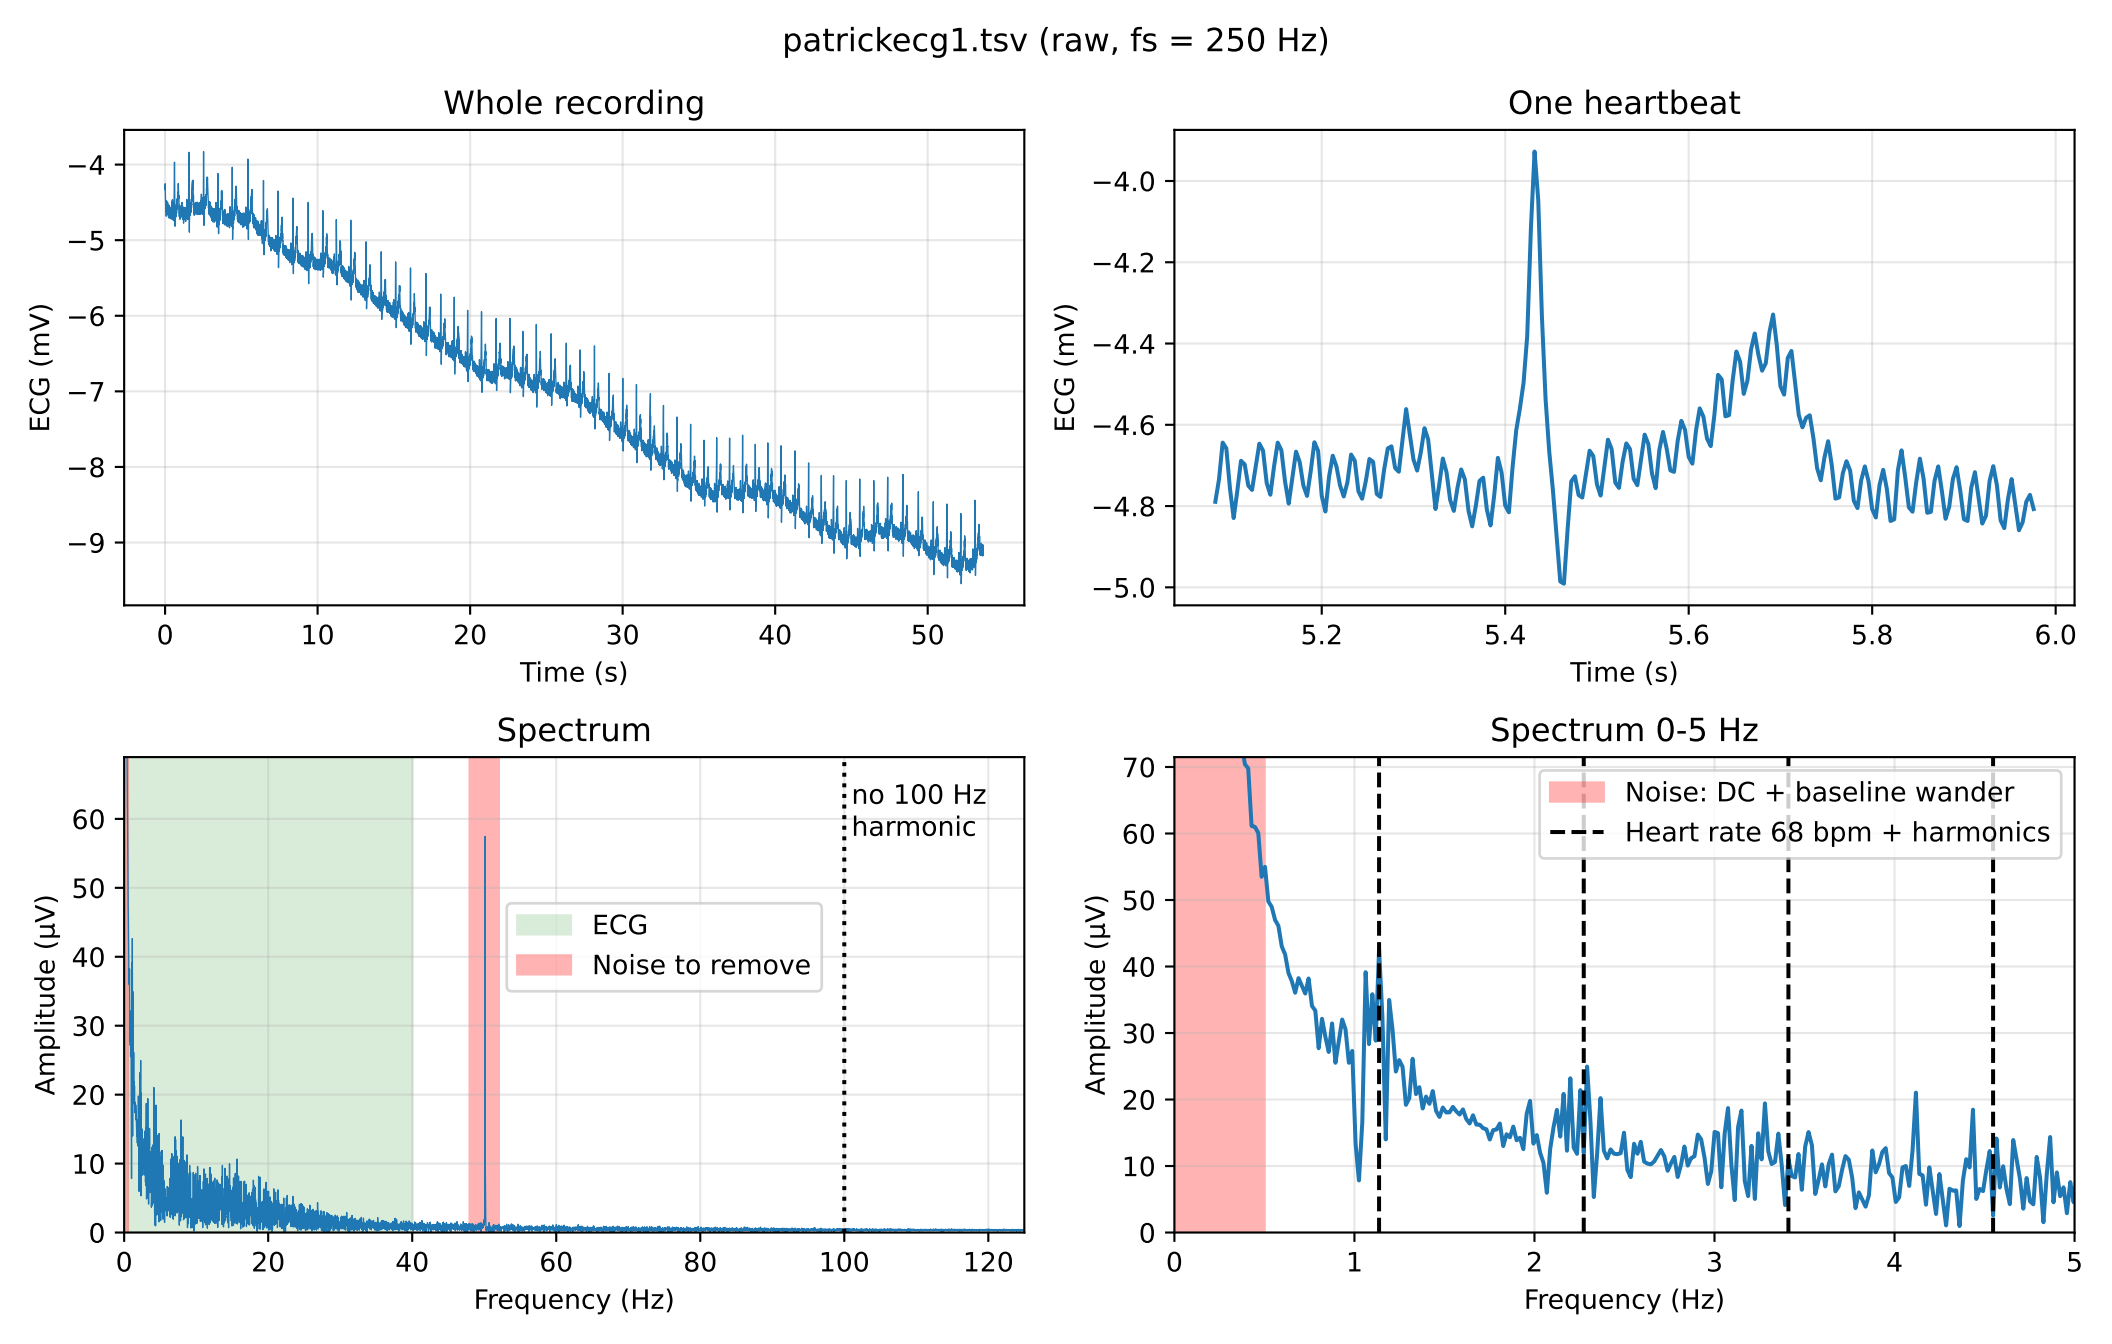

patrickecg1.tsv (raw, fs = 250 Hz)
Whole recording
ECG (mV)
Time (s)
One heartbeat
ECG (mV)
Time (s)
Spectrum
Amplitude (µV)
Frequency (Hz)
ECG
Noise to remove
no 100 Hz
harmonic
Spectrum 0-5 Hz
Amplitude (µV)
Frequency (Hz)
Noise: DC + baseline wander
Heart rate 68 bpm + harmonics