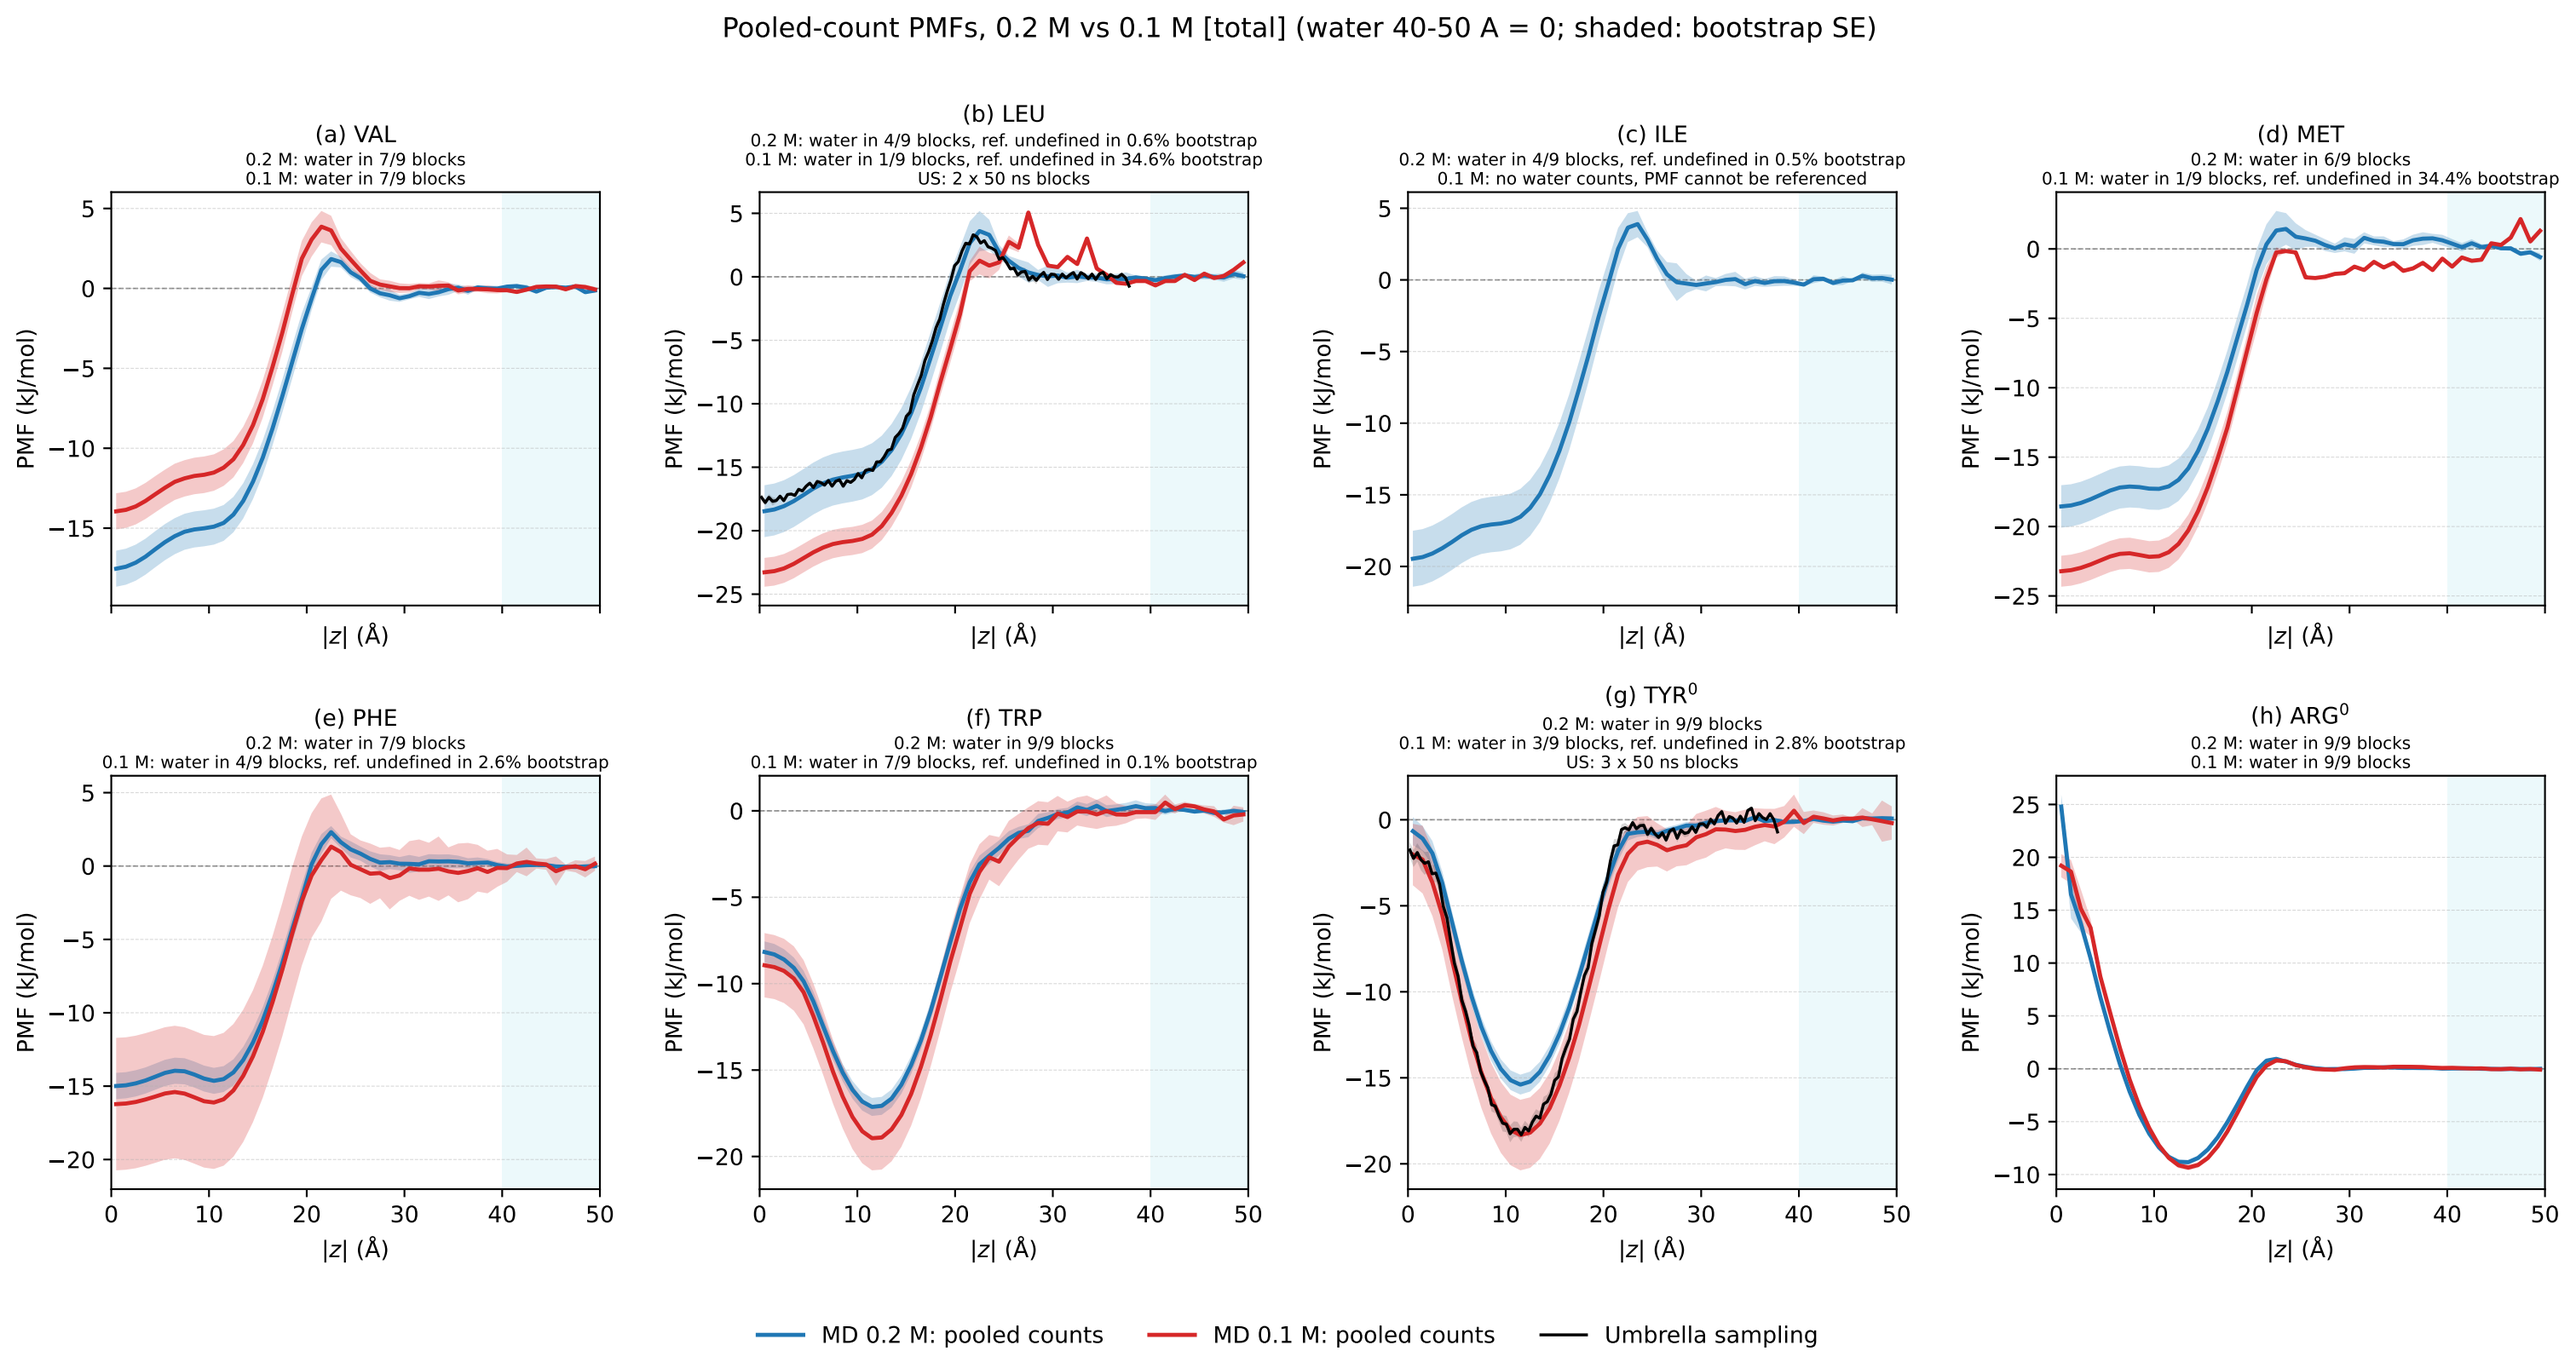
Pooled-count PMFs, 0.2 M vs 0.1 M [total] (water 40-50 A = 0; shaded: bootstrap SE)
(a) VAL
0.2 M: water in 7/9 blocks
0.1 M: water in 7/9 blocks
(b) LEU
0.2 M: water in 4/9 blocks, ref. undefined in 0.6% bootstrap
0.1 M: water in 1/9 blocks, ref. undefined in 34.6% bootstrap
US: 2 x 50 ns blocks
(c) ILE
0.2 M: water in 4/9 blocks, ref. undefined in 0.5% bootstrap
0.1 M: no water counts, PMF cannot be referenced
(d) MET
0.2 M: water in 6/9 blocks
0.1 M: water in 1/9 blocks, ref. undefined in 34.4% bootstrap
(e) PHE
0.2 M: water in 7/9 blocks
0.1 M: water in 4/9 blocks, ref. undefined in 2.6% bootstrap
(f) TRP
0.2 M: water in 9/9 blocks
0.1 M: water in 7/9 blocks, ref. undefined in 0.1% bootstrap
(g) TYR0
0.2 M: water in 9/9 blocks
0.1 M: water in 3/9 blocks, ref. undefined in 2.8% bootstrap
US: 3 x 50 ns blocks
(h) ARG0
0.2 M: water in 9/9 blocks
0.1 M: water in 9/9 blocks
PMF (kJ/mol)
|z| (Å)
MD 0.2 M: pooled counts
MD 0.1 M: pooled counts
Umbrella sampling