



অসম শক্তি বিতৰণ কোম্পানী লিমিটেড
ASSAM POWER DISTRIBUTION COMPANY LIMITED
 [CIN / চিআইন- U40109AS2003SGC007242]

No : CGM(PP&D)/APDCL/GTPA/PART-22/2025-26/ **4626**

Dated : **02/06/26**

To,

Chief General Manager (LAR)
5th Floor, Bijulee Bhawan
Paltan bazar, Guwahati-1.

Sub: Approval of GTP

Ref: i) Letter No, CGM(D&S)/APDCL/LAR/Bongaigaon Medical College/2025-26/48, Dated:26.05.26

Sir,

With reference to the subject cited above, it is to inform you that the GTP along with drawings submitted from your end vide under Ref: i) have been scrutinized by the technical team of the office of the undersigned and the following items are hereby approved subject to full compliance to the highlighted corrections and recommendations. Details of materials:

Sl No.	Item Description	Manufacture
1	Mid Span Joint/Tension Joint for 33KV MVCC	M/S Masters Electricals (Joint mask), Howrah
2	Termination Kit for 33KV MVCC	
3	Anchor/Dead End Clamp for 33KV MVCC	
4	Helical Ties	
5	End Termination for 11KV XLPE Cable	
6	End Termination for 33KV XLPE Cable	M/S Jainco Power Ltd. Howrah, W.B.
7	ACSR Rabbit Conductor	

Moreover, you are also requested to ensure that the approved item supplied strictly comply with the approved GTP & highlighted corrections/recommendations. All factory acceptance tests shall be conducted upon the item. The date of manufacture of the said item shall be later than the date of issue of this letter.

This is for favour of your kind information and necessary action.

Yours sincerely

Chief General Manager (PP&D)



ASSAM POWER DISTRIBUTION COMPANY LIMITED.

OFFICE OF THE CHIEF GENERAL MANAGER (D),

(LOWER ASSAM REGION)

CIN: U40109AS2003SGC007242

No. CGM (D&S)/APDCL/LAR/Bongaigaon Medical College/2025-26/ 48

Date: 26/05/24

To,

The Chief General Manager (PP&D),
APDCL, Bijulee Bhawan, 7
Paltan Bazar, Guwahati-1.

dyg, P&D

ACM (Tel)
/ DM (Tel)

Sub: Forwarding of GTP & Drawing

Ref: 1. Letter received from M/s U.K. Enterprise, R.P.Road, Dispur, vide No. UKE/BMC/2026-27/72 dated: 21.05.2026.
2. Letter received from M/s U.K. Enterprise, R.P.Road, Dispur, vide No. UKE/BMC/2026-27/76 dated: 23.05.2026.

Sir,

With reference to the above subject, enclosed please find herewith a two (2) letter's received from M/s U.K. Enterprise, R.P.Road, Dispur regarding submission of GTP and drawings of following materials for the work Construction of 33KV Dedicated Medical College Feeder from 132KV/33KV Dhaligaon GSS to the premises of Bongaigaon Medical College, Majgaon and associated works under Bongaigaon-ESD-I against LoA issued vide No. CGM(D&S)/APDCL/LAR/ Bongaigaon Medical College /2025-2026/38 dated: 13.05.2025 for your information and necessary action.

Details are as follows :-

A)

Sl. No.	Description of item	Vendor Details
1	MID Span Joint/Tension Joint for 33KV MVCC	M/s Master Electricals (Jointmask), Ganesh Complex, NH-6, Howrah-711322
2	Termination Kit for 33KV MVCC	
3	Anchor/Deadend Clamp for 33KV MVCC	
4	Helical Ties	
5	End Termination for 11KV XLPE Cable	
6	End Termination for 33KV XLPE Cable	

B)

Sl. No.	Description of item	Vendor Details
1	ACSR Rabbit Conductor	M/s Jainco Transmission Ltd., 70 Diamond harbour Rd, Kolkata

Encl:- As Above.

Yours faithfully

Chief General Manager (D&S)
APDCL, LAR





M/S. U.K. ENTERPRISE

Govt. Approved (Class I) Contractor ,

Deals with all Electrical, Civil works & Consultant

UDYAM REGISTRATION NO. UDYAM-AS-03-0005077

Dr. R.P. Road, Dispur, Guwahati-781006, Ph.98643-46349,90853-90161 Email: babuitalukdar@gmail.com

No. UKE/ BMC/2026-27/72

Date :21.05.2026

To
The Chief General Manager(D&S)
APDCL (LAR), Bijullee Bhawan,
Paltan Bazar, Guwahati -1

Sub:- Approval of GTP and Drawing

Ref:- 1. LOA No. CGM(D&S)/APDCL/LAR/Bongaigaon Medical College /2025-26/38
Dt. 13.05.2026

Sir,


With reference to the above , we have the honour to forward herewith the GTP and Drawing of the following materials for favour of according necessary approval from your end .
The details are as follows :-

Sl. No.	Item description	Name & Address of Manufacturer	Remarks
1	MID Span Joint/Tension Joint For 33kV MVCC	M/s. Master Electricals (Jointmask) Ganesh Complex, NH-6, Howrah-711322 (W.B)	
2	Termination KIT For 33kV MVCC		
3	Anchor / Deadend Clamp for 33kV MVCC		
4	Helical Ties		
5	End Termination for 11kV XLPE Cable		
6	End Termination for 33kV XLPE Cable		

The above materials will be utilised for Construction of 33kV Dedicated Medical College Feeder from 132/33kV Dhaligaon GSS to the premises of the Bongaigaon Medical College, Majgaon and associated work under Bongaigaon ESD-I under Deposit Work Scheme

Thanking you in anticipation and assuring our best service in future .

Enclo. : As above

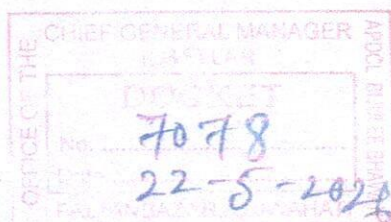

GUARANTEED TECHNICAL PARTICULARS (GTP) OF HEAT SHRINKABLE TYPE MID SPAN JOINT / TENSION JOINT FOR 1 CORE 241SQMM. 33KV MEDIUM VOLTAGE COVERED CONDUCTOR AAAC

Owner Name Of :	ASSAM POWER DISTRIBUTION COMPANY LIMITED
Name of the Work :	BONGAIGOAN MEDICAL COLLEGE
Name of Contractor :	M/s. U.K.Enterprise, Dispur, Guwahati,
LOA NO. & Date:	CGM (D&S)/APDCL /LAR/ Bongaigaon Medical college/2025-26/ 38 Date: 13.05.2026
Manufacturer & Address :	Jointmask® M/s - MASTER ELECTRICALS, GANESH COMPLEX, NH-6, RAGHUDEVPUR, HOWRAH - 711322, W.B.


SL NO.	PARTICULARS	BIDDER'S OFFER
1	Name of the Manufacturer	M/s - MASTER ELECTRICALS GANESH COMPLEX, NH-6, RAGHUDEVPUR, HOWRAH - 711322, W.B.
2	APPLICABLE STANDARD	: EN-50397-2
3	RATED VOLTAGE OF CABLE ACCESSORIES	: 33kV
4	MAX OPERATING VOLTAGE OF CABLE ACCESSORIES	: 36kV
5	AC HIGH VOLTAGE WITHSTAND	: 33KV AC FOR 1MIN
6	TYPE OF TUBING/S MOLDED PARTS	: Heat Shrink Type
7	MATERIALS TRACKING MATERIAL - TERMINATION ONLY	: Cross linked Polyolefin
8	TYPE OF FERRULE	: Full tension crimping type as per DIN spec.
9	TYPE OF LUG	: Crimping type as per DIN spec.
10	OUTER SHEATH REPLACEMENT (In case of joint)	: Heat Shrink Type insulating material Polyolefin Cross Linked Through radiation
11	DI-ELECTRIC STRENGTH AS PER ESI-09-13 a.) Insulating tubing b.) Anti-tracking tubing	: $\geq 10kV$ per mm : $\geq 10kV$ per mm
12	TENSILE STRENGTH AS PER ESI-09-13 a.) Insulating tubing b.) Anti-tracking tubing	: 10 N/mm ² (Minimum) : 8 N/mm ² (Minimum)
13	ULTIMATE ELONGATION AS PER ESI-09-13 a.) Insulating tubing b.) Anti-tracking tubing	: $\geq 200\%$: $\geq 200\%$
14	IS ANY METALLIC PART CARRYING POTENTIAL IN OPERATION EXPOSED DURING INSTALLATION	NO
15	INSTALLATION	CRIMPING BY HEXAGONAL COMPRESSION
16	PHASE CONDUCTOR DIA	95 - 241 Sq.mm /as per covered conductor size - 241Sq.mm.
17	CONNECTION BY COMPRESSION PRASSURE	YES
18	MATERIAL	AL. ALLOY FOR MECHANICAL CONNECTOR/FERRUL, UV RESISTANCE POLYMER FOR HEAT SHRINKABLE TYPE SHRINK SLEEVE
19	MARKING	Jointmask JMSCC - 241 APDCL

* All tests certificates to be submitted along with supply.

DRAWING OF HEAT SHRINKABLE TYPE MID SPAN JOINT FOR SINGLE CORE
241SQMM. 33KV MEDIUM VOLTAGE COVERED CONDUCTOR




MODEL NO: JMSSC-241

Jointmask®

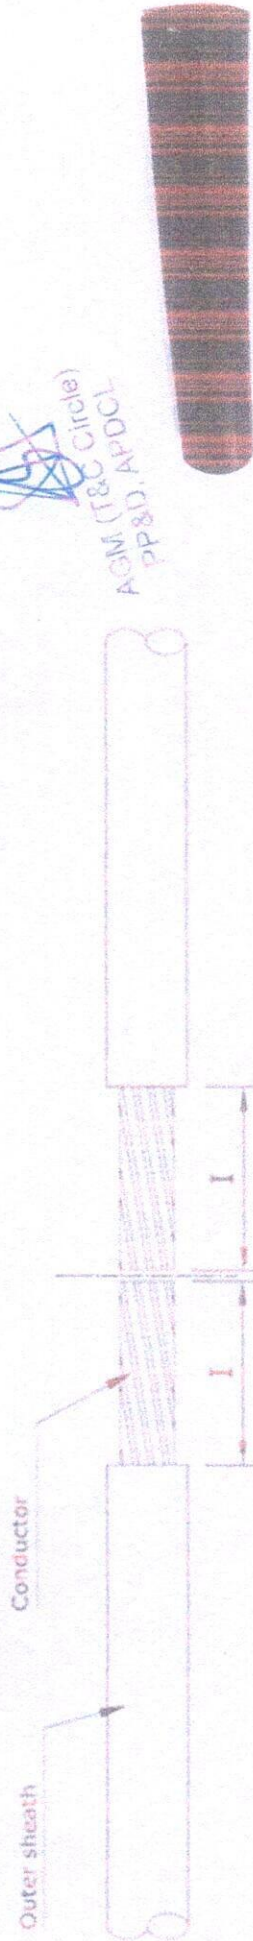

H.S. OUTER SLEEVE

H.S. INSULATING SLEEVE

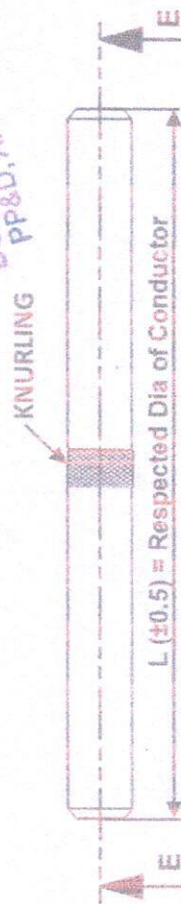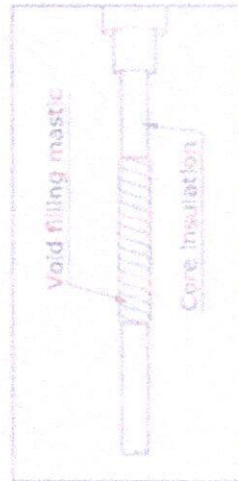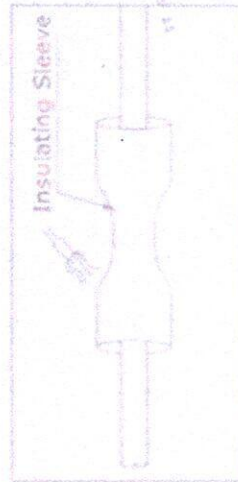

MARKING: Jointmask
JMSSC - 241
APDCL



DM (T&C Circle)
PP&D, APDCL

Owner Name Of:	ASSAM POWER DISTRIBUTION COMPANY LIMITED
Name of the Work:	BONGAIGAON MEDICAL COLLEGE
Name of Contractor:	M/s. U.K. Enterprise, Dispur, Guwahati,
LOA NO. & Date:	CGM (D&S) /APDCL /LAR/ Bongaigaon Medical college/2025-26/ 38 Date: 13.05.2026
Manufacturer & Address:	Jointmask® M/s - MASTER ELECTRICALS, GANESH COMPLEX, NH-6, RAGHUDEVPUR, HOWRAH - 711322, W.B.

UNLESS OTHERWISE SPECIFIED: DIMENSIONS ARE IN MILLIMETERS SURFACE FINISH TOLERANCES: LINEAR: ANGULAR:	FINISH:	DEBURR AND BREAK SHARP EDGES	MASTER ELECTRICALS HOWRAH - 711322 TRADE MARK: Jointmask
NAME	SIGNATURE	DATE	TITLE: HEAT SHRINKABLE TYPE STRAIGHT THROUGH / MIDSPAN JOINT FOR 33KV 50-241sq mm. Overhead Medium Voltage Covered Conductor
DRAWN			DWG NO. ME/JMSSC/33KV/50-241
CHECKED			DO NOT SCALE DRAWING
APPROVED			SCALE: REVISION: SHEET 1 OF 1
INCH			A4

**GUARANTEED TECHNICAL PARTICULARS (GTP) OF TERMINATION KIT FOR 33 KV SINGLE CORE
241MM SQ AAC COVERED CONDUCTOR**

Owner Name Of :	ASSAM POWER DISTRIBUTION COMPANY LIMITED
Name of the Work :	BONGAIGOAN MEDICAL COLLEGE
Name of Contractor:	M/s. U.K.Enterprise, Dispur, Guwahati,
LOA NO. & Date:	CGM (D&S) /APDCL /LAR/ Bongaigaon Medical college/2025-26/ 38 Date: 13.05.2026
Manufacturer & Address :	Jointmask® M/s - MASTER ELECTRICALS, GANESH COMPLEX, NH-6, RAGHUDEVPUR, HOWRAH - 711322, W.B.

SL NO.	PARTICULARS	BIDDER'S OFFER
1	NAME OF THE MANUFACTURER	M/s - MASTER ELECTRICALS GANESH COMPLEX, NH-6, RAGHUDEVPUR, HOWRAH - 711322, W.B.
2	APPLICABLE STANDARD	IS: 13573-2011 (Latest amendment)
3	TYPE OF CABLE JOINTING KIT	HEAT SHRINKABLE TERMINATION KIT
4	NOMINAL SYSTEM VOLTAGE (KV)	30 KV
5	MAXIMUM SYSTEM VOLTAGE (KV)	36KV
6	NO. OF MAIN CORE	1 CORE
7	NO. OF BRANCH CORE	NA
8	MAXIMUM PERFORMANCE	AS PER SPECIFICATION
9	SIZE	241Sq.mm.
10	TYPE OF INSULATION	XLPE
11	TYPE OF SCREENING	NA
12	A.C. VOLTAGE WITHSTAND (DRY)	33KV FOR 1 MINUTE
13	THERMAL SHORT CIRCUIT	AS PER CABLE CROSS SECTION AND MATERIAL CONDUCTOR.
14	IS ANY METALLIC PART CARRYING POTENTIAL IN OPERATION EXPOSED DURING INSTALLATION	NO
15	INSTALLATION	
16	CONNECTION BY COMPRESSION PRASSURE	CRIMPING BY HEXAGONAL COMPRESSION
17	MATERIAL	YES
		AL. ALLOY FOR MECHANICAL CONNECTOR/FERRUL, UV RESISTANCE POLYMER FOR HEAT SHRINK
18	GENERAL TOLERANCE	SLEEVE
19	MARKING	±5%
		Jointmask

All tests certificates to be submitted along with supply.


4m
DM (T&C Circle)
PP&D, APDCL




*AGM (T&C Circle)
PP&D, APDCL*



DRAWING OF TERMINATION KIT FOR 33 KV SINGLE CORE 241MM SQ
AAAC COVERED CONDUCTOR

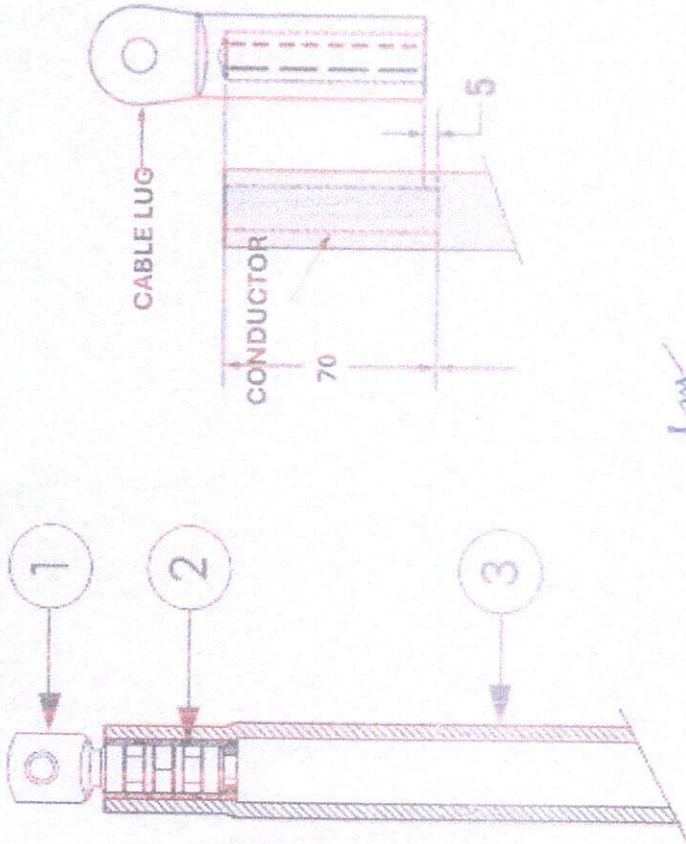

Cable Preparation:

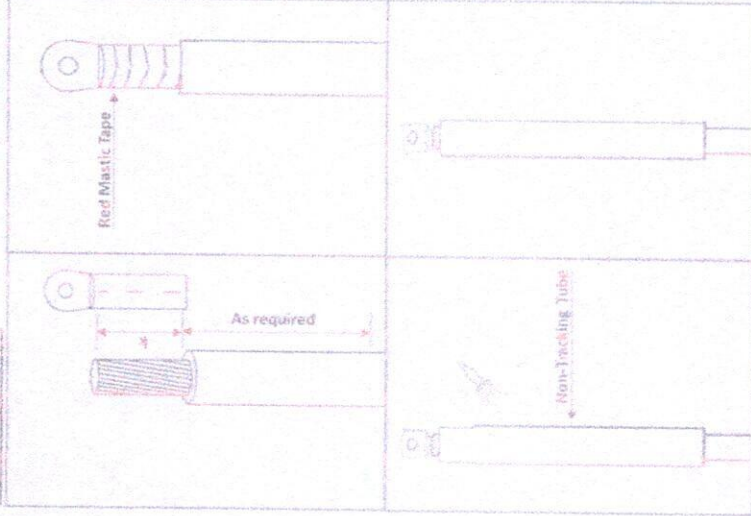

BILL OF MATERIAL		
REP	DESCRIPTION	QTY
1	AL. CABLE LUG	01
2	RED MASTIC TAPE	01
3	HEAT SHRINKABLE SLEEVE	01

"APPROVED"

DM (T&C Circle)
PP&D, APDCL



AGM (T&C Circle)
PP&D, APDCL

Owner Name Of	ASSAM POWER DISTRIBUTION COMPANY LIMITED
Name of the Work :	BONGAIGOAN MEDICAL COLLEGE
Name of Contractor:	M/s. U.K.Enterprise, Dispur, Guwahati,
LOA NO. & Date:	CGM (D&S) /APDCL /LAR/ Bongaigaon Medical college/2025-26/ 38 Date: 13.05.2026
Manufacturer & Address :	M/s - MASTER ELECTRICALS, GANESH COMPLEX, NH-6, RAGHUDEVPUR, HOWRAH - 711322, W.B.

UNLESS OTHERWISE SPECIFIED: DIMENSIONS ARE IN MILLIMETERS SURFACE FINISH: TOLERANCES: LINEAR: ANGULAR:		FINISH:	DEBUR AND BREAK SHARP EDGES	TRADE MARK:	
NAME	SIGNATURE	DATE		MASTER ELECTRICALS HOWRAH - 711322	
DRAWN				Jointmask	
CHK'D				TERMINATION KIT FOR 33KV 1 CORE INSULATED Covered Conductor	
APP'D				DWG NO. ME/33KV/TK-120-241	
MFG				DO NOT SCALE DRAWING	
G.A				SCALE: REVISION: A4 SHEET 1 OF 1	

**GUARANTEED TECHNICAL PARTICULARS (GTP) OF ANCHOR/DEADEND CLAMP FOR MVCC CABLE FOR
33KV 241SQMM (DEC MVCC 21-30)**

Owner Name Of:	ASSAM POWER DISTRIBUTION COMPANY LIMITED
Name of the Work:	BONGAIGOAN MEDICAL COLLEGE
Name of Contractor:	M/s. U.K.Enterprise, Dispur, Guwahati,
LOA NO. & Date:	CGM (D&S)/APDCL /LAR/ Bongaigaon Medical college/2025-26/ 38 Date: 13.05.2026
Manufacturer & Address:	Jointmask® M/s - MASTER ELECTRICALS, GANESH COMPLEX, NH-6, RAGHUDEVPUR, HOWRAH - 711322, W.B.

SL NO.	PARTICULARS	BIDDER'S OFFER
1	Name of the Manufacturer	M/s - MASTER ELECTRICALS GANESH COMPLEX, NH-6, RAGHUDEVPUR, HOWRAH - 711322, W.B.
2	Application Standard	EN 50397-2
3	Range of Conductor Size	120 - 241Sq.mm/as per covered conductor size - 241Sq.mm.
4	Installation (With/Without Disassembly)	Without Disassembly (Ready to Use)
5	Type & Grade Metallic / Non-Metallic material	Heat Treated Al.Alloy for Body, UV Resistant Thermoplastic for Wedge, Stainless Steel for Bail
6	Type of Design	Wedge Type
7	Colour of Non-Metallic Parts	Black
8	Application	33kV
9	Dimension	As per GA Drawing
10	Tolerance	±5%
11	Marking on Connector	Jointmask DEC MVCC 21-30

All tests certificates to be submitted along with supply.




Signature: [Signature]
DGM (T&C Circle)
PP&D, APDCL


Signature: [Signature]
DGM (T&C Circle)
PP&D, APDCL



DRAWING FOR ANCHOR DEAD END CLAMP FOR MVCC CABLE 33KV 120-241SQMM
MODEL No: DEC MVCC 21-30 (120SQMM)

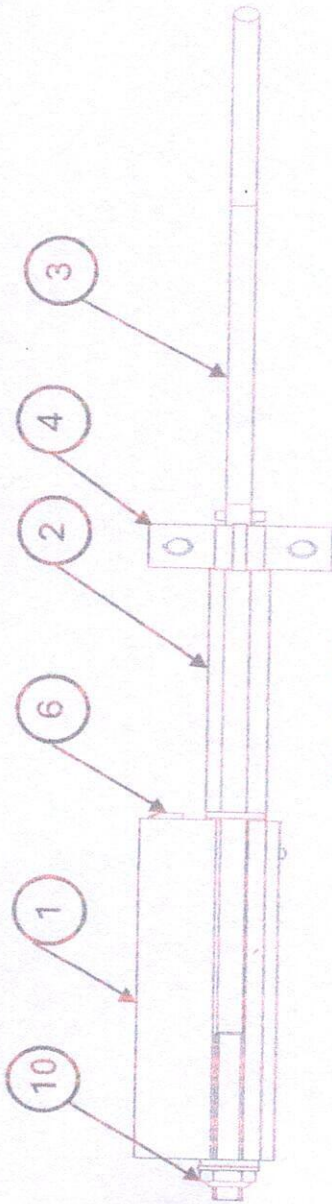

SIDE VIEW

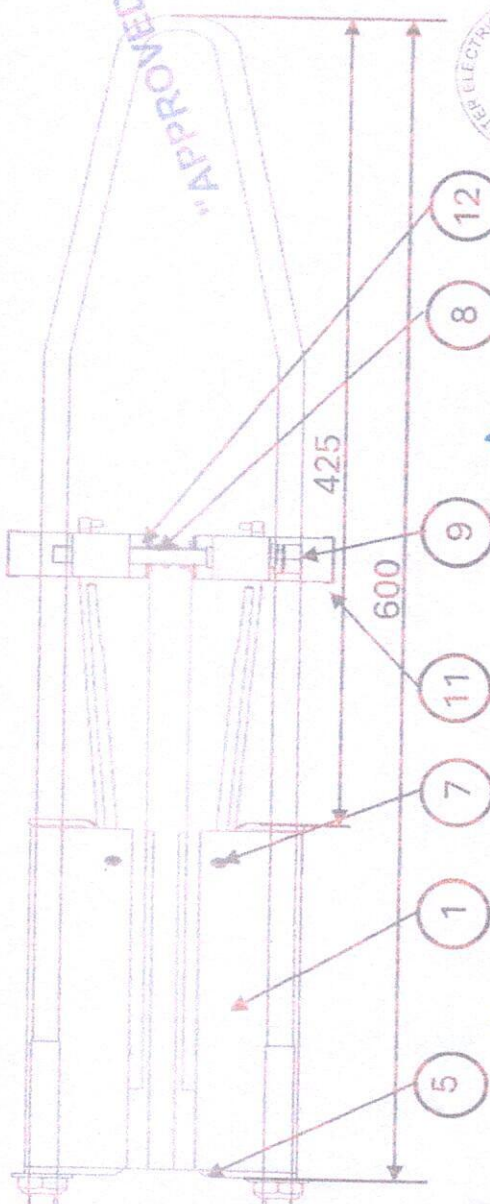

TOP VIEW

APPROVED



M/s U.K. Enterprise,
Dispur, Guwahati,
APDCL

Owner Name Of :	ASSAM POWER DISTRIBUTION COMPANY LIMITED
Name of the Work :	BONGAIGOAN MEDICAL COLLEGE
Name of Contractor :	M/s. U.K. Enterprise, Dispur, Guwahati,
LOA NO. & Date:	CGM (D&S)/APDCL /LAR/ Bongaigaon Medical college/2025-26/ 38 Date: 13.05.2026
Manufacturer & Address :	M/s - MASTER ELECTRICALS, GANESH COMPLEX, NH-6, RAGHUDEVPUR, HOWRAH - 711322, W.B.

TECHNICAL DATA			
SL NO.	DESCRIPTION	MATERIAL	QTY
1	ALUMINIUM BODY	AL. ALLOY	1NO
2	WEDGE	THERMOPLASTIC	2 NOS
3	BAIL	STAINLESS STEEL	1NO
4	IPC		01SET
5	BAIL HOLDER PLATE	AL. ALLOY	02NOS
6	WEDGE SUPPORT	THERMOPLASTIC	02NOS
7	WEDGE GUIDE SCREW	SS	02NOS
8	SPRING	STEEL	01NO
9	M10 BOLT	GALVANIZED STEEL	02NOS
10	LOCK NUT	SS	02NOS
11	STRIPNER PLATE	SS	02NOS
12	TEETH COVER	ENGINEERING RUBBER	02NOS
13	RANGE :- Ø21mm - Ø30mm MVCC CABLE (120-241SQMM)		
14	SPECIFICATION :- EN 50397-2		



M/s U.K. Enterprise,
Dispur, Guwahati,
APDCL

UNLESS OTHERWISE SPECIFIED: DIMENSIONS ARE IN MILLIMETERS SURFACE FINISH: TOLERANCES: ±5% LINEAR: ANGULAR:		THICKNESS	DEBUR AND BREAK SHARP EDGES	MASTER ELECTRICALS HOWRAH - 711322	
NAME	SIGNATURE	DATE		TRADE MARK :	Jointmask
DRAWN				FILE :	TENSION CLAMP 120-241SQMM MVCC
CHECKED				DWG NO.	ME/JDEC/MVCC/21-30
APPROVED					
DATE					
SCALE	DO NOT SCALE DRAWING	REVISION:	WEIGHT:		
Q.A	A4				
					SHEET 1 OF 1

GUARANTEED TECHNICAL PARTICULARS (GTP) OF NON METALLIC HELICAL TIES FOR 33kV & 36kV

(JCT-241)

Owner Name Of :	ASSAM POWER DISTRIBUTION COMPANY LIMITED
Name of the Work :	BONGAIGOAN MEDICAL COLLEGE
Name of Contractor :	M/s. U.K.Enterprise, Dispur, Guwahati,
LOA NO. & Date:	CGM (D&S)/APDCL /LAR/ Bongaigaon Medical college/2025-26/ 38 Date: 13.05.2026
Manufacturer & Address :	Jointmask® M/s - MASTER ELECTRICALS, GANESH COMPLEX, NH-6, RAGHDEVPUR, HOWRAH - 711322, W.B.

SL NO.	PARTICULARS	BIDDER'S OFFER
1	Name of the Manufacturer	M/s - MASTER ELECTRICALS GANESH COMPLEX, NH-6, RAGHDEVPUR, HOWRAH - 711322, W.B.
2	Application Standard	EN 50397-2
3	Range of Conductor size	50 Sq.mm to 241 Sq.mm /as per covered conductor size - 241 Sq.mm.
4	Range of Cable Diameter	Ø14mm - Ø29mm
5	Operating/Rated voltage/Application	For 33kV & 36kV Polymeric/Porcelain type Pin Insulator
6	Pin Insulator Neck Diameter	22±3mm(Polymer Insulator), 75±3mm(Porcelain Insulator)
7	Type & Grade Metallic / Non-Metallic material	UV Resistance Thermoplastic
8	Type of Tie	Non Metallic Helical Tie (Top Tie / Side Tie)
9	Mounting	Can mount directly on cable without any accessories
10	Dimension	As per GA Drawing
11	Tolerance	±5%
12	Marking on Connector	Jointmask JCT - 241

"APPROVED"

* All tests certificates to be submitted along with supply.

Lgla

DM (T&C Circle)
PP&D, APDCLAGM (T&C Circle)
PP&D, APDCLDGM (T&C Circle)
PP&D, APDCL


DRAWING OF NON METALLIC HELICAL TIES FOR 33KV/36KV FOR 50-241SQMM
MODEL No : JCT - 241

Jointmask®

NON METALLIC HELICAL SIDE TIES

Ø Insulator Groove

Colour Tape

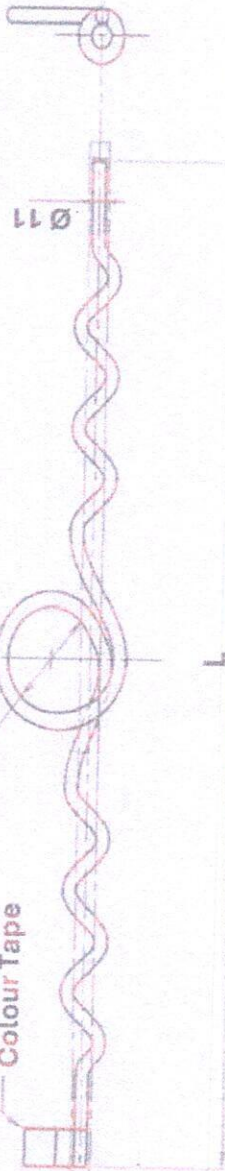


AGM (T&C Circle)
PP&D, APDCL

VOLTAGE RATING	TYPE OF TIES	COVERED CONDUCTOR		TIE ROD	
		SIZE (mm ²)	DIA (mm)	LENGTH (mm)	GROOVE DIA
33 kV & 36kV	SIDE	50 - 241	14.0-29.0	840-1000	54mm - 120mm

NON METALLIC HELICAL TOP TIES

Ø CONDUCTOR

GROOVE DIAMETER

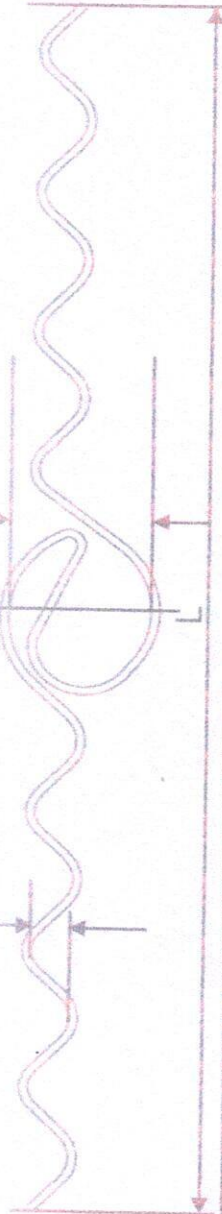

VOLTAGE RATING	TYPE OF TIES	COVERED CONDUCTOR		TIE ROD		POLYMER INSULATOR NECK DIA. (mm)
		SIZE (mm ²)	DIA (mm)	DIA (mm)	LENGTH (mm)	
33KV & 36KV	TOP	50 - 241	14.0 - 29.0	13.0 ± 2	900 ± 100	75 ± 3
						22 ± 3

AGM (T&C Circle)
PP&D, APDCL

APPROVED

DGM (T&C Circle)
PP&D, APDCL



Assam Power Distribution Company Limited

Bongaigaon Medical College

M/s. U.K. Enterprise, Dispur, Guwahati,

CGM (D&S)/APDCL /LAR/ Bongaigaon Medical college/2025-26/ 38

Date: 13.05.2026

Jointmask® M/s - MASTER ELECTRICALS, GANESH COMPLEX, NH-6,

RAGHUDEVPUR, HOWRAH - 711322, W.B.

MASTER ELECTRICALS
HOWRAH - 711322

TRADE MARK: Jointmask

HILL: CABLE TIE FOR 33KV, 36KV

DWG NO. ME/JCT - 33/50-241

DO NOT SCALE DRAWING

SCALE: A4

REVISION: SHEET OF 1

UNLESS OTHERWISE SPECIFIED: DIMENSIONS ARE IN MILLIMETERS SURFACE FINISH: TOLERANCES: ±5% ANGULAR:		FINISH:		DEBUR AND BREAK SHARP EDGES	
NAME	SIGNATURE	DATE			
DRAWN					
CHECKED					
APPROVED					
WFO					
G.A					

MATERIAL:

WEIGHT:

GUARANTEED TECHNICAL PARTICULARS (GTP) OF HEAT SHRINKABLE TYPE OUTDOOR END TERMINATION FOR 11KV (E) XLPE, SIZE - 1 X 35-630

Owner Name Of :	ASSAM POWER DISTRIBUTION COMPANY LIMITED
Name of the Work :	BONGAIGOAN MEDICAL COLLEGE
Name of Contractor:	M/s. U.K.Enterprise, Dispur, Guwahati,
LOA NO. & Date:	CGM (D&S)/APDCL /LAR/ Bongaigaon Medical college/2025-26/ 38 Date: 13.05.2026
Manufacturer & Address :	Jointmask® M/s - MASTER ELECTRICALS, GANESH COMPLEX, NH-6, RAGHUDEVPUR, HOWRAH - 711322, W.B.

SL NO.	PARTICULARS	BIDDER'S OFFER
1	Name of the Manufacturer	M/s - MASTER ELECTRICALS GANESH COMPLEX, NH-6, RAGHUDEVPUR, HOWRAH - 711322, W.B.
2	BRAND NAME	: JOINTMASK
3	APPLICABLE STANDARD	: IS: 13573-II-2011, IEC 60502-4
4	NOMINAL SYSTEM VOLTAGE (KV)	: 11KV
5	A.C. VOLTAGE WITHSTAND (DRY)	: 28.5KV FOR 5 MINUTES
6	A.C. VOLTAGE WITHSTAND (WET)	: 25.5KV FOR 1 MINUTE
7	LOAD CYCLE TEST • Temperature • Duration of heating after steady state temperature • Total duration of cycle • Duration of Cooling • Number of Cycles in Air • Continuous phase to ground Voltage Withstand	95-100°C 2 hours 8 hours 3 Hours 60 Cycles 16KV Less than 10pC @ 11KV 75KV/p 48KV for 30 MINUTES As per cable cross section and material of conductor. 2.5 x Is As per IS:13573-II-2011 10 Cycles (Additional test as per IEC 60502-2010) 1000 hrs. at 8KV Polyolefin based. High Permittivity. Indoor, Ambient Temperature (50°C Max.) Crimping / Mechanical For crimping type : same as cable conductor material For Mechanical type : Al. or Cu. Alloys according to connector manufacturers technology. 31 mm/kV min. 5 Years Yes
8	PARTIAL DISCHARGE	
9	IMPULSE VOLTAGE	
10	D.C. VOLTAGE WITHSTAND	
11	THERMAL SHORT CIRCUIT	
12	DYNAMIC SHORT CIRCUIT WITHSTAND	
13	LEAK TIGHTNESS	
14	SALT FOG TEST (Conductivity of salt solution = 1600mS/m.	
15	MATERIAL OF THE TUBING/MOULDED PARTS	
16	METHOD OF STRESS CONTROL	
17	ALLOWABLE KIT STORAGE TEMPERATURE	
18	TYPE OF LUG	
19	MATERIAL OF LUG	
20	CREEPAGE DISTANCE	
21	SHELF LIFE OF H.S. COMPONENTS	
22	Installation Instruction	



"APPROVED"

AGM (T&C Circle)
PP&D, APDCL



DRAWING OF HEAT SHRINKABLE OUTDOOR END TERMINATION FOR SINGLE CORE 35-630 sq. mm. 11KV(E) XLPE CABLE

Jointmask®

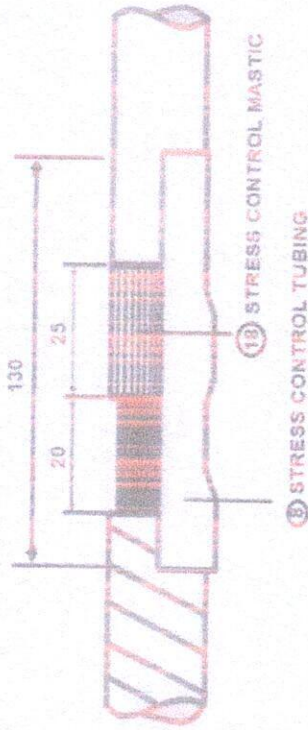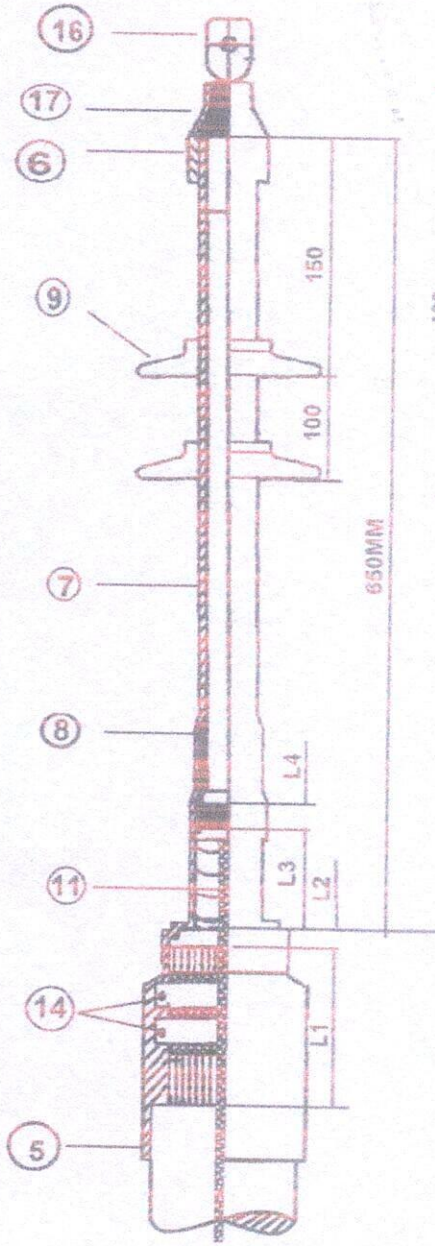

Cable Cutting Dimensions for 1 Core Cables				
Cable Size sq. mm	L1	L2	L3	L4
630-1000 sq. mm	65	10	150	20
300-500 sq. mm	65	10	150	20
120-240 sq. mm	65	10	150	20
16-95 sq. mm	50	10	150	20

L4	LENGTH OF SEMI CONDUCTING SCREEN OF CORE
L3	LENGTH OF METALLIC SHIELDING OF CORE
L2	LENGTH OF INNER SHEATH
L1	LENGTH OF ARMOUR



DM (T&C Circle)
PP&D, APDCL

AGM (T&C Circle)
PP&D, APDCL

DGM (T&C Circle)
PP&D, APDCL

Owner Name of:	ASSAM POWER DISTRIBUTION COMPANY LIMITED
Name of the Work :	BONGAIGOAN MEDICAL COLLEGE
Name of Contractor:	M/s. U.K. Enterprise, Dispur, Guwahati,
LOA NO. & Date:	CGM (D&S) /APDCL /LAR/ Bongaigaon Medical college/2025-26/ 38 Date: 13.05.2026
Manufacturer & Address :	Jointmask® M/s - MASTER ELECTRICALS, GANESH COMPLEX, NH-6, RAGHUDEVPUR, HOWRAH - 711322, W.B.

UNLESS OTHERWISE SPECIFIED: DIMENSIONS ARE IN MILLIMETERS		FINISH	DRAWER AND BREAK SHARP EDGES	TRADE MARK: Jointmask	
SURFACE FINISH: TOLERANCES: ±5%		SIGNATURE	DATE	TITLE: HEAT SHRINKABLE OUTDOOR TERMINATION FOR 11KV(E) 1 CORE 35-630 MM. XLPE CABLES	
ANGULAR:		NAME		DWG NO: ME/11KV/SOD	
ISAWIN				DO NOT SCALE DRAWING	
CHK'D				SCALE: REVISION: A4	
APPVD				SHEET 1 OF 1	
WFO					
G.A					

MASTER ELECTRICALS
HOWRAH - 711322


GUARANTEED TECHNICAL PARTICULARS (GTP) OF HEAT SHRINKABLE TYPE OUTDOOR END TERMINATION FOR 33KV (E) XLPE, SIZE - 1 X 35-630

Owner Name Of :	ASSAM POWER DISTRIBUTION COMPANY LIMITED
Name of the Work :	BONGAIGOAN MEDICAL COLLEGE
Name of Contractor:	M/s. U.K.Enterprise, Dispur, Guwahati,
LOA NO. & Date:	CGM (D&S) /APDCL /LAR/ Bongaigaon Medical college/2025-26/ 38 Date: 13.05.2026
Manufacturer & Address :	Jointmask® M/s - MASTER ELECTRICALS, GANESH COMPLEX, NH-6, RAGHUDEVPUR, HOWRAH - 711322, W.B.

SL NO.	PARTICULARS	BIDDER'S OFFER
1	Name of the Manufacturer	M/s - MASTER ELECTRICALS GANESH COMPLEX, NH-6, RAGHUDEVPUR, HOWRAH - 711322, W.B.
2	BRAND NAME	: JOINTMASK
3	APPLICABLE STANDARD	: IS: 13573-II-2011 (Latest Amendment)
4	NOMINAL SYSTEM VOLTAGE (kV)	: 33kV
5	A.C. VOLTAGE WITHSTAND (DRY)	: 85.5kV FOR 5 MINUTES
6	A.C. VOLTAGE WITHSTAND (WET)	: 76kV FOR 5 MINUTES
7	LOAD CYCLE TEST	
	• Temperature	: 95-100°C
	• Duration of heating after steady state temperature	: 2 hours
	• Total duration of cycle	: 8 hours
	• Duration of Cooling	: 3 Hours
	• Number of Cycles in Air	: 60 Cycles
	• Continuous phase to ground Voltage Withstand	: 50kV
8	PARTIAL DISCHARGE	: Less than 10pC @ 11kV
9	IMPULSE VOLTAGE	: 170kVp
10	D.C. VOLTAGE WITHSTAND	: 144kV for 5 MINUTES
11	THERMAL SHORT CIRCUIT	: As per cable cross section and material of conductor.
12	DYNAMIC SHORT CIRCUIT WITHSTAND	: 2.5 x As per IS:13573-II-2011
13	LEAK TIGHTNESS	: 10 Cycles (Additional test as per IEC 60502-2010)
14	SALT FOG TEST (Conductivity of salt solution = 1600mS/m.	: 1000 hrs. at 22.5kV
15	MATERIAL OF THE TUBING/MOULDED PARTS	: Polyolefin based.
16	METHOD OF STRESS CONTROL	: High Permittivity.
17	ALLOWABLE KIT STORAGE TEMPERATURE	: Indoor, Ambient Temperature (50°C Max.)
18	TYPE OF LUG	: Crimping / Mechanical
19	MATERIAL OF LUG	: For crimping type : same as cable conductor material For Mechanical type : Al. or Cu. Alloys according to connector manufacturers technology.
20	SHELF LIFE OF H.S. COMPONENTS	: 5 Years
21	Installation Instruction	: Yes

"APPROVED"


AGM (T&C Circle)
PP&D, APDCL





Ⓢ All tests certificates to be submitted along with supply.

DRAWING OF HEAT SHRINKABLE OUTDOOR END TERMINATION FOR SINGLE CORE 35-630 sq.mm. 33KV(E) XLPE CABLE

Jointmask®

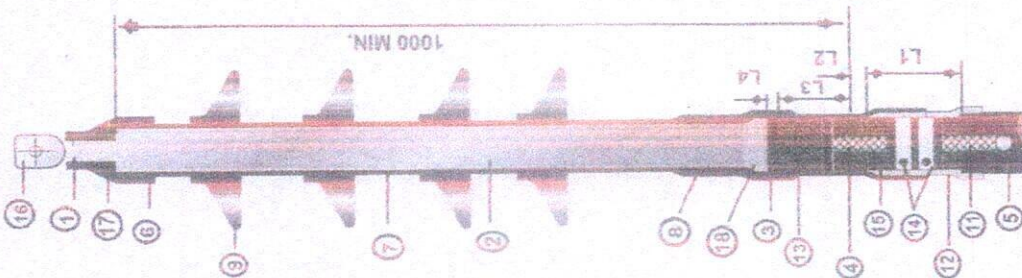

L4	LENGTH OF SEMI CONDUCTING SCREEN OF CORE
L3	LENGTH OF METALLIC SHIELDING OF CORE
L2	LENGTH OF INNER SHEATH
L1	LENGTH OF ARMOUR

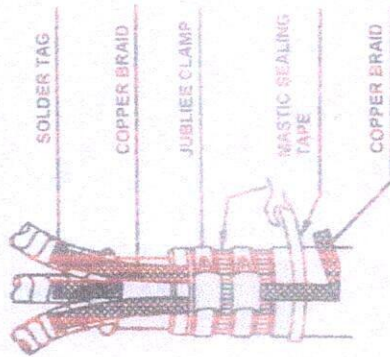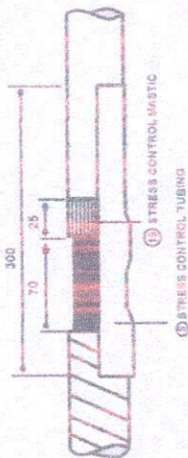

Cable Cutting Dimensions for 1 Core Cables				
Cable Size sq.mm	L1	L2	L3	L4
630-1000 sq.mm	65	10	175	70
300-500 sq.mm	65	10	175	70
120-240 sq.mm	65	10	175	70
16-95 sq.mm	50	10	175	70

"APPROVED"

DGM (T&C Circle)
PP&D, APDCL



DGM (T&C Circle)
PP&D, APDCL

DESCRIPTION
1. CONDUCTOR
2. INSULATION
3. SEMI CONDUCTING SCREEN
4. METAL SHIELD
5. OUTER SHEATH
6. TERMINAL SLEEVE
7. H.S ANTI TRACKING TUBING
8. H.S. STRESS CONTROL TUBING
9. RAIN SHED
11. TINNED COPPER EARTH BRAID
12. ARMOUR
13. INNER SHEATH
14. SS JUBILEE CLAMPS
15. MASTIC SEALING TAPE
16. COPPER TERMINAL LUGS
17. RED MASTIC TAPE
18. STRESS CONTROL MASTIC
19. SILICONE GREASE
20. ALOXITE EMERY TAPE
21. CLEANING TISSUE

MASTER ELECTRICALS HOWRAH - 711322
TRADE MARK: Jointmask
TITLE: HEAT SHRINKABLE OUTDOOR END TERMINATION FOR 33KV(E) 1 CORE 120-95mm XLPE CABLES
DWG NO. ME/33KV/SOUT
DO NOT SCALE DRAWING
SCALE
REVISION
A4
SHEET OF 1

DEBRIED AND BREAK SHARP EDGES
FRISID
UNLESS OTHERWISE SPECIFIED: DIMENSIONS ARE IN MILLIMETERS
SURFACE FINISH: TOLERANCES: ±5%
LINEAR: ANGULAR:
NAME: SIGNATURE: DATE:
DRAWN: CHECKED: APPVED: INSG: G.A.
MATERIAL:
WEIGHT:

Owner Name Of:	ASSAM POWER DISTRIBUTION COMPANY LIMITED
Name of the Work:	BONGAIGOAN MEDICAL COLLEGE
Name of Contractor:	M/s. U.K.Enterprise, Dispur, Guwahati,
LOA NO. & Date:	CGM (D&S)/APDCL /LAR/ Bongaigaon Medical college/2025-26/ 38 Date: 13.05.2026
Manufacturer & Address:	Jointmask® M/s - MASTER ELECTRICALS, GANESH COMPLEX, NH-6, RAGHUDEVPUR, HOWRAH - 711322, W.B.