



ASSAM POWER DISTRIBUTION COMPANY LIMITED.
OFFICE OF THE CHIEF GENERAL MANAGER (D),
(LOWER ASSAM REGION)
CIN: U40109AS2003SGC007242

No CGM (D&S)/APDCL/LAR/Bongaigaon Medical College/2025-26/ 52

Date: 04/06/2026

To,
The, CEO
Bongaigaon-EC,
APDCL, LAR, Bongaigaon

Sub: Approval of GTP and drawings.

Ref: 1. Letter received from CGM(PP&D) vide No. CGM(PP&D)/APDCL/GTP/Poles/PSC & STP/109 dated: 29/05/2026
2. Letter received from M/s U.K. Enterprise, R.P. Road, Dispur vide letter no. UKE/BMC/2026-27/69 dated: 20.05.2026.

With reference to the above subject, this is to inform you that GTP along with drawings of item mentioned below is hereby approved subject to the strict compliance to the highlighted corrections and recommendations of the GTP. All factory accepted tests shall be conducted upon the item and submitted along with supply and verified before installation. The date of manufacturing of the said item should be after the date of issue of this letter.

➔ GTP for the following items have been approved.

Sl. No.	Description of item	Vendor Details
1	GI Steel Tubular pole, SP-80	M/s BST Inratech Limited, 1, R.N.Mukherjee Road, North Block, 2 nd Floor, Kolkata-700001 (WB)
2	GI Steel Tubular pole, SP-76	
3	GI Steel Tubular pole, SP-66	

Following points are also to be followed in addition to all others criteria included in approved GTP and drawings as mentioned:

1. Minimum of 86 microns on average taken over 10 points across the length of the pole.
2. The weight of a single pole shouldn't be less than 90% of the specified weight. However, for bulk, the weight of the poles shouldn't be less than 92.5% of the calculated weight.
3. Galvanization of the pole is to be done only after the swaging process is completed.
4. Any evidence suggesting the galvanization before swaging or application of zinc spray paint on any of the poles shall result in outright rejection of the whole lot of poles.

N.B: It is to be noted that this approval is solely against the furnished GTP of the said material and shall not be treated as approval of vendor under APDCL.

Encl: - Approved GTPs.

Yours faithfully

Chief General Manager (D&S)
APDCL, LAR

Memo No CGM (D&S)/APDCL/LAR/Bongaigaon Medical College/2025-26/
Copy to:

1. The CGM(PP&D), APDCL, Bijulee Bhawan, Paltanbazar, Ghy-01 for your information.
2. M/s U.K. Enterprise, R.P.Road, Dispur for information and necessary action.
3. Relevant File

Chief General Manager (D&S)
APDCL, LAR

No CGM (D&S)/APDCL/LAR/Bongaigaon Medical College/2025-26/

Date:



ASSAM POWER DISTRIBUTION CO. LTD

PROJECT PLANNING & DESIGN

Office: Bijulee Bhawan, 6th floor, Paltan Bazar, Guwahati-781001;

Web site: www.apdcl.org E Mail: cgmppdapdcl@yahoo.com

CIN: U40109AS2003SGC007242 GSTIN: 18AABCL1354J1ZJ

No. CGM(PP&D)/APDCL/GTP/Poles/PSC & STP/109

Date: 29/5/2026

To,

✓ The Chief General Manager (D&S),
LAR, APDCL, 5th floor, Bijulee Bhawan,
Paltan Bazar, Guwahati-1

DM-II

29/5/2026

Sub : Approval of GTP and drawings.

Ref : Your letter no. CGM(D&S)/APDCL/LAR/Bongaigaon Medical College/2025-26/42 dated 25.05.2026

Sir,

With reference to the subject mentioned above, it is to inform you that the following GTP submitted from your end has been scrutinized by the technical team of the undersigned and hereby approved subject to full compliance to the highlighted corrections and recommendations. Details of materials are as under:

Sl No	Item Description	Manufacturer
1	GI Steel Tubular Pole, SP-66	M/s BST Infratech Limited, Kolkata, West Bengal
2	GI Steel Tubular Pole, SP-76	
3	GI Steel Tubular Pole, SP-80	

You are requested to ensure that the item supplied strictly complies with the approved GTP and highlighted corrections and recommendations. All factory acceptance tests shall be conducted upon the items and submitted along with supply and verified before installation.

Encl : As stated above.

Yours Faithfully

Chief General Manager (PP&D), APDCL
Bijulee Bhawan, 6th Floor, Paltan Bazar
Guwahati-01

Memo No. CGM(PP&D)/APDCL/GTP/Poles/PSC & STP/

Date:


Copy to:

1. The GM, Bongaigaon Zone, APDCL, UAR for information.
2. The CEO, Bongaigaon Electrical Circle, APDCL, LAR for information & needful.
3. The relevant office file.

Chief General Manager (PP&D), APDCL

AGM-I
for wa.
no mentioned
in the approval.

29/5/2026

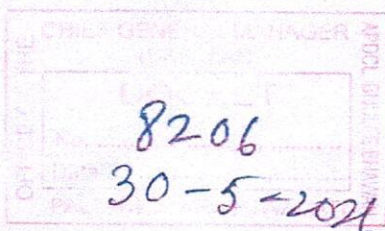

GUARANTEED TECHNICAL PARTICULARS OF 12M LONG SWAGED STEEL TUBULAR POLE 410-SP66(Galvanized):

SL. NO.	DESCRIPTION	UNIT	DETAILS
1	Name of Manufacturer		BST INFRATECH LIMITED
2	Governing Standards for tube		ERW Pipe as per IS 1161
3	Name of Tube/Pipe Manufacture		BST INFRATECH LIMITED
	Contractor		U.K. ENTERPRISE
	Client		ASSAM POWER DISTRIBUTION COMPANY LTD.
	Project		
4	Standard followed for Manufacturing & Testing		As per IS: 2713/1980
5	Designation of pole/Materials description		12M long 410-SP66 ✓
6	Overall Length	Mtr	12 ✓
7	Planting Depth	Mtr	2 ✓
8	Load applied from top at distance	Mtr	0.6 ✓
9	Height above ground	Mtr	10 ✓
	Length of section details :-		
10	a) Bottom section (h3)	Mtr	5.80 ✓
	b) Middle section (h2)	Mtr	3.10 ✓
	c) Top section (h1)	Mtr	3.10 ✓
	Out side diameter & thickness of section details :-		
11	a) Bottom section (h3)	mm	219.1x5.9 ✓
	b) Middle section (h2)	mm	193.7x4.85 ✓
	c) Top section (h1)	mm	165.1x4.5 ✓
	Swaged & Welded joint length :-		
12	a) Top with Middle (J1)	mm	400 ✓
	b) Middle with Bottom (J2)	mm	450 ✓
13	Approximate weight Pole	Kg	322 ✓
14	Breaking Load	Kgf	916 ✓
15	Crippling Load	Kgf	650 ✓
16	Load for permanent set test not exceeding 13 mm	Kgf	445 ✓
17	Load for temporary deflection of 157.5 mm	Kgf	169 ✓
18	Working load with factor of safety: 2.5 (in kgf/Col-14(2) & Col-13(2.5 as per IS:2713)	Kgf	325 & 366 ✓
19	Drop test		As per IS 2713/1980
20	Galvanization		Mass of zinc coating 460-610gms per sq mtr as per IS:4759 and HDG as per IS:2629 ✓
21	Tolerance		As per relevant IS:2713/1980 (Part I to III) with latest amendment ✓
22	Galvanized Baseplate and top cap		400x400x8mm and Canopy type Top Cap welded ✓
23	Earthing arrangement		As per relevant IS:2713/1980 (Part I to III) with latest amendment ✓
24	Marking on Pole		APDCL ✓

For BST INFRATECH LIMITED

* Minimum of 86 micron on average of 50 points across the length of the pole.

* The weight of a single pole shall not be less than 90% of the specified weight. However, for bulk, the weight of the poles shall not be less than 92.5% of the calculated weight.

M.S. Pipe | G.I. Pipe | Steel Tubular Poles | Transmission Towers | TMT Bars | Wire Rods | M.S. & G.I. Wires | M. S. Angle, Channel, Joist

Project Office : BST Infratech Limited, 3/219, Vivek Khand, Gomti Nagar, Lucknow. U.P.-226010

BST Infratech Limited, 99A, Sharda Mandir Road, Sainik Society, Shakti Nagar, Jabalpur, M.P.-482001

Registered Office:

Martin Burn House, 1, R. N. Mukherjee Road,
North Block, 2nd Floor, Room No. 231 & 232
Kolkata - 700 001, West Bengal, India
Phone : (033) 2262 3914/15, Fax : (033) 2262 3915

Corporate Office:

20B, British India Street
9th Floor, Kolkata - 700 069
Phone : (033) 2262 8471/72
(033) 4065 9097

Works :

Jamuria Industrial Estate, Mondalpur,
Jamuria - 713336, Dist - Burdwan (W.B.), India
Phone : (0341) 2456 677 / 78, Fax : (0341) 2456 679
email : babastrips@gmail.com


AGM (T&C Circle)
PP&D, APDCL

DGM (T&C Circle)
PP&D, APDCL



We reserve all rights in this document and in the information contained there in reproduction, use or disclosure to third parties without express authority is strictly forbidden BSTL

DETAIL REFER C

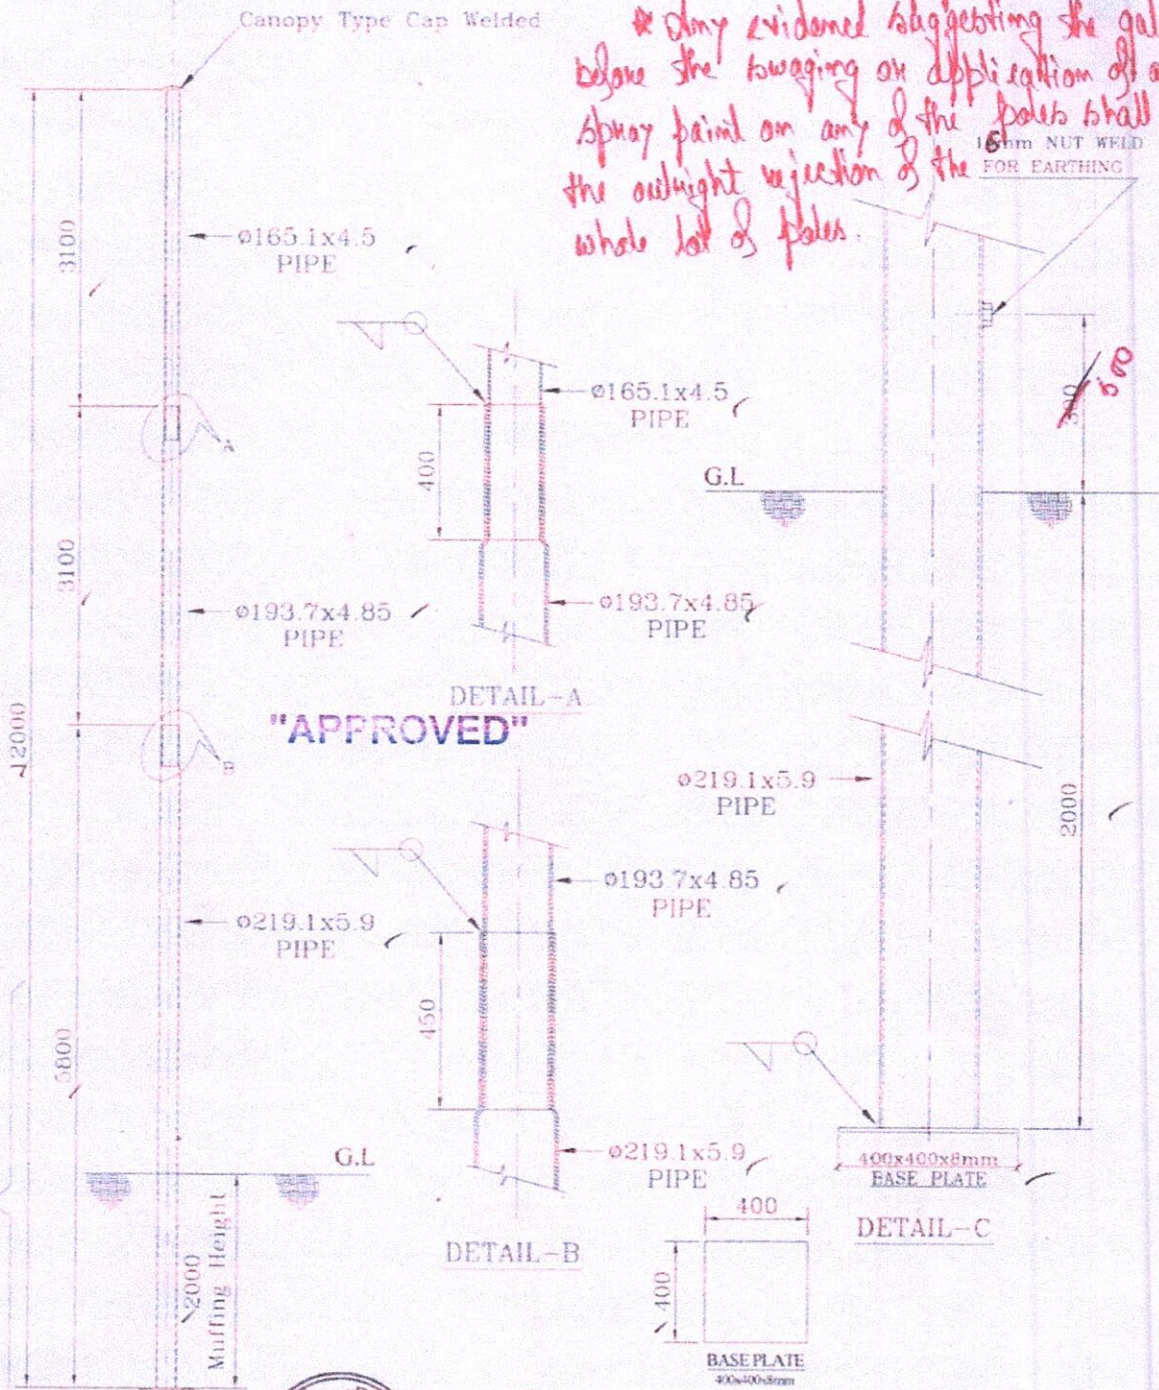

NOTE:


1. ALL DIMENSIONS ARE IN MM
2. POLE AS PER IS: 2713-1981
3. Mass of Zinc coating 460-610 gms per square Mtr. as per IS: 4759. First Dip Galvanized as per IS: 2629

NAME OF CLIENT	অসম পাৰি বিতৰণ কোম্পানী লিমিটেড ASSAM POWER DISTRIBUTION COMPANY LIMITED
CONTRACTOR	U. K. ENTERPRISE
MANUFACTURER	BSTL, BSTI INFRATECH LIMITED, (Kolkata, WB)
DRAWING TITLE	Galvanized Steel Tapered Pole Standard Type of 1.2 Mtr. Long 410-57-66 As per IS: 2713-1981
Drawing No.	BSTI/PPDCL/245/2020
SCALE	1:1
SIZE	A4
REV.	0
Drawn By	U. K. Enterprise
Checked By	J. K. Saha
Approved By	
Date	06/01/2021

DM (Civil)
PP&D, APDCL

AGM (T&C Circle)
PP&D, APDCL

DGM (T&C Circle)
PP&D, APDCL

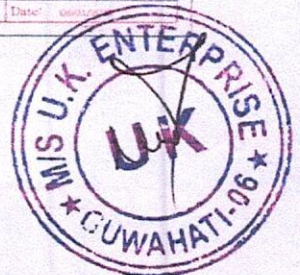

* Galvanisation of the pole is to be done on after the swaging process is completed.
* Any evidence suggesting the galvanisation before the swaging or application of any zinc spray paint on any of the poles shall result in the outright rejection of the whole lot of poles.

GUARANTEED TECHNICAL PARTICULARS OF 14.5M LONG SWAGED STEEL TUBULAR POLE 410-SP76(Galvanized):

SL. NO.	DESCRIPTION	UNIT	DETAILS
1	CONTRACTOR NAME		M/S. U.K. ENTERPRISE
2	Owner Name		ASSAM POWER DISTRIBUTION COMPANY LTD.
3	PROJECT NAME		
4	Name of Manufacturer		BST INFRATECH LIMITED
5	Place of Manufacturer		Jamuria Industrial Estate, PO-Mondalpur Jamuria-713336 Dist. Paschim Burdwan, West Bengal
6	Country of Origin		India
7	IS Standard Application		IS-2713/1980 (Part I to III) with latest amendment
8	Type of Pole		Swaged type
9	Total Length		14.5 Mtr long
10	"APPROVED"		
	Out side diameter & thickness of section details :-		
	a) Bottom section (h3)	mm	219.1x5.9
	b) Middle section (h2)	mm	193.7x4.85
	c) Top section (h1)	mm	165.1x4.5
11	Minimum Guaranteed weight of pole (without baseplate):	kg.	380kg.as per IS-2713/1980
12	Effective length of Section :		
	a) Bottom section (h3)	mtr	6.5
	b) Middle section (h2)	mtr	4
	c) Top section (h1)	mtr	4
13	Breaking Load	Kgf	724
14	Crippling Load	Kgf	514
15	Load for permanent set test not exceeding 13 mm	Kgf	352
16	Load for temporary deflection of 157.5 mm	Kgf	81
17	Working load with factory of safety-2.5 (in kgf)-Col-14(2) & Col-13(2.5 as per IS-2713)	Kgf	290
18	Galvanization - gm/sqm		Mass of zinc coating not less than 610gm/sqm (86 micron approx) IS-2619/1985 IS-2633/1986 & IS-4736/1986 with latest amendment
19	Baseplate		A mild steel baseplate of size 400x400mm welded at bottom of pole. 10
20	Finish/Manufacturing clause		As per relevant IS-2713/1980 (Part I to III) with latest amendment.
21	Remarks: 1) Tolerance for outside diameter, thickness, length, weight and straightness shall be in accordance with IS-2713/1980 (Part I to III) with latest amendment (2) The Pole shall be GALVANIZED and coated with black bituminous paint conforming to IS-158/1968 throughout internally & externally upto eleven which goes inside the earth. (3) Test shall be carried out before supply of each consignment at the manufacturer's works and test certificate should be submitted to the purchaser for approved prior to delivery.		

For BST INFRATECH LIMITED

* Minimum of 86 micron on average of 10 points across the length of the pole.

* The weight of a single pole shall not be less than 90% of the specified weight. However, for bulk, the weight of the poles shall not be less than 92.5% of the calculated weight.

Manufacturers of :

M.S. Pipe | G.I. Pipe | Steel Tubular Poles | Transmission Towers | TMT Bars | Wire Rods | W-Beam | M.S. & G.I. Wires | M. S. Angle, Channel, Joist

Registered Office:

Martin Burn House, 1, P. N. Mukherjee Road,
North Block, 2nd floor, Room No. 231 & 232
Kolkata - 700 001, West Bengal, India
Phone : (033) 2262 3914/15, Fax : (033) 2262 3915

Corporate Office:


20B, British India Street
4th Floor, Kolkata - 700 069
Phone : (033) 2262 8471/72
(033) 4065 9097

Works :

Jamuria Industrial Estate, Mondalpur,
Jamuria - 713336 Dist. Burdwan (W.B.), India
Phone : (0341) 2456 677 / 78, Fax : (0341) 2456 679
email : babastrips@gmail.com

AGM (T&C Circle)
PP&D, APDCL

AGM (T&C Circle)
PP&D, APDCL

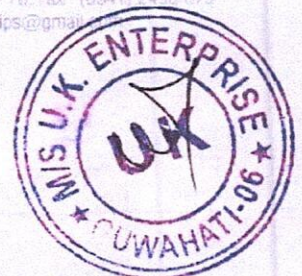


* Galvanisation of the pole is to done only after the swaging process is completed.

(canopy type) * Any evidence suggesting the application of zinc spray paint on galvanisation before the swaging process on any of the poles, & whole lot of poles shall be outright rejected.

We reserve all rights in this documents and in the information contained there in Reproduction, use or disclosure to third parties without express authority is strictly forbidden BSTL.

DETAIL REFER-C

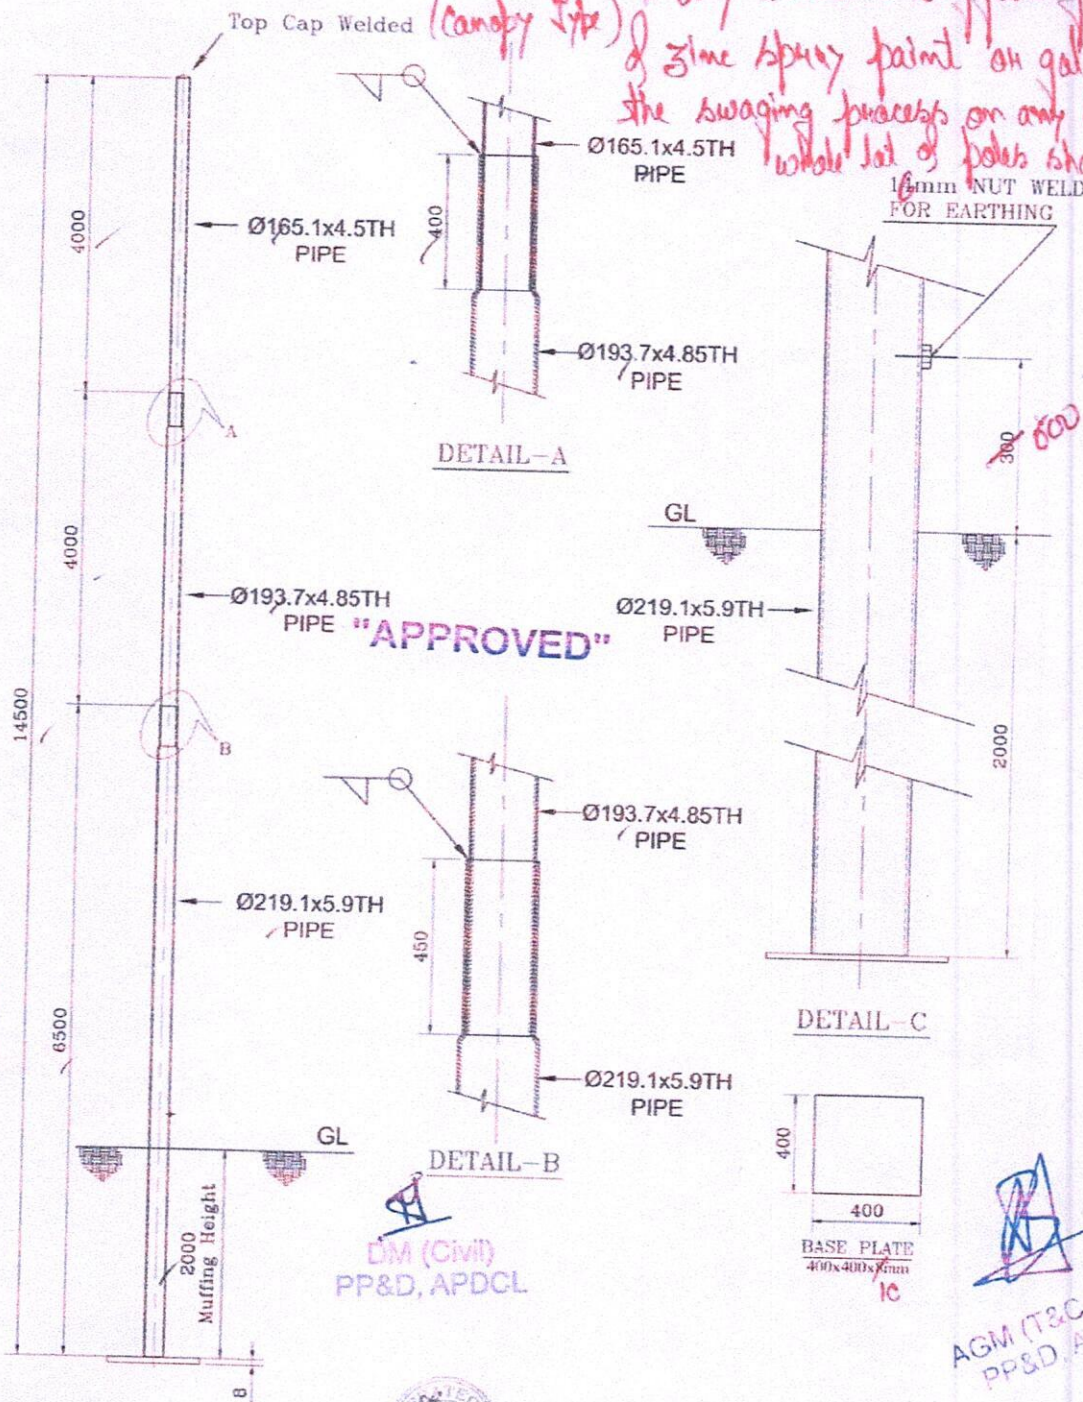

DM (Civil)
PP&D, APDCL


AGM (T&C Circle)
PP&D, APDCL

NOTE:-

1. ALL DIMENSIONS ARE IN MM.
2. PULSAS PER IS:2713-1990.
3. Rate of Zinc coating 460-610gms per square Mtr. as per IS:4759. Hot Dip Galvanised as per IS:2629.
4. The pole coated with Black Bituminous upto the plinth level from bottom as per IS:150-1968.

OWNER NAME	Arsam Power Distribution Company Limited (APDCL)
CONTRACTOR	M/S. U.K. ENTERPRISE
PROJECT	
TITLE	Galvanized Steel Tower Pole (Square Type) of 14.5Mtr. Long 400-130-26 As per IS:2713:1990
MANUFACTURER	IST INFRA TECH LIMITED, Guwahati, WB
DRAWING NO.	BSTL/ATGTSR/06-2401

DGM (T&C Circle)
PP&D, APDCL

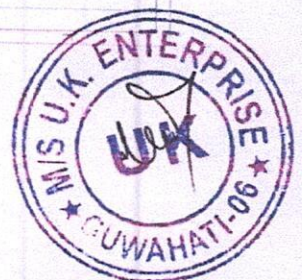

GUARANTEED TECHNICAL PARTICULARS OF 16M LONG SWAGED STEEL TUBULAR POLE 410-SP80(Galvanized):

SL. NO.	DESCRIPTION	UNIT	DETAILS
1	CONTRACTOR NAME		U.K ENTERPRISE
2	Owner Name		ASSAM POWER DISTRIBUTION COMPANY LTD.
3	PROJECT NAME		
4	Name of Manufacturer		BST INFRATECH LIMITED
5	Place of Manufacturer		Jamuria Industrial Estate, PO-Mondalpur Jamuria-712336, Dist Paschim Bardhaman, West Bengal
6	Country of Origin		India
7	IS Standard Application		IS 2713/1980 (Part I to III) with latest amendment
8	Type of Pole		Swaged type
9	Total Length		16 Mtr long
	Out side diameter & thickness of section details :-		
10	a) Bottom section (h3)	mm	219.1x5.9
	b) Middle section (h2)	mm	193.7x4.85
	c) Top section (h1)	mm	165.1x4.5
11	Minimum Guaranteed weight of pole (without baseplate):	kg.	416kg.as per IS.2713/1980
	Effective length of Section :		
12	a) Bottom section (h3)	mtr	7
	b) Middle section (h2)	mtr	4.5
	c) Top section (h1)	mtr	4.5
14	Breaking Load	Kgf	657
15	Crippling Load	Kgf	466
16	Load for permanent set test not exceeding 13 mm	Kgf	319
17	Load for temporary deflection of 157.5 mm	Kgf	60
18	Working load with factory of safety:-2.5(in kgf)-Col-14(2) & Col-13(2.5 as per IS.2713)	Kgf	263
20	Galvanization - gm/sqm		Mass of zinc coating not less than 610gm/sqm(86 micron approx)IS-2619/1985,IS-2633/1986 & IS-4736/1986 with latest amendment.
21	Baseplate		A mild steel baseplate of size 400x400mm welded at bottom of pole.
22	Finish/Manufacturing clause		As per relevant IS 2713/1980 (Part I to III) with latest amendment.
23	Remarks: 1) Tolerance for outside diameter, thickness, length, weight and straightness shall be in accordance with IS:2713/1980 (Part I to III) with latest amendment. (2) The Pole shall be GALVANIZED and coated with black bituminous paint conforming to IS:159/1968 throughout internally & externally upto seven inch goes inside the earth. (3) Test shall be carried out before supply of each consignment at the manufacturer's works and test certificate should be submitted to the purchaser for approved prior to delivery.		

For BST INFRATECH LIMITED

(*) Minimum of 86 microns on average of 10 points across the length of the pole.

* The weight of a single pole shall not be less than 90% of the specified weight. However, for bulk, the weight of the poles shall not be less than 92.5% of the calculated weight.

Manufacturers of :

M.S. Pipe | G.I. Pipe | Steel Tubular Poles | Transmission Towers | TMT Bars | Wire Rods | W-Beam | M.S. & G.I. Wires | M. S. Angle, Channel, Joist

Registered Office:

Martin Burn House, 1, R. N. Mukherjee Road,
North Block, 2nd Floor, Room No. 231 & 232
Kolkata - 700 001, West Bengal, India
Phone : (033) 2262 3914/15, Fax : (033) 2262 3916

Corporate Office:


208, British India Street
9th Floor, Kolkata - 700 009
Phone : (033) 2262 8471/72
(033) 4065 6037

Works :

Jamuria Industrial Estate, Mondalpur
Jamuria - 712336, Dist - Bardhaman (WB), India
Phone : (0341) 2456 677 / 78, Fax : (0341) 2456 679
Email : babastrips@gmail.com

AGM (T&C Circle)
PP&D, APDCL

DGM (T&C Circle)
PP&D, APDCL




* Galvanisation of the pole is to be done only after the swaging process is completed.

* Any evidence suggesting the galvanisation before the swaging process or application of any zinc spray paint on any of the poles shall result in outright rejection of the entire lot of poles.

We reserve all rights in this documents and in the information contained there in Reproduction, use or disclosure to third parties without express authority is strictly forbidden BSTL.

DETAIL, REFER - C

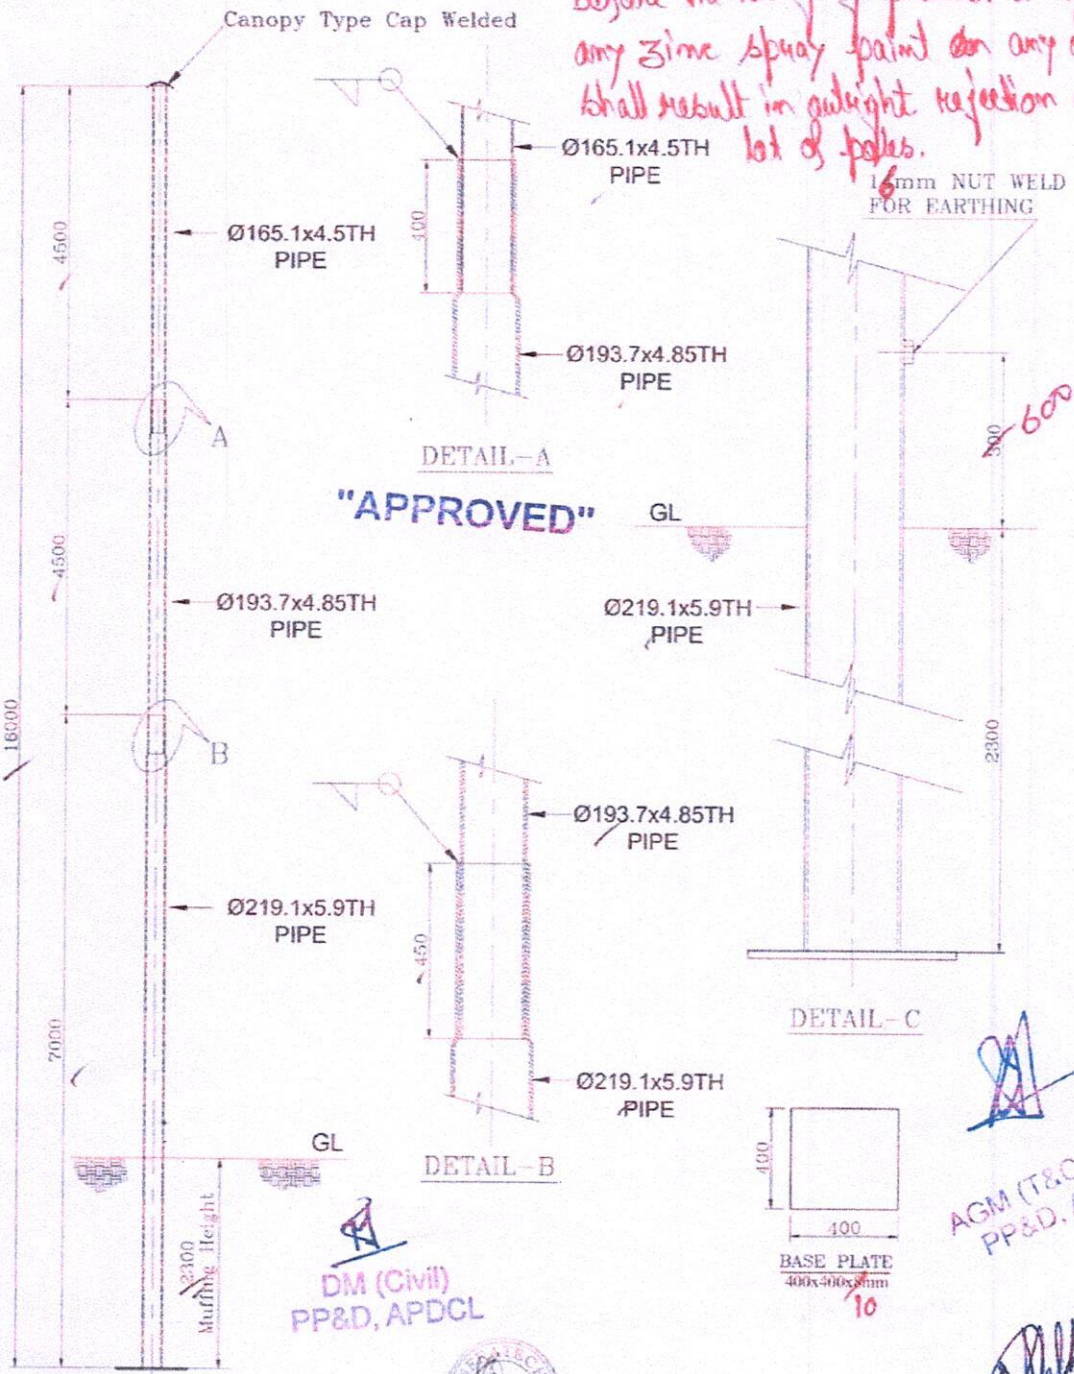

"APPROVED"

DM (Civil)
PP&D, APDCL

AGM (T&C Circle)
PP&D, APDCL

- NOTE:-**
1. ALL DIMENSIONS ARE IN MM.
 2. POLE AS PER IS 2713-1980.
 3. Mass of Zinc coating 960-610 gms per square Mtr. as per IS 4759, Hot Dip Galvanised as per IS 2624.
 4. The pole coated with Black Bitumastic upto the plinth level from bottom as per IS 138-1968.

OWNER NAME	Assam Power Distribution Company Limited (APDCL)
CONTRACTOR	M/S. U.K. ENTERPRISE
PROJECT	
TITLE	Galvanised Steel Tubular Pole (Swaged Type) of 1.6Mtr. Long 410-190 As per IS 2713/1980
MANUFACTURER	BST INFRA TECH LIMITED, (Kolkata, WB)
DRAWING NO.	BSTL/SPP/SPAD/00-24/01

