



ASSAM POWER DISTRIBUTION COMPANY LIMITED.
OFFICE OF THE CHIEF GENERAL MANAGER (D),
(LOWER ASSAM REGION)
CIN: U40109AS2003SGC007242

No CGM (D&S)/APDCL/LAR/Bongaigaon Medical College/2025-26/

Date: 04/06/2026

To,
 The, CEO
 Bongaigaon-EC,
 APDCL, LAR, Bongaigaon

Sub: **Approval of GTP and drawings.**

- Ref: 1. Letter received from CGM(PP&D) vide No. CGM(PP&D)/APDCL/GTPA/PART-22/2025-26/4624 dated: 02/06/2026.
 2. Letter received from M/s U.K. Enterprise, R.P. Road, Dispur vide letter no. UKE/BMC/2026-27/71 dated: 21.05.2026.
 3. Letter received from M/s U.K. Enterprise, R.P. Road, Dispur vide letter no. UKE/BMC/2026-27/76 dated: 21.05.2026.

With reference to the above subject, this is to inform you that GTP along with drawings of item mentioned below is hereby approved subject to the strict compliance to the highlighted corrections and recommendations of the GTP. All factory accepted tests shall be conducted upon the item and submitted along with supply and verified before installation. The date of manufacturing of the said item should be after the date of issue of this letter.

➔ **GTP for the following items have been approved.**

Sl. No.	Description of item	Vendor Details
1	33 KV V cross arm	M/s R.H. Electrical Works, Kantalia Ind. Complex, Danshi, Howrah, WB
2	11KV Channel X Arm (100X50X6X3200)mm	
3	GI Angle for tie (50X50X6X1000)mm	
4	GI Angle (50X50X6X1000)mm	
5	GI Earth pipe, 50mm dia, 3 mtr long	
6	11KV Channel X Arm (100X50X6X2200)mm	
7	PG Clamp for Raccoon	
8	11KV D.O Fuse, 150 A	
9	H/F for Disc for Raccoon, Tension type	
10	H/F for Disc, 45KN, T&C type	
11	GI Angle (50X50X6)mm for cross bracing	
12	HT Stay set	
13	33KV Danger Plate	
14	Hexagonal Nuts, Bolts, Washer, Spring washer, Foundation Bolt	
15	GI pole clamp, 50X6mm	M/s Jainco Transmission Ltd., 70 Diamond harbour rd, Kolkata
16	11KV Disc insulator, 70KN, T&C polymeric	
17	11KV Pin Insulator	
18	33KV Pin Insulator	M/s Jainco Power Ltd., Howrah, WB
19	ACSR Raccoon Conductor	
20	ACSR Wolf Conductor	

N.B: It is to be noted that this approval is solely against the furnished GTP of the said material and shall not be treated as approval of vendor under APDCL.
 Encl: - Approved GTPs.

Yours faithfully

[Signature]
 Chief General Manager (D&S)

Date:

Memo No CGM (D&S)/APDCL/LAR/Bongaigaon Medical College/2025-26/
 Copy to:

1. The CGM(PP&D), APDCL, Bijulee Bhawan, Paltanbazar, Ghy-01 for your information.
2. M/s U.K. Enterprise, R.P. Road, Dispur for information and necessary action.
3. Relevant File

Chief General Manager (D&S)

অসম শক্তি বিতৰণ কোম্পানী লিমিটেড
ASSAM POWER DISTRIBUTION COMPANY LIMITED
[CIN / চিআইন- U40109AS2003SGC007242]

No : CGM(PP&D)/APDCL/GTPA/PART-22/2025-26/4624

Dated : 02/06/26

To,

✓ Chief General Manager (LAR)
5th Floor, Bijulee Bhawan
Paltan bazar, Guwahati-1.

Sub: Approval of GTP

Ref: i) Letter No, CGM(D&S)/APDCL/LAR/Bongaigaon Medical College/2025-26/45,
Dated:25.05.2026

Sir,

With reference to the subject cited above, it is to inform you that the GTP along with drawings submitted from your end vide under Ref: i) have been scrutinized by the technical team of the office of the undersigned and the following items are hereby approved subject to full compliance to the highlighted corrections and recommendations. Details of materials :

Sl No.	Item Description	Manufacture
1	33KV V Cross Arm	M/S R.H Electrical Works, Howrah, W.B.
2	11KV Channel X Arm (100X50X6X3200) mm	
3	GI Angle for Tie (50X50X6X1000) mm	
4	GI Angle (50X50X6X1000) mm	
5	GI Earth Pipe, 50mm Dia 3m Long	
6	11KV Channel X Arm (100X50X6X2200) mm	
7	PG Clamp for Raccoon	
8	11KV DO Fuse	
9	H/F for Disc for Raccoon, Tension Type	
10	H/F for Disc, 45KN, T&C Type	
11	GI Angle (50X50X6) mm for Cross Bracing	
12	HT Stay Set	
13	33KV Danger Plate	
14	Hexagonal Nuts, Bolts, Washer, Spring Washer, Foundation Bolt	
15	GI Pole Clamp, 50X6mm	M/S Jainco Transmission Ltd., Kolkata
16	11KV Disc Insulator	
17	11KV Pin Insulator	M/S Jainco Power Ltd,
18	33KV Pin Insulator	
19	ACSR Raccoon Conductor	
20	ACSR Wolf Conductor	

Moreover, you are also requested to ensure that the approved item supplied strictly comply with the approved GTP & highlighted corrections/recommendations. All factory acceptance tests shall be conducted upon the item. The date of manufacture of the said item shall be later than the date of issue of this letter.

This is for favour of your kind information and necessary action.

Yours sincerely

Chief General Manager (PP&D)

O/o the Chief General Manager (PP&D) / মুখ্য মহা প্রবন্ধকৰ কাৰ্যালয় (পি.পি.এণ্ড.ডি)
Bijulee Bhawan, 6th Floor, Paltan Bazar, Guwahati, Assam - 781001
বিজুলী ভৱন, ষষ্ঠ মহলা, পল্টন বজাৰ, গুৱাহাটী, অসম - ৭৮১০০১
E-Mail: cgmpdpd.mattc@apdcl.org, Phone 0361-2739514, Fax 0361-2739535



অসম শক্তি বিতৰণ কোম্পানী লিমিটেড
ASSAM POWER DISTRIBUTION COMPANY LIMITED
 [CIN / চিআইন- U40109AS2003SGC007242]

No : CGM(PP&D)/APDCL/GTPA/PART-22/2025-26/4624

Dated : 02/06/26

To,

Chief General Manager (LAR)
5th Floor, Bijulee Bhawan
Paltan bazar, Guwahati-1.

Sub: Approval of GTP

Ref: i) Letter No, CGM(D&S)/APDCL/LAR/Bongaigaon Medical College/2025-26/45,
 Dated:25.05.2026

Sir,

With reference to the subject cited above, it is to inform you that the GTP along with drawings submitted from your end vide under Ref: i) have been scrutinized by the technical team of the office of the undersigned and the following items are hereby approved subject to full compliance to the highlighted corrections and recommendations. Details of materials :

Sl No.	Item Description	Manufacture
1	33KV V Cross Arm	M/S R.H Electrical Works, Howrah, W.B.
2	11KV Channel X Arm (100X50X6X3200) mm	
3	GI Angle for Tie (50X50X6X1000) mm	
4	GI Angle (50X50X6X1000) mm	
5	GI Earth Pipe, 50mm Dia 3m Long	
6	11KV Channel X Arm (100X50X6X2200) mm	
7	PG Clamp for Raccoon	
8	11KV DO Fuse	
9	H/F for Disc for Raccoon, Tension Type	
10	H/F for Disc, 45KN, T&C Type	
11	GI Angle (50X50X6) mm for Cross Bracing	
12	HT Stay Set	
13	33KV Danger Plate	
14	Hexagonal Nuts, Bolts, Washer, Spring Washer, Foundation Bolt	
15	GI Pole Clamp, 50X6mm	M/S Jainco Transmission Ltd., Kolkata
16	11KV Disc Insulator	
17	11KV Pin Insulator	
18	33KV Pin Insulator	M/S Jainco Power Ltd,
19	ACSR Raccoon Conductor	
20	ACSR Wolf Conductor	

Moreover, you are also requested to ensure that the approved item supplied strictly comply with the approved GTP & highlighted corrections/recommendations. All factory acceptance tests shall be conducted upon the item. The date of manufacture of the said item shall be later than the date of issue of this letter.

This is for favour of your kind information and necessary action.

Yours sincerely

Chief General Manager (PP&D)



ASSAM POWER DISTRIBUTION COMPANY LIMITED.

OFFICE OF THE CHIEF GENERAL MANAGER (D),

(LOWER ASSAM REGION)

CIN: U40109AS2003SGC007242

No. CGM (D&S)/APDCL/LAR/Bongaigaon Medical College/2025-26/45

Date: 25/05/26

To,

The Chief General Manager (PP&D),
APDCL, Bijulee Bhawan,
Paltan Bazar, Guwahati-1.

Sub: Forwarding of GTP & Drawing

Ref: 1. Letter received from M/s U.K. Enterprise, R.P.Road, Dispur, vide No. UKE/BMC/2026-27/71 dated: 21.05.2026.
2. Letter received from M/s U.K. Enterprise, R.P.Road, Dispur, vide No. UKE/BMC/2026-27/76 dated: 21.05.2026.

Sir,

With reference to the above subject, enclosed please find herewith a two (2) letter's received from M/s U.K. Enterprise, R.P.Road, Dispur regarding submission of GTP and drawings of following materials for the work Construction of 33KV Dedicated Medical College Feeder from 132KV/33KV Dhaligaon GSS to the premises of Bongaigaon Medical College, Majgaon and associated works under Bongaigaon-ESD-I against LoA issued vide No. CGM(D&S)/APDCL/LAR/ Bongaigaon Medical College /2025-2026/38 dated: 13.05.2026 for your information and necessary action.

Details are as follows :-

A)

Sl. No.	Description of item	Vendor Details
1	33 KV V cross arm	M/s R.H. Electrical Works, Kantalia Ind. Complex, Danshi, Howrah, WB
2	11KV Channel X Arm (100X50X6X3200)mm	
3	GI Angle for tie (50X50X6X1000)mm	
4	GI Angle (50X50X6X1000)mm	
5	GI Earth pipe, 50mm dia, 3 mtr long	
6	11KV Channel X Arm (100X50X6X2200)mm	
7	PG Clamp for Raccoon	
8	11KV D.O Fuse, 150 A	
9	H/F for Disc for Raccoon, Tension type	
10	H/F for Disc, 45KN, T&C type	
11	GI Angle (50X50X6)mm for cross bracing	
12	HT Stay set	
13	33KV Danger Plate	
14	Hexagonal Nuts, Bolts, Washer, Spring washer, Foundation Bolt	
15	GI pole clamp, 50X6mm	

B)

Sl. No.	Description of item	Vendor Details
1	11KV Disc insulator, 70KN, T&C polymeric	M/s Jainco Transmission Ltd., 70 Diamond harbour rd, Kolkata
2	11KV Pin Insulator	
3	33KV Pin Insulator	
4	ACSR Raccoon Conductor	M/s Jainco Power Ltd., Howrah, WB
5	ACSR Wolf Conductor	

Encl:- As Above.



Yours faithfully

Chief General Manager (D&S)
APDCL, LAR



M/S. U.K. ENTERPRISE

Govt. Approved (Class I) Contractor,
Deals with all Electrical, Civil works & Consultant

UDYAM REGISTRATION NO. UDYAM-AS-03-0005077

Dr. R.P. Road, Dispur, Guwahati-781006, Ph.98643-46349, 90853-90161 Email: babultalukdar@gmail.com

No. UKE/ BMC/2026-27/ 71

Date 21.05.2026

To

The Chief General Manager(D&S)
APDCL (LAR), Bijulee Bhawan,
Paltan Bazar, Guwahati -1

Sub:- Approval of GTP and Drawing

Ref:- LOA No. CGM(D&S)/APDCL/LAR/Bongaigaon Medical College /2025-26/38
Dt. 13.05.2026

Sir,

With reference to the above, we have the honour to forward herewith the GTP and Drawing of the following materials for favour of according necessary approval from your end.


The details are as follows :-


Sl. No.	Item description	Name & Address of Manufacturer	Remarks
1	33 KV V Cross arm	M/S. R.H. Electrical Works, Kantalia Industrial Complex, Vill. Danshi, P.O. Nobra Howrah- PIN 711409(W.B)	
2	11 KV Channel cross arm 100x50x6x3200mm		
3	GI Angle for Tie 50x50x6x1000mm		
4	GI Angle, 50x50x6x500mm		
5	GI Earth pipe, 50 mm dia, 3 mtr. long		
6	11 KV Channel cross arm 100x50x6x2200mm		
7	PG Clamp for Raccoon		
8	11 KV D.O. Fuse, 150 Amps		
9	H/F for Disc for Raccoon, Tension type		
10	H/F for Disc, 45 KN, T&C type		
11	GI Angle, 50x50x6mm for cross bracing		
12	HT Stay set		
13	33 KV Danger Plate		
14	Hexagonal Nuts, Bolts, Washer, Spring washer, Foundation Bolt		
15	GI Pole clamp, 50x6 mm		

The above materials will be utilised for Construction of 33kv Dedicated Medical College Feeder from 132/33kv Dhaligaon GSS to the premises of the Bongaigaon Medical College, Majgaon and associated work under Bongaigaon ESD-I under Deposit Work Scheme

Thanking you in anticipation and assuring our best service in future.

Endo. : As above

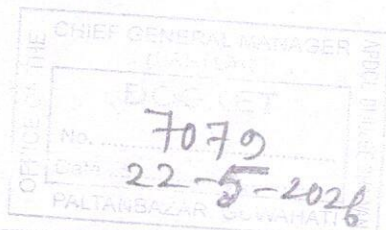



R.H. ELECTRICAL WORKS

AN ISO 9001 : 2015 ISO 45001 : 2018 ISO 14001 : 2015

Mfg cum supplier of: HT & LT Overhead Transmission and Distribution Line Materials


Office-Cum-Factory : Kantalia Industrial Complex, Vill : Danshi, P.O. : Nibra,
P.S. : Domjur, Salap, Howrah - 711409

GSTIN : 19ACFPH9960F1ZB + E-mail: rhelect92@gmail.com + Mob: 9051459149 / 9874584815


Owner	 ASSAM POWER DISTRIBUTION COMPANY LIMITED.
NAME OF PROJECT	BONGAIGOAN MEDICAL COLLEGE
LOA No	CGM (D&S) /APDCL /LAR/ Bongaigaon Medical college/2025-26/ 38, Date:13.05.2026
Contractor	M/s. U.K. Enterprise, Dispur, Guwahati.
Manufacturer	M/s. R.H. Electrical Works, Howrah (W.B)
Title	G.I 33 KV "V" CROSS ARM WITH TOP CLEAT
Drawing No.	RHEW/VCROSS ARM/26-27/21

GUARANTEED TECHNICAL PARTICULARS FOR G.I 33 KV "V" CROSS ARM WITH TOP CLEAT		
S. N.	DESCRIPTION	PARTICULAR
1.	Item	33 KV GI "V" Cross Arm with Top Cleat
2.	Size of "V" Cross Arm & Top Cleat	V-Cross Arm : Channel 100x50x6 mm Top Cleat : Channel 100x50x6x350 mm Long
3.	Sectional weight	9.56 Kg per Mtr. (for Channel 100x50x6 mm)
4.	Material	Mild Steel Channel & Angle
5.	Process	Hot Dip Galvanized
6.	Tolerance	As per $\pm 5\%$
7.	Dimensions (Length/Breadth/Width)	As per approved drawing.
8.	Thickness	6 mm
9.	Applicable Standard	IS : 2062
10.	Zinc Coating	86 Microns
11.	Galvanization Conformance	IS: 2629

⊗ All test certificates to be submitted along with supply.


DM (T&C Circle)
PP&D, APDCL
Date: 19-05-2026


AGM (T&C Circle)
PP&D, APDCL



DGM (T&C Circle)
PP&D, APDCL


M/s. R.H. Electrical Works
Howrah (W.B)




TECHNICAL DATA :


1. All Dimensions are in mm.
 2. General Tolerance : As per IS: 1852.
 3. Material : Mild Steel Channel, Angle & Flat conform to IS 2062 with latest amendments.
 4. Process : Hot Dip Galvanized, conform to IS 2633, IS 2629.
- Zinc Coating thickness - 85 Microns.

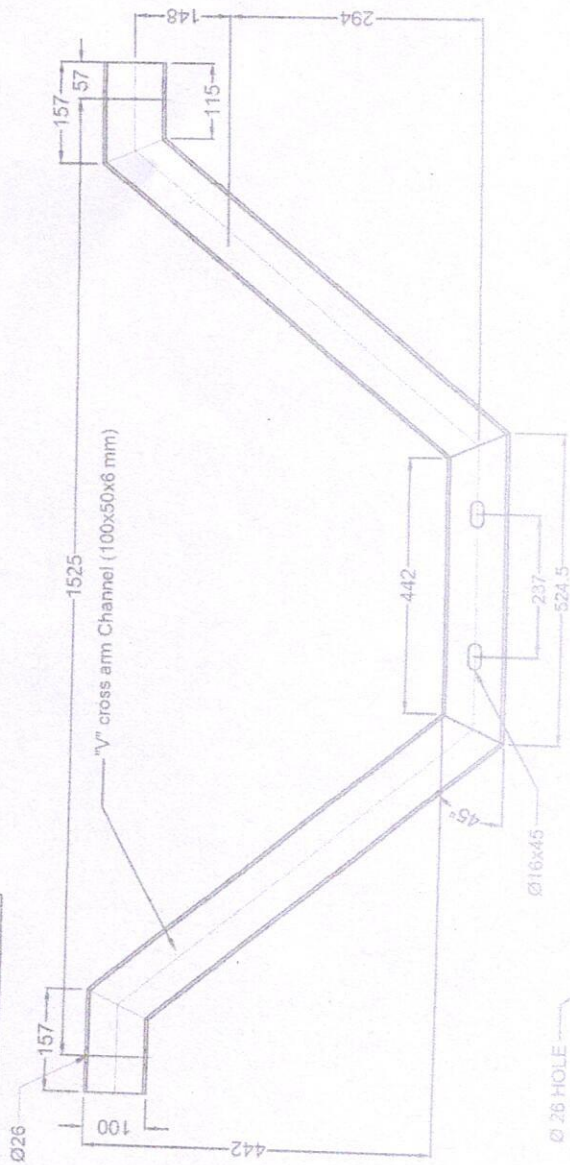


33KV V-CROSS ARM

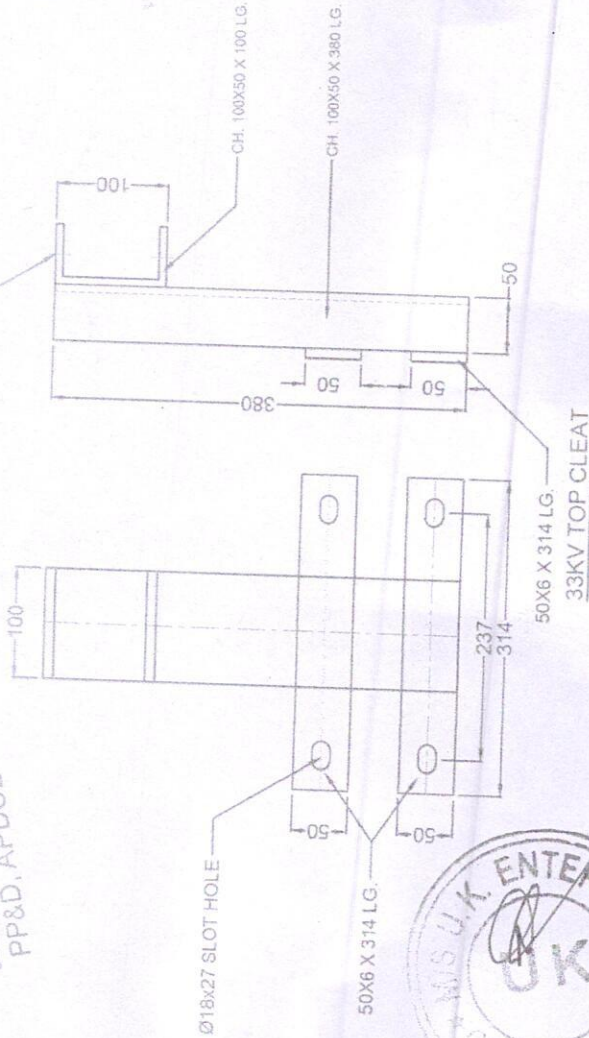

DM (T&C Circle)
PP&D, APDCL



OWNER	ASSAM POWER DISTRIBUTION COMPANY LIMITED.
PROJECT	BONGAIGOAN MEDICAL COLLEGE
CONTRACTOR	M/s. U.K. Enterprise, Dispur, Guwahati.
LOA No	CGM (D&S)/APDCL/LAR/ Bongaigaon Medical college/2025-26/ 38, Date: 13.05.2026
MANUFACTURER	R. H. Electrical Works
TITLE	GI 33KV "V" CROSS ARM WITH TOP CLEAT
Checked By	Drawn By
A. Hossain	Prabhu Pal
Drw. Date	Scale
10.05.2026	N/S
Sheet No	Rev. No
1 OF 1	1



R.H. ELECTRICAL WORKS

AN ISO 9001 : 2015 ISO 45001 : 2018 ISO 14001 : 2015

Mfg cum supplier of: HT & LT Overhead Transmission and Distribution Line Materials

Office-Cum-Factory : Kantalia Industrial Complex, Vill : Danshi, P.O. : Nibra,
P.S. : Domjur, Salap, Howrah - 711409

GSTIN : 19ACFPH9960F1ZB + E-mail: rhelect92@gmail.com + Mob: 9051459149 / 9874584815

Owner	 ASSAM POWER DISTRIBUTION COMPANY LIMITED.
NAME OF PROJECT	BONGAIGOAN MEDICAL COLLEGE
LOA No	CGM (D&S) /APDCL /LAR/ Bongaigaon Medical college/2025-26/ 38, Date:13.05.2026
Contractor	M/s. U.K.Enterprise, Dispur, Guwahati.
Manufacturer	M/s. R.H. Electrical Works, Howrah (W.B)
Title	GI Channel 100X50X6X3200 mm
Drawing No.	RHEW/GICHANNEL100X50X3200/26-27/22

GUARANTEED TECHNICAL PARTICULARS FOR GI CHANNEL 100X50X6X3200 MM		
S. N.	DESCRIPTION	PARTICULAR
1.	Item	GI Channel Cross Arm
2.	Size	100x50x6 mm x Length 3200 mm
3.	Sectional weight	9.56 Kg per Mtr.
4.	Material	Mild Steel Channel (Galvanized)
5.	Process	Hot Dip Galvanising
6.	Tolerance	As per $\pm 5\%$
7.	Length	3200 mm
8.	Breadth	100 mm
9.	Width	50 mm
10.	Thickness	6 mm
11.	Applicable Standard	IS: 2062
12.	Zinc Coating	86 Microns
13.	Galvanization Conformance	IS: 2629


All test certificates to be submitted alongwith supply.

DM (T&C Circle)
PP&D, APDCL


Date : 19-05-2026



AGM (T&C Circle)
PP&D, APDCL

DGM (T&C Circle)
PP&D, APDCL



M/s. R.H. Electrical Works
Howrah (W.B)





"APPROVED"

3200 mm Long



DM (T&C Circle)
PP&D, APDCL


AGM (T&C Circle)
PP&D, APDCL

DGM (T&C Circle)
PP&D, APDCL


NOTES :

1. All Dimensions are in mm.
2. General Tolerance : $\pm 5\%$.
3. Material : Mild Steel Channel, conform to IS 2062 with latest amendments.
4. Process : Hot Dip Galvanized, conform to IS 2633, IS 2629, Zinc Coating thickness - 86 Microns.

DRN. BY	NAME	SIGNATURE	DATE	REV. NO.	REV. DT.	SHEET NO.	SCALE	SHEET SIZE	ALL DIMENSIONS ARE IN MM.
CHKD. BY	A. Hussain			00		1 OF 1	N.T.S	A4	
APPVD. BY	A. Hussain								



Owner	ASSAM POWER DISTRIBUTION COMPANY LIMITED.
PROJECT	BONGAIGOAN MEDICAL COLLEGE
Name of Contractor	M/s. U.K. Enterprise, Dispur, Guwahati.
LOA No	CGM (DMS)/APDCL/LAR/ Bongaigaon Medical college/2025-26-38, Date: 13.05.2026
MANUFACTURER	R.H. ELECTRICAL WORKS
DRG TITLE :	Office cum Factory :- Kantalia Industrial Complex, Howrah - 711409
DRG. NO. :	GI CHANNEL 100X50X3 3200MM
	RHEW/GI CHANNEL 100X50X3 3200/26-27/22
	DATE : 19.05.2026



R.H. ELECTRICAL WORKS

AN ISO 9001 : 2015 ISO 45001 : 2018 ISO 14001 : 2015

Mfg cum supplier of: HT & LT Overhead Transmission and Distribution Line Materials

Office-Cum-Factory : Kantalia Industrial Complex, Vill : Danshi, P.O. : Nibra,
P.S. : Domjur, Salap, Howrah - 711409

GSTIN : 19ACFPH9960F1ZB + E-mail: rhelect92@gmail.com + Mob: 9051459149 / 9874584815


Owner	 ASSAM POWER DISTRIBUTION COMPANY LIMITED.
NAME OF PROJECT	BONGAIGOAN MEDICAL COLLEGE
LOA No	CGM (D&S) /APDCL /LAR/ Bongaigaon Medical college/2025-26/ 38, Date:13.05.2026
Contractor	M/s. U.K.Enterprise, Dispur, Guwahati.
Manufacturer	M/s. R.H. Electrical Works, Howrah (W.B)
Title	TYE Angle 50x50x6x1000mm
Drawing No.	RHEW/TYEANGLE/26-27/23

GUARANTEED TECHNICAL PARTICULARS FOR TYE ANGLE 50X50X6X1000MM		
S.N.	DESCRIPTION	PARTICULAR
1.	Item	GI Angle
2.	Size	50x50x6 mm x Length 1000 mm
3.	Sectional weight	4.5 Kg per Mtr.
4.	Material	Mild Steel Angle
5.	Process	Hot Dip Galvanising
6.	Tolerance	As per $\pm 5\%$
7.	Length	1000 mm
8.	Breath	50 mm
9.	Width	50 mm
10.	Thickness	6 mm
11.	Applicable Standard	IS: 2062
12.	Zinc Coating	86 Microns
13.	Galvanization Conformance	IS: 2629

* All tests certificates to be submitted alongwith supply.

Date : 19-05-2026

M/s. R.H. Electrical Works
Howrah (W.B)


DM (T&C Circle)
PP&D, APDCL



AGM (T&C Circle)
PP&D, APDCL


DGM (T&C Circle)
PP&D, APDCL



TECHNICAL DATA:

1. All Dimensions are in mm.
2. General Tolerance : As per IS: 1852.
3. Material : Mild Steel Channel, conform to IS 2062 with latest amendments.
4. Process : Hot Dip Galvanized, conform to IS 2633, IS 2629,
Zinc Coating thickness - 85 Microns.

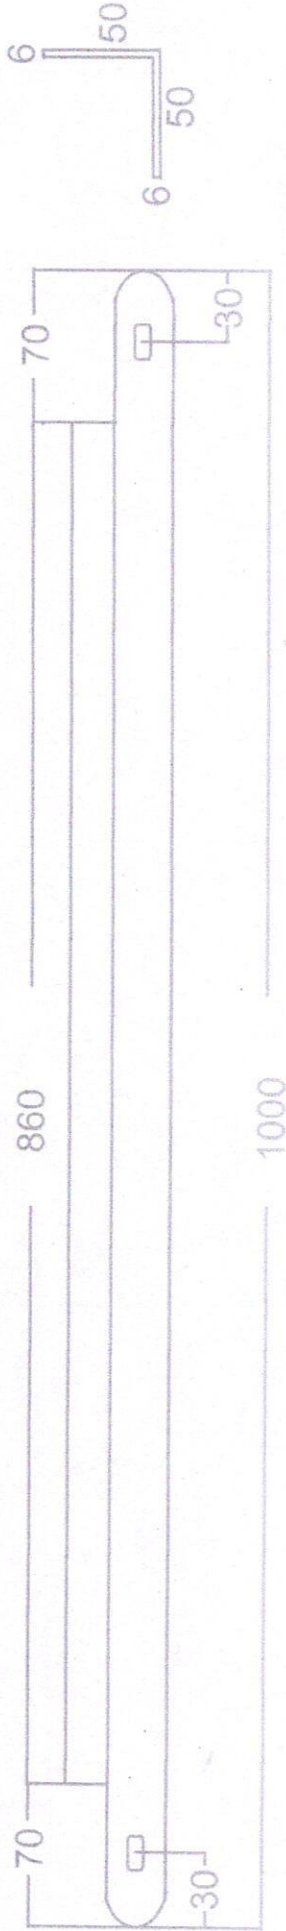


APPROVED

DM (T&C Circle)
PP&D, APDCL

AGM (T&C Circle)
PP&D, APDCL


DGM (T&C Circle)
PP&D, APDCL



OWNER	ASSAM POWER DISTRIBUTION COMPANY LIMITED.		
PROJECT	BONGAIGOAN MEDICAL COLLEGE		
NAME OF CONTRACTOR:	M/s. U.K. Enterprise, Dispur, Guwahati.		
LOA No	CGM (D&S) / APDCL / IAR/ Bongaigaon Medical college/2025-26/ 38, Date: 13.05.2026		
MANUFACTURER :	R.H. ELECTRICAL WORKS Office-Cum-Factory : Kantalia Industrial Complex, Howrah - 711409		
DRG. TITLE :	TYE ANGLE 50x50x6x1000MM		
DRG. NO. :	RHEW/TYE/ANGLE/26-27/23	DATE -	19.05.26

DRN. BY	NAME	SIGNATURE	DATE	REV. NO.	REV. DT.	SHEET NO.	SCALE	SHEET SIZE	ALL DIMENSIONS ARE IN MM.	
CHKD. BY	MD. HOSSAIN			00			N.T.S	A4		
APPVD. BY	A. HUSSAIN					1 OF 1				

Disclaimer: This is the sole Property of R.H.ELECTRICAL WORKS copy of this Drawing is legally offence.



R.H. ELECTRICAL WORKS

AN ISO 9001 : 2015 ISO 45001 : 2018 ISO 14001 : 2015

Mfg cum supplier of: HT & LT Overhead Transmission and Distribution Line Materials

Office-Cum-Factory : Kantalia Industrial Complex, Vill : Danshi, P.O. : Nibra,
P.S. : Domjur, Salap, Howrah - 711409

GSTIN : 19ACFPH9960F1ZB + E-mail: rhelect92@gmail.com + Mob: 9051459149 / 9874584815


Owner	 ASSAM POWER DISTRIBUTION COMPANY LIMITED.
NAME OF PROJECT	BONGAIGOAN MEDICAL COLLEGE
LOA No	CGM (D&S) /APDCL /LAR/ Bongaigaon Medical college /2025-26/ 3B, Date:13.05.2026
Contractor	M/s. U.K. Enterprise, Dispur, Guwahati.
Manufacturer	M/s. R.H. Electrical Works, Howrah (W.B)
Title	GJ ANGLE CROSS ARM (50X50X6 MM) FOR CROSS BRACING
Drawing No.	RHEW/ANGLE50X50X6/26-27/34

GUARANTEED TECHNICAL PARTICULARS FOR GJ ANGLE CROSS ARM 50X50X6 MM FOR CROSS BRACING		
S.N.	DESCRIPTION	PARTICULAR
1.	Item	GJ Angle Cross Arm
2.	Size	50x50x6 mm
3.	Sectional weight	4.50 Kg per Mtr.
4.	Material	Mild Steel Angle
5.	Process	Hot Dip Galvanising
6.	Tolerance	As per $\pm 5\%$
7.	Length	As per requirement and approved drawing. (50x50x6 x 2200 mm for Bracing Belting - 2 Nos. and 50x50x6 x 2500 mm for Bracing "X" - 2 Nos.)
8.	Breath	50 mm
9.	Width	50 mm
10.	Thickness	6 mm
11.	Applicable Standard	IS : 2062
12.	Zinc Coating	86 Microns
13.	Galvanization Conformance	IS : 2629

(*) All test certificates to be submitted along with supply.

"APPROVED"

Date: 19-05-2026


DM (T&C Circle)
PP&D, APDCL


AGM (T&C Circle)
PP&D, APDCL



DGM (T&C Circle)
PP&D, APDCL

M/s. R.H. Electrical Works
Howrah (W.B)



TECHNICAL DATA :

1. All Dimensions are in mm.
 2. General Tolerance : $\pm 5\%$.
 3. Material : Mild Steel Angle, conform to IS 2062 with latest amendments.
 4. Process : Hot Dip Galvanizing, conform to IS 20633/IS 27239.
- Zinc Coating thickness - 86 Microns.



50

50



As Per Requirement




"APPROVED"

DM (T&C Circle)
PP&D, APDCL

AGM (T&C Circle)
PP&D, APDCL


DGM (T&C Circle)
PP&D, APDCL



OWNER	ASSAM POWER DISTRIBUTION COMPANY LIMITED.
PROJECT	BONGAIGAN MEDICAL COLLEGE
CLIENT	M/S. U.K. ENTERPRISE, Dispur, Guwahati
LOA No	CGM (D&S) / APDCL / AR / Bongaigaon Medical college / 2025.26 / 38. Date: 13.05.2026
MANUFACTURER	R. H. Electrical Works Office-Cum-Factory: Kamruli Industrial Complex, Howrah - 711109
TITLE	GI ANGLE CROSS ARM (50X50X6 MM) FOR CROSS BRACING
Checked By	Drawn By
A. Bhosain	Pradip Paul
RBH/VA/NGLE/50X50X6/26.27/31	19.05.2026
NTS	A4
1 OF 1	

TECHNICAL DATA :


1. All Dimensions are in mm.
2. General Tolerance : As per IS: 1852.
3. Material : Mild Steel Channel, conform to IS 2062 with latest amendments.
4. Process : Hot Dip Galvanized, conform to IS 2633, IS 2629.
Zinc Coating thickness - 85 Microns.

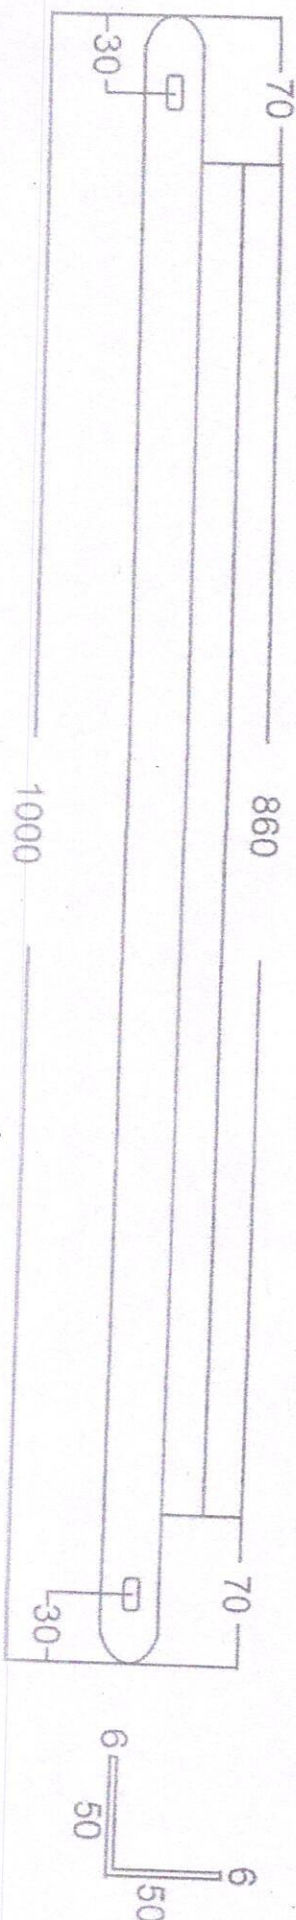

DM (T&C Circle)
PP&D, APDCL

AGM (T&C Circle)
PP&D, APDCL

DGM (T&C Circle)
PP&D, APDCL



NAME	SIGNATURE	DATE	REV NO.	REV DT	SHEET NO.	SCALE	SHEET SIZE	ALL DIMENSIONS ARE IN MM.
DRG. BY	MD. HOSSAIN		00		1 OF 1	N.T.S.	A4	
CHKD. BY	AMIT							
APPD. BY	A. HUSSAIN							

OWNER	ASSAM POWER DISTRIBUTION COMPANY LIMITED
PROJECT	BONGAIGOAN MEDICAL COLLEGE
NAME OF CONTRACTOR	M/S. I.K. Enterprises, Dispur, Guwahati.
LOA No	CGNID&S/APPCL/CLAR/Bongaigoon Medical College/2025-26/38
Date	13.05.2026


MANUFACTURER : **R.H. ELECTRICAL WORKS**

Office-Cum-Factory : Kamalia Industrial Complex, Howrah - 711-09

DRG. TITLE : TVE ANGLE 50x50x1000x100

DRG. NO. : RHPW/TVE ANGLE/76/2703

DATE : 19.05.26



R.H. ELECTRICAL WORKS

AN ISO 9001 : 2015 ISO 45001 : 2018 ISO 14001 : 2015

Mfg cum supplier of: HT & LT Overhead Transmission and Distribution Line Materials

Office-Cum-Factory : Kantalia Industrial Complex, Vill : Danshi, P.O. : Nibra,
P.S. : Domjur, Salap, Howrah - 711409

GSTIN : 19ACFPH9960F1ZB + E-mail: rhelect92@gmail.com + Mob: 9051459149 / 9874584815


Owner	 ASSAM POWER DISTRIBUTION COMPANY LIMITED.
NAME OF PROJECT	BONGAIGOAN MEDICAL COLLEGE
LOA No	CGM (D&S) /APDCL /LAR/ Bongaigaon Medical college/2025-26/ 38, Date:13.05.2026
Contractor	M/s. U.K. Enterprise, Dispur, Guwahati.
Manufacturer	M/s. R.H. Electrical Works, Howrah (W.B)
Title	GI EARTHING PIPE 50 MM DIA. X 3 MTR. LONG
Drawing No.	RHEW/GIEARTHINGPIPE50X3000/26-27/24

GUARANTEED TECHNICAL PARTICULARS FOR GI EARTHING PIPE 50 MM DIA. X 3 MTR. LONG		
S. N.	DESCRIPTION	PARTICULAR
1.	Material	Mild Steel as per IS-1239B, Class medium
2.	Standard Applicable	IS-1239 B Class Medium
3.	Length of Pipe	3000 mm
4.	Diameter of Pipe	50 mm.
6.	Internal Dia of Pipe	100 NB
6.	12 mm Hole	100 mm below top of GI Pipe
8.	Galvanization standard	Mass of Zinc: IS4736-1986-64 Micron for wall thickness between 2-5 mm Uniformly of Zinc : IS 2633-1986 (4 Dips of 1 Minute each on copper sulphate solution
8.	Cutting	Angular
9.	Tolerance	± 5%

* All test certificates to be submitted along with supply.


"APPROVED"

Date: 19-05-2026


DM (T&C Circle)
PP&D, APDCL


AGM (T&C Circle)
PP&D, APDCL

M/s. R.H. Electrical Works
Howrah (W.B)


DGM (T&C Circle)
PP&D, APDCL



TECHNICAL DATA :

1. All Dimensions are in mm.
2. General Tolerance : $\pm 5\%$.
3. G.I Pipe shall conform to IS: 1239 (Part-I)/1990 with latest amendments.
4. Process of surface coating : Hot Dip Galvanizing, conform to IS: 2633, IS: 2629.
5. Bolts (M10X40), Nuts (M10) & Sp. washers (M10) are not in scope of supply.


Dimensional Details

A	B	C	D	E
3000	150	75	100	100

BILL OF MATERIALS :

S.N.	DESCRIPTION	QTY. (In Nos.)	MATERIAL
1.	EARTH PIPE : 50 MM DIA X 3000 MM LONG	1	G.I PIPE (Class-B)


"APPROVED"

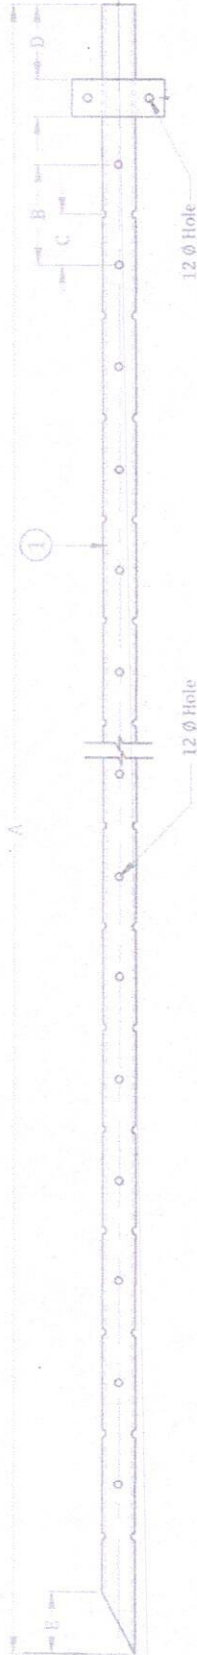

A.G.M. (T&C Circle)
PP&D, APDCL

A.G.M. (T&C Circle)
PP&D, APDCL

DGM (T&C Circle)
PP&D, APDCL



ASSAM POWER DISTRIBUTION COMPANY LIMITED.

BONGAIGOAN MEDICAL COLLEGE

M/s. U.K. Enterprise, Dispur, Guwahati.

CGM (D&S)/APDCL / IAR/ Bongaigaon Medical college/2025-26/38, Date: 13.05.2026

R.H. ELECTRICAL WORKS

Office-cum-Factory : Kantalia Industrial Complex, Howrah - 711409


All Dimensions are in mm.

DRN. BY	NAME	SIGNATURE	DATE	REV. NO.	REV. DT.	SHEET NO.	SCALE	SHEET SIZE
CHKD. BY	A. Hussain			00		1 of 1	N.T.S	A4
APPVD. BY	A. Hussain							

G.I. EARTHING PIPE : 50 MM DIA. X 3 MTR. LONG

RHEW/GIEARTHING/PIPE/IN/3000/26-27/24

DATE : 19.05.2026



R.H. ELECTRICAL WORKS

AN ISO 9001 : 2015 ISO 45001 : 2018 ISO 14001 : 2015

Mfg cum supplier of: HT & LT Overhead Transmission and Distribution Line Materials

Office-Cum-Factory : Kantalia Industrial Complex, Vill : Danshi, P.O. : Nibra,

P.S. : Domjur, Salap, Howrah - 711409

GSTIN : 19ACFPH9960F1ZB

E-mail: rhelect92@gmail.com

Mob: 9051459149 / 9874584815

Owner	 ASSAM POWER DISTRIBUTION COMPANY LIMITED.
NAME OF PROJECT	BONGAIGOAN MEDICAL COLLEGE
LOA No	CGM (D&S) /APDCL /LAR/ Bongaigaon Medical college/2025-26/ 38, Date:13.05.2026
Contractor	M/s. U.K. Enterprise, Dispur, Guwahati.
Manufacturer	M/s. R.H. Electrical Works, Howrah (W.B)
Title	GI CHANNEL CROSS ARM : 100X50X6X2200 MM
Drawing No.	RHEW/CHANNEL2200/26-27/29


GUARANTEED TECHNICAL PARTICULARS FOR GI ANGLE CROSS ARM : 100X50X6X2200 MM

S. N.	DESCRIPTION	PARTICULAR
1.	Item	GI Channel
2.	Size	100x50x6 mm x Length 2200 mm
3.	Sectional weight	9.56 Kg per Mtr.
4.	Material	Mild Steel Channel (Galvanized)
5.	Process	Hot Dip Galvanizing
6.	Tolerance	As per $\pm 5\%$
7.	Length	2200 mm
8.	Breath	100 mm
9.	Width	50 mm
10.	Thickness	6 mm
11.	Applicable Standard	IS: 2062
12.	Zinc Coating	86 Microns
13.	Galvanization Conformance	IS: 2629


"APPROVED"

⊗ All tests certificates to be submitted alongwith supply.


Date : 19-05-2026


DM (T&C Circle)
PP&D, APDCL


AGM (T&C Circle)
PP&D, APDCL



M/s. R.H. Electrical Works
Howrah (W.B)

DGM (T&C Circle)
PP&D, APDCL



TECHNICAL DATA :

1. All Dimensions are in mm.
 2. General Tolerance : $\pm 5\%$.
 3. Material : Mild Steel Angle, conform to IS 2062 with latest amendments.
 4. Process : Hot Dip Galvanized, conform to IS 2633, IS 2629.
- Zinc Coating thickness - 86 Microns.

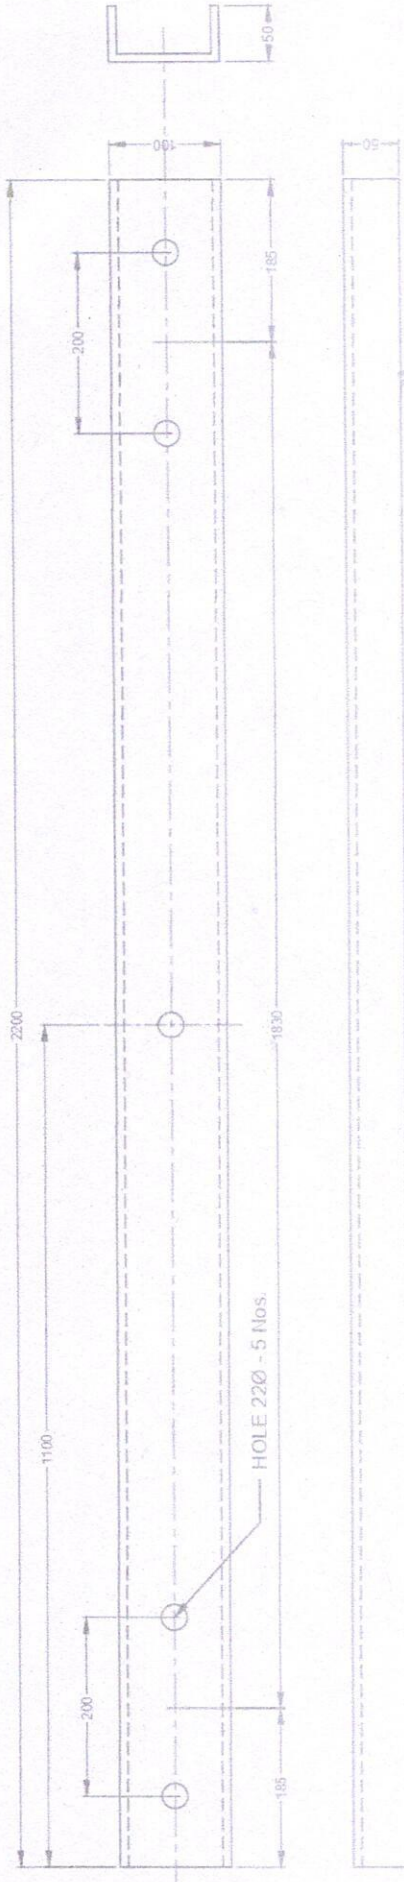

APPROVED


AGM (T&C Circle)
PP&D, APDCL

DGM (T&C Circle)
PP&D, APDCL

DM (T&C Circle)
PP&D, APDCL



OWNER	ASSAM POWER DISTRIBUTION COMPANY LIMITED.
PROJECT	BONGAIGOAN MEDICAL COLLEGE
CLIENT	M/s. U.K. ENTERPRISE, Dispur, Guwahati
LOA No	CGM (D&S) /APDCL /L&E/ Bongaigaon Medical college/2025-26/38, Date:13.05.2026
MANUFACTURER	R. H. Electrical Works Office-Cum-Factory : Kantalia Industrial Complex, Howrah - 711409
TITLE	GI CHANNEL CROSS ARM : 100X50X6X2200 MM
Checked By	Drawn By
A. Hussain	Prabhu Pal
Dwg. No.	Dwg. Date
RHEW/CHANNEL/200/26-27/29	19.05.2026
Sheet No	Rev. No
1 OF 1	



R.H. ELECTRICAL WORKS

AN ISO 9001 : 2015 ISO 45001 : 2018 ISO 14001 : 2015

Mfg cum supplier of: HT & LT Overhead Transmission and Distribution Line Materials

Office-Cum-Factory : Kantalia Industrial Complex, Vill : Danshi, P.O. : Nibra,

P.S. : Domjur, Salap, Howrah - 711409

GSTIN : 19ACFPH9960F1ZB



E-mail: rhelect92@gmail.com




Mob: 9051459149 / 9874584815

Owner	 ASSAM POWER DISTRIBUTION COMPANY LIMITED.
NAME OF PROJECT	BONGAIGOAN MEDICAL COLLEGE
LOA No	CGM (D&S) /APDCL /LAR/ Bongaigaon Medical college/2025-26/ 38, Date:13.05.2026
Contractor	M/s. U.K. Enterprise, Dispur, Guwahati.
Manufacturer	M/s. R.H. Electrical Works, Howrah (W.B)
Title	P.G CLAMP FOR ACSR RACCOON
Drawing No.	RHEW/PG(RC)/26-27/31


GUARANTEED TECHNICAL PARTICULARS FOR P.G CLAMP FOR ACSR RACCOON		
S. N.	PARAMETERS	OFFERED VALUE
1.	Type of Clamp	Parallel Groove Type Clamp (P.G Clamp)
2.	P.G Clamp Suitable for	ACSR RACCOON to RACCOON Conductor
3.	MATERIAL :	Clamp Top : Aluminium Alloy. Clamp Bottom : Aluminium Alloy.
4.	PG CLAMP Conforms to :	IS: 5561/1970 with latest amendments
5.	Technical Standard.	The Grooves of the clamp are suitable to provide maximum contact area when fitted with conductor. Slip strength is equivalent to 95% of UTS of relevant ACSR conductor.
6.	General Tolerance :	± 5%

⊛ All test certificates to be submitted "APPROVED" along with supply.


DM (T&C Circle)
PP&D, APDCL



AGM (T&C Circle)
PP&D, APDCL



DGM (T&C Circle)
PP&D, APDCL




Date : 19-05-2026

M/s. R.H. Electrical Works
Howrah (W.B)




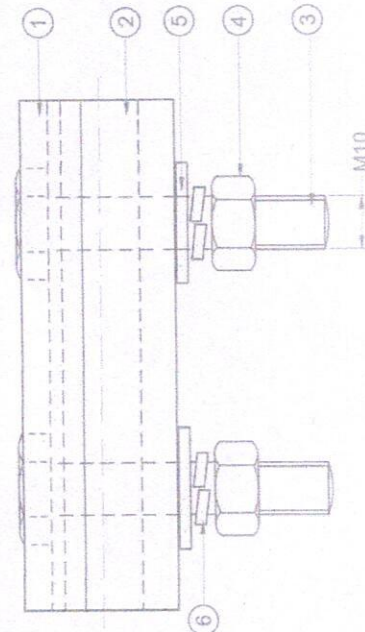

ELEVATION

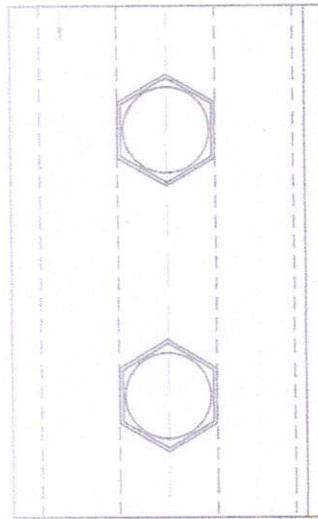

PLAN

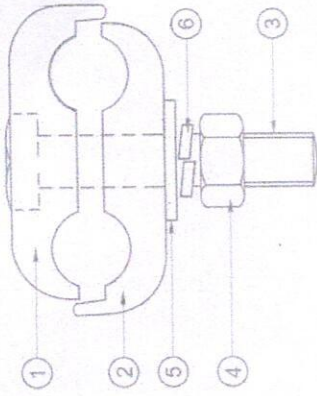

"APPROVED"


DM (T&C Circle)
PP&D, APDCL

DM (T&C Circle)
PP&D, APDCL

BILL OF MATERIALS		
S.N.	DESCRIPTION	MATERIAL
1.	CLAMP TOP	ALUMINIUM ALLOY
2.	CLAMP BOTTOM	ALUMINIUM ALLOY
3.	BOLT : M10	MILD STEEL HDG.
4.	NUT : M10	MILD STEEL HDG.
5.	FLAT WASHER : M10	MILD STEEL E.G.
6.	SP. WASHER : M10	SP. STEEL E.G.

NOTE:


- 1) All dimensions are in mm. unless otherwise mentioned.
- 2) All Dimensions are subject to Tolerance : $\pm 5\%$.
- 3) P.G Clamp Two Bolted type and suitable for ACSR Raccoon to ACSR Raccoon Conductor.



DM (T&C Circle)
PP&D, APDCL

Owner	ASSAM POWER DISTRIBUTION COMPANY LIMITED.
PROJECT	BONGAIGOAN MEDICAL COLLEGE
Name of Contractor:	M/s. U.K. Enterprise, Dispur, Guwahati.
LOA No	CGM (D&S) /APDCL/LAR/ Bongaigaon Medical college/2025-26/ 38, Date: 13.05.2026
MANUFACTURER	R.H. ELECTRICAL WORKS Office cum Factory : Kamada Industrial Complex, Howrah - 711409
DRG. TITLE:	P.G CLAMP FOR ACSR RACCOON
DRG. NO.:	RHEW/PG(RC)/26-27/31
DATE:	19.05.2026

DRN BY	NAME	SIGNATURE	DATE	REV. NO.	REV. DT.	SHEET NO.	SCALE	SHEET SIZE	ALL DIMENSIONS ARE IN MM.	
CHKD. BY	A. Hussain			00		1 OF 1	N.T.S	A4		
APPROV. BY	A. Hussain									



R.H. ELECTRICAL WORKS

AN ISO 9001 : 2015 ISO 45001 : 2018 ISO 14001 : 2015

Mfg cum supplier of: HT & LT Overhead Transmission and Distribution Line Materials

Office-Cum-Factory : Kantalia Industrial Complex, Vill : Danshi, P.O. : Nibra,

P.S. : Domjur, Salap, Howrah - 711409

GSTIN : 19ACFPH9960F1ZB + E-mail: rhelect92@gmail.com + Mob: 9051459149 / 9874584815

Owner	 ASSAM POWER DISTRIBUTION COMPANY LIMITED.
NAME OF PROJECT	SSB CAMP
LOA No	CGM (D&S) /APDCL /LAR/ SSB Camp, Tetelia/2025-26/ 29, Date:15.03.2026
Contractor	The Global Centre, Dispur, Guwahati.
Manufacturer	M/s. R.H. Electrical Works, Howrah (W.B)
Title	11 KV, 150A, 3-PH DROP-CUT FUSE OUT
Drawing No.	RHEW/11DROPFUSEOUT/26-27/43

GUARANTEED TECHNICAL PARTICULARS 11 KV 150 DROP-OUT FUSE(set-3 Unit)		
S. N.	DESCRIPTION	OFFERED VALUE
1.	Type	Bracket Type
2.	Installation	Vertical Mounting
3.	Application	Outdoor Type
4.	Applicable standard	As per TS
5.	Normal System Voltage	11KV
6.	Highest System Voltage	12KV
7.	Continuous current rating	150A
8.	Frequency	50 Hz
9.	One minute power Frequency withstand voltage	
a.	To earth & between poles	28kV(R.M.S)
b.	Across Isolating Distance	32kV(R.M.S)
10.	One minute Lighting impulse withstand voltage	
a.	To earth & between poles	75kV(Peak)
b.	Across Isolating distance	85kV(Peak)
11.	Puncture withstand test voltage	1.3x Actual flashover voltage
12.	Temperature rise unit	
a.	Contact silver plated	60°C over ambient temperature
b.	Terminals	60°C over ambient temperature
13.	Base Insulations value	320 mm
14.	Rated Breaking Capacity	8KA Asymmetrical
15.	Particulars of main contacts	
a.	Type	Lift off type
b.	Material	Brass/G.m
c.	Surface Treatment	Silver plated
16.	Material used in connector	Alu.alloy
17.	Fuse carrier	Copper Alloy/Brass with silver plated
18.	Type of fuse link	Bakelite Fuse link uses (but not supply by us)
19.	Mounting arrangement	Hot dip galvanized


"APPROVED"

DM (T&C Circle)
PP&D, APDCL

AGM (T&C Circle)
PP&D, APDCL

DGM (T&C Circle)
PP&D, APDCL





R.H. ELECTRICAL WORKS

AN ISO 9001 : 2015 ISO 45001 : 2018 ISO 14001 : 2015

Mfg cum supplier of: HT & LT Overhead Transmission and Distribution Line Materials

Office-Cum-Factory : Kantalia Industrial Complex, Vill : Danshi, P.O. : Nibra,
P.S. : Domjur, Salap, Howrah - 711409

GSTIN : 19ACFPH9960F1ZB + E-mail: rhelect92@gmail.com + Mob: 9051459149 / 9874584815

20.	Insulators	
a.	Type	2 Nos post insulator
b.	Make	RR/PIPL/ADPRO or any other reputed manufacturers as per IS: 2544 & IEC-61109 with latest amendments
c.	Rated Voltage	11KV
d.	Total height	254mm
e.	Creepage distance	320 mm
f.	Visible discharge voltage	9 kV
g.	Canilever Load	3250N
h.	Tensile Strength	5kN
i.	Torsional Strength	30Nm
j.	Compression Strength	3200N
k.	Flashover voltage	50KV
l.	Minimum beam strength	1070 Kg
21.	Number of Insulators	2 Nos

⊗ All tests certificates to be submitted along with supply.

Date: 20-05-2026

M/s. R.H. Electrical Works
Howrah (W.B)

"APPROVED"

DM (T&C Circle)
PP&D, APDCL

AGM (T&C Circle)
PP&D, APDCL

DGM (T&C Circle)
PP&D, APDCL




NOTE:-

1. System Voltage : 11 KV
2. Rated Voltage : 12 KV
3. Rated Current : 150A
4. Rated Frequency : 50Hz.
5. Power Frequency withstand Voltage
- a. Earth & Between Poles : 28 KV rms.
- b. Across Isolating Distance : 32 KV rms.
6. Total Creepage Distance : 320 mm (Approx)
7. All non Ferrous Parts shall be Silver Plated 5 Microns (Approx)
8. All Dimensions are in mm. Except and Otherwise Specified.
9. All Dimension are subject to Tolerance $\pm 5\%$
10. All Ferrous Parts Shall Be Hot-Dip Galvanized as per IS 2633. Bolts, Nut & Washer Shall be Zinc Plated.
11. Terminal Connectors are 6-Bolted type, Suitable for ACSR RACCOON Conductor.

DM (T&C Circle)
PP&D, APDCL

AGM (T&C Circle)
PP&D, APDCL


DGM (T&C Circle)
PP&D, APDCL

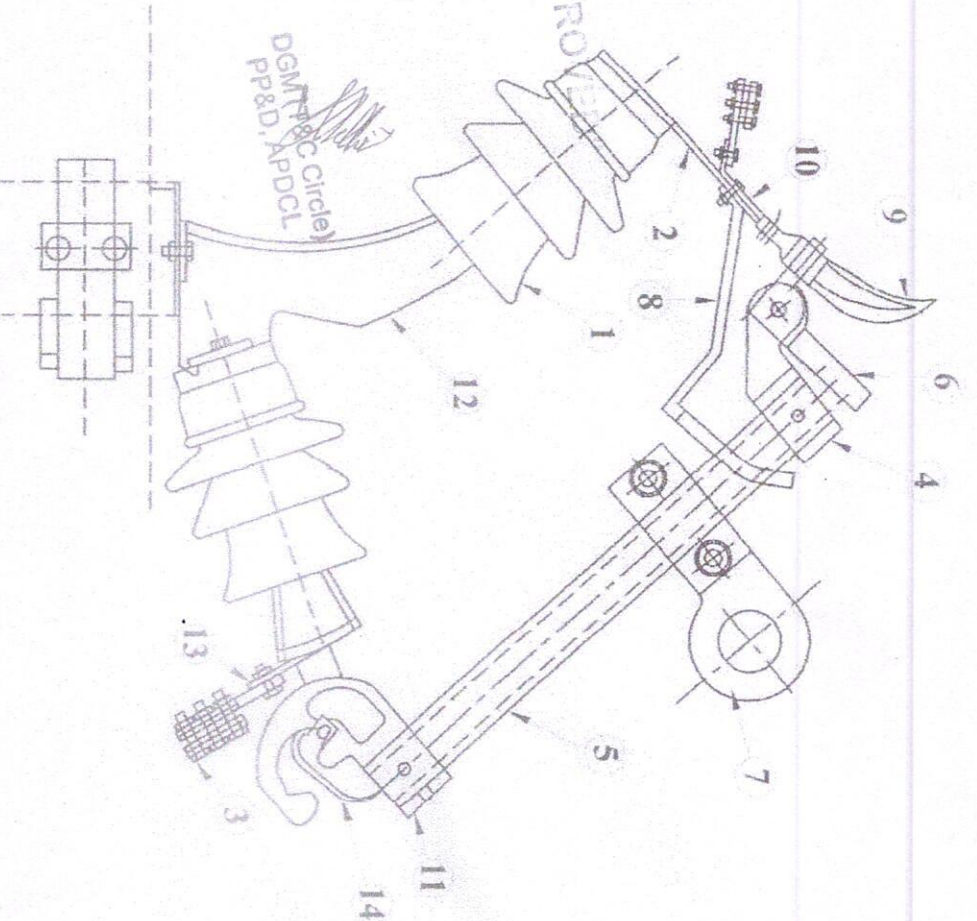

Sl. No.	DESCRIPTION	MATERIAL	QTY.
1	11 KV POST INSULATED CUBIC BOX	PORE CLAY	6 NO.
2	FLAT SHIP	MS. HDG.	3 NO.
3	TERMINAL CONNECTOR	AL. ALLOY	6 NO.
4	INSUL	GM/BRASS INSULVTR	1 NO.
5	FUSE CARRIER TUBE, 25mm ID X 18 ID	300P	1 NO.
6	MALE CONTACT	GM/BRASS (SILVTR)	1 NO.
7	SOLE BUSHING	AL. ALLOY	1 NO.
8	SHEET IRON	MS. HDG.	1 NO.
9	DEVICE CONTACT	GM/BRASS	1 NO.
10	HIGH PRESSURE SPRING SHIP	COPPER SHIP	1 NO.
11	IRON SHIP	GM/BRASS (SILVTR)	1 NO.
12	MOUNTING BRACKET	CS. HDG.	1 NO.
13	POWER CLAMP	MS. HDG.	1 NO.
14	TERMINAL (NOT SUPPLY IN)	TELETYPE COPPER	1 NO.

NAME	SIGNATURE	DATE	REV. NO.	REV. DT.	SHEET NO.	SCALE	SHEET SIZE
DRN. BY			00		1 OF 1	NTS	A4
CHND. BY							
CHK. BY							

Owner		 ASSAM POWER DISTRIBUTION COMPANY LIMITED	
Name of Contractor	The Global Centre, Dispur, Gauhati.		
LOA NO	CGM (D&S)/APDCL/LAR/SSB Camp, Teelaha, 2025, 26/19 Date: 15.03.2026		
PROJECT	SSB CAMP		
MANUFACTURER	R. H. Electrical Works		
TITLE	Office-Cum-Factory : Kanduli Industrial Complex, Hombh- 711109		
11KV, 150A, 3-PH DROP-CUT FUSE OUT			
Checked By	Drawn By	Drawing No.	
		Page, Date Scale, Sheet Size, Sheet No, Rev No, Rev Date	



R.H. ELECTRICAL WORKS

AN ISO 9001 : 2015 ISO 45001 : 2018 ISO 14001 : 2015

Mfg cum supplier of: HT & LT Overhead Transmission and Distribution Line Materials

Office-Cum-Factory : Kantalia Industrial Complex, Vill : Danshi, P.O. : Nibra,
P.S. : Domjur, Salap, Howrah - 711409

GSTIN : 19ACFPH9960F1ZB ✦ E-mail: rhelect92@gmail.com ✦ Mob: 9051459149 / 9874584815

Owner	 ASSAM POWER DISTRIBUTION COMPANY LIMITED.
NAME OF PROJECT	BONGAIGOAN MEDICAL COLLEGE
LOA No	CGM (D&S) /APDCL /LAR/ Bongaigaon Medical college/2025-26/ 38, Date:13.05.2026
Contractor	M/s. U.K.Enterprise, Dispur, Guwahati.
Manufacturer	M/s. R.H. Electrical Works
TITLE	11KV TENSION H/W FITTINGS for ACSR 'RACCOON' Conductor (3-Bolted T&C Type)
DRAWING NO.	RHEW/11KVHWFITTINGSFORRACCOON/26-27/32

GTP FOR 11KV TENSION H/W FITTINGS for ACSR 'RACCOON' Conductor (3-Bolted T&C Type)			
S.N	PARAMETERS	MATERIAL	QTY.
1.	Cross-Arm Straps (35X5 mm)	M.S. Hot Dip Galvanized.	1 Pair (2 Nos.)
2.	Tension Clamp with Keeper (3-Bolted type)	Alu. Alloy.	1 pair.
3.	"U" Bolt with 2 No. Nuts (M 12)	M.S. Electro Galvanized.	3 pairs.
4.	Bolt & Nut (M 16X145)	M.S. Electro Galvanized.	1 no.
5.	Rivets (M 16)	M.S. Electro Galvanized.	1 no.
6.	Plain Washers (M 16)	M.S. Electro Galvanized.	1 no.
7.	Spring Washer (M 16)	M.S. Electro Galvanized.	1 no.
8.	Plain Washers (M 12)	M.S. Electro Galvanized.	6 nos.
9.	Spring Washer (M 12)	M.S. Electro Galvanized.	6 nos.
10.	Split Pins	S.S	2 nos.
11.	Type of Disc Hardware Fittings	T&C Type.	
12.	Hardware Fittings suitable for conductor	ACSR 'RACCOON' Conductor	
13.	Minimum Failing Load of Al. Clamp :	45 KN	
14.	Tolerance on Dimensions	± 5%.	
15.	Applicable Standard:	IS : 2486 amended upto date.	

"APPROVED"

⊗ All tests certificates to be submitted alongwith supply.

[Signature]
DM (T&C Circle)
PP&D, APDCL


Date : 19.05.2026

[Signature]
AGM (T&C Circle)
PP&D, APDCL

[Signature]
DM (T&C Circle)
PP&D, APDCL



M/s. R.H. Electrical Works
Howrah (W.B)



TECHNICAL DATA :



1. HW Fittings suitable for Disc Insulator (T&C Type) and shall conform to IS: 2486 (Part-I & II).
2. U.T.S of Hardware Fittings : 45 KN.
3. Slip Strength of Al. Clamp assembly : 95 % of U.T.S of Conductor.
4. All Ferrous parts are Hot Dip Galvanized conforming to IS: 6745/1972, IS: 7633 with amendments. Spring washers are Electro-Galvanized as per IS: 1573/1986 with amendments.
5. Clamp is suitable for ACSRI/AAAC RACCOON Conductor.
6. Disc Insulators (T&C Type) are not in scope of supply.
7. Marking on Al. Tension Clamp : "RJC".
8. All Dimensions are in mm.
9. General Tolerance on Dimensions & Weight : $\pm 5\%$.

"APPROVED"

DM (T&C Circle)
PP&D, APDCL

BGM (T&C Circle)
PP&D, APDCL

AGM (T&C Circle)
PP&D, APDCL

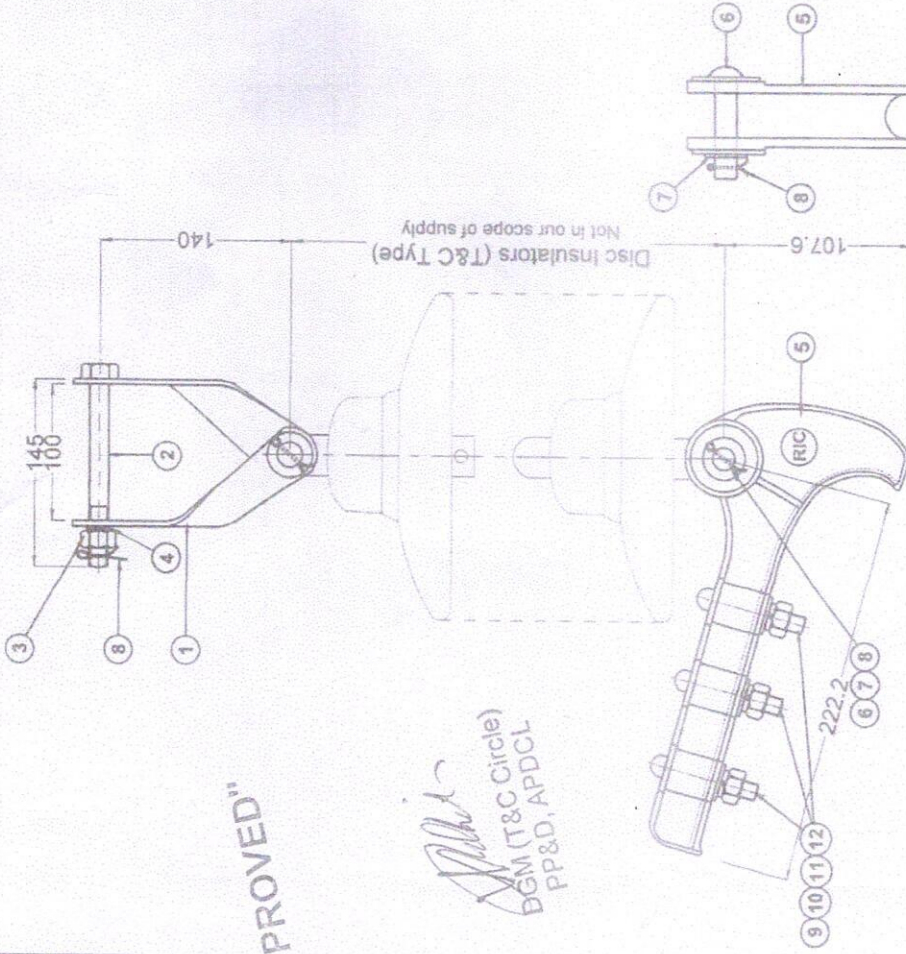


BILL OF MATERIALS

S.N.	DESCRIPTION	QTY.	MATERIAL
1.	CROSS-ARM STRAPS : 35X5 MM	1 PAIR	MILD STEEL H.D.G
2.	HEXAGONAL BOLT : M16X145	1 NO.	MILD STEEL H.D.G
3.	HEX NUT : M16	1 NO.	MILD STEEL H.D.G
4.	SP. WASHER : M16	1 NO.	SP. STEEL E.G.
5.	TENSION CLAMP (Body with Keeper)	1 NO.	ALUMINIUM ALLOY
6.	RVET : 16 MM	1 NO.	MILD STEEL HDG
7.	PLAIN WASHER : M16	1 NO.	MILD STEEL HDG
8.	SPLIT PIN	2 NO.	STAINLESS STEEL
9.	U-BOLT : M16	3 NO.	MILD STEEL H.D.G
10.	HEX NUT : M12	6 NO.	MILD STEEL H.D.G
11.	PLAIN WASHER : M12	6 NO.	MILD STEEL H.D.G
12.	SP. WASHER : M12	6 NO.	SP. STEEL E.G.

Owner :	ASSAM POWER DISTRIBUTION COMPANY LIMITED
NAME OF PROJECT :	BONGAIGOAN MEDICAL COLLEGE
LOA No. :	CGM (D&S) /APDCL /JAG/ Bongaigaon Medical college/2025-26/ 38, Date:13.05.2026
Name of Contractor :	M/s. U.K. Enterprise, Dispur, Guwahati.
Manufacturer :	R.H. ELECTRICAL WORKS
Drawing Title :	11KV TENSION HW FITTINGS for ACSRI/AAAC RACCOON Conductor
Drawing No. :	IT&C-1488
Drawn By :	Chak. & Approved By :
Sheet No. :	A4
Scale :	1 OF 1
Date :	10.05.26
Rev. No. :	Rev. 1





R.H. ELECTRICAL WORKS

AN ISO 9001 : 2015 ISO 45001 : 2018 ISO 14001 : 2015

Mfg cum supplier of: HT & LT Overhead Transmission and Distribution Line Materials

Office-Cum-Factory : Kantalia Industrial Complex, Vill : Danshi, P.O. : Nibra,

P.S. : Domjur, Salap, Howrah - 711409

GSTIN : 19ACFPH9960F1ZB + E-mail: rhelect92@gmail.com + Mob: 9051459149 / 9874584815


Owner	 ASSAM POWER DISTRIBUTION COMPANY LIMITED.
NAME OF PROJECT	BONGAIGOAN MEDICAL COLLEGE
LOA No	CGM (D&S) /APDCL /LAR/ Bongaigaon Medical college/2025-26/ 38, Date:13.05.2026
Contractor	M/s. U.K.Enterprise, Dispur, Guwahati.
Manufacturer	M/s. R.H. Electrical Works, Howrah (W.B)
Title	45 KN T&C Type tension disc H/W Fittings for Raccoon
Drawing No.	RHEW/45KVT&CHWFORRACCOON/26-27/33

Guaranteed Particular Technical of 45 KN T&C Type Hardware Fitting

Sl. No.	Technical Parameter	Offered value
1	Type	T&C (Two Bolted)
2	Ultimate Strength	45 KN
3	Suitable for conductor Size	ACSR Conductor / as required or equivalent AAAC. (Rabbit)
4	Slip strength of tension clamp	95% of UTS
5	Referred IS Standard	IS 2486
6	Material Used	
a)	Cross Arm Strap	Mild Steel (HDG)
b)	Bolted Type Tension Clamp	Aluminum Alloy
c)	Split Pin	Stainless steel
d)	Bolt	Mild Steel (HDG)
e)	Nut	Mild Steel (HDG)
f)	Spring Washer	Electro-galvanized
g)	Plain Washer	Mild Steel (HDG)
h)	Size of U Bolt	M12
7	Galvanizing	AS per IS
8	Tolerance	± 5%

⊗ All tests certificates to be submitted along with supply.

"APPROVED"



Date : 19-05-2026

M/s. R.H. Electrical Works
Howrah (W.B)

DM (T&C Circle)
PP&D, APDCL

AGM (T&C Circle)
PP&D, APDCL


DGM (T&C Circle)
PP&D, APDCL



NOTES:


1. Disc H/W Fitting Shall conform to IS : 2486
2. Disc H/W Fitting suitable for ACSR RACCOON Conductor/ as required or equivalent AAAC.
3. All Ferrous parts are Hot-Dip - Galvanized (HDG) & Sp Washer are Electro Galvanized.
4. Ultimate Strength : 45 KN.
5. Sleep Strength of Tension Clamp : 95% of UTS of respective Conductor.
6. All Dimension are in mm.
7. General Tolerance on Dimensions $\pm 5\%$

AGM (T&C Circle)
PP&D, APDCL

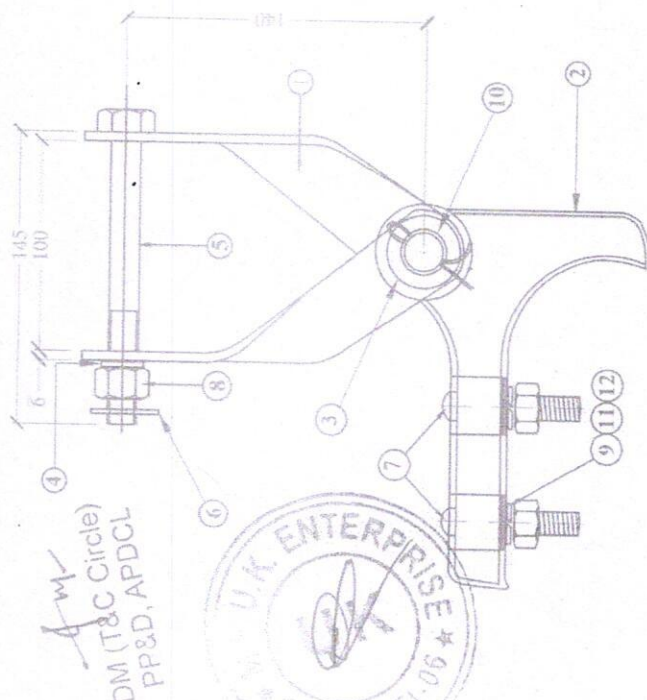

"APPROVED"

AGM (T&C Circle)
PP&D, APDCL

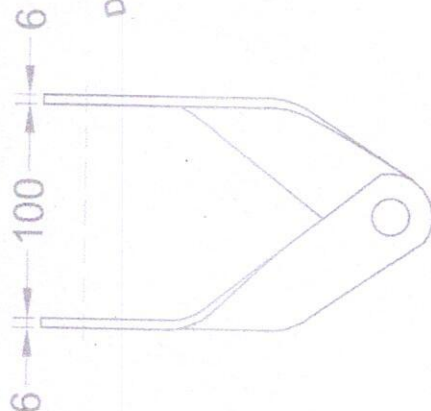

CROSS STRAPS

BILL OF MATERIALS:

S.N.	DESCRIPTION	QTY.	MATERIAL
1.	CROSS-ARM STRAPS : 35X6MM	1 Pair	MILD STEEL HDG
2.	TENSION CLAMP(2 - 'U' BOLTED TYPE)	1 NO.	ALU. ALLOY
3.	PLAIN WASHER : M16	1 NO.	MILD STEEL HDG
4.	SP WASHER : M16	1 NO.	MILD STEEL (EG)
5.	HEXAGONAL BOLT : M16X145	1 NO.	MILD STEEL HDG
6.	SPLIT PIN	2 NO.	SS
7.	U - BOLT : M12	2 NO.	MILD STEEL HDG
8.	NUT : M16	1 NO.	MILD STEEL HDG
9.	NUT : M12	4 NO.	MILD STEEL HDG
10.	RIVET : M16	1 NO.	MILD STEEL HDG
11.	PLAIN WASHER : M12	4 NO.	MILD STEEL HDG
12.	SP WASHER : M12	4 NO.	MILD STEEL (EG)



TWO-BOLTED T&C TYPE TENSION DISC H/W FITTING

OWNER	ASSAM POWER DISTRIBUTION COMPANY LIMITED.
PROJECT	BONGAIGOAN MEDICAL COLLEGE
CLIENT	M/s. U.K. ENTERPRISE, Dispur, Guwahati
LOA No	CGM (D&S) /APDCL /LAR/ Bongaigaon Medical college/2025-26/ 38, Date:13.05.2026
MANUFACTURER	R.H. ELECTRICAL WORKS Office Cum Factory : Kanaila Industrial Complex, Howrah - 711409
TITLE	(45KV) 'T&C' Type tension disc H/W Fitting for RACCOON
DRG. NO.	RHEW/45KV T&C H/W FOR RACCOON/26-27/33 DATE: 19.05.2026

DRN. BY	NAME	SIGNATURE	DATE	REV. NO	REV. DT.	SHEET NO.	SHEET SIZE	ALL DIMENSIONS ARE IN MM.
CHKD. BY				00		1 OF 1	N.T.S	
APPVD. BY							A4	



R.H. ELECTRICAL WORKS

AN ISO 9001 : 2015 ISO 45001 : 2018 ISO 14001 : 2015

Mfg cum supplier of: HT & LT Overhead Transmission and Distribution Line Materials

Office-Cum-Factory : Kantalia Industrial Complex, Vill : Danshi, P.O. : Nibra,
P.S. : Domjur, Salap, Howrah - 711409

GSTIN : 19ACFPH9960F1ZB + E-mail: rhelect92@gmail.com + Mob: 9051459149 / 9874584815

Owner	 ASSAM POWER DISTRIBUTION COMPANY LIMITED.
NAME OF PROJECT	BONGAIGOAN MEDICAL COLLEGE
LOA No	CGM (D&S) /APDCL /LAR/ Bongaigaon Medical college/2025-26/ 38, Date:13.05.2026
Contractor	M/s. U.K. Enterprise, Dispur, Guwahati.
Manufacturer	M/s. R.H. Electrical Works, Howrah (W.B)
Title	G.I ANGLE CROSS ARM (50X50X6 MM) FOR CROSS BRACING
Drawing No.	RHEW/ANGLE50X50X6/26-27/34

GUARANTEED TECHNICAL PARTICULARS FOR G.I ANGLE CROSS ARM 50X50X6 MM FOR CROSS BRACING

S.N.	DESCRIPTION	PARTICULAR
1.	Item	GI Angle Cross Arm
2.	Size	50x50x6 mm
3.	Sectional weight	4.50 Kg per Mtr.
4.	Material	Mild Steel Angle
5.	Process	Hot Dip Galvanising
6.	Tolerance	As per $\pm 5\%$
7.	Length	As per requirement and approved drawing. (50x50x6 x 2200 mm for Bracing Belting - 2 Nos. and 50x50x6 x 2500 mm for Bracing "X" - 2 Nos.)
8.	Breath	50 mm
9.	Width	50 mm
10.	Thickness	6 mm
11.	Applicable Standard	IS : 2062
12.	Zinc Coating	86 Microns
13.	Galvanization Conformance	IS : 2629

"APPROVED"

* All tests certificates to be submitted along with supply

DM (T&C Circle)
PP&D, APDCL


Date : 19-05-2026

DM (T&C Circle)
PP&D, APDCL

DGM (T&C Circle)
PP&D, APDCL





M/s. R.H. Electrical Works
Howrah (W.B)



1. All Dimensions are in mm.
 2. General Tolerance : $\pm 5\%$.
 3. Material : Mild Steel Angle, conform to IS 2062 with latest amendments.
 4. Process : Hot Dip Galvanising, conform to IS 20633/IS 20639.
- Zinc Coating thickness - 86 Microns.



DM (T&C Circle)
PP&D, APDCL

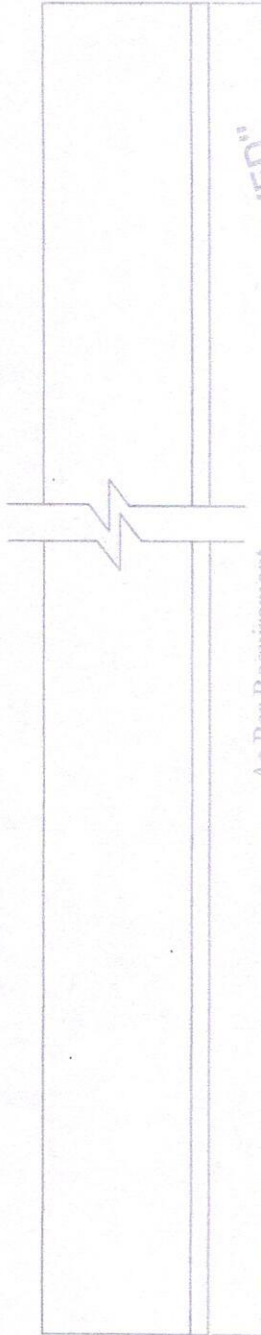

As Per Requirement

"APPROVED"




DM (T&C Circle)
PP&D, APDCL

DM (T&C Circle)
PP&D, APDCL



OWNER	ASSAM POWER DISTRIBUTION COMPANY LIMITED.
PROJECT	BONGAIGOAN MEDICAL COLLEGE
CLIENT	M/s. U.K. ENTERPRISE, Dispur, Guwahati
LOA No	CGM (D&S)/APDCL/LAB/Bongaigaon Medical college/2025-26/38, Date: 13.05.2026
MANUFACTURER	R. H. Electrical Works Office-Cum-Factory: Kantalia Industrial Complex, Howrah - 711409
TITLE	GI ANGLE CROSS ARM (50X50X6 MM) FOR CROSS BRACING
Checked By	Drawn By
A. Hussain	Prabhu Pal
Dwg. No.	Dwg. Date
19.05.2026	19.05.2026
Sheet No.	Sheet Size
1 OF 1	A4
Rev.	Rev.
1	1



R.H. ELECTRICAL WORKS

AN ISO 9001 : 2015 ISO 45001 : 2018 ISO 14001 : 2015

Mfg cum supplier of: HT & LT Overhead Transmission and Distribution Line Materials

Office-Cum-Factory : Kantalia Industrial Complex, Vill : Danshi, P.O. : Nibra,

P.S. : Domjur, Salap, Howrah - 711409

GSTIN : 19ACFPH9960F1ZB + E-mail: rhelect92@gmail.com + Mob: 9061459149 / 9874584815

Owner	 ASSAM POWER DISTRIBUTION COMPANY LIMITED.
NAME OF PROJECT	BONGAIGOAN MEDICAL COLLEGE
LOA No	CGM (D&S) /APDCL /LAR/ Bongaigaon Medical college/2025-26/ 38, Date:13.05.2026
Contractor	M/s. U.K. Enterprise, Dispur, Guwahati.
Manufacturer	M/s. R.H. Electrical Works
TITLE	HT GALVANIZED STAY SET (20 MM DIA.)
DRAWING NO.	RHEW/HTGALVANIZINGSTAYSET20MM/26-27/27

G.T.P FOR HT GALVANIZED STAY SET (20 MM DIA.)

S.N.	PARAMETERS	OFFERED VALUE
1.	ANCHOR ROD :	
a.	Material	Mild Steel - Hot Dip Galvd.
b.	Diameter of Rod	20 mm.
c.	Length of Rod	1800 mm.
d.	Type of Head	Square head for locking with Anchor plate.
e.	Threaded Length	300 mm.
f.	Ratchet Nut	One (1 No).
2.	BOW :	
a.	Material	Mild Steel - H.D. Galvd.
b.	Diameter of Rod	16 mm.
c.	Overall length	450 mm
d.	Cross Head	Cast Iron - H.D. Galvd. both ends of bow rod are properly riveted with cross head.
3.	ANCHOR PLATE :	
a.	Material	Mild Steel Plate - Hot Dip Galvd.
b.	Dimension of plate	300X300 X 8 mm. thk.
c.	Hole size at the centre	22X22 mm Square hole.
4.	THIMBLE :	
a.	Material	Mild Steel Sheet - H.D. Galvd.
b.	Thickness of G.I. Sheet	1.5 mm. matching with bow.
5.	Surface Coating :	All parts of Stay Set are Hot-Dip galvanized as per IS: 2629.
6.	Minimum Failing Load :	4900 Kgf.
7.	General Tolerance.	± 5%.
8.	Applicable Standard :	IS : 2486 /as per I.S.


"APPROVED"

DGM (T&C Circle)
PP&D, APDCL

⊗ All tests certificates to be submitted alongwith supply

DM (T&C Circle)
PP&D, APDCL
Date : 19.05.2026

AGM (T&C Circle)
PP&D, APDCL



M/s. R.H. Electrical Works
Howrah (W.B)

Technical drawing of a bow for a boat, showing three parts:

- 1 ANCHOR ROD (200 X 1800 mm)**: A long rod with a diameter of 20 Ø. It has a total length of 1800 mm. The rod is shown with a cross-section of 200 mm width and 1800 mm length. The rod is secured with a nut and washer at one end.
- 2 DETAILS OF BOW**: A cross-section of the bow showing a central hole with a diameter of 16 Ø. The bow has a total width of 150 mm and a height of 20 mm. The central hole is labeled "16 Ø".
- 3 THIMBLE**: A small component with a diameter of 16 Ø. It has a total length of 22 mm and a central hole with a diameter of 1.5 mm. The thimble is shown with a cross-section of 16 Ø and a length of 22 mm.

Additional dimensions and labels:

- ANCHOR PLATE (100 X 500 X 6 mm)**: A rectangular plate with a width of 100 mm and a length of 500 mm. It has a central hole with a diameter of 16 Ø. The plate is shown with a cross-section of 6 mm thickness.
- CROSS HEAD**: A component with a diameter of 16 Ø. It has a total length of 20 mm and a central hole with a diameter of 16 Ø. The cross head is shown with a cross-section of 16 Ø and a length of 20 mm.
- Both ends are Riveted**: A label indicating that the bow is secured with rivets at both ends.
- MAX 20R**: A label indicating the maximum radius of the bow.
- 16 Ø**: A label indicating the diameter of the central hole in the bow.
- 20 Ø ROD**: A label indicating the diameter of the anchor rod.
- 150**: A dimension indicating the width of the bow.
- 20**: A dimension indicating the height of the bow.
- 22**: A dimension indicating the length of the thimble.
- 1.5**: A dimension indicating the diameter of the central hole in the thimble.
- 16 Ø**: A dimension indicating the diameter of the central hole in the cross head.
- 20**: A dimension indicating the length of the cross head.
- 100**: A dimension indicating the width of the anchor plate.
- 500**: A dimension indicating the length of the anchor plate.
- 6**: A dimension indicating the thickness of the anchor plate.
- 16 Ø**: A dimension indicating the diameter of the central hole in the anchor plate.
- 1800**: A dimension indicating the length of the anchor rod.
- 200**: A dimension indicating the width of the anchor rod.
- 1800**: A dimension indicating the length of the anchor rod.
- 200**: A dimension indicating the width of the anchor rod.

S.N.	DESCRIPTION	QTY.	MATERIAL
1.	ANCHOR ROD : 300 X 1000 overall length	1	M.S GALVD
2.	BOW : 100 Reduced Height riveted with C.I Cross Head	1	M.S GALVD
3.	THIMBLE : 1.5 thick	1	M.S GALVD
4.	ANCHOR PLATE : 300 X 300 X 6 thick	1	M.S GALVD
5.	CHECK NUT	1	M.S GALVD

OWNER	ASSAM POWER DISTRIBUTION COMPANY LIMITED.
PROJECT	BONGAIGOAN MEDICAL COLLEGE
CLIENT	M/s. U.K. ENTERPRISE, Dispur, Gauhati
LOA No	CGM (D&S) /APOCL /LAR/ Bongaigaon Medical college/2025-36/ 38, Date:13.05.2026
MANUFACTURER	R.H. ELECTRICAL WORKS Office-Cum Factory : Kantala Industrial Complex, Howrah - 711409
TITLE	HT GALVANIZING STAY SET (20 MM DIA)
DRG. NO	BHFW-HTGALVANIZINGSTAYSET/2026/26-27-27 DATE: 19.05.2026

NOTES:

- 1) All dimensions are in mm, unless otherwise mentioned.
- 2) All Dimensions are subject to Tolerance : $\pm 5\%$.
- 3) All M & S items shall be Hot-Dip Galvanized as per IS : 2620.
- 4) Minimum Failing Load : 4900 Kgt.

ASSLY. ORG. OF
HT STAY-SET

76

NEW HIGALVIZINGSTAYSETNOIN 767777

DATE: 19-05-2026



R.H. ELECTRICAL WORKS

AN ISO 9001 : 2015 ISO 45001 : 2018 ISO 14001 : 2015

Mfg cum supplier of: HT & LT Overhead Transmission and Distribution Line Materials


Office-Cum-Factory : Kantalia Industrial Complex, Vill : Danshi, P.O. : Nibra,
P.S. : Domjur, Salap, Howrah - 711409

GSTIN : 19ACFP9960F1ZB + E-mail: rhelect92@gmail.com + Mob: 9051459149 / 9874584815

Owner	 ASSAM POWER DISTRIBUTION COMPANY LIMITED.
NAME OF PROJECT	BONGAIGOAN MEDICAL COLLEGE
LOA No	CGM (D&S) /APDCL /LAR/ Bongaigaon Medical college/2025-26/ 38, Date:13.05.2026
Contractor	M/s. U.K. Enterprise, Dispur, Guwahati.
Manufacturer	M/s. R.H. Electrical Works
Title	33 KV DANGER BOARD
Drawing No.	RHEW/33KVDANGERBOARD/26-27/28

G.T.P FOR 33 KV DANGER BOARD		
S.N	PARAMETERS	OFFERED VALUE
1.	Material of Danger Plate	Mild Steel Sheet
2.	DIMENSIONS of Danger Plate :	
a.	Length	250 mm.
b.	Breadth	200 mm.
c.	Thickness	1.6 mm. (Finished)
3.	Colour & Finish	Back ground of Front side of Danger Plate is Vitreous enameled white and letters, figures and painting of skull and Bones in signal Red colour. The corners of the plate are rounded off. The plate is Weather Proof.
4.	Language	The letterings "DANGER", "VOLTS" & "33000" are in English and Assamese.
5.	Letterings	Dimensions of all letters and figures are as per drawing with proper spacing between them.
6.	General Tolerance	± 5 %.
7.	Reference Standard	IS: 2551-1982/T.S

⊗ All tests certificates to be submitted alongwith supply




DM (T&C Circle)
PP&D, APDCL

Date : 19-05-2026


AGM (T&C Circle)
PP&D, APDCL


DGM (T&C Circle)
PP&D, APDCL

M/s. R.H. Electrical Works
Howrah (W.B)



TECHNICAL DETAILS :

1. ALL DIMENSIONS ARE IN MM.
2. GENERAL TOLERANCE : $\pm 5\%$
3. CORNERS OF THE PLATE ARE ROUNDED OFF.
4. ALL LETTERINGS ARE CENTERLly SPACED.
5. SIZE OF THE PLATE : 250 MM X 200 MM.
6. MATERIAL : M.S SHEET - 1.6 MM THICK. (FINISHED).
7. LANGUAGE : ENGLISH & ASSAMESE.
8. BACK GROUND OF FRONT SIDE : ENAMELED WHITE. LETTERS, FIGURE & PAINTING OF SKULL AND CROSS BONES SHALL BE IN SIGNAL RED COLOUR.
9. STANDARD : AS PER IS: 2551:1982 OR THE LATEST VERSION.




"APPROVED"

DM (T&C Circle)
PP&D, APDCL

R. H. Electrical Works
Office Cum Factory : Kanihah Industrial Complex, Howrah - 711409



OWNER	ASSAM POWER DISTRIBUTION COMPANY LIMITED.
PROJECT	BONGAIGOAN MEDICAL COLLEGE
CONTRACTOR	M/s. U.K. Enterprise, Dispur, Guwahati.
LOA No	CGM (D&S)/APDCL/LAR/ Bongaigaon Medical college/2015-26/38, Date: 13.05.2026
MANUFACTURER	R. H. Electrical Works Office Cum Factory : Kanihah Industrial Complex, Howrah - 711409
TITLE	33 KV DANGER BOARD
Checked By	Drawn By
A. Hussain	Prabhu Pal
Drawing No.	
Page	Date
1	19.05.26
1 OF 1	



R.H. ELECTRICAL WORKS

AN ISO 9001 : 2015 ISO 45001 : 2018 ISO 14001 : 2015

Mfg cum supplier of: HT & LT Overhead Transmission and Distribution Line Materials

Office-Cum-Factory : Kantalia Industrial Complex, Vill : Danshi, P.O. : Nibra,
P.S. : Domjur, Salap, Howrah - 711409

GSTIN : 19ACFPH9960F1ZB + E-mail: rhelect92@gmail.com + Mob: 9051459149 / 9874584815

Owner	 ASSAM POWER DISTRIBUTION COMPANY LIMITED.
NAME OF PROJECT	BONGAIGOAN MEDICAL COLLEGE
LOA No	CGM (D&S) /APDCL /LAR/ Bongaigaon Medical college/2025-26/ 38, Date:13.05.2026
Contractor	M/s. U.K. Enterprise, Dispur, Guwahati.
Manufacturer	M/s. R.H. Electrical Works, Howrah (W.B)
Title	HEXAGONAL BOLT, HEXAGONAL NUT, PLAIN WASHER, SPRING WASHER, FOUNDATION BOLT : M25X825, FOUNDATION BOLT : M 16X525
Drawing No.	RHEW/HEX NUT/26-27/25, RHEW/HEX BOLT/26-27/26

GUARANTEED TECHNICAL PARTICULARS FOR HEXAGONAL BOLT, HEXAGONAL NUT, PLAIN WASHER, SPRING WASHER, FOUNDATION BOLT : M25X825, FOUNDATION BOLT : M 16X525	
1. Specifications & Application Dimension Standards	
a. Bolts	: IS 1363 Part 1 & 2 : 2002 / IS 12427
b. Nuts	: IS 1363 Part 3: 1992 / IS 14394: 1996
c. Spring washer	: IS 3063: 1994
d. Flat Washer	: IS 2016: 1967
2. Tolerances	: IS 1367 Part 2: 2002
3. Raw Material	
a. For Bolts, Nuts	: IS 1367 Part 3: 2002, IS 1367 Part 6: 1994
b. For Plain Washer	: Carbon Steel
c. Spring Washers	: IS 4072 : 1975
4. Chemical Composition	
a. For Bolts & Nuts (Class 5.6)	
Carbon	: 0.13% - 0.55%
Phosphorus (Max)	: 0.05%
Sulphur (Max)	: 0.060%
5. Mechanical Properties	
a) For Bolts (IS: 1367 Part III - 2002) (Class 5.6)	
i. Tensile Strength (Min)	: 500 N/mm ²
ii. Stress under proof load (Min)	: 280 N/mm ²
iii. Hardness HRB (Min)	: 79 HRB
iv. Elongation after fracture (%Min)	: 20%
v. Strength under wedge load (Min)	: 500 N/mm ²
vi. Head soundness test	: No fracture
b) For Hex Nuts (IS: 1367-1994 part VI and 14394-1996) (Class 5)	
i. Proof Load (Min)	: 500 N/mm ²
ii. Hardness HRB (Min.)	: 100 HRB
c) For Spring washers	
i. Hardness test	: IS 3063-1994
ii. Permanent set. Test	: IS 3063-1994
iii. Permanent load Test	: IS 3063-1994
iv. Twist test	: IS 3063-1994


"APPROVED"



DM (T&C Circle)
PP&D, APDCL

AGM (T&C Circle)
PP&D, APDCL

DGM (T&C Circle)
PP&D, APDCL



R.H. ELECTRICAL WORKS

AN ISO 9001 : 2015 ISO 45001 : 2018 ISO 14001 : 2015

Mfg cum supplier of: HT & LT Overhead Transmission and Distribution Line Materials

Office-Cum-Factory : Kantalia Industrial Complex, Vill : Danshi, P.O. : Nibra,

P.S. : Domjur, Salap, Howrah - 711409

GSTIN : 19ACFPH9960F1ZB + E-mail: rhelect92@gmail.com + Mob: 9051459149 / 9874584815

6. a) Hot Dip Galvanizing of Bolts & Nuts	: IS 1367 (part XIII) - 1983
i. Mass of coating (g/m ² min)	: 300 gm/m ² (min average)
ii. Coating thickness (mm-min)	: 73 microns (min average)
b) Hot Dip Galvanizing of P.washers	: IS 4759 - 1996
i. Mass of coating (g/m ² min)	: 460 gm/m ² (Under 5 mm but not less 2mm) : 340 gm/m ² (Under 2 mm but not less 1.2 mm)
ii. Coating thickness (mm-min)	: 66 microns
c) Electro- Galvanizing of S.washers	: IS 1573
i. Mass of coating (g/m ² min)	: 56 gm/m ²
ii. Coating thickness (mm-min)	: 8 microns
7. Sampling Procedure for bolts & nuts, washers	: IS 1367 Part - 17/IS: 6821 - 1973
8. Dimensional Particulars for Bolts	
Nuts, spring washers and Flat washers	: Bolt Nut S/W F/W
a. IS Standard	: IS:1363 IS:1363 IS:3063 IS:2016
b. Shank diameter (ds) 'mm'	: IS:1363 ----- ----- -----
c. Width across flat (s) 'mm'	: do do ----- -----
d. Width across corners (e) 'mm'	: do ----- ----- -----
e. Thickness of Bolt head (k) 'mm'	: do ----- ----- -----
f. Length of thread (b)	: do ----- ----- -----
g. Thread size of Nut (m) in mm	: IS 1363 : 1992
h. Spring washers d1, d2, b, s, h	: IS 3063 : 1994
i. Flat washers d1, D, s	: IS 2016 : 1967

⊕ All test certificates to be submitted along with supply

DM (T&C Circle)
PP&D, APDCL

Date : 19-05-2026

AGM (T&C Circle)
PP&D, APDCL




M/s. R.H. Electrical Works
Howrah (W.B)

DGM (T&C Circle)
PP&D, APDCL




Countersink at Start of Thread Permissible

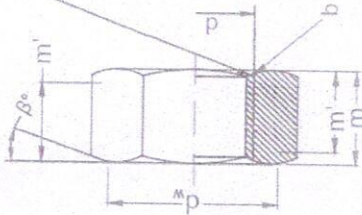

$\beta = 15^\circ \text{ To } 30^\circ$

HEX NUT

DM (T&C Circle)
PP&D, APDCL



S. No	THREAD SIZE	TOLL	M8	M10	M12	M16	M20
1.	PITCH		1.25	1.50	1.75	2.00	2.50
2.	A/F	MIN	12.57	15.57	17.57	23.16	29.16
		MAX	13.00	16.00	18.00	24.00	30.00
3.	A/C	MIN	14.20	17.59	19.85	26.17	32.95
4.	m	MIN	6.40	8.00	10.40	14.10	16.90
		MAX	7.90	9.50	12.20	15.90	19.00
5.	m ²	MIN	5.10	6.40	8.30	11.30	13.50
6.	d _w	MIN	11.50	14.50	16.50	22.00	27.70

1. s - Across Flat
2. c - Across Corner
3. m - Nut Thickness
4. m² - Wrenching Height
5. d_w - Bearing Face
6. Property Class - 5

DM (T&C Circle)
PP&D, APDCL

"APPROVED"

NOTES :

1. All Dimensions are in mm.
2. Specifications & Application Dimension Standards : As per IS 1363 Part 3-1992 / IS 14304-1996.
3. Tolerances : IS 1367 Part 2-2002
3. Raw Material : IS 1367 Part 3-2002, IS 1367 Part 6-1994
4. Finish : Hot Dip Galvanized conform to IS 1367 (Part XIII)-1983.
5. Zinc Coating thickness - 73 microns. (min average). Mass of coating - 300 gm/sq. m (min average)
5. For Full Thread Bolt Thread Length = Shank Length (b) = (l).

DRN BY
CHKD BY
APPVD BY

NAME
A. Hussain
A. Hussain

DATE
00

REV. NO.
00

REV. DT.
1 OF 1

SHEET NO.
A4

SCALE
N.T.S

SHEET SIZE
A4

ALL DIMENSIONS ARE
IN MM.

OWNER
ASSAM POWER DISTRIBUTION COMPANY LIMITED.

PROJECT
BONGAIGOAN MEDICAL COLLEGE

Name of Contractor:
M/s. U.K. Enterprise, Dispur, Guwahati.

LOA No
CGM (D&S)/APDCL /LAR/ Bongaigaon Medical college/2025-36/ 38,
Date : 13.05.2026


MANUFACTURER : R.H. ELECTRICAL WORKS

Office-Cum-Factory : Kantalla Industrial Complex, Howrah - 711409.

DRG. TITLE: HEXAGONAL NUT

DRG. NO. : RHEW/HEX NUT/26-27/25

DATE: 19.05.2026

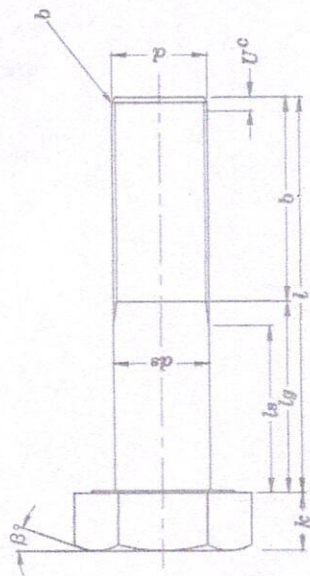

HEX BOLT

DM (T&C Circle)
PP&D, APDCL



For < 125 i.e. for length upto 125 mm.
For < 125 i.e. for length between 126 to 200 mm.
For < 200 i.e. for length above 200 mm.

"APPROVED"

DM (T&C Circle)
PP&D, APDCL

S. No	THREAD SIZE	TOLL	M8	M10	M12	M16	M20
1.	PITCH		1.25	1.50	1.75	2.00	2.50
2.	THREAD LENGTH (b) (MIN)	a	22.00	26.00	30.00	38.00	46.00
		b	28.00	32.00	36.00	44.00	52.00
		c	41.00	45.00	49.00	57.00	65.00
3.	SHANK DIA (Gs)	MIN	7.42	9.42	11.30	15.30	19.16
		MAX	8.58	10.58	12.70	16.70	20.84
4.	ACROSS CORNER (c)	MIN	14.20	17.59	19.85	26.17	32.95
5.	ACROSS FLAT (s)	MIN	12.57	15.57	17.57	23.16	29.16
		MAX	13.00	16.00	18.00	24.00	30.00
6.	HEAD THICKNESS (k)	MIN	4.92	5.95	7.05	9.25	11.60
		MAX	5.67	6.85	7.95	10.75	13.40

NOTES :

- All Dimensions are in mm.
- Specifications & Application Dimension Standards : As per IS 1363 Part 1 & 2-2002 / IS 12427
- Tolerances : IS 1367 Part 2-2002
- Raw Material : IS 1367 Part 3-2002, IS 1367 Part 6-1994.
- Surface finish : Hot Dip Galvanized conform to IS 1367 (Part XIII)-1983.
- Zinc Coating thickness - 73 microns. (min average). Mass of coating - 300 gm/sq. m (min average)
- For Full Thread Bolt Thread Length = Shank Length (b) = (l).

OWNER	ASSAM POWER DISTRIBUTION COMPANY LIMITED.
PROJECT	BONGAIGOAN MEDICAL COLLEGE
Name of Contractor:	M/s. U.K. Enterprise, Dispur, Guwahati.
LOA No	CGM (D&S) /APDCL /LAR/ Bongaigaon Medical college/2025-26/ 38, Date : 13.05.2026
MANUFACTURER :	R.H. ELECTRICAL WORKS
	Office-Cum-Factory : Kantalia Industrial Complex, Howrah - 711409.
DRG. TITLE:	HEXAGONAL BOLT
DRG. NO. :	RHW/HEX BOLT/26-27/26
	DATE : 19.05.26

ALL DIMENSIONS ARE
IN MM.

SHEET SIZE
A4

SCALE
N.T.S

SHEET NO.
1 OF 1

REV. NO.
00


DATE

SIGNATURE

NAME

CHKD. BY
A. Hussain

APPROD. BY
A. Hussain



R.H. ELECTRICAL WORKS

AN ISO 9001 : 2015 ISO 45001 : 2018 ISO 14001 : 2015

Mfg cum supplier of: HT & LT Overhead Transmission and Distribution Line Materials

Office-Cum-Factrory : Kantalia Industrial Complex,Vill : Danshi,P.O. : Nibra,


P.S. : Domjur, Salap, Howrah - 711409

GSTIN : 19ACFPH9960F1ZB + E-mail:rhelect92@gmail.com + Mob: 9051459149 / 9874584815

Owner	 ASSAM POWER DISTRIBUTION COMPANY LIMITED.
NAME OF PROJECT	BONGAIGOAN MEDICAL COLLEGE
LOA No	CGM (D&S) /APDCL /LAR/ Bongaigaon Medical college/2025-26/ 38, Date:13.05.2026
Contractor	M/s. U.K.Enterprise, Dispur, Guwahati.
Manufacturer	M/s. R.H. Electrical Works, Howrah (W.B)
Title	Pole Clamp (50x6)
Drawing No.	RHEW/POLECLAMP50X6/26-27/35

GUARANTEED TECHNICAL PARTICULARS FOR POLE CLAMP (50X6)		
S. N.	DESCRIPTION	PARTICULAR
1.	Item	Pole Clamp (50X6 mm)
2.	Size	50x6 mm
3.	Sectional weight	2.24 Kg per Mtr.
4.	Material	Mild Steel ss per IS 2062:2011
5.	Process	Hot Dip Galvanized
6.	Tolerance	IS-1852
7.	Width	50 mm
8.	Thickness	6 mm
9.	Holes Specification	18mm Ø
10.	Clamp Centre to Center Distance for Top	230 mm
11.	Clamp Centre to Center Distance for Middle	256 mm
12.	Clamp Centre to Center Distance for Bottom	290 mm
13.	Applicable Standard	IS : 2062
14.	Zinc Coating	85 Microns
15.	Galvanization Conformance	IS : 2629

⊗ All test certificates to be submitted alongwith supply.


DM (T&C Circle)
PP&D, APDCL


Date: 19-05-2026


AGM (T&C Circle)
PP&D, APDCL


DGM (T&C Circle)
PP&D, APDCL

M/s. R.H. Electrical Works
Howrah (W.B)





AGM (T&C Circle)
PP&D, APDCL



DGM (T & C Circle)
PP&D, APDCL

Am.
DM (T&C Circle)
PP&D, APDCL



NOTES :

1. All Dimensions are in mm.
2. General Tolerance : $\pm 5\%$.
3. Material : Mild Steel Channel, conform to IS 2062 with latest amendments.
4. Process : Hot Dip Galvanized, conform to IS 2633, IS 2629, Zinc Coating thickness - 86 Microns



ASSAM POWER DISTRIBUTION COMPANY LIMITED,									
Owner		BONGAIGOAN MEDICAL COLLEGE							
NAME OF PROJECT		M/s. U. K. Enterprise, Dispur, Guwahati.							
Name of Contractor		CGM (D&S)/APDCL /LAR/ Bongaigaon Medical college/2025-26/ 38,							
LOA No.:		Date: 13.05.2026							
MANUFACTURER		R.H. ELECTRICAL WORKS							
DRG TITLE :		Office cum Factory : Kantalia Industrial Complex, Howrah - 711409							
DRG. NO :		POLE CLAMP (50N6)							
		REVIEW/POLE CLAMP/50N6/26-27/38							
		DATE : 19.05.2026							

NOTES :

- All Dimensions are in mm.
- General Tolerance : $\pm 5\%$.
- Material : Mild Steel Channel, conform to IS 2062 with latest amendments.
- Process : Hot Dip Galvanized, conform to IS 2633, IS 2629, Zinc Coating thickness - 86 Microns.

NAME	SIGNATURE	DATE	REV. NO	REV. DT	SHEET NO	SCALE	SHEET SIZE
DRN BY							
CHKD BY	A. Hussain		00		1 OF 1	N.T.S 	A4
APPRVD BY	A. Hussain						

ALL DIMENSIONS ARE IN MM.



M/S. U.K. ENTERPRISE

Govt. Approved (Class I) Contractor ,

Deals with all Electrical, Civil works & Consultant

UDYAM REGISTRATION NO. UDYAM-AS-03-0005077

Dr. R.P. Road, Dispur, Guwahati-781006, Ph.98643-46349,90853-90161 Email: babultalukdar@gmail.com

No. UKE/ BMC /2026-27/ 76

Date 21.05.2026

To

The Chief General Manager(D&S)
APDCL (LAR), Bijulee Bhawan ,
Paltan Bazar , Guwahati -1

Sub:- Approval of GTP & Drawing

Ref:- LOA No. CGM(D&S)/APDCL/LAR/Bongaigaon Medical College /2025-26/38
Dt. 13.05.2026

Sir,

With reference to the above , we have the honour to forward herewith the GTP and Drawing of the following materials for favour of according necessary approval from your end .


The details are as follows :-

Sl. No.	Item description	Name & Address of Manufacturer	Contact Person	Remarks
1	11 KV Disc insulator , 70 KN, T&C (Poly)	M/S. Jainco Transmission Limited , 70, Diamond harbor Road , Kolkata-700023	Mr. Rahul Amin, Mobile No. 6297613371	
2	11KV Pin insulator			
3	33 KV Pin Insulator			
4	ACSR Raccoon	M/S. Jainco Power Limited , Howrah (W.B) PIN-711411		
5	ACSR Wolf			

The above materials will be utilised for Construction of 33kV Dedicated Medical College Feeder from 132/33kV Dhaligaon GSS to the premises of the Bongaigaon Medical College, Majgaon and associated work under Bongaigaon ESD-I under Deposit Work Scheme

Thanking you in anticipation and assuring our best service in future .

Encl. : As above

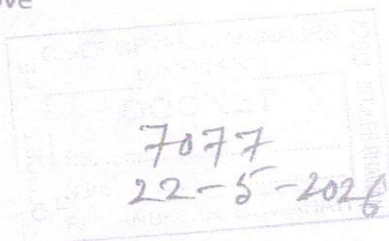



ISO : 9001

JAINCO
TRANSMISSION LIMITED

Manufacturers & Exporter of

TRANSMISSION & POLE LINE HARDWARE FITTINGS & FASTENERS

Office: 70, Diamond Harbour Road, Kolkata - 700 023

Phone : + 91 (33) 2449 5410/5893, 3292 0742

Fax : + 91 (33) 2449 5410

Materials	11KV, 70KN, COMPOSITE POLYMER DISC INSULATOR (T&C Type)	
Approving Authority	Assam Power Distribution Company Limited	
Client	M/s. U.K.Enterprises, Guwahati-6	
Project	Bongai gaon Medical College.	
LOA No.		
MANUFACTRER	M/s. Jainco Transmission Limited, Howrah -711411	
GUARANTEED TECHNICAL PARTICULARS OF 11KV, 70KN, POLYMER DISC INSULATOR (T&C Type)		
S. No.	Parameter (Description)	Offered
1	Name of Manufacturer	M/s. Jainco Transmission Limited, Howrah -711411
2	Address	
a)	Registered Office	Dhanshree Towers 70, Diamond Harbour Road, Suit No. 3B & 3C, Kolkata - 700 023, INDIA.
b)	Factory	Jalan Complex, Gate No. 1, Lane No. 7, Jangalpur, Bombay Road (NH6) Howrah - 711 411, INDIA
3	Type of Insulators	Composite Polymeric Insulator
4	Standard according to which insulators are manufactured & tested	IEC 61109 - 2008
5	Name of material used in manufacture of the Insulator	
a)	Material of core rod (FRP) i) E-Glass or ECR-glass ii) Boron Content	ECR-glass fiber, Boron Free
b)	Material of housing & weather sheds (silicon content by weight) i) Housing ii) Weather Sheds	Silicon Rubber Silicon Alloy Compound of Thickness 3mm. Silicon rubber-yin 30% Silicon Content by weight
c)	Type Material of end fittings	Tongue & Clevis Type Hot dip galvanized spheroidal graphite cast iron
d)	Sealing compound for end fittings	RTV Silicon Sealant
6	Colour Glaze of Insulator	Gray/Light Grey
7	Electrical characteristics :	
a)	Nominal system voltage (kVrms)	11
b)	Highest system voltage ((kVrms)	12
c)	Dry Power frequency withstand voltage (kVrms)	70

DM (T&C Circle)
PP&D, APDCL

AGM (T&C Circle)
PP&D, APDCL

DGM (T&C Circle)
PP&D, APDCL





JAINCO

Manufacturers & Exporters of:
TRANSMISSION POLE LINE HARDWARE FITTINGS & PARTS
Office: 70, Diamond Harbour Road, Kolkata - 700 023
Phone: -- 91 (33) 2449 5410/5893, 3282 0742
Fax: -- 91 (33) 2449 5410

d)	Wet power frequency withstand voltage (kVrms)	40
e)	Dry Power frequency flashover voltage (kVrms)	75
f)	Wet Power frequency flash over voltage (kVrms)	45
Dry lighting impulse withstand voltage		
g)	i) Positive (kV peak)	110
	ii) Negative (kV peak)	110
Dry lighting impulse flashover voltage		
h)	i) Positive (kV peak)	120
	ii) Negative (kV peak)	130
i)	RIV at 1 Mhz when energized at 10kV/30kV (rms) under dry condition (microvolts)	Less than 100 micro volts
j)	Creepage Distance Min. (mm)	320
k)	Visible discharge voltage kV (rms)	9
8	Mechanical failing load KN	70
9	Dimensions:	
a)	Diameter of FRP Rod (mm)	16 ± 2.14MM
b)	Length of FRP Rod (mm)	200 ± 10%
c)	Diameter of weather sheds (mm)	95 ± 5.5mm
d)	Thickness of Housing (mm)	3
e)	Min. Dry Arc Distance (mm)	160
f)	Weight of Insulator	0.700 Kg. ± 10%
10	Dimensioned drawing of insulator (including weight with tolerance in weight) enclosed	Yes
11	Method of fixing of sheds to housing: Single mould or modular construction (injection moulding/compression moulding)	Single injection Moulding
12	No. of weather threads	3
13	Type of Sheds	
a)	Aerodynamics	Yes, Aerodynamics
b)	With under Ribs	No
14	Center to Center distance between Tonge & Clevis	300mm
15	Packing Details: of Packing No. of Insulator in each pack Gross weight of each pack	Type Wooden Crates/Corrugated Boxes Min 12 max, 40 Nos. of Insulators in each pack ≤ 50 Kgs.
16	Marking	Each Insulator shall be marked with Manufacturer name, 11kV, 45kN, Month, year, APDCL, RDSS
17	Tolerance	As Per IEC 61109 - 2008

④ All tests certificates to be submitted along with supply.
Note: One 10mm Ring or 20mm thick spot of suitable quality of this paint shall be marked on end fitting of each composite long rod i.e. for 11kV 70kN Long rod unit with Red color

DM (T&C Circle)
PP&D, APDCL

AGM (T&C Circle)
PP&D, APDCL

DGM (T&C Circle)
PP&D, APDCL



Factory: Unit - I, Howrah, Andra Road (Near Industrial Estate, Bank, & Howrah) - 711 402

Phone: 2653 8730, 2653 4731 • Fax: 2653 4731


Unit - II, Jalan Corridor, Gate No. 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38, 39, 40, 41, 42, 43, 44, 45, 46, 47, 48, 49, 50, 51, 52, 53, 54, 55, 56, 57, 58, 59, 60, 61, 62, 63, 64, 65, 66, 67, 68, 69, 70, 71, 72, 73, 74, 75, 76, 77, 78, 79, 80, 81, 82, 83, 84, 85, 86, 87, 88, 89, 90, 91, 92, 93, 94, 95, 96, 97, 98, 99, 100, 101, 102, 103, 104, 105, 106, 107, 108, 109, 110, 111, 112, 113, 114, 115, 116, 117, 118, 119, 120, 121, 122, 123, 124, 125, 126, 127, 128, 129, 130, 131, 132, 133, 134, 135, 136, 137, 138, 139, 140, 141, 142, 143, 144, 145, 146, 147, 148, 149, 150, 151, 152, 153, 154, 155, 156, 157, 158, 159, 160, 161, 162, 163, 164, 165, 166, 167, 168, 169, 170, 171, 172, 173, 174, 175, 176, 177, 178, 179, 180, 181, 182, 183, 184, 185, 186, 187, 188, 189, 190, 191, 192, 193, 194, 195, 196, 197, 198, 199, 200, 201, 202, 203, 204, 205, 206, 207, 208, 209, 210, 211, 212, 213, 214, 215, 216, 217, 218, 219, 220, 221, 222, 223, 224, 225, 226, 227, 228, 229, 230, 231, 232, 233, 234, 235, 236, 237, 238, 239, 240, 241, 242, 243, 244, 245, 246, 247, 248, 249, 250, 251, 252, 253, 254, 255, 256, 257, 258, 259, 260, 261, 262, 263, 264, 265, 266, 267, 268, 269, 270, 271, 272, 273, 274, 275, 276, 277, 278, 279, 280, 281, 282, 283, 284, 285, 286, 287, 288, 289, 290, 291, 292, 293, 294, 295, 296, 297, 298, 299, 300, 301, 302, 303, 304, 305, 306, 307, 308, 309, 310, 311, 312, 313, 314, 315, 316, 317, 318, 319, 320, 321, 322, 323, 324, 325, 326, 327, 328, 329, 330, 331, 332, 333, 334, 335, 336, 337, 338, 339, 340, 341, 342, 343, 344, 345, 346, 347, 348, 349, 350, 351, 352, 353, 354, 355, 356, 357, 358, 359, 360, 361, 362, 363, 364, 365, 366, 367, 368, 369, 370, 371, 372, 373, 374, 375, 376, 377, 378, 379, 380, 381, 382, 383, 384, 385, 386, 387, 388, 389, 390, 391, 392, 393, 394, 395, 396, 397, 398, 399, 400, 401, 402, 403, 404, 405, 406, 407, 408, 409, 410, 411, 412, 413, 414, 415, 416, 417, 418, 419, 420, 421, 422, 423, 424, 425, 426, 427, 428, 429, 430, 431, 432, 433, 434, 435, 436, 437, 438, 439, 440, 441, 442, 443, 444, 445, 446, 447, 448, 449, 450, 451, 452, 453, 454, 455, 456, 457, 458, 459, 460, 461, 462, 463, 464, 465, 466, 467, 468, 469, 470, 471, 472, 473, 474, 475, 476, 477, 478, 479, 480, 481, 482, 483, 484, 485, 486, 487, 488, 489, 490, 491, 492, 493, 494, 495, 496, 497, 498, 499, 500, 501, 502, 503, 504, 505, 506, 507, 508, 509, 510, 511, 512, 513, 514, 515, 516, 517, 518, 519, 520, 521, 522, 523, 524, 525, 526, 527, 528, 529, 530, 531, 532, 533, 534, 535, 536, 537, 538, 539, 540, 541, 542, 543, 544, 545, 546, 547, 548, 549, 550, 551, 552, 553, 554, 555, 556, 557, 558, 559, 560, 561, 562, 563, 564, 565, 566, 567, 568, 569, 570, 571, 572, 573, 574, 575, 576, 577, 578, 579, 580, 581, 582, 583, 584, 585, 586, 587, 588, 589, 590, 591, 592, 593, 594, 595, 596, 597, 598, 599, 600, 601, 602, 603, 604, 605, 606, 607, 608, 609, 610, 611, 612, 613, 614, 615, 616, 617, 618, 619, 620, 621, 622, 623, 624, 625, 626, 627, 628, 629, 630, 631, 632, 633, 634, 635, 636, 637, 638, 639, 640, 641, 642, 643, 644, 645, 646, 647, 648, 649, 650, 651, 652, 653, 654, 655, 656, 657, 658, 659, 660, 661, 662, 663, 664, 665, 666, 667, 668, 669, 670, 671, 672, 673, 674, 675, 676, 677, 678, 679, 680, 681, 682, 683, 684, 685, 686, 687, 688, 689, 690, 691, 692, 693, 694, 695, 696, 697, 698, 699, 700, 701, 702, 703, 704, 705, 706, 707, 708, 709, 710, 711, 712, 713, 714, 715, 716, 717, 718, 719, 720, 721, 722, 723, 724, 725, 726, 727, 728, 729, 730, 731, 732, 733, 734, 735, 736, 737, 738, 739, 740, 741, 742, 743, 744, 745, 746, 747, 748, 749, 750, 751, 752, 753, 754, 755, 756, 757, 758, 759, 760, 761, 762, 763, 764, 765, 766, 767, 768, 769, 770, 771, 772, 773, 774, 775, 776, 777, 778, 779, 780, 781, 782, 783, 784, 785, 786, 787, 788, 789, 790, 791, 792, 793, 794, 795, 796, 797, 798, 799, 800, 801, 802, 803, 804, 805, 806, 807, 808, 809, 810, 811, 812, 813, 814, 815, 816, 817, 818, 819, 820, 821, 822, 823, 824, 825, 826, 827, 828, 829, 830, 831, 832, 833, 834, 835, 836, 837, 838, 839, 840, 841, 842, 843, 844, 845, 846, 847, 848, 849, 850, 851, 852, 853, 854, 855, 856, 857, 858, 859, 860, 861, 862, 863, 864, 865, 866, 867, 868, 869, 870, 871, 872, 873, 874, 875, 876, 877, 878, 879, 880, 881, 882, 883, 884, 885, 886, 887, 888, 889, 890, 891, 892, 893, 894, 895, 896, 897, 898, 899, 900, 901, 902, 903, 904, 905, 906, 907, 908, 909, 910, 911, 912, 913, 914, 915, 916, 917, 918, 919, 920, 921, 922, 923, 924, 925, 926, 927, 928, 929, 930, 931, 932, 933, 934, 935, 936, 937, 938, 939, 940, 941, 942, 943, 944, 945, 946, 947, 948, 949, 950, 951, 952, 953, 954, 955, 956, 957, 958, 959, 960, 961, 962, 963, 964, 965, 966, 967, 968, 969, 970, 971, 972, 973, 974, 975, 976, 977, 978, 979, 980, 981, 982, 983, 984, 985, 986, 987, 988, 989, 990, 991, 992, 993, 994, 995, 996, 997, 998, 999, 1000



ISO : 9001

JAINCO

"APPROVED"

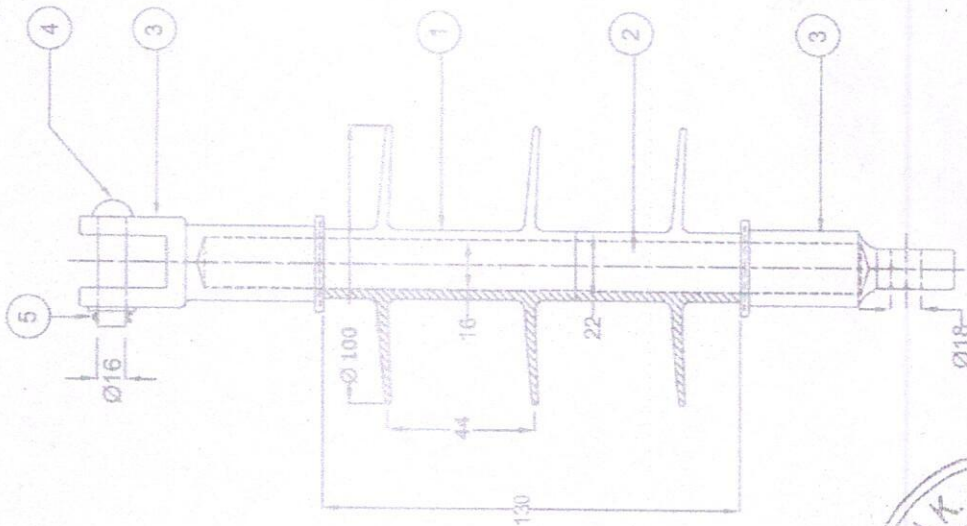

DM (T&C Circle)
PP&D, APDCL


TECHNICAL DATA :-

- 1) MECHANICAL CHARACTERISTICS
MECHANICAL LOAD - 70 KN
- 2) ELECTRICAL CHARACTERISTICS :-
 - (a) WET 1 MINUTE POWER FREQUENCY WITHSTAND VOLTAGE : 35 KV
 - (b) DRY LIGHTNING IMPULSE WITHSTAND VOLTAGE : 95 KV
 - (c) NORMAL SYSTEM VOLTAGE : 11 KV
 - (d) HIGHEST SYSTEM VOLTAGE : 12 KV
- 3) CREEPAGE DISTANCE : 320 MM (MIN.)
- 4) NO OF SHADES - 3 NOS.
- 5) STANDARD SPECIFICATION - IEC 61109
- 6) TOLERANCE AS PER IEC 61109 $\pm(0.04d + 1.5)$ mm WHEN $d \leq 300$ mm
 $\pm(0.025d + 6)$ mm WHEN $d > 300$ mm
- 7) ALL DIMENSION ARE IN MM.



Approving Authority	Assam Industrial Development Corporation Limited
Client	M/s. U.K. Enterprises, Guwahati-6
Project	RD55
JAINCO TRANSMISSION LTD. 70, DIAMOND HARBOUR ROAD, KOLKATA - 700 023 INDIA	11 KV-70 KN POLYMER DISC INSULATOR T&C TYPE
DRG. NO. JTL/PI/TC/11/003	DATE :- 14.04.26
REV :- 00	SCALE :- N.T.S
CODE NO :-	CHECKED :- A.B
DRAWN :- S.L	APPROVED :- P.GHOSH

FILE DEST - ENLHADRAWINGTYPE TEST DRAWINGFILE32



DM (T&C Circle)
PP&D, APDCL



JAINCO

Manufacturers & Exporters of
TRANSMISSION & POWER LINE HARDWARE FITTINGS & FASTENERS
Office: 70, Diamond Harbour Road, Kolkata - 700 023
Phone: ++ 91 (33) 2449 5410/5893, 3292 0742
Fax: ++ 91 (33) 2449 5410

Materials	11KV, 5KN, COMPOSITE POLYMER PIN INSULATOR		
Approving Authority	Assam Power Distribution Company Limited		
Client	M/s. U.K.Enterprises, Guwahati-6		
Project	Bongaigaon Medical College.		
LOA No.			
MANUFACTRER	M/s. Jainco Transmission Limited, Howrah -711411		
GUARANTEED TECHNICAL PARTICULARS OF 11KV, 05KN, COMPOSITE POLYMER PIN INSULATOR			
S. No.	Parameter (Description)	Offered	
1	Name of Manufacturer	M/s. Jainco Transmission Limited, Howrah -711411	
2	Address		
a)	Registered Office	Dhanshree Towers 70, Diamond Harbour Road, Suit No. 3B & 3C, Kolkata - 700 023, INDIA.	
b)	Factory	Jalan Complex, Gate No. 1, Lane No. 7, Jangalpur, Bombay Road (NH6) Howrah - 711 411, INDIA	
3	Type of Insulators	Composite Polymeric Insulator	
4	Standard according to which insulators are manufactured & tested	IEC 61109 - 2008	
5	Name of material used in manufacture of the Insulator	"APPROVED"  DGM (T&C Circle) PP&D, APDCL	
a)	Material of core rod (FRP) i)E-Glass or ECR-glass ii)Boron Content		ECR-glass fiber, Boron Free
b)	Material of housing & weather sheds (silicon content by weight) i)Housing ii)Weather Sheds		Silicon Rubber Silicon Content- Min 30% by weight
c)	Material of end fittings		Hot dip galvanized spheroidal graphite cast Iron
d)	Sealing compound for end fittings		RTV Silicon Sealant
6	Colour Glaze of Insulator	Gray/Light Grey	

DM (T&C Circle)
PP&D, APDCL

AGM (T&C Circle)
PP&D, APDCL





JAINCO

INSULATORS & HARDWARE

Manufacturers & Exporters of
PANSYMS OIL & POLYMER HARDWARE FITTINGS & FASTENERS
Office: 70, Diamond Harbour Road, Kolkata - 700 023
Phone: ++ 91 (33) 2449 5410/5893, 3292 0742
Fax: ++ 91 (33) 2449 5410

7	Electrical characteristics :	
a)	Nominal system voltage (kVrms)	11
b)	Highest system voltage ((kVrms)	12
c)	Dry Power frequency withstand voltage (kVrms)	70
d)	Wet power frequency withstand voltage (kVrms)	70
e)	Dry Power frequency flashover voltage (kVrms)	70
f)	Wet Power frequency flash over voltage (kVrms)	45
g)	Dry lighting impulse withstand voltage i) Positive (kV peak) ii) Negative (kV peak)	45 45
h)	Dry lighting impulse flashover voltage i) Positive (kV peak) ii) Negative (kV peak)	145 145
i)	RIV at 1 Mhz when energized at 10KV (rms) under dry condition (microvolts)	Less than 100 micro volts
j)	Creepage Distance Min. (mm)	320
8	Minimum Mechanical failing load KN	5
9	Dimensions:	
a)	Weight of Insulator	0.800 Kg. $\pm$ 10%
b)	Diameter of FRP Rod (mm)	20.5 $\pm$ 2.32MM
c)	Length of FRP Rod (mm)	185 $\pm$ 10%
d)	Diameter of weather sheds (mm)	100 $\pm$ 5.5mm
e)	Thickness of Housing (mm)	3
f)	Min. Dry Arc Distance (mm)	165
10	Dimensioned drawing of insulator (including weight with tolerance in weight) enclosed	Yes
11	Method of fixing of sheds to housing: Single mould or modular construction (injection moulding/compression moulding)	Single injection Moulding
12	No. of weather threads	3
13	Type of Sheds	
a)	Aerodynamics	Yes, Aerodynamics
b)	With under Ribs	No
14	Packing Details: Type of Packing No. of Insulator in each pack Gross weight of each pack	HDPE Bags/Corrugated Boxes Min 12 max. 40 Nos. of Insulators in each pack $\leq$ 50 Kgs.

"APPROVED"

DGM (T&C Circle)
PP&D, APDCL

⊗ All test certificates to be submitted alongwith supply

DM (T&C Circle)
PP&D, APDCL

AGM (T&C Circle)
PP&D, APDCL
Factory: Unit 4, Howrah Industrial Estate, Bankura Highway, T-1, 400
Phone: ++ 91 (33) 2449 5410/5893, 3292 0742
Unit 11, Jalar Co. Industrial Estate, Lane No. 7, Jangadpur, Bembay Road, NHEP, Howrah
Phone: ++ 91 (33) 2449 5410/5893, 3292 0742
Website: www.jainco.net





JAINCO

TRANSMISSION LIMITED

Manufacturers & Exporter of:
TRANSMISSION & POLE LINE HARDWARE FITTINGS & FASTNERS
Office : 70, Diamond Harbour Road, Kolkata - 700 023
Phone : ++ 91 (33) 2449 5410/5693, 3292 0742
Fax : ++ 91 (33) 2449 5410


Materials	33KV, 10KN, COMPOSITE POLYMER PIN INSULATOR	
Approving Authority	Assam Power Distribution Company Limited	
Client	M/s. U.K.Enterprises, Guwahati-6	
Project	Bongaigaon Medical College.	
LOA No.		
MANUFACTRER	M/s. Jainco Power Limited, Howrah -711411	
GUARANTEED TECHNICAL PARTICULARS OF 33KV, 10KN, COMPOSITE POLYMER PIN INSULATOR (T&C Type)		
S. No.	Parameter (Description)	Offered
1	Name of Manufacturer	M/s. Jainco Power Limited, Howrah -711411
2	Address	
a)	Registered Office	Dhanshree Towers 70, Diamond Harbour Road, Suit No. 3B & 3C, Kolkata - 700 023, INDIA.
b)	Factory	Jalan Complex, Gate No. 1, Lane No. 7, Jangalpur, Bombay Road (NH6) Howrah - 711 411, INDIA
3	Type of Insulators	Composite Polymeric Insulator
4	Standard according to which insulators are manufactured & tested	IEC 61109 - 2008
5	Name of material used in manufacture of the Insulator	
a)	Material of core rod (FRP) i)E-Glass or ECR -glass ii)Boron Content	ECR-glass fiber, Boron Free
b)	Material of housing & weather sheds (silicon content by weight) i)Housing ii)Weather Sheds	Silicon Rubber Silicon Content- Min 30% by weight
c)	Material of end fittings	Hot dip galvanized spheroidal graphite cast Iron
d)	Sealing compound for end fittings	RTV Silicon Sealant
6	Colour Glaze of Insulator	Gray/Light Grey
7	Electrical characteristics :	
a)	Nominal system voltage (kVrms)	33
b)	Highest system voltage ((kVrms)	36

"APPROVED"

DGM (T&C Circle)
PP&D, APDCL

DM (T&C Circle)
PP&D, APDCL

AGM (T&C Circle)
PP&D, APDCL



Factory : Unit - I : Howrah Amta Road (Makel Industrial Estate) Balrikuri, Howrah - 711 402
Phone : 2653 8700, 2653 4730 • Fax : 2653 4730
Unit - II : Jalan Complex Gate No-1, Lane No-7, Jangalpur, Bombay Road (NH6) Howrah
e-mail : jainco_surat@rediffmail.com • Website : www.jainco.net



ISO : 9001

JAINCO

TRANSMISSION LIMITED

Manufacturers & Exporter of:
TRANSMISSION & POLE LINE HARDWARE FITTINGS & FASTNERS
Office : 70, Diamond Harbour Road, Kolkata - 700 023
Phone : ++ 91 (33) 2449 5410/5893, 3292 0742
Fax : ++ 91 (33) 2449 5410

c)	Dry Power frequency withstand voltage (kVrms)	100
d)	Wet power frequency withstand voltage (kVrms)	80
e)	Dry Power frequency flashover voltage (kVrms)	>125
f)	Wet Power frequency flash over voltage (kVrms)	>90
g)	Dry lighting impulse withstand voltage i) Positive (kV peak) ii) Negative (kV peak)	185 185
h)	Dry lighting impulse flashover voltage i) Positive (kV peak) ii) Negative (kV peak)	190 190
i)	RIV at 1 Mhz when energized at 10kV/30kV (rms) under dry condition (microvolts)	Less than 100 micro volts
j)	Creepage Distance Min. (mm)	900
k)	Visible discharge voltage kV (rms)	27 kV
8	Minimum Mechanical failing load KN	10
9	Dimensions:	
a)	Weight of Insulator	2.5 Kg. $\pm$ 10%
b)	Diameter of FRP Rod (mm)	24 $\pm$ 2.14MM
c)	Length of FRP Rod (mm)	>390
d)	Diameter of weather sheds (mm)	100 $\pm$ 5.5mm
e)	Thickness of Housing (mm)	3
f)	Min. Dry Arc Distance (mm)	390
10	Dimensioned drawing of insulator (including weight with tolerance in weight) enclosed	Yes
11	Method of fixing of sheds to housing: Single mould or modular construction (injection moulding/compression moulding)	Single injection Moulding
12	No. of weather threads	8 Shed
13	Type of Sheds	
a)	Aerodynamics	Yes, Aerodynamics
b)	With under Ribs	No
14	Packing Details: Type of Packing No. of Insulator in each pack Gross weight of each pack	Wooden Crate/Corrugated Boxes Min 12 max, 40 Nos. of Insulators in each pack $\leq$ 50 Kgs.
15	Marking	Each Insulator shall be marked with Manufacturer name, 33kV, 10kN, Month, year, APDCL, RDSS

"APPROVED"

DGM (T&C Circle)
PP&D, APDCL

AGM (T&C Circle)
PP&D, APDCL

Note: One 10mm Ring or 20mm thick spot of suitable quality of this paint shall be marked on end fitting of each composite long rod i.e. for 33kV 10kN Long rod unit

At tests certificates to be submitted along with supply

Factory : Unit - I : Howrah Amta Road (Makel Industrial Estate) Ballikuri, Howrah - 711 402

Phone : 2653 8700, 2653 4730 • Fax : 2653 4730

Unit - II : Jalan Complex Gate No-7, Lane No-7, Jangalpur, Bombay Road (NH6), Howrah

e-mail : jainco_surana@vsnl.net • Website : www.jainco.net

DM (T&C Circle)
PP&D, APDCL





JAINCO



SL	ITEM DESCRIPTION	MATERIAL
1	HOUSING	SILICON RUBBER
2	CORE	FRP ROD
3	END FITTINGS	SGGI/MCI/FORGED STEEL
4	M24 NUT	MILD STEEL, HDG
5	M24 SPRING WASHER	SPRING STEEL, HDG/EG

APPROVED

AGM (T&C Circle)
PP8D, APDCL

DGM (T&C Circle)
PP8D, APDCL

TECHNICAL DATA :-

1) MECHANICAL CHARACTERISTICS
MECHANICAL LOAD - 10 KN

2) ELECTRICAL CHARACTERISTICS :-


(a) WET 1 MINUTE POWER FREQUENCY WITHSTAND VOLTAGE : 70 KV
(b) DRY LIGHTNING IMPULSE WITHSTAND VOLTAGE : 185 KV
(c) NORMAL SYSTEM VOLTAGE 33 KV
(d) HIGHEST SYSTEM VOLTAGE 36 KV

3) CREEPAGE DISTANCE : 900 MM (MIN.)
4) NO OF SHADES - 8 NOS.

5) STANDARD SPECIFICATION - IEC 61109
6) TOLERANCE: $\pm (0.04d + 1.5)mm$ WHEN $d < 300mm$

$\pm (0.025d + 6)mm$ WHEN $d > 300mm$

7) MARKING: CSPDCL / JTL / 10KN / M-Y
8) ALL DIMENSION ARE IN MM.

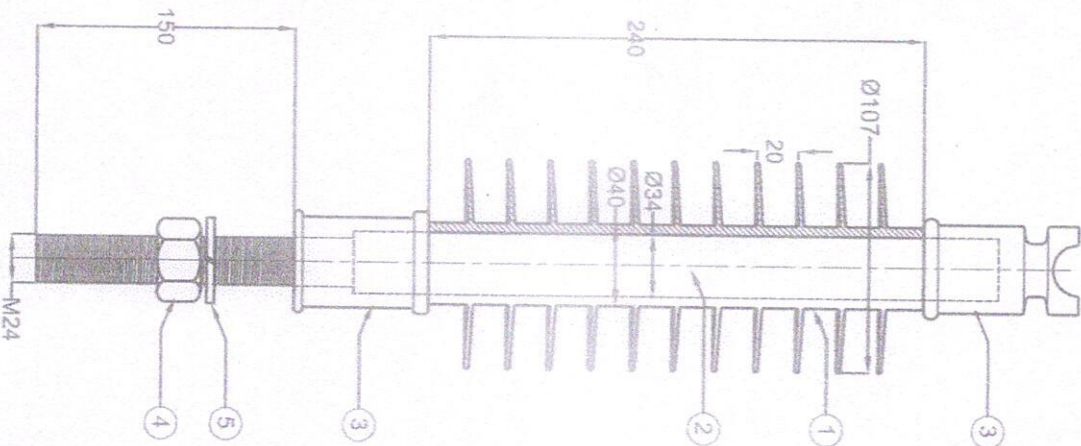

Approving Authority	Assam Industrial Development Corporation Limited
Client	M/s. UK Enterprises, Guwahati-6
Project	RDS

JAINCO TRANSMISSION LTD, 70, DIAMOND HARBOUR ROAD, KOLKATA - 700023 INDIA	33 KV COMPOSITE POLYMERIC PIN INSULATOR 10KN	GEN. TOLERANCE : $\pm 0.7mm$ OR 45% WHICHEVER IS GREATER
DRG. NO. JTL/PPIN/33/002A	DATE : 06.03.25	REV : 00
SCALE : N.T.S		



JAINCO POWER LIMITED

CIN : U40108WB2022PLC256813

Manufacturers & Exporter of

POWER CABLE & CONDUCTORS & ACCESSORIES

Office : Dhanshree Tower, 70, Diamond Harbour Road,

Room No. 3B, 3C & 3G, 3rd Floor, Kolkata - 700023, India

Phone : +91 (33) 2449 5410, 2449 5893

Email : sales@jainco.net, mktg@jainco.net

Website : www.jainco.net

Approving Authority		
Client	M/s. U.K.Enterprises, Guwahati-6	
Project	Bongaigaon Medical College.	
LOA No.		
MANUFACTRER	M/s. Jainco Power Limited, Howrah -711411	
Guaranteed Technical Particular		
SL No	Particulars	Conductors
1	Conductor Type & Designation	6/4.09 - 1/4.09 mm ASCR RACCOON CONDUCTOR
2	Maker's Name and address	JAINCO POWER LIMITED
	A. Aluminium Rods	NALCO/BALCO/HINDALCO,VEDANTA and other approved sources
	B. Steel Rods	Nirmal wires, Kritika wires, Hulas, Usha Martin, Bajarang wires and other BIS Approved sources
	C. Complete conductor	JAINCO POWER LIMITED
3	Particulars of Raw Materials	
3.1	Aluminium	
a)	Minimum purity of EC Grade Aluminium	99.5%(Min)
b)	Maximum Copper Content	0.04%(Max)
3.2	Steel Wires/Rods	
a)	Carbon	0.5% to 0.85%
b)	Manganese	0.5% to 1.1%
c)	Phosphorus	0.035% (Max)
d)	Sulphur	0.045% (Max)
e)	Silicon	0.1% to 0.35%
3.3	Zinc	
a)	Minimum purity of Zinc	99.95% as per IS 209
	Stranding & wire diameter	
	A. Aluminium	
	Normal	4.09
	Minimum	4.05
	Maximum	4.13
	B. Steel	
	Normal	4.09
	Minimum	4.01
	Maximum	4.17
5	Nominal Aluminium area in Sq.mm	80
6	Sectional area of Aluminium in Sq.mm	78.83
7	Total Sectional area in Sq.mm	91.97
8	Cross sectional area of Nominal Diameter wire in Sq.mm	
	A. Aluminium	13.14
	B. Steel	13.14
	C. Overall diameter of the conductor	12.27
9	Breaking load of conductor in KN	26.91

Factory : Jalan Complex, Gate No. 1, Lane No. 6, Jangalpur, Bombay Road (NH6), Howrah - 711411

DM (T&C Circle)
PP&D, APDCL

Celebrating 50 glorious years of JAINCO GROUP





JAINCO POWER LIMITED

CIN : U40108WB2022PLC256813

Manufacturers & Exporter of

POWER CABLE & CONDUCTORS & ACCESSORIES

Office : Dhanshree Tower, 70, Diamond Harbour Road,
Room No 3B, 3C & 3G, 3rd Floor, Kolkata - 700023, India

Phone : +91 (33) 2449 5410, 2449 5693

Email : sales@jainco.net, mktg@jainco.net

Website : www.jainco.net

10	Minimum Breaking load	
	Aluminium	
	Before Stranding	2.08
	After Stranding	1.98
	Steel	
	Before Stranding	17.27
11	After Stranding	16.4
	Zinc Coating of steel wire	
	Before Stranding	
	Uniformity of coating, Number & Duration of dips process test, withstood	1 Min 3 Dips 1/2 Min 1 Dip
	After Stranding	
	Uniformity of coating, Number & Duration of dips process test, withstood	1 Min 3 Dips 1/2 Min 1 Dip
12	Minimum weight of Coating Gm/Sq.mm	
	Before Stranding	275
	After Stranding	261.25
	Mass in KG per KM	
	A. Aluminium	216.52 (Approx.)
	B. Steel	102.48 (Approx.)
13	C. Conductor	319 (Approx.)
	Resistance in ohm per KM at 20° C	
	A. Aluminium	2.194
14	B. Conductor	0.3712
	Continuous maximum current rating of conductor (Amps. In still air at 45° C ambient temperatures) (Approx.)	249
	Modulus of elasticity of conductor	79 GN/m ²
16	Co-efficient of linear expansion per degree centigrade of	
	A. Aluminium	23.0X10 ⁻⁶ /°C
	B. Steel	11.5X10 ⁻⁶ /°C
	C. Conductor	19.1X10 ⁻⁶ /°C
17	Standard length of each piece in KM	1.500 + 5% (2 Length Drum)
18	Approximate dimensions of drum in mm	1220 X 600 X 710
19	Weight of all conductor in one drum in KG	1027 (Approx.)
20	Weight of all drum in KG	80 (Approx.)
21	Gross Weight of the Drum including weight of the conductor	1107 (Approx.)
22	Standard according to which conductor will be manufactured and tested	IS:398 Part-2
23	Lay Ratio	NA
A	Steel core 6 wire layer	NA
B	Aluminium 1st layer	(Max) 14 to (Min) 10
C	Aluminium 2nd layer	NA
24	Other Particulars If any	NA

"APPROVED"

DGM (T&C Circle)
PP&D, APDCL




⊙ All tests certificates to be submitted with supply For Jainco Power Limited

Factory : Jalan Complex, Gate No. 1, Lane No. 6, Jangalpur, Bombay Road (NH6), Howrah - 711104

Celebrating 50 glorious years of JAINCO GROUP

DM (T&C Circle)
PP&D, APDCL





JAINCO POWER LIMITED

CIN: U40108WB2022PLC256813

Manufacturers & Exporter of:

POWER CABLE & CONDUCTORS & ACCESSORIES

Office: Dhanshree Tower, 70, Diamond Harbour Road,
Room No. 3B, 3C & 3G, 3rd Floor, Kolkata - 700023, India

Phone : +91 (33) 2449 5410, 6297613371


Email : bd.jpl@jainco.net, info.jpl@jainco.net

Website : www.jainco.net

NAME OF PROJECT	M/s. THE GLOBAL CENTRE
CONTRACTOR	UK ENTERPRISE
PROJECT NAME	SSB CAMP
MANUFACTURER	M/S. JAINCO POWER LIMITED, Dhanshree Towers, 70, Diamond Harbour Road, Suit No. 3B & 3C, Kolkata - 700 023, INDIA.

DRWINGS FOR RACCON CONDUCTOR

CONSTRUCTIONAL DRAWING OF 80MM² RACCOON CONDUCTOR

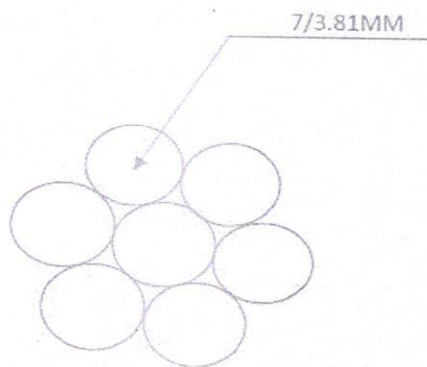

"APPROVED"

Wire Diameter : 3.81MM $\pm$ 1%
Lay Ratio : 10 to 14 (Right Hand)
O.D : Approx 11.43 mm

DGM (T&C Circle)
PP&D, APDCL



ALL SPECIFICATIONS AS PER IS 398 PT 4

DM (T&C Circle)
PP&D, APDCL

AGM (T&C Circle)
PP&D, APDCL

Factory : Jalan Complex, Gate No. 1, Lane No. 6, Jangalpur, Bombay Road (NH6), Howrah - 711411

Celebrating 50 glorious years of JAINCO GROUP



JAINCO POWER LIMITED

CIN : U40108WB2022PLC256813
Manufacturers & Exporter of
POWER CABLE & CONDUCTORS & ACCESSORIES
Office : Dhanshree Tower, 70, Diamond Harbour Road,
Room No 3B, 3C & 3G, 3rd Floor, Kolkata - 700023, India
Phone : +91 (33) 2449 5410, 2449 5893
Email : sales@jainco.net, mktg@jainco.net
Website : www.jainco.net

Guaranteed Technical Particulars of ACSR WOLF Conductor

Approving Authority				
Client	M/s. U.K. Enterprises, Guwahati-6			
Project	Bongaigam Medical College			
LOA No.				
MANUFACTURER	M/s. Jainco Power Limited, Howrah -711411			
Sl. No.	Particulars	Unit	Standard	Value offered
1	Manufacturer's Name and Address			
a)	E.C. Grade Aluminium Rod / Ingots		BALCO, NALCO, HINDALCO, any other ISI manufacturer	
b)	High Tensile Galvanized Steel Wire		Hulas Wires, Usha Martin, Kritika Wires, Nirmal Wires & Narayan Wires & other ISI Manufacturer	
2	Indian Standards			
a)	For Conductor		IS:398(Part-II):2025	IS:398(Part-II):2025
b)	For Drum		IS:1778:1980	IS:1778:1980
3	E.C. Grade Aluminium Rod			
a)	Indian Standards		IS:5484:1978	IS:5484:1978
b)	Composition	%	Purity 99.5(Min.)	Purity 99.5(Min.)
4	High Tensile Galvanized Steel Wire			
a)	Indian Standards		IS:4826:1979	IS:4826:1979
b)	Chemical Composition	%	C=0.50 to 0.85 P=0.035(Max.) S=0.045(Max.) Si=0.10 to 0.35 Mn=0.50 to 1.10	C=0.50 to 0.85 P=0.035(Max.) S=0.045(Max.) Si=0.10 to 0.35 Mn=0.50 to 1.10
5	Galvanizing			
a)	Indian Standards		IS:4826:1979	IS:4826:1979
b)	Purity of Zinc	%	99.95 (Min)	99.95 (Min)
c)	Process of Galvanizing		Hot Dip	Hot Dip
6	Aluminium Strands			
a)	Diameter			
i)	Nominal	mm	2.59	2.59
ii)	Maximum	mm	2.61	2.61
iii)	Minimum	mm	2.57	2.57
b)	Cross sectional area of nominal diameter wire	mm ²	5.269	5.269
c)	Minimum Weight	Kg/Km	14.24	14.24
d)	Breaking Load(Min)			
i)	Before stranding	KN	0.90	0.90
ii)	After stranding	KN	0.86	0.86
e)	Electrical Resistance at 20°C(Max)	Ohm/Km	5.449	5.449
f)	Co-efficient of linear expansion	per °C	23.0 x 10 ⁻⁶	23.0 x 10 ⁻⁶
g)	Modulus of elasticity	Kg./cm ²	80 GN/m ²	80 GN/m ²


Factory : Jalan Complex, Gate No. 1, Lane No. 6, Jangalpur, Bombay Road (NH6), Howrah - 711411

Celebrating 50 glorious years of JAINCO GROUP

DM (T&C Circle)
PP&D, APDCL

AGM (T&C Circle)
PP&D, APDCL

DGM (T&C Circle)
PP&D, APDCL





JAINCO POWER LIMITED

CIN : U40108WB2022PLC256813

Manufacturers & Exporter of

POWER CABLE & CONDUCTORS & ACCESSORIES

Office : Dhanshree Tower, 70, Diamond Harbour Road,

Room No 3B, 3C & 3G, 3rd Floor, Kolkata - 700023, India

Phone : +91 (33) 2449 5410, 2449 5893

Email : sales@jainco.net, mktg@jainco.net

Website : www.jainco.net

j)	Modulus of elasticity	Kg./cm ²	0.80×10^6	0.80×10^6
k)	Co-efficient of linear expansion	per °C	17.8×10^{-6}	17.8×10^{-6}
l)	Nominal weight of complete ACSR Conductor	Kg/Km	726	726
ii	Tolerance on Weight of Conductor		As per IS:398(Pt-II)/2025	As per IS:398(Pt-II)/2025
m)	Continuous max.current rating of conductor in still air at 45°C ambient temperature	Ampere	As Per ISS	As Per ISS
n)	Calculated Resistance at 20°C (Max)	Ω/Km	0.1828	0.1828
o)	Standards Length	Meters	2500	2500
p)	Tolerance on Standard Length	%	± 5	± 5
q)	Random Length	%	10	10
r)	Drum Dimension	mm	1300 X 457 X 813	1300 X 457 X 813
s)	Joints in Strands			
	i) Steel - 6 Wire		No Joints	No Joints
	ii) Aluminium - 18 Wire		No two joints within 15 meters	No two joints within 15 meters
	iii) Aluminium - 12 Wire		No two joints within 15 meters	No two joints within 15 meters
t)	Method of making joints		As per clause no. 9.0 of IS 398(Part-II) 2025	As per clause no. 9.0 of IS 398(Part-II) 2025

* All tests certificates to be submitted alongwith supply.



"APPROVED"

For Jainco Power Limited

DM (T&C Circle)
PP&D, APDCL


AGM (T&C Circle)
PP&D, APDCL

DGM (T&C Circle)
PP&D, APDCL



Factory : Jalan Complex, Gate No. 1, Lane No. 5, Jangalpur, Bombay Road (NH6), Howrah - 711411

Celebrating 50 glorious years of JAINCO GROUP



JAINCO POWER LIMITED

CIN : U40108WB2022PLC256813

Manufacturers & Exporter of

POWER CABLE & CONDUCTORS & ACCESSORIES

Office : Dhanshree Tower, 70, Diamond Harbour Road

Room No 3B, 3C & 3G, 3rd Floor, Kolkata - 700023, India

Phone : +91 (33) 2449 5410, 2449 5893

Email : sales@jainco.net, mktg@jainco.net

Website : www.jainco.net

h)	Minimum UTS of Strand	KN/MM ²	0.161	0.161
7	Steel Strands			
a)	Diameter			
	i) Nominal	mm	2.59	2.59
	ii) Maximum	mm	2.64	2.64
	iii) Minimum	mm	2.54	2.54
	Cross sectional area of nominal diameter wire	mm ²	5.269	5.269
b)	Minimum Weight	Kg/Km	41.09	41.09
c)	Breaking Load(Min)			
	i) Before stranding	KN	6.92	6.92
	ii) After stranding	KN	6.57	6.57
d)	Elongation of 200 mm gauge length on breaking (Elongation Test)			
	i) Before stranding (Min)	%	4	4
	ii) After stranding (Min)	%	3.5	3.5
e)	No. of twist on a length equal to 100 times the diameter of wire (Torsion Test)			
	i) Before stranding	Nos.	18(Min.)	18(Min.)
	ii) After stranding	Nos.	16(Min.)	16(Min.)
f)	Minimum Weight of Zinc Coating			
	i) Before stranding	gm/m ²	230	230
	ii) After stranding	gm/m ²	218.5	218.5
g)	Uniformity of Zinc Coating			
	No. of dips for 1 minute duration which the strands can withstand (Presee Test)			
	i) Before stranding (Min)	Nos.	2.5	2.5
	ii) After stranding (Min)	Nos.	2 x 1 min	2 x 1 min
h)	Co-efficient of linear expansion	per °C	17.8 x 10 ⁻⁶	17.8 x 10 ⁻⁶
i)	Modulus of elasticity	Kg./cm ²	1.9 x 10 ⁶	1.9 x 10 ⁶
j)	Minimum UTS of Strand	KN/MM ²	1.247	1.247
8	Complete Conductor			
a)	Code		Wolf ACSR	Wolf ACSR
b)	Standard Nominal Copper Area	mm ²	92	92
c)	Equivalent Nominal Aluminium Area	mm ²	150	150
d)	Sectional Aluminium Area	mm ²	158.1	158.1
e)	Total Sectional Area	mm ²	194.9	194.9
f)	Overall Diameter	mm	18.13	18.13
g)	Strands & Wire Diameter			
	i) Aluminium	Nos/mm	30/2.59	30/2.59
	ii) Steel	Nos/mm	7/2.59	7/2.59
h)	Lay Ratio			
	i) Steel - 6 Wire		Max-28 / Min-13	Max-28 / Min-13
	ii) Aluminium - 12 Wire		Max-16 / Min-10	Max-16 / Min-10
	iii) Aluminium - 18 Wire		Max-14 / Min-10	Max-14 / Min-10
i)	Calculated Breaking Load	KN	67.63	67.63

Factory : Jalan Complex, Gate No. 1, Lane No. 5, Jangalpur, Bombay Road (NH6), Howrah - 711011

Celebrating 50 glorious years of JAINCO GROUP

DM (T&C Circle)
PP&D, APDCL

AGM (T&C Circle)
PP&D, APDCL

DGM (T&C Circle)
PP&D, APDCL





JAINCO POWER LIMITED

CIN: U40108WB2022PLC256813

Manufacturers & Exporter of:

POWER CABLE & CONDUCTORS & ACCESSORIES

Office: Dhanshree Tower, 70, Diamond Harbour Road,
Room No. 3B, 3C & 3G, 3rd Floor, Kolkata - 700023, India

Phone : +91 (33) 2449 5410, 6297613371


Email : bd.jpl@jainco.net, info.jpl@jainco.net

Website : www.jainco.net

NAME OF PROJECT	M/s. THE GLOBAL CENTRE
CONTRACTOR	UK ENTERPRISE
PROJECT NAME	SSB CAMP
MANUFACTURER	M/S. JAINCO POWER LIMITED, Dhanshree Towers, 70, Diamond Harbour Road, Suit No. 3B & 3C, Kolkata - 700 023, INDIA.

DRWINGS FOR WOLF CONDUCTOR

CONSTRUCTIONAL DRAWING OF WOLF CONDUCTOR

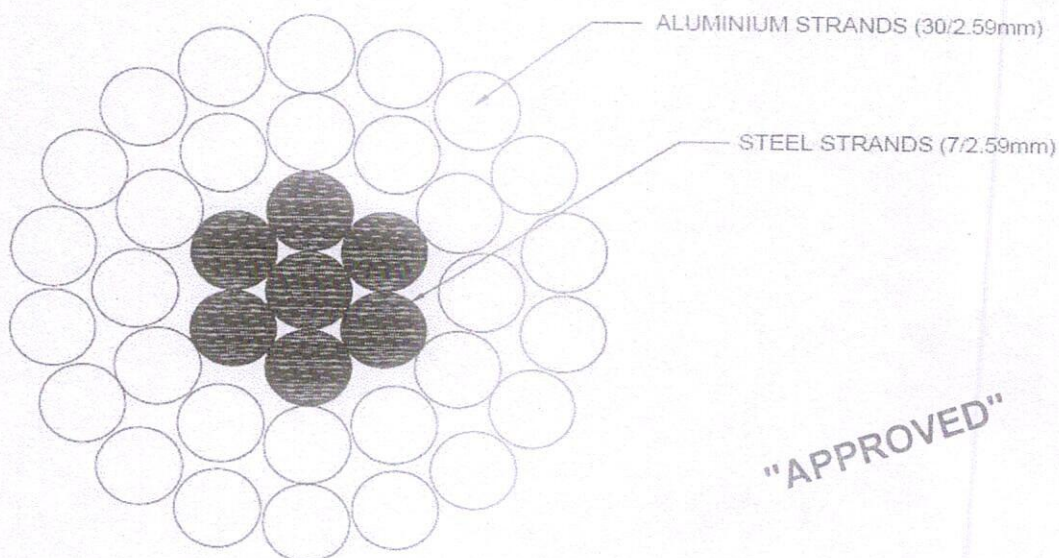

"APPROVED"

DM (T&C Circle)
PP&D, APDCL

AGM (T&C Circle)
PP&D, APDCL

DGM (T&C Circle)
PP&D, APDCL



Factory : Jalan Complex, Gate No. 1, Lane No. 6, Jangalpur, Bombay Road (NH6), Howrah - 711411

Celebrating **50** glorious years of JAINCO GROUP