



ASSAM POWER DISTRIBUTION COMPANY LIMITED.
OFFICE OF THE CHIEF GENERAL MANAGER (D & S),
(LOWER ASSAM REGION)
CIN: U40109AS2003SGC007242

No CGM (D&S)/APDCL/LAR/Bongaigaon Medical College/2025-26/ 54

Date: 01/06/2026

To,
The, CEO
Bongaigaon-EC,
APDCL, LAR, Bongaigaon

Sub: **Approval of GTP and drawings.**

Ref: 1. Letter received from CGM(PP&D) vide No. CGM(PP&D)/APDCL/GTPA/PART-22/2025-26/4626 dated 02/06/2026 .
2. Letter received from M/s U.K. Enterprise, R.P. Road, Dispur vide letter no. UKE/BMC/2026-27/72 dated: 21.05.2026
3. Letter received from M/s U.K. Enterprise, R.P. Road, Dispur vide letter no. UKE/BMC/2026-27/76 dated: 23.05.2026

With reference to the above subject, this is to inform you that GTP along with drawings of item mentioned below is hereby approved subject to the strict compliance to the highlighted corrections and recommendations of the GTP. All factory accepted tests shall be conducted upon the item and submitted along with supply and verified before installation. The date of manufacturing of the said item should be after the date of issue of this letter.

➔ GTP for the following items have been approved.

Sl. No.	Description of item	Vendor Details
1	MID Span Joint/Tension Joint for 33KV MVCC	M/s Master Electricals (Jointmask), Ganesh Complex, NH-6, Howrah-711322
2	Termination Kit for 33KV MVCC	
3	Anchor/Deadend Clamp for 33KV MVCC	
4	Helical Ties	
5	End Termination for 11KV XLPE Cable	
6	End Termination for 33KV XLPE Cable	
7	ACSR Rabbit Conductor	M/s Jainco Transmission Ltd., 70 Diamond harbour Rd, Kolkata

N.B: It is to be noted that this approval is solely against the furnished GTP of the said material and shall not be treated as approval of vendor under APDCL.

Encl: - Approved GTPs.

Yours faithfully

Chief General Manager (D&S)

Memo No CGM (D&S)/APDCL/LAR/Bongaigaon Medical College/2025-26/

Date:

Copy to:

1. The CGM(PP&D), APDCL, Bijulee Bhawan, Paltanbazar, Ghy-01 for your information.
2. M/s U.K. Enterprise, R.P.Road, Dispur for information and necessary action.
3. Relevant File

Chief General Manager (D&S)



অসম শক্তি বিতৰণ কোম্পানী লিমিটেড
ASSAM POWER DISTRIBUTION COMPANY LIMITED
[CIN / চিআইন- U40109AS2003SGC007242]

20/05/26

৭৮
(৭)

No : CGM(PP&D)/APDCL/GTPA/PART-22/2025-26/4626

Dated : 02/06/26

To,

✓ Chief General Manager (LAR)
5th Floor, Bijulee Bhawan
Paltan bazar, Guwahati-1.

Sub: Approval of GTP

Ref: i) Letter No, CGM(D&S)/APDCL/LAR/Bongaigaon Medical College/2025-26/48, Dated:26.05.26

Sir,

With reference to the subject cited above, it is to inform you that the GTP along with drawings submitted from your end vide under Ref: i) have been scrutinized by the technical team of the office of the undersigned and the following items are hereby approved subject to full compliance to the highlighted corrections and recommendations. Details of materials:


Sl No.	Item Description	Manufacture
1	Mid Span Joint/Tension Joint for 33KV MVCC	M/S Masters Electricals (Joint mask), Howrah
2	Termination Kit for 33KV MVCC	
3	Anchor/Dead End Clamp for 33KV MVCC	
4	Helical Ties	
5	End Termination for 11KV XLPE Cable	
6	End Termination for 33KV XLPE Cable	M/S Jainco Power Ltd. Howrah, W.B.
7	ACSR Rabbit Conductor	

Moreover, you are also requested to ensure that the approved item supplied strictly comply with the approved GTP & highlighted corrections/recommendations. All factory acceptance tests shall be conducted upon the item. The date of manufacture of the said item shall be later than the date of issue of this letter.

This is for favour of your kind information and necessary action.

Yours sincerely

Chief General Manager (PP&D)

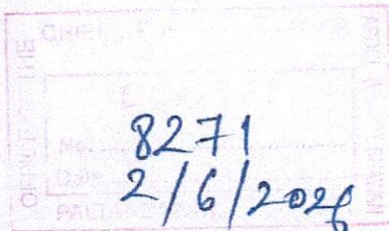

DM(T)
1
03/06/26
CGM (D&S)
APDCL (LAR)



M/S. U.K. ENTERPRISE

Govt. Approved (Class I) Contractor,

Deals with all Electrical, Civil works & Consultant

UDYAM REGISTRATION NO. UDYAM-AS-03-0005077

Dr. R.P. Road, Dispur, Guwahati-781006, Ph.98643-46349, 90853-90161 Email: babultalukdar@gmail.com

47

No. UKE/ BMC/2026-27/ 76

Date 23.05.2026

To
✓ The Chief General Manager(D&S)
APDCL (LAR), Bijulee Bhawan,
Paltan Bazar, Guwahati -1

Sub:- Approval of GTP and Drawing

Ref:- 1. LOA No. CGM(D&S)/APDCL/LAR/Bongaigaon Medical College /2025-26/38
Dt. 13.05.2026

Sir,

With reference to the above, we have the honour to forward herewith the GTP and Drawing of the following materials for favour of according necessary approval from your end.

The details are as follows :-


Sl. No.	Item Description	Name of Manufacturer	Remarks
1	ACSR Rabbit	M/S. Jainco Power Limited, Dhanshree Tower, 70, Dimond Harbour Road, Room No. 3B, 3C,, 3 rd Floor, Kolkata -700023 Phone No. 91(33)24495410, 629713371	

The above materials will be utilised for Construction of 33kV Dedicated Medical College Feeder from 132/33kV Dhaligaon GSS to the premises of the Bongaigaon Medical College, Majgaon and associated work under Bongaigaon ESD-I under Deposit Work Scheme

Thanking you in anticipation and assuring our best service in future.

Endo. : As above

Yours faithfully
Authorised Signatory

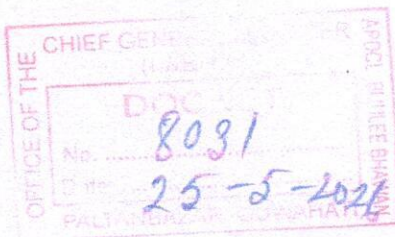

Chandhury,
DM(T)

25/5/2026
CGM(D&S)
APDCL(LAR)



JAINCO POWER LIMITED

CIN: U40108WB2022PLC256813

Manufacturers & Exporter of:

POWER CABLE & CONDUCTORS & ACCESSORIES

Office: Dhanshree Tower, 70, Diamond Harbour Road,
Room No. 3B, 3C & 3G, 3rd Floor, Kolkata - 700023, India

Phone : +91 (33) 2449 5410, 6297613371

Email : bd.jpl@jainco.net, info.jpl@jainco.net

Website : www.jainco.net

CLIENT : www.jainco.net

CLIENT	ASSAM POWER DISTRIBUTION COMPANY LIMITED		
CONTRACTOR	UK ENTERPRISE		
SCHEME			
PROJECT NAME	Bongaigaon Medical College		
LOAN NO.	LOA No. CGM(D&S)/APDCL/LAR/Bongaigaon Medical College /2025-26/38 Dt 13.05.2026		
MANUFACTURER	M/S. JAINCO POWER LIMITED, Dhanshree Towers, 70, Diamond Harbour Road, Suit No. 3B & 3C, Kolkata - 700023, INDIA.		
GUARANTEED TECHNICAL PARTICULARS FOR ACSR-RABBIT CONDUCTOR			
SL. NO.	DESCRIPTION	UNIT	ACSR RABBIT 50 Sq. mm
1.0	Maker's Name & Address		M/S. JAINCO POWER LIMITED, Dhanshree Towers, 70, Diamond Harbour Road, Suit No. 3B & 3C, Kolkata - 700023, INDIA.
2.0	Particulars of Raw Material		
2.1	a) Aluminium Rods		NALCO, BALCO & HINDALCO
	b) Steel		TATA STEEL, SAIL, ELECTRO STEEL
2.2	Aluminium		
	a) Minimum Purity of Aluminium	%	99.5
	b) Maximum Copper Content	%	0.04
2.3	Steel Wires / Rods		
	a) Carbon	%	0.50 to 0.85
	b) Manganese	%	0.50 to 1.10
	c) Phosphorus	%	0.035 max
	d) Sulphur	%	0.045 max
	e) Silicon	%	0.10 to 0.35
2.4	Zinc		
	Minimum Purity of Zinc	%	99.95
3.0	Aluminium Strands after Stranding		
3.1	Diameter		
	a) Nominal	mm	6/3.35
	b) Maximum	mm	6/3.38
	c) Minimum	mm	6/3.32
4.0	Steel Strands after Stranding		
4.1	Diameter		
	a) Nominal	mm	1/3.35
	b) Maximum	mm	1/3.42
	c) Minimum	mm	1/3.28
5.0	Cross Sectional Area of (Nominal diameter wire in Sq. mm (Total)	mm ²	52
	a) Aluminium Wire	mm ²	8.91
	b) Steel Wire	mm ²	8.81

AGM (T&C Circle)
PP&D, APDCL

"APPROVED"

BGM (T&C Circle)
PP&D, APDCL

AGM (T&C Circle)
PP&D, APDCL

"APPROVED"

BGM (T&C Circle)
PP&D, APDCL



DM (T&C Circle)
PP&D, APDCL

Factory : Jalan Complex, Gate No. 1, Lane No. 6, Jangajpur, Bombay Road (NH6), Howrah - 711411

Celebrating 50 glorious years of JAINCO GROUP





JAINCO POWER LIMITED

CIN: U40108WB2022PLC256813

Manufacturers & Exporter of:

POWER CABLE & CONDUCTORS & ACCESSORIES

Office: Dhanstree Tower, 70, Diamond Harbour Road,
Room No. 3B, 3C & 3G, 3rd Floor, Kolkata - 700023, India

Phone : +91 (33) 2449 5410, 6297613371

Email : bd.jpi@jainco.net, info.jpi@jainco.net

Website : www.jainco.net

6.0	Galvanizing		
	a) Minimum weight of zinc coating after stranding	gm/m ²	260
	b) Minimum number of one minute dips galvanized strand can withstand in the test (after stranding)	Nos.	1 min x 2 1/2 min x 1
7.0	Elongation/Torsion After Stranding		
	a) Elongation	%	3.5 (min)
	b) Torsion (No. of Twist)	Times	16 (min)
8.0	ACSR Stranded Conductor Breaking Load	kN	18.25
8.1	Aluminium Breaking Load after Stranding	kN	1.36 (min)
8.2	Steel Breaking Load after Stranding	kN	11
8.3	Lay Ratio of the Conductor		
	a) 6 wire aluminium layer		10 to 14
	b) 12 wire aluminium layer		-
	c) 18 wire aluminium layer		-
8.4	D.C. resistance of conductor at 20° C	Ohm/Km	0.5524 (max)
8.5	D.C. resistance of strand at 20° C	Ohm/Km	3.265
8.6	Co-efficient of linear expansion		
8.7	a) Aluminium		23.0 x 10 ⁻⁶
	b) Steel		11.5 x 10 ⁻⁶
	c) Conductor		19.1 x 10 ⁻⁶
8.8	Maximum single length of conductor that can be manufactured if required for single stretch	Metre	2500
8.9	Tolerance on standard length of conductor	%	± 5%
8.10	Direction of lay for outside layer		Right Hand
9.0	Linear mass of the Conductor		
10.0	Standard	Kg/Km	213.6
	a) Conductor	Kg/Km	144.9
	b) Steel	Kg/Km	68.8
	c) Modulus of Elasticity of Conductor	EN/m ²	79
11.0	Dimension of the drum	mm	1170x508x610
12.0	Weight of the conductor in reel/drum in Kg.	KG	535
13.0	Weight of the reel/drum in Kg.	KG	100 ± 10 %
14.0	Gross weight of reel/drum including weight of	KG	976 ± 10 %
15.0	Standard according to which the conductor will be manufactured and tested.	mm	IS: 398 (Part-II) of 1996 & IS: 4826-1979 with latest amendment
16.0	Marking on Drum		Manufacturer's name & Address, Contract/ Specification No., Size & Type of Conductor, Net Wt. of Conductor, Gross weight of Conductor & drum, Length of conductor, Position of conductor end, Drum & lot no., Name & Add. of consignee, Month & year of manufacturing, Project name - APDCL/RDSS-Addl HH, Arrow marking with the word "How This Way"

AGM (T&C Circle)
PP&D, APDCL


"APPROVED"

DGM (T&C Circle)
PP&D, APDCL

All tests certificate to be submitted alongwith supply.

Factory : Jalan Complex, Gate No. 1, Lane No. 6, Jangalpur, Bombay Road (NH6), Howrah - 711401

Celebrating 50 glorious years of JAINCO GROUP





JAINCO POWER LIMITED

CIN: U40108WB2022PLC256813

Manufacturers & Exporter of:

POWER CABLE & CONDUCTORS & ACCESSORIES

Office: Dhanshree Tower, 70, Diamond Harbour Road,
Room No. 3B, 3C & 3G, 3rd Floor, Kolkata -700023, India

Phone : +91 (33) 2449 5410, 6297613371


Email : bd.jpl@jainco.net, info.jpl@jainco.net

Website : www.jainco.net

NAME OF PROJECT	ASSAM POWER DISTRIBUTION COMPANY LIMITED
CONTRACTOR	UK ENTERPRISE
PROJECT NAME	BONGAIGAON MEDICAL COLLEGE
MANUFACTURER	M/S. JAINCO POWER LIMITED, Dhanshree Towers, 70, Diamond Harbour Road, Suit No. 3B & 3C, Kolkata - 700 023, INDIA.

DRWINGS FOR RABBIT CONDUCTOR

CONSTRUCTIONAL DRAWING OF 55MM² RABBIT CONDUCTOR

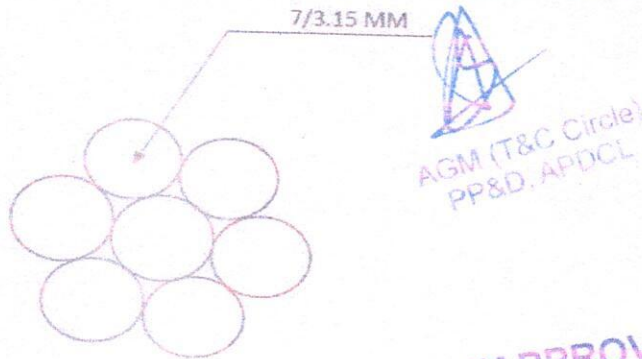

"APPROVED"

Wire Diameter : 3.15MM $\pm$ 1%
Lay Ratio : 10 to 14 (Right Hand)
O.D : Approx 9.45 mm

DGM (T&C Circle)
PP&D, APDCL

DM (T&C Circle)
PP&D, APDCL

ALL SPECIFICATIONS AS PER IS 398 PT 4



Factory : Jalan Complex, Gate No. 1, Lane No. 6, Jangaipur, Bombay Road (NH6), Howrah - 711411

Celebrating **50** glorious years of JAINCO GROUP



JAINCO POWER LIMITED

CIN: U40108WB2022PLC256813

Manufacturers & Exporter of:

POWER CABLE & CONDUCTORS & ACCESSORIES


Office: Dhanshree Tower, 70, Diamond Harbour Road,
Room No. 3B, 3C & 3G, 3rd Floor, Kolkata -700023, India

Phone : +91 (33) 2449 5410, 6297613371

Email : bd.jpl@jainco.net, info.jpl@jainco.net

Website : www.jainco.net

CLIENT	ASSAMPOWERDISTRIBUTIONCOMPANYLIMITED
CONTRACTOR	UKENTERPRISE
SCHEME	
PROJECTNAME	Bongaigaon Medical College
LOANO.	LOA No. CGM(D&S)/LAR/ Bongaigaon Medical College/2025-26/38 Dt. 13.05.2026
MANUFACTURER	M/S JAINCOPOWERLIMITED, Dhanshree Towers, 70, Diamond Harbour Road, Suite No. 3B & 3C, Kolkata -700023, INDIA.

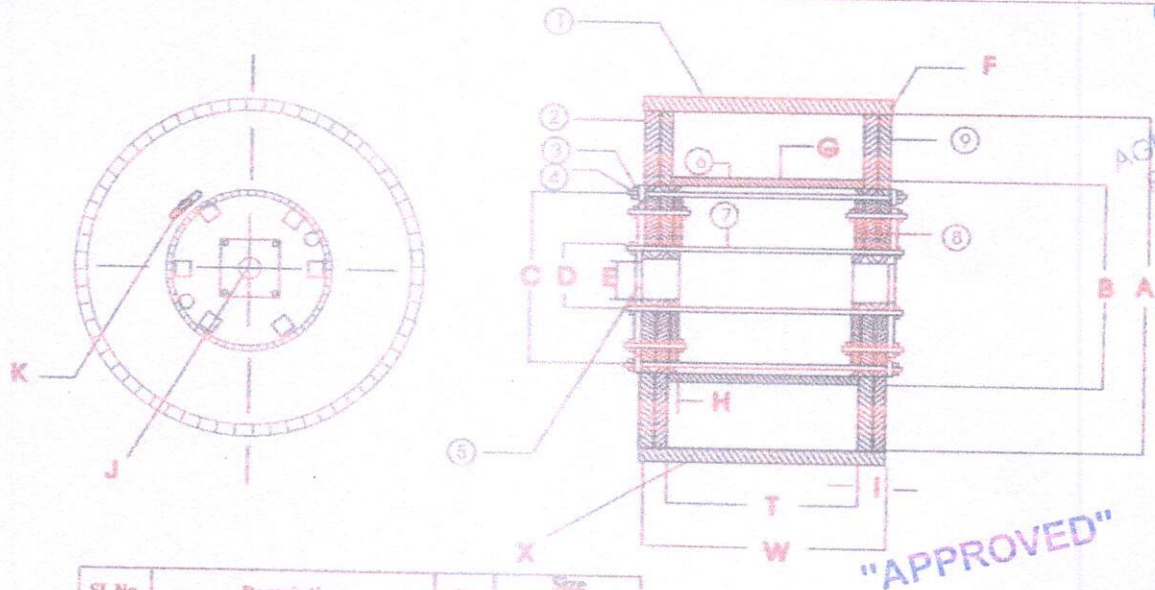

AGM (T&C Circle)
PP&D, APDCL

SL.No.	Description	Qty	Size
1	Flange Diameter		1170
2	Barrel Diameter		508
3	Traverse		610
4	Flange Thickness		2x23
5	Bore Diameter		80
6	Barrel end Support Thickness		50
7	Barrel end & External lagging thickness		50
8	Stretchers	6	100x50
9	Bolt	6	15
10	Square Washer	4	50x5
11	Spindle Plate	2	230x230x6
12	Spindle Plate Bolt	4	12
13	Binders	1	GL Wire
14	Center Piece Provided	1	Yes
15	Any specific value that has not been mentioned in the above table shall be strictly as per IS 1772:1980		

Standard Length per drum	1
Standard Length	2500 ±5%
Gross Weight (Max)	976 Kgs ± 10%
Net Weight (Max)	876 Kgs ± 10%
Tare Weight (Approx)	100 Kgs ±10%

DM (T&C Circle)
PP&D, APDCL

DGM (T&C Circle)
PP&D, APDCL



Factory : Jalan Complex, Gate No. 1, Lane No. 6, Jangalpur, Bombay Road (NH6), Howrah -

Celebrating 50 glorious years of JAINCO GROUP

