



ASSAM POWER DISTRIBUTION COMPANY LIMITED.
OFFICE OF THE CHIEF GENERAL MANAGER (D & S),
(LOWER ASSAM REGION)

CIN: U40109AS2003SGC007242

No CGM (D&S)/APDCL/LAR/Bongaigaon Medical College/2025-26/70

Date: 10/07/2026

To,

M/s U.K. Enterprise,
R.P. Road, Dispur

Sub: Approval of GTP and drawings.

Ref: 1. Letter received from CGM(PP&D) vide No. CGM(PP&D)/APDCL/GTPA/PART-22/2025-26/4711 dated 26/06/2026.
2. Letter received from M/s U.K. Enterprise, R.P. Road, Dispur vide letter no. UKE/BMC/2026-27/144 dated: 23.05.2026

With reference to the above subject, this is to inform you that GTP along with drawings of item mentioned below is hereby approved subject to the strict compliance to the highlighted corrections and recommendations of the GTP. All factory accepted tests shall be conducted upon the item and submitted along with supply and verified before installation. The date of manufacturing of the said item should be after the date of issue of this letter.

✦ GTP for the following items have been approved.

Sl. No.	Description of item	Vendor Details
1	AAAC Covered Conductor, 1 Core 241Sqmm	M/s Havells India Alwar, Rajasthan, India

- N.B: 1. It is to be noted that this approval is solely against the furnished GTP of the said material and shall not be treated as approval of vendor under APDCL.
2. Tests Certificates are to be submitted along with the supply.

Encl: - Approved GTPs.

Yours faithfully

Chief General Manager (D&S)

Date:

Memo No CGM (D&S)/APDCL/LAR/Bongaigaon Medical College/2025-26/

Copy to:

1. The CGM(PP&D), APDCL, Bijulee Bhawan, Paltanbazar, Ghy-01 for your information.
2. The CEO, Bongaigaon-EC, APDCL, LAR for information and necessary action.
3. Relevant File

Chief General Manager (D&S)



অসম শক্তি বিতৰণ কোম্পানী লিমিটেড
ASSAM POWER DISTRIBUTION COMPANY LIMITED
[CIN / চিআইন- U40109AS2003SGC007242]

69

No : CGM(PP&D)/APDCL/GTPA/PART-22/2025-26/4711

Dated : 26/6/2026

To,

Chief General Manager (LAR)
5th Floor, Bijulee Bhawan
Paltan bazar, Guwahati-1.

Sub: Approval of GTP

Ref: i) Letter No, CGM(D&S)/APDCL/LAR/Bongaigaon Medical College/2025-26/58, Dated:25.06.26

Sir,

With reference to the subject cited above, it is to inform you that the GTP along with drawings submitted from your end vide under Ref: i) have been scrutinized by the technical team of the office of the undersigned and the following items are hereby approved subject to full compliance to the highlighted corrections and recommendations. Details of materials :

SI No.	Item Description	Manufacture
1	AAAC Covered Conductor, 1X241sqmm	M/S Havells India, Alwar

Moreover, you are also requested to ensure that the approved item supplied strictly comply with the approved GTP & highlighted corrections/recommendations. All factory acceptance tests shall be conducted upon the item. The date of manufacture of the said item shall be later than the date of issue of this letter.

This is for favour of your kind information and necessary action.

Yours sincerely

Chief General Manager (PP&D)

O/o the Chief General Manager (PP&D) / মুখ্য মহা প্রবন্ধকৰ কাৰ্যালয় (পি-পি-এণ্ড-ডি)
Bijulee Bhawan, 6th Floor, Paltan Bazar, Guwahati, Assam - 781001
বিজুলী ভৱন, ষষ্ঠ মহলা, পল্টন বজাৰ, গুৱাহাটী, অসম - ৭৮১০০১
E-Mail: cgmpdpd.mattc@apdcl.org, Phone 0361-2739514, Fax 0361-2739535



ASSAM POWER DISTRIBUTION COMPANY LIMITED.

OFFICE OF THE CHIEF GENERAL MANAGER (D),
(LOWER ASSAM REGION)

CIN: U40109AS2003SGC007242

No. CGM (D&S)/APDCL/LAR/Bongaigaon Medical College/2025-26/ 58

Date: 25/06/2026

To,

The Chief General Manager (PP&D),
APDCL, Bijulee Bhawan, 7
Paltan Bazar, Guwahati-1.

Sub: Forwarding of GTP & Drawing

Ref: 1. Letter received from M/s U.K. Enterprise, R.P.Road, Dispur, vide No. UKE/BMC/2026-27/144 dated: 23.06.2026.

Sir,

With reference to the above subject, enclosed please find herewith a letter received from M/s U.K. Enterprise, R.P.Road, Dispur regarding submission of GTP and drawings of following materials for the work Construction of 33KV Dedicated Medical College Feeder from 132KV/33KV Dhaligaon GSS to the premises of Bongaigaon Medical College, Majgaon and associated works under Bongaigaon-ESD-I against LoA issued vide No. CGM(D&S)/APDCL/LAR/ Bongaigaon Medical College /2025-2026/38 dated: 13.05.2026 for your information and necessary action.

Details are as follows :-

Sl. No.	Description of item	Vendor Details
1	AAAC Covered Conductor, 1 Core 241Sqmm	M/s Havells India Alwar, Rajasthan, India

Encl:- 1. Copy of letter under Reference.
2.GTP and Drawing

Yours faithfully

Chief General Manager (D&S)
APDCL, LAR





M/S. U.K. ENTERPRISE

Govt. Approved (Class I) Contractor,
Deals with all Electrical, Civil works & Consultant

UDYAM REGISTRATION NO. UDYAM-AS-03-0005077

Dr. R.P. Road, Dispur, Guwahati-781006, Ph.98643-46349, 90853-90161 Email: babultalukdar@gmail.com

No. UKE/ BMC/2026-27/ 144

Date 23.06.2026

To
✓ The Chief General Manager(D&S)
APDCL (LAR), Bijulee Bhawan,
Paltan Bazar, Guwahati -1

Sub:- Approval of GTP and Drawing

Ref:- 1. LOA No. CGM(D&S)/APDCL/LAR/Bongaigaon Medical College /2025-26/38
Dt. 13.05.2026

Sir,

With reference to the above, we have the honour to forward herewith the GTP and Drawing of the following materials for favour of according necessary approval from your end.

The details are as follows :-

Sl. No.	Item Description	Name of Manufacturer	Remarks
1	AAAC Covered Conductor, 1cr. 241 sq. mm	M/S. Havells India limited Alwar, Rajasthan, India, Mobile No. 9864783339	

The above materials will be utilised for Construction of 33kV Dedicated Medical College Feeder from 132/33kV Dhaligaon GSS to the premises of the Bongaigaon Medical College, Majgaon and associated work under Bongaigaon ESD-I under Deposit Work Scheme


Thanking you in anticipation and assuring our best service in future.

Endo. : As above



Atul Choudhary,
DM(T)

1/23/6/2026
CGM (D&S)
APDCL (LAR)

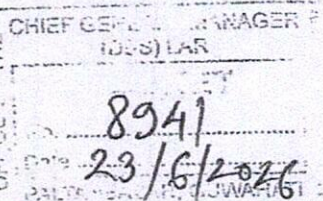

NAME OF THE CONTRACTOR: M/s. U.K. ENTERPRISE
 NAME OF THE PROJECT: Bongaigaon Medical College
 NAME OF THE CLIENT: Assam Power Distribution Company Limited
 LOA NO.: CGM(D&M)/APDCL/LAR/Bongaigaon Medical College/2025-26/38 Dt. 13.05.26
 NAME OF THE MANUFACTURER: HAVELLS INDIA LIMITED
 CABLE DETAILS: 1X241 AAAC MVCC
 VOLTAGE GRADE 33KV



HAVELLS INDIA LTD. (CABLE DIVISION) - ALWAR

Technical Particulars

Our Ref. No. : HIL/GTP/YYY/0026, Dated - 12.06.2026

S.N	Descriptions	Unit	AAAC COVERED CONDUCTOR
1	Name of Manufacturer.		241 SQ MM
2	Applicable Standard to which cable conforms		HAVELLS INDIA LIMITED
3	Type of cable		GENERALLY CONFORMING TO IS - 338 PT-IV / EN 50197-1
4	Voltage Grade	KV	AAAC COVERED CONDUCTOR
5	Phase Conductor detail		33
	- Conductor material		AAAC CONDUCTOR as per IS - 338-IV
	- Nominal cross-sectional Area	mm ²	241
	- Number of strands / Nom. dia of strands	No.	19/4.02
	- Form of conductor	mm	Stranded Non-Compacted circular
	- Breaking Load of conductor	SN	70.81
	- Longitudinal Water Blocking		Yes
	- Longitudinal Water Blocking		Sealable extruded water blocking layer shall be provided over central strand & in between layers of conductor
6	Screening on Conductor :		
	- Type & Material		Semiconducting Compound by extrusion
	- Approx. Thickness of semiconducting part	mm	0.30
7	Insulation :		
	- Material		XLPE
	- Nominal thickness	mm	2.43
	- Colour		Natural
8	Outer covering :-		
	- Material		[Track Resistant, Erosion resistant & UV Resistant]
	- Nominal thickness	mm	1.20
	- Colour		BLACK
9	Standard drum length	Mtrs.	1000 ± 5%
10	Non Standard Drum length	%	Max. 5% of ordered quantity
11	Allowable max. cond. Temp. when carrying cont. rated current (Temp. at which water blocking material shall remain stable)	Deg. C	90
12	Allowable max. cond. Temp. at the time of short circuit (Temp. at which water blocking material shall remain stable)	Deg. C	250
13	Short Circuit current rating for 1 Sec. duration	kA/MVA	25.62
14	Conductor DC Resistance at 20°C. (Max.)	Ohm/km	0.143
15	Over all diameter (mm) (Approx)		30
16	Weight (Kg/km) (Approx)		1020
17	Max load (IEC 60507), cond temp 90 °C, air temp. 40 °C, wind speed 0.5 m/s, Solar radiation 1045 W/m ² , Approximate value (continuous)	Amp	485
18	Marking detail (Embossing/printing)		
19	SEQUENTIAL LENGTH MARKING		HAVELLS 33 KV XLPE, AAAC COVERED CONDUCTOR (SIZE IN SQMM) - (MFG. YEAR), AS PER EN 50197-1 IN GENERAL
20	Insulation Resistance (Volume resistivity) (Min.)		SHALL BE PROVIDED BY PRINTING AT EVERY MTR OF CABLE
	at 27 Deg.C	Ohm-cm	1 X 10 ¹⁴
	at 90 Deg.C	Ohm-cm	1 X 10 ¹²
21	Lightning Impulse Withstand Voltage	KV	100
22	Design Life		We confirm use of cables for 25 years under stipulated functional conditions & use of cables as per relevant IS: 2253 wherever applicable.
23	Packing material		Non Returnable wooden drums

* Values indicated as "Approx." are for guidelines only

* In case of any Typographical Error / Discrepancy, relevant standards shall be prevailed.

CLASSIFICATION : PUBLIC

@ All tests certificates to be submitted alongwith supply

AGM (T&C Circle)
 PP&D, APDCL

Yours Faithfully,
 For Havells India Ltd.
 Angadkorush,
 Manager - Cable.
 Email: Angadkorush@havells.com
 Phone no: 7002287518.

DGM (T&C Circle)
 PP&D, APDCL

DM (T&C Circle)
 PP&D, APDCL





HAVELLS

HAVELLS INDIA LTD. (CABLE DIVISION) - ALWAR

CROSS-SECTIONAL DRAWING

120 mm², 160 mm² & 241 mm² 33kV, AAAC COVERED CONDUCTOR

Aluminum Alloy Wires

Extruded Longitudinal water blocking layer

Extruded semi conductive layer


Covering (Insulation) of Track Resistant XLPE

(Track Resistant, Erosion resistant & UV Resistant)

"APPROVED"

Customer: APDCL

DWG NOT TO SCALE

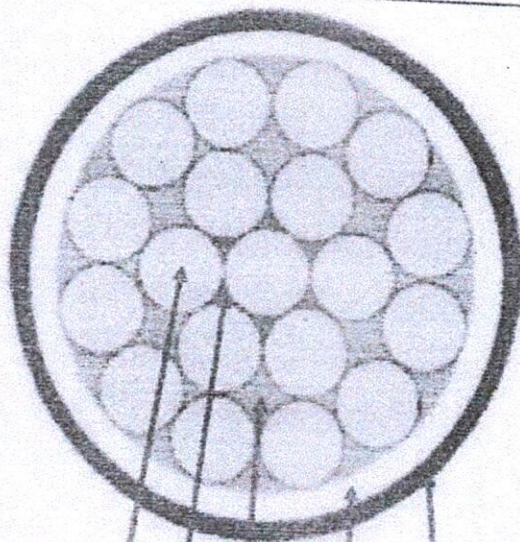

an
DM (T&C Circle)
PP&D, APDCL

[Signature]
AGM (T&C Circle)
PP&D, APDCL

[Signature]
DSM (T&C Circle)
PP&D, APDCL



JAINCO POWER LIMITEDJalan Complex , Gate No. - 1, Lane No. - 6
Jangalpur, Bombay Road (NH6), Howrah-711411

CUSTOMER Assam Power Distribution Company Ltd.
 CONTRACTOR M/s. U.K. Enterprises, Guwahati-6
 P.O. NO. UKE/PO/Deposit/2026-27/70(A), Dated: 03.06.2026
 LOA No. CGM(D)/APDCL/LAR/Bongaigaon Medical Collage/2025-26/38, Dt. 13.05.2026
 Letter No. MD/APDCL/HR/Misc/1/2021/146, Dated 23.06.2026
 Code : ACSR Wolf Size 30/7/2.59 mm

Real No.	Specimen No.		Dia. (mm)	Breaking Load	Elongation	Resistance	Wrapping	GALVANISING		Torsion	Procedure qualification test on welded joint of Al. Strands	Lay Ratio
	Al.	St.				Ohms/km	8 on x 6 off	Wt. of Zn. Coat	Uniformity			
UK/A2W0/1	1		2.58	1.13		5.225	OK				NA	
	2		2.59	1.15		5.234	OK					
	3		2.60	1.10		5.192	OK					
	4		2.59	1.01		5.183	OK					
	5		2.58	1.09		5.177	OK					
	6		2.58	1.06		5.151	OK					
	7		2.60	1.06		5.164	OK					
	8		2.60	1.02		5.221	OK					
	9		2.58	1.00		5.200	OK					
	10		2.59	1.14		5.176	OK					
	11		2.60	0.96		5.225	OK					
	12		2.59	1.07		5.169	OK					
	13		2.59	1.15		5.199	OK					
	14		2.60	1.11		5.174	OK					
	15		2.59	1.05		5.233	OK					
	16		2.58	1.14		5.166	OK					
	17		2.59	1.14		5.193	OK					
	18		2.59	1.04		5.177	OK					11.45
	1		2.59	1.04		5.166	OK				OK	
	2		2.59	0.95		5.192	OK					
	3		2.60	1.06		5.173	OK					
	4		2.58	1.06		5.179	OK					
	5		2.60	1.02		5.164	OK					
	6		2.59	1.04		5.160	OK					
	7		2.59	1.08		5.213	OK					
	8		2.59	1.04		5.174	OK					
	9		2.58	0.95		5.224	OK					
	10		2.58	1.03		5.182	OK					
	11		2.59	0.95		5.172	OK					
	12		2.58	1.06		5.213	OK					12.78
	1		2.59	8.40	5.5		OK	296	OK	30		
	2		2.59	8.10	4.5		OK	326	OK	26		
	3		2.61	7.90	5.5		OK	342	OK	27		
	4		2.61	8.50	5.0		OK	311	OK	25		
	5		2.59	8.00	6.5		OK	317	OK	28		
	6		2.58	7.70	5.5		OK	326	OK	25		
	7		2.58	8.50	6.5		OK	360	OK	28		16.05

THE RESULTS HAVE BEEN OBTAINED AFTER STRANDING

SPECIFICATION & TESTING AS PER :

IS : 398 : PART II 2025

Aluminium	Minimum	2.57	0.86	--	--	own dia	--	--	--	Not less than 130 Mpa	10 TO 14(Outer)
	Maximum	2.61	--	--	5.449		--	--	--		10 TO 16(Inner)
Steel	Minimum	2.54	6.57	3.5	--	4 x dia of wire	218.5	2 x 1min	16 Turns	--	13 TO 28
	Maximum	2.64	--	--	--		--	--		--	

Test Conducted By

Test Witnessed By

Mosarrat H Khan
 DGM (QA&I)
 JAINCO Power Limited

Manoj Sarkar
 DGM(RE), O/o the CGM(RE)
 Bijulee Bhawan, APDCL