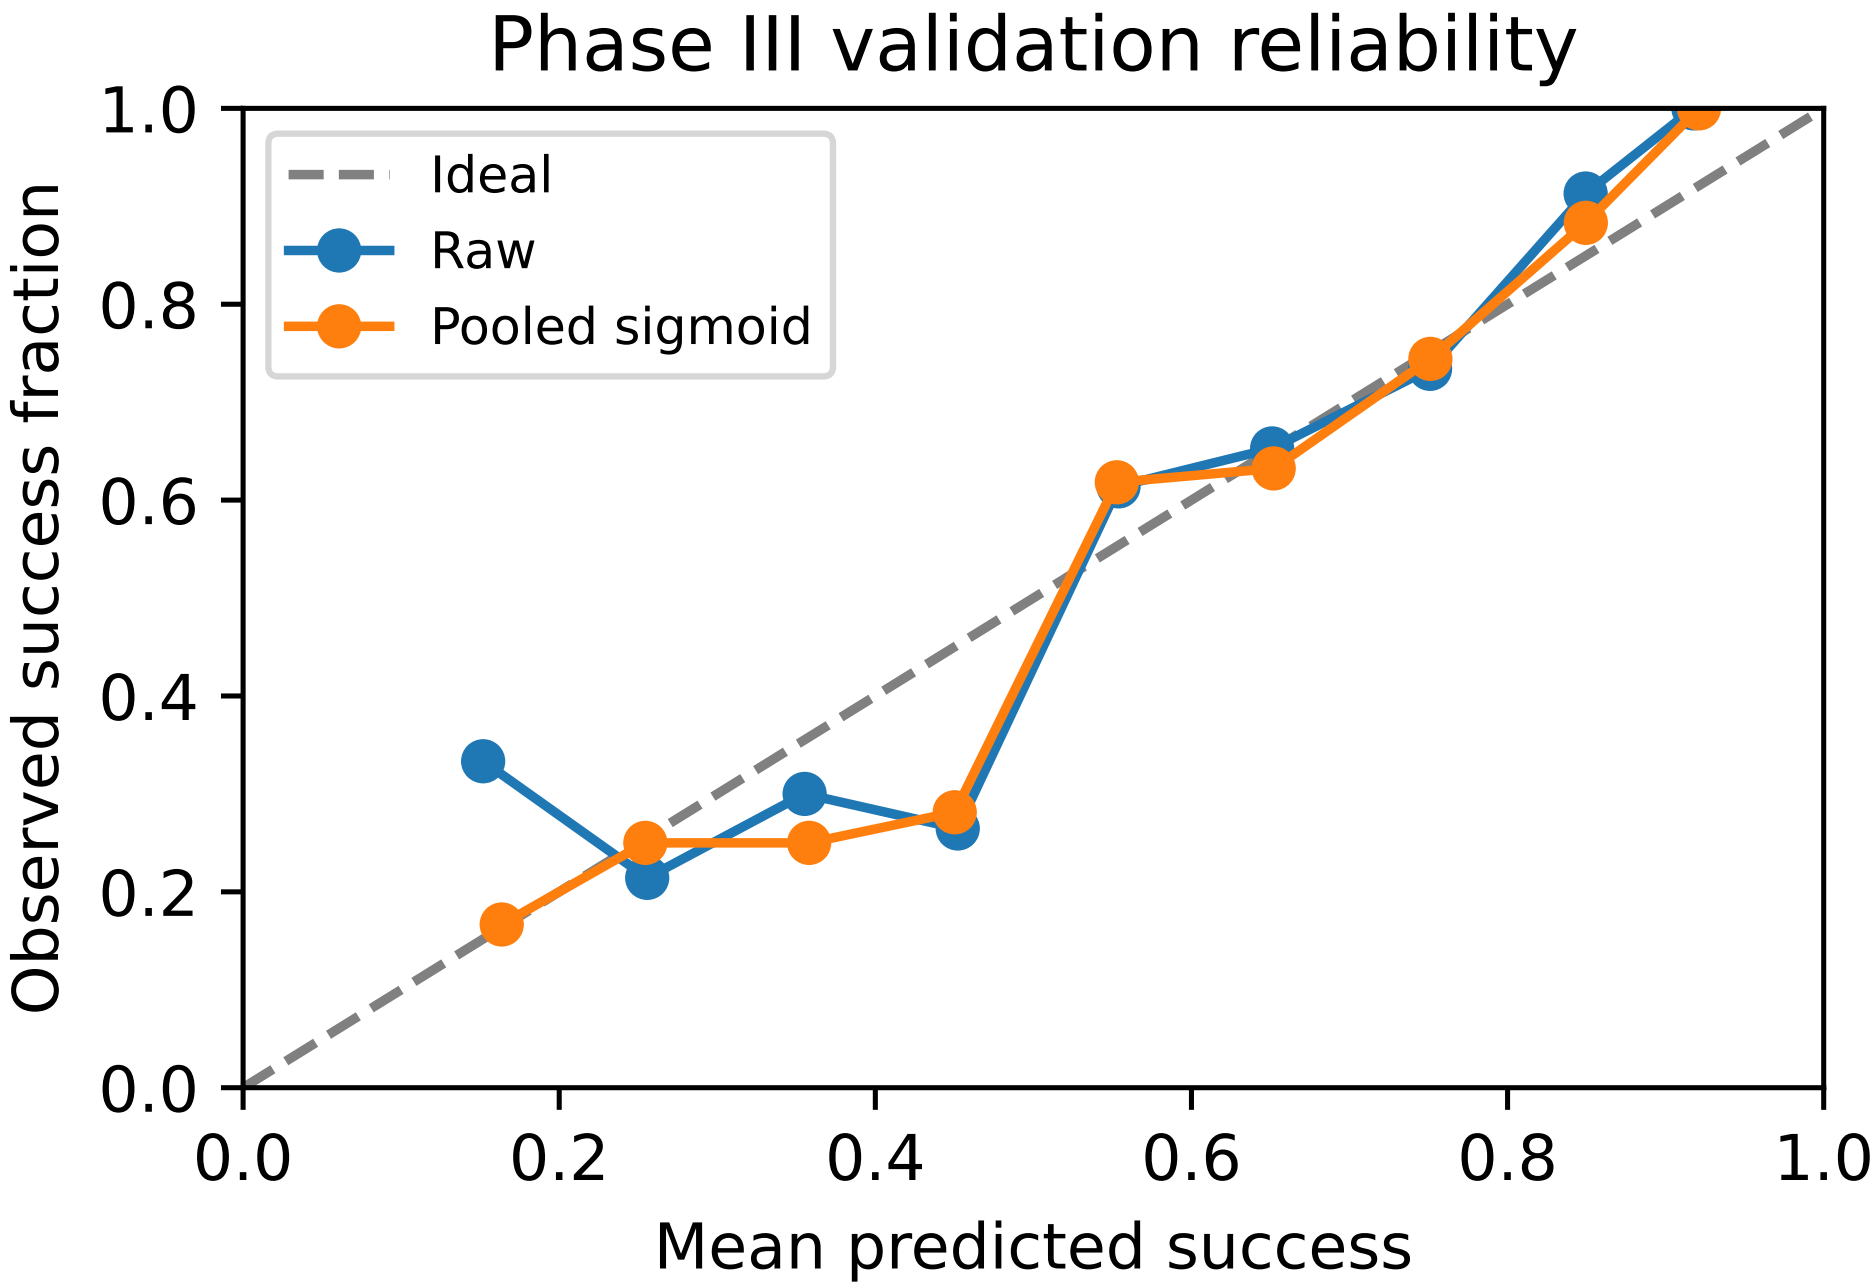
Phase III validation reliability
Ideal
Raw
Pooled sigmoid
Observed success fraction
Mean predicted success
0.0
0.2
0.4
0.6
0.8
1.0